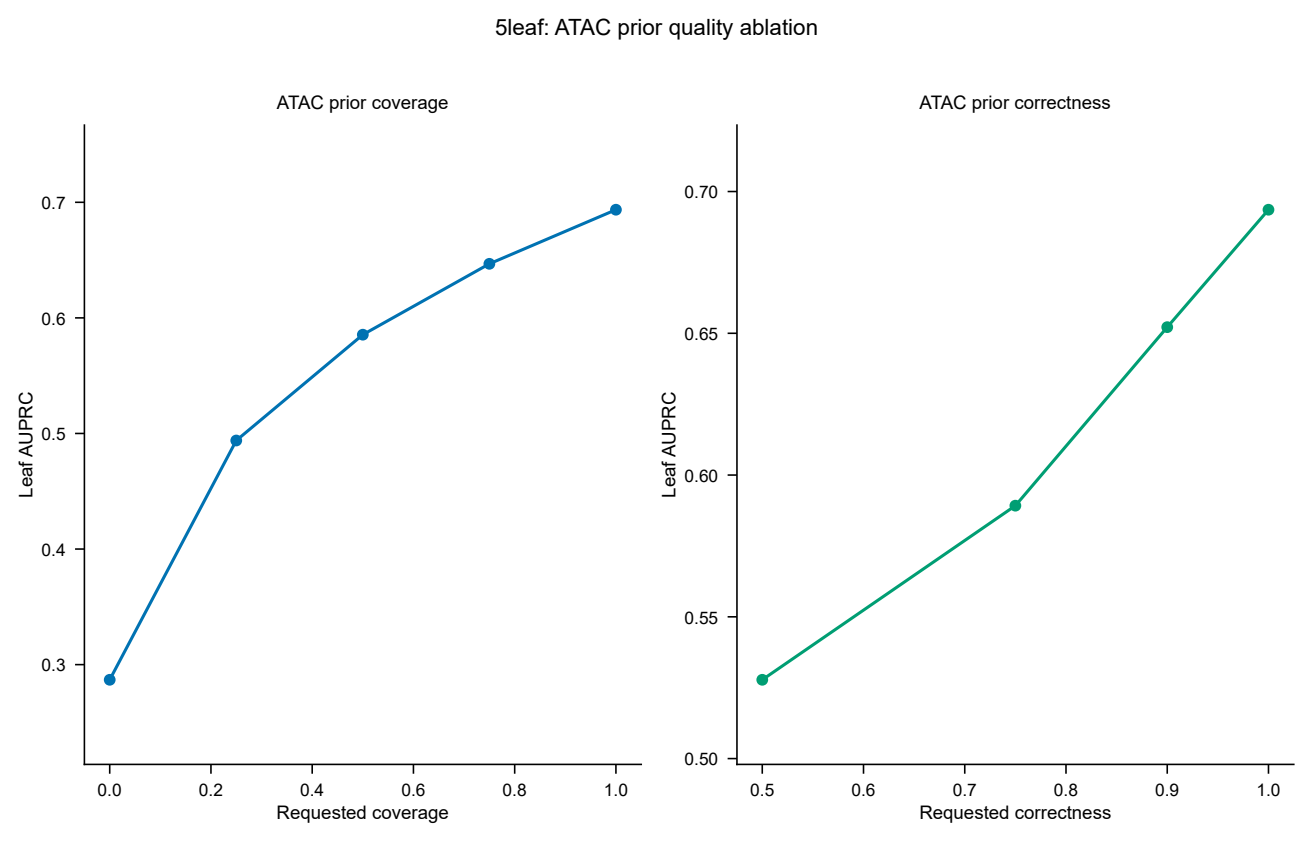
5leaf: ATAC prior quality ablation
ATAC prior coverage
Leaf AUPRC
0.7
0.6
0.5
0.4
0.3
0.0
0.2
0.4
0.6
0.8
1.0
Requested coverage
ATAC prior correctness
Leaf AUPRC
0.70
0.65
0.60
0.55
0.50
0.5
0.6
0.7
0.8
0.9
1.0
Requested correctness