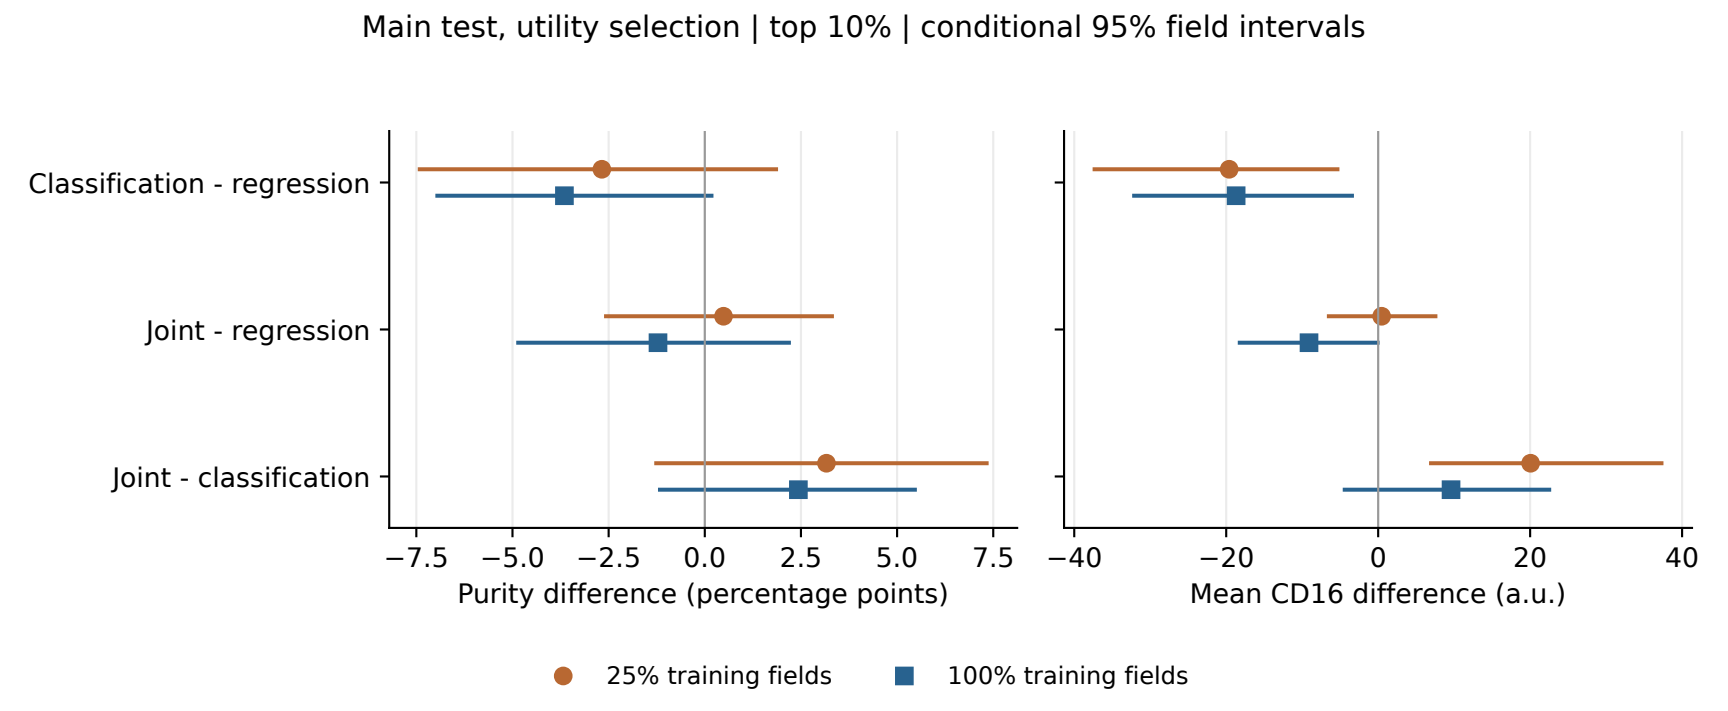
Main test, utility selection | top 10% | conditional 95% field intervals
Classification - regression
Joint - regression
Joint - classification
−7.5
−5.0
−2.5
0.0
2.5
5.0
7.5
Purity difference (percentage points)
−40
−20
0
20
40
Mean CD16 difference (a.u.)
25% training fields
100% training fields