


Per-gate ablation: removing any single gate keeps leak at zero across all 4 backbones (n=114 pool)

Selector acceptance per leave-one-out variant



Cross-trial leak rate $\times$ backbone (all 0.00)

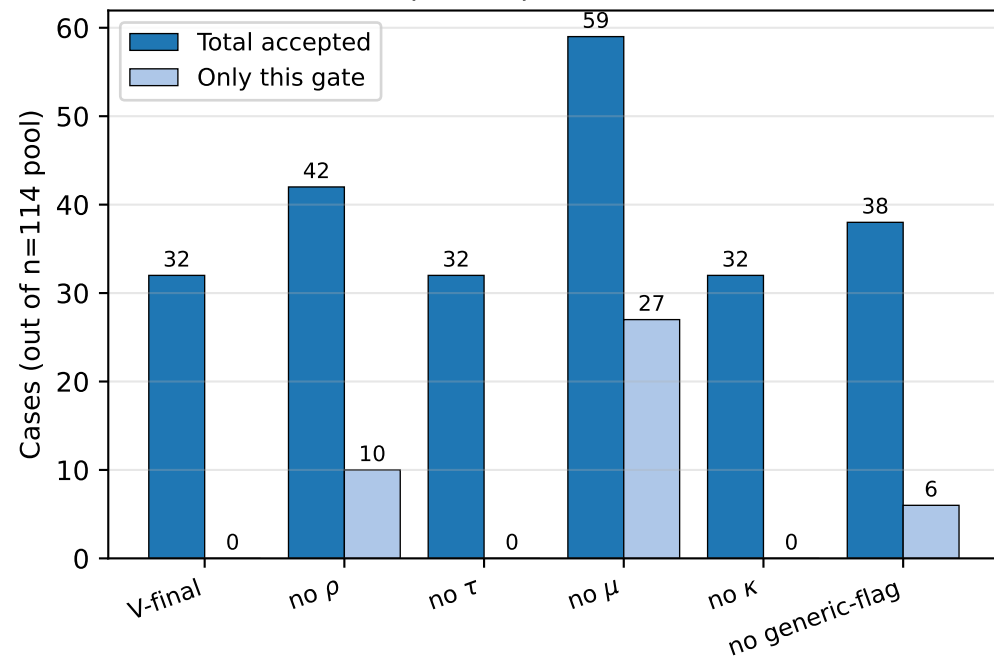