



A


Absorption

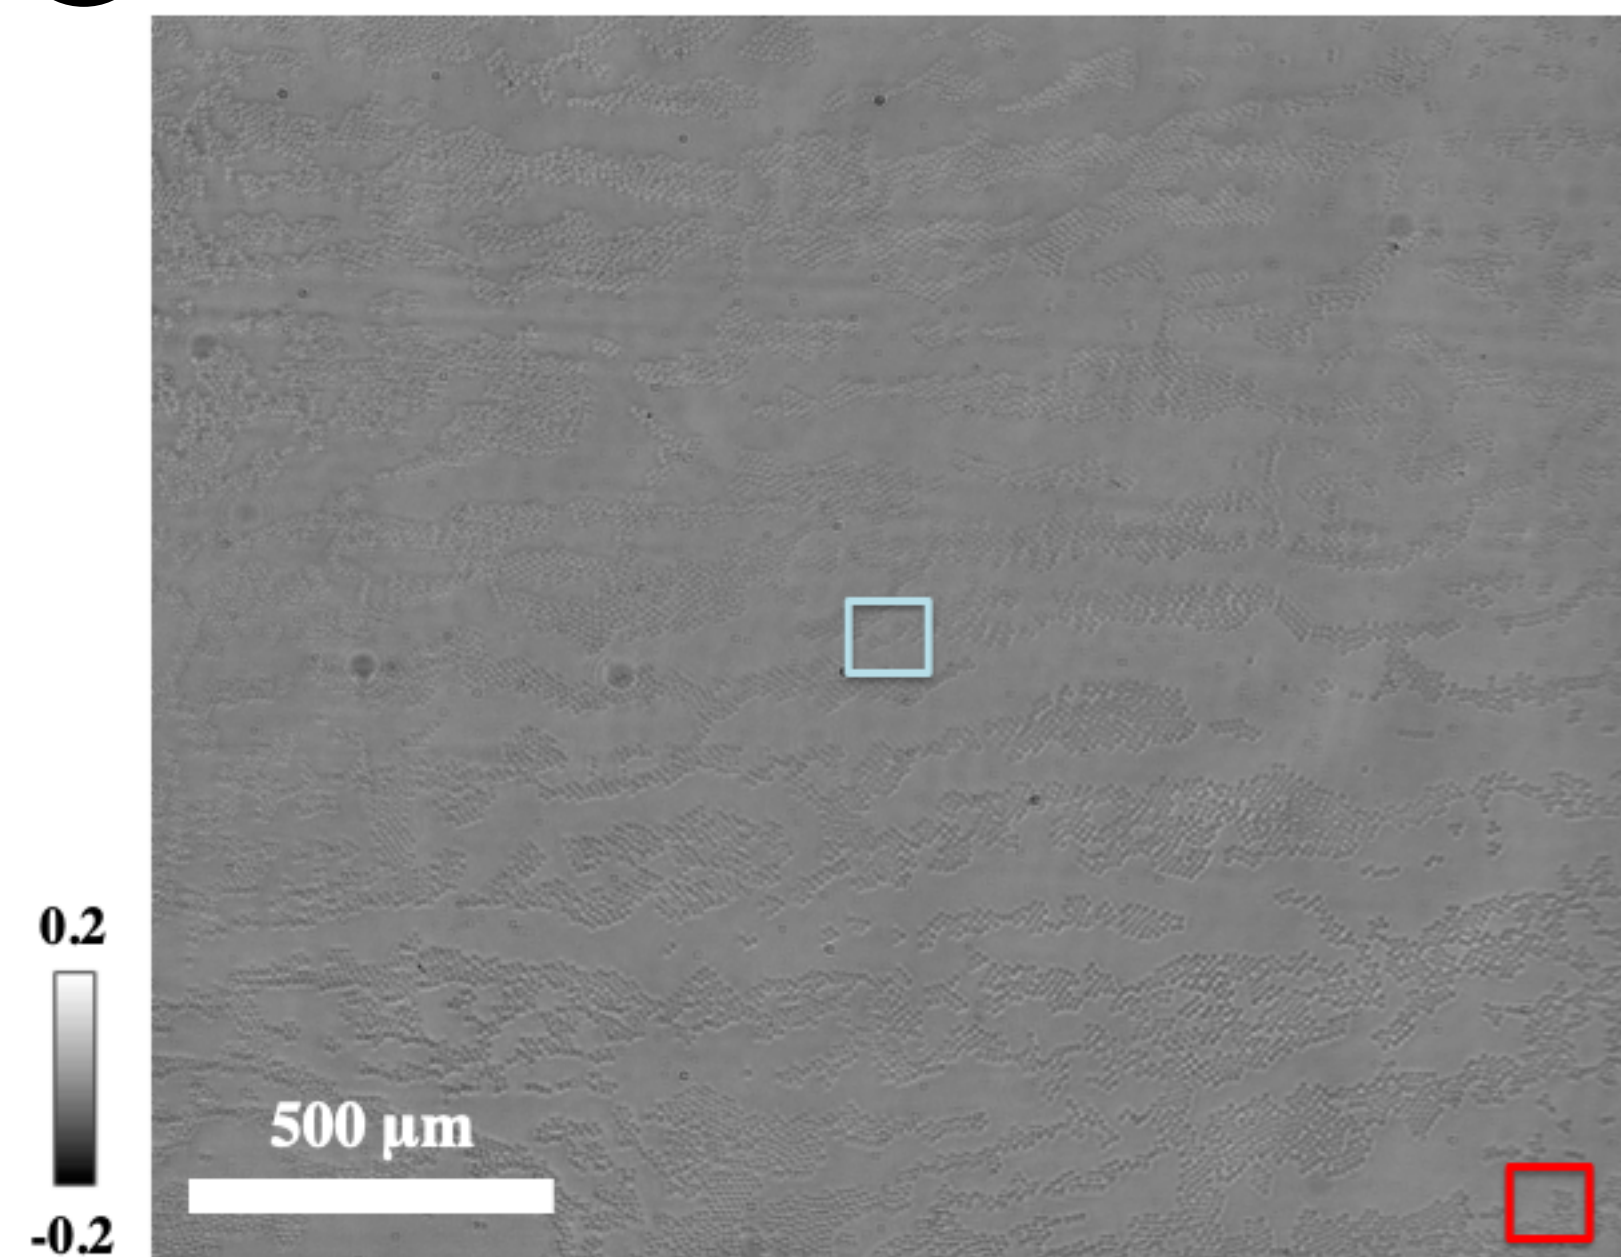

Phase

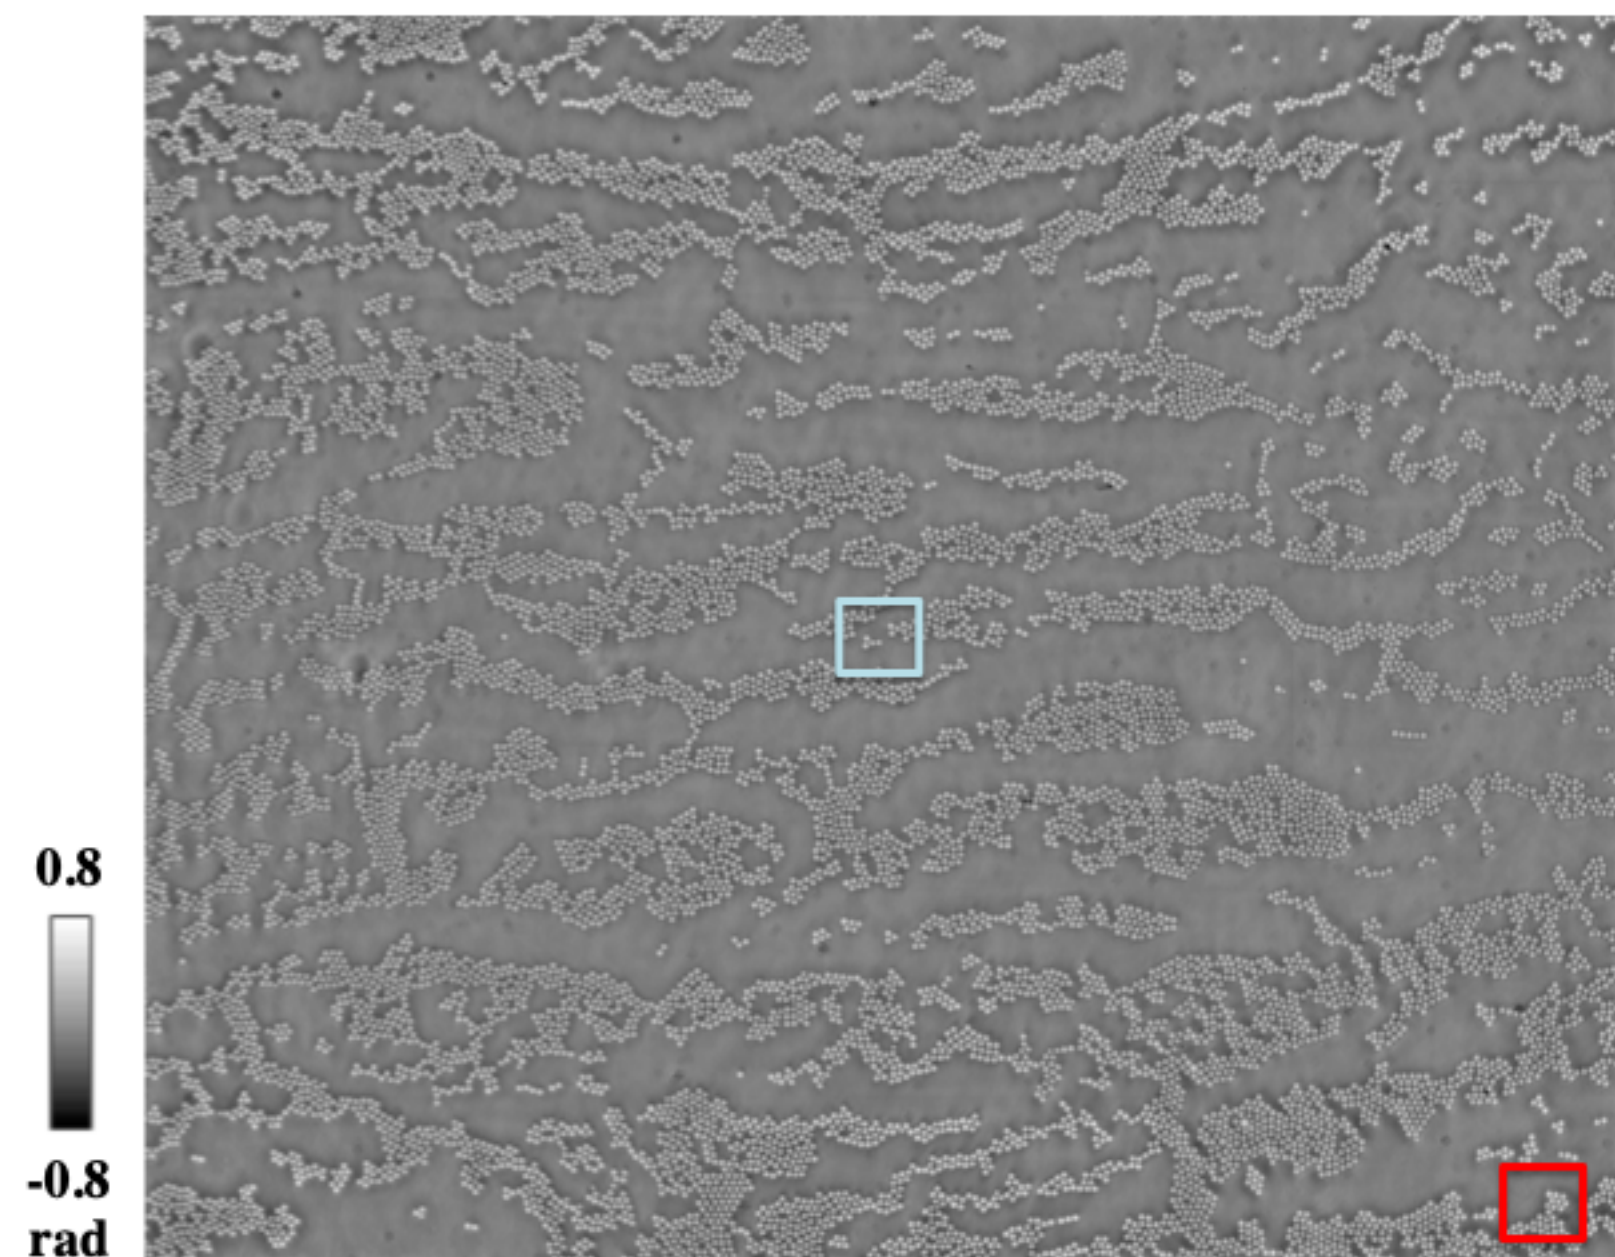

Aberrations

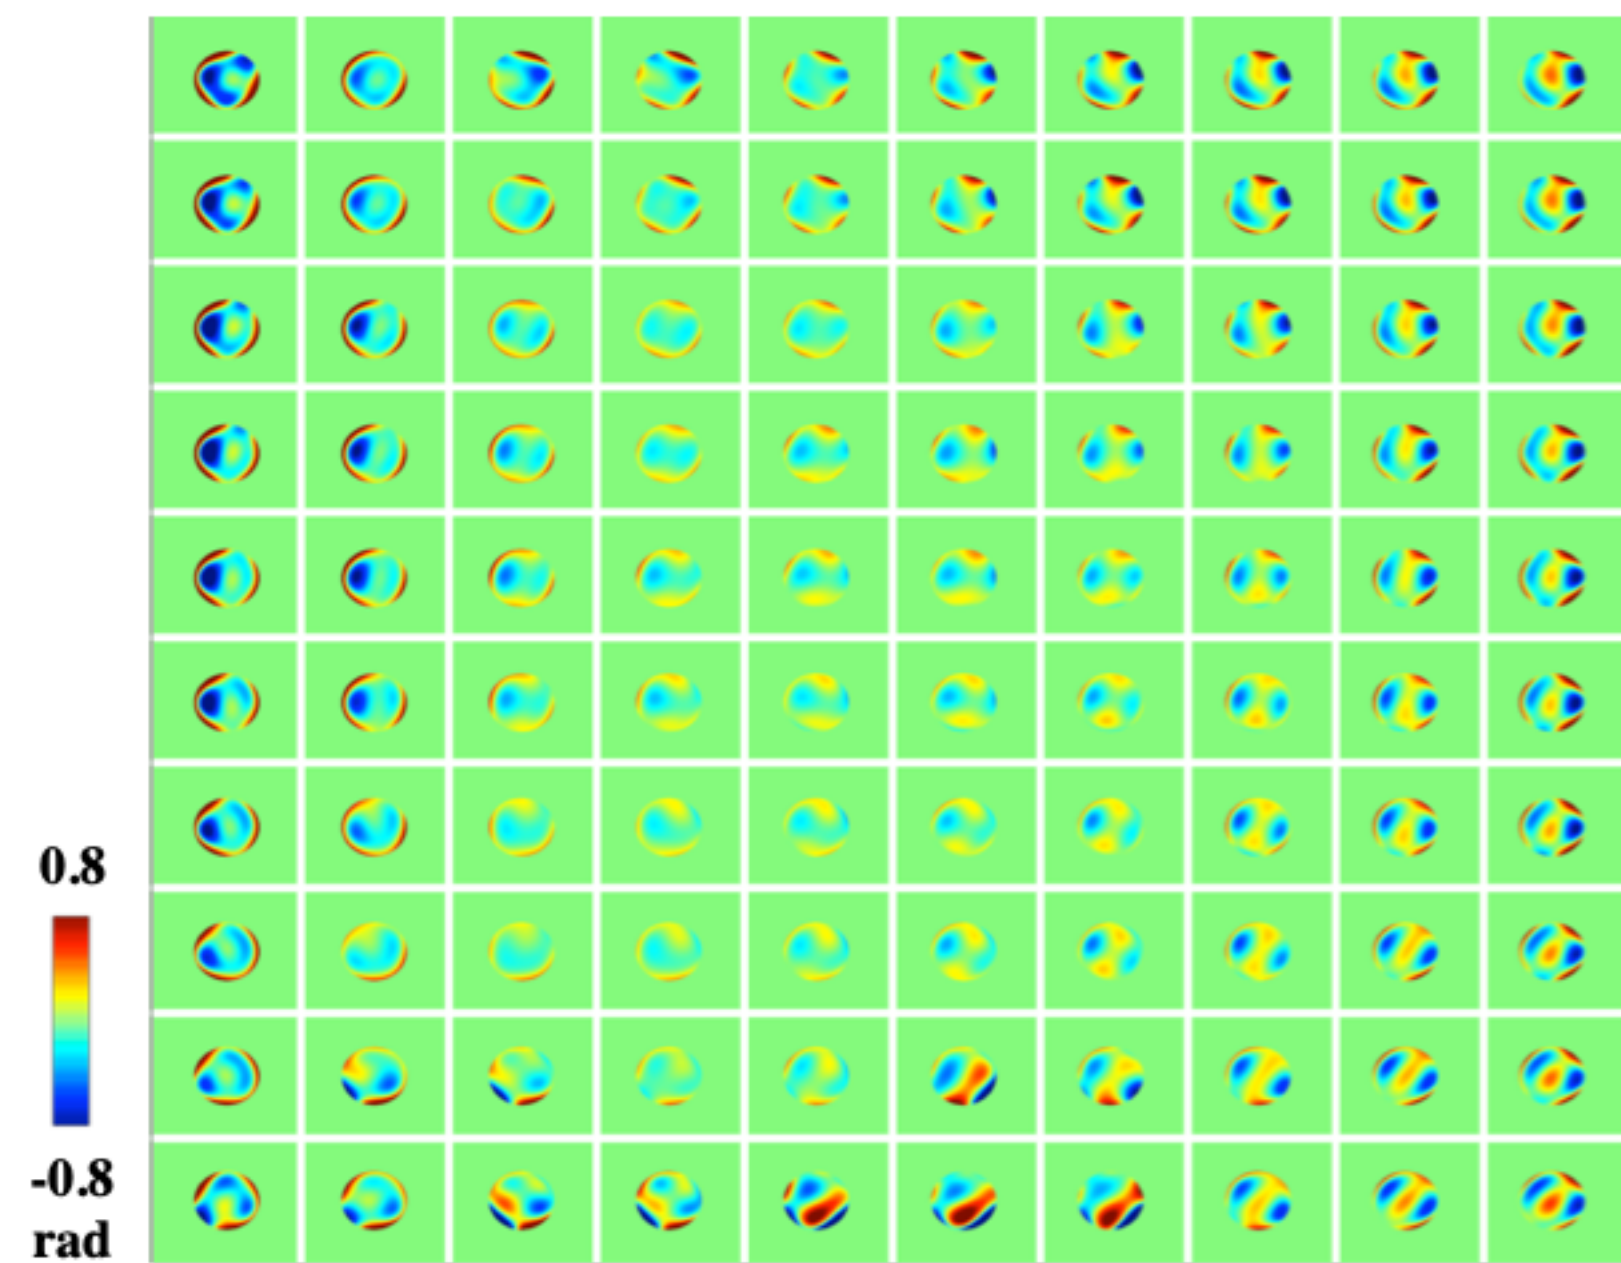


B

Uncorrected

Corrected

Pupil

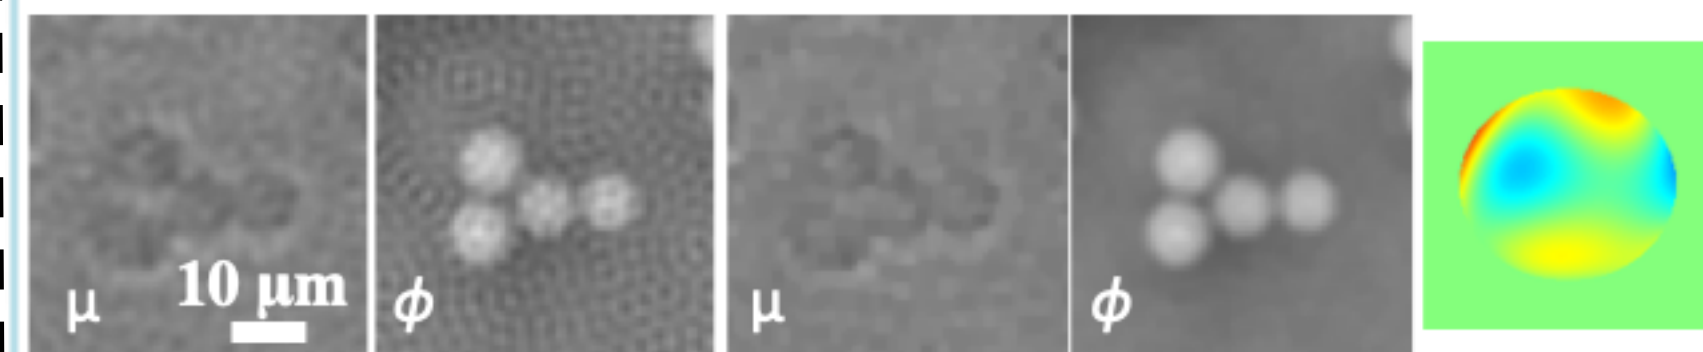

Uncorrected

Corrected

Pupil

