(1) ABBREVIATIONS

**N.F = Inner Face**
**F.F = Outer Face**
**B.F = Both Faces**
**c/c = Centre To Centre Distances**
**T = Top**
**B = Bottom**
**T & B = Top and Bottom**

(2) SYSTEM OF UNITS

- **All dimensions are given in FEET-INCHES and spacings are in inches.**
- **All elevations are in feet-inches. only written dimensions are to be followed.**

(3) CONCRETE

- **Concrete for Columns to have a minimum of 4000 p.s.i cylinder strength at 28 days.**
- **Concrete for all members to have a minimum of 3000 p.s.i cylinder strength at 28 days.**
- **Blinding Concrete (1:4:8) shall be comprising of one part portland cement 4 parts local sand and 8 parts Margala crushed stone free from dust and organic materials.**

(4) REINFORCING STEEL

**All bars to be High Yield steel shall be confirming to ASTM A615(a) grade 60 as approved by the engineer, having minimum yield strength of 60,000 psi & minimum ultimate strength of 90,000 psi.**
**Use deformed steel only**

(5) CONCRETE PROTECTION TO REINFORCEMENT

**Minimum clear concrete cover to reinforcement shall be as follows unless otherwise specified on the drawing**

| STRUCTURAL ELEMENT | COVER INCHES |
|---|---|
| **Foundations** | **2"** |
| **Walls (Including retaining walls)** | |
| **Face exposed to weather or earth** | **2"** |
| **Face not exposed to weather or earth** | **3/4"** |
| **Slab** | **3/4"** |
| **Columns (to ties)** | **1 1/2"** |
| **Beams** | **1 1/2"** |
| **R.C.C Walls** | **1"** |
| **Slab on Grade** | **1"** |

(6) AGGREGATE SIZE

All aggregate should be well graded
**Maximum aggregate size shall be as follows unless otherwise approved by the engineer**

| Structural Element | Maximum Aggregate Size |
|---|---|
| **Foundations** | **3/4" down** |
| **Columns** | **3/4" down** |
| **Beams** | **3/4" down** |
| **Walls** | **1/2" down** |
| **Slabs** | **1/2" down** |

(7) DETAILING OF REINFORCEMENT

**Dotted line indicates that reinforcement is top side or nearer to the observer.**
**Firm line indicates that reinforcement bottom or far side from the observer.**
**Indicates lapped splice.**

(8) SPACING

**The first and last in walls, slabs, stirrups in beams and ties in columns should start and end at a maximum of half the adjacent bar spacing Reinforcement may be adjusted laterally to maintain a clear distance of at least 1 inch between reinforcement and water stops, pipes and embedments etc.**

(9) ACCESSORIES & CHAIRS

**Bar supports spacers and their accessories are not shown on the drawings and should be as follows, For RAFTS 3/4" dia. 5'-0" center, For SLABS 1/2" dia. 4'-0" center, elsewhere as recommended by the engineer may be used.**

(10) LAP LENGTHS

**Unless otherwise stated on the drawing following lap lengths shall be provided. Except when otherwise shown on the drawing whenever reinforcing bars of different sizes to be supplied, lap length shall be governed by smaller of the two bars.**

(A) TOP BARS

| FC'(PSI) \ BAR SIZE | DEVELOPMENT LENGTH "INCHES" (FY=60,000 PSI) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| | #3 | #4 | #5 | #6 | #7 | #8 | #9 | #10 | #11 |
| 3000 | 21" | 30" | 36" | 42" | 63" | 72" | 81" | 90" | 99" |
| 4000 | 18" | 24" | 33" | 36" | 54" | 63" | 69" | 78" | 84" |
| 6000 | 15" | 20" | 25" | 30" | 44" | 50" | 57" | 63" | 69" |

(A) TOP BARS

| FC'(PSI) \ BAR SIZE | SPLICE/LAP LENGTH "INCHES" (FY=60,000 PSI) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| | #3 | #4 | #5 | #6 | #7 | #8 | #9 | #10 | #11 |
| 3000 | 27" | 39" | 48" | 54" | 81" | 93" | 105" | 114" | 129" |
| 4000 | 24" | 33" | 42" | 48" | 72" | 81" | 90" | 102" | 111" |
| 6000 | 20" | 26" | 33" | 39" | 57" | 65" | 74" | 82" | 90" |

(B) BOTTOM BARS

| FC'(PSI) \ BAR SIZE | DEVELOPMENT LENGTH "INCHES" (FY=60,000 PSI) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| | #3 | #4 | #5 | #6 | #7 | #8 | #9 | #10 | #11 |
| 3000 | 18" | 21" | 27" | 33" | 48" | 54" | 63" | 59" | 75" |
| 4000 | 15" | 18" | 24" | 30" | 42" | 48" | 54" | 60" | 66" |
| 6000 | 12" | 15" | 19" | 23" | 34" | 39" | 44" | 48" | 53" |

(B) BOTTOM BARS

| FC'(PSI) \ BAR SIZE | SPLICE/LAP LENGTH "INCHES" (FY=60,000 PSI) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| | #3 | #4 | #5 | #6 | #7 | #8 | #9 | #10 | #11 |
| 3000 | 21" | 27" | 36" | 42" | 63" | 72" | 81" | 90" | 99" |
| 4000 | 18" | 24" | 30" | 36" | 54" | 63 | 72" | 78" | 84" |
| 6000 | 16" | 20" | 25" | 30" | 44" | 51" | 57" | 62" | 69" |

(11) HOLDING BARS :-

**Unless otherwise indicated all holding bars to be 3/8" dia. @ 10" c/c**

(12) EMBEDDED ITEMS

- **Embedded items and hold fasts required for doors and windows not shown in structural drawings, care to be taken in positioning and securely fastening in place. Embedded items shall be free of oil and other foreign matter such as loose coatings of rust.**
- **For sleeves and other embedded items refer Electrical, HVAC & Plumbing drawings.**
- **All conduits & pipes to be laid in concrete shell be above main reinforcement of slabs & beams & with the approval of Engineer.**

(13) LOCAL ADJUSTMENTS

**it would not materially effect the design.**
**Local adjustments to accommodate fixtures/ embedments, Openings may be made at site but subject to the approval of the engineer.**

(14) **Coordinate these drawings with Architectural, HVAC, Plumbing and Electrical drawings**

(15) **Steel, aggregates and concrete will be tested at different stages reports will be varified by the consultant regularly**

(16) CURING;

**All concrete members will be cured for Min.18 days.**

(17) SHUTTERING AND FORM WORK

**Roof slab will be dried before removal of its shuttering**
**No loading will be allowed on newly poured slab before 7 days.**
**Removal of shuttering and form work will be as follows:**
**column = 2 days**
**beam sides = 2 days**
**beam bottom = 21 days**
**roof slabs = 21 days**

(18) **Do not guess any thing if doubt ask**

(19) **Non-loadbearing walls are not shown in REINFORCEMENT PLAN. Keep them 2' below the slab level AT THE TIME OF POURING. Complete them after the REMOVEL OF SHUTTERING.**

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | |
| CHECKED BY: ENGR. SHAHZAD AYUB | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: GENERAL NOTES |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-GEN-01 (01 OF 02) |
| DATE: 11-03-25 | REV. 0 |

(20)

**Safe bearing capacity of soil adopted is 0.70 ton per sq ft. as per Soil Investigation Report.**

(21)

**Ordinary portland cement, conforming to bs-12/ps-232 shall be used in all R.C.C works.**

(22)

**Cement from different sources shall not be mixed for the structure, unless approved.**

(23)

**All reinforcing bars shall be held firmly in place before and during the pouring of concrete by means of adequate number of wires,chairs and supports to prevent dislocation during the course of construction.**

(24)

**During construction, safety and stability of the structure and all temporary works shall be given prime importance. utmost care and precaution shall be exercised by the Site Incharge during the work against any mishap or accident.**

(25)

**Bars in beams shall be joggled in vertical plane for laps and shall be staggered.**

(26)

**All laps shall not be provided within location of column, beam joints, or within twice the member depth from the face of a joint.**

(27)

**Bars in column shall be joggled for laps & placed within within middle third.**

(28)

**Position of bars in beams shall be adjusted keeping in view the position of vertical bars of the columns.**

(29)

**Stirrups shall be placed in such a way that their hooks shall be staggered and located in compression face, with 135° hook.**

(30)

**Concrete test cylinders/cubes shall be cured with the same method and under conditions as those for the concrete work they represent.**

(31)


**No concrete shall be poured until its formwork and reinforcement has been inspected and approved by the engineer, and proper pre-camber provided.**

(32)


**All back filling must be done in 9" layer compacted to 6" with 95% M.P.D compacted.**

(33)


**Use water proofing chemical in all r.c.c retaining walls and water retaining structure concrete.**

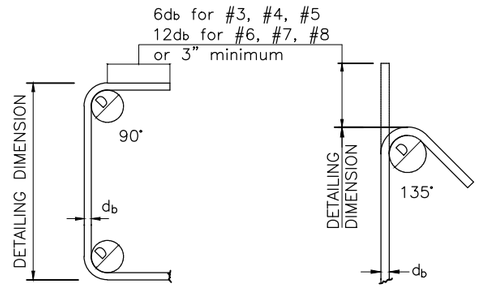


| BAR DIA | D mm |
|---|---|
| #3 | 3" |
| #4 | 3" |
| #5 | 3½" |

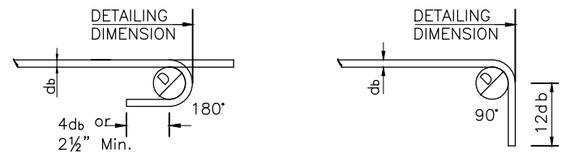


TYPICAL STIRRUP AND TIE HOOKS DETAIL

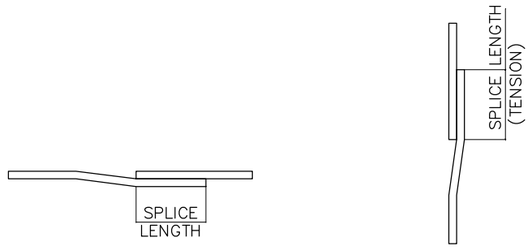



BEAM SPLICE (TYP.)

COLUMN SPLICE (TYP.)

STIRRUPS, HOOKS, SPLICES AND REINFORCEMENT BAR SPACING DETAILS.

**3+3-#6 (T&B) FOR OPENING SIZE OVER 1'-8"x1'-8" BUT ≤ 2'-6"x2'-6"**
**3+3-#4 (T&B) FOR OPENING SIZE LESS THAN 1'-8"X1'-8"**

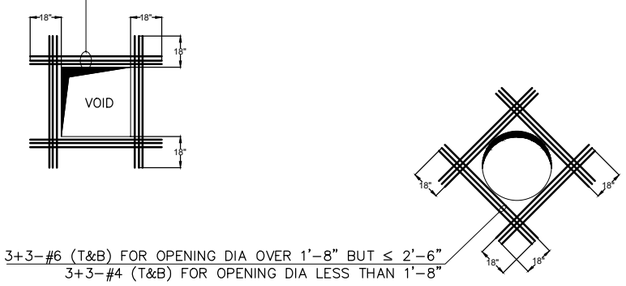


3+3–#6 (T&B) FOR OPENING DIA OVER 1'–8" BUT ≤ 2'–6"
3+3–#4 (T&B) FOR OPENING DIA LESS THAN 1'–8"

REINFORCEMENT DETAIL AT OPENING IN SLAB/SLEEVES.

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11–03–25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P–1, VALANCIA TOWN, LAHORE
CELL: 042–111000722
E–mail: info@shahzadayub.com


DESIGNED BY: ENGR. USAMA KHAN
DRAWN BY: SIKANDAR ALI
CHECKED BY: ENGR. SHAHZAD AYUB
APPROVED BY: ENGR. SHAHZAD AYUB
SCALE: N.T.S.
SHEET SIZE: A3
DATE: 11–03–25


CLIENT: NEW METRO CITY

PROJECT: AMBER MOSQUE AT NMC LAHORE

TITLE: GENERAL NOTES

DRAWING NO.: STRUCTURE DWG–GEN–01 (02 OF 02)

REV.: 0

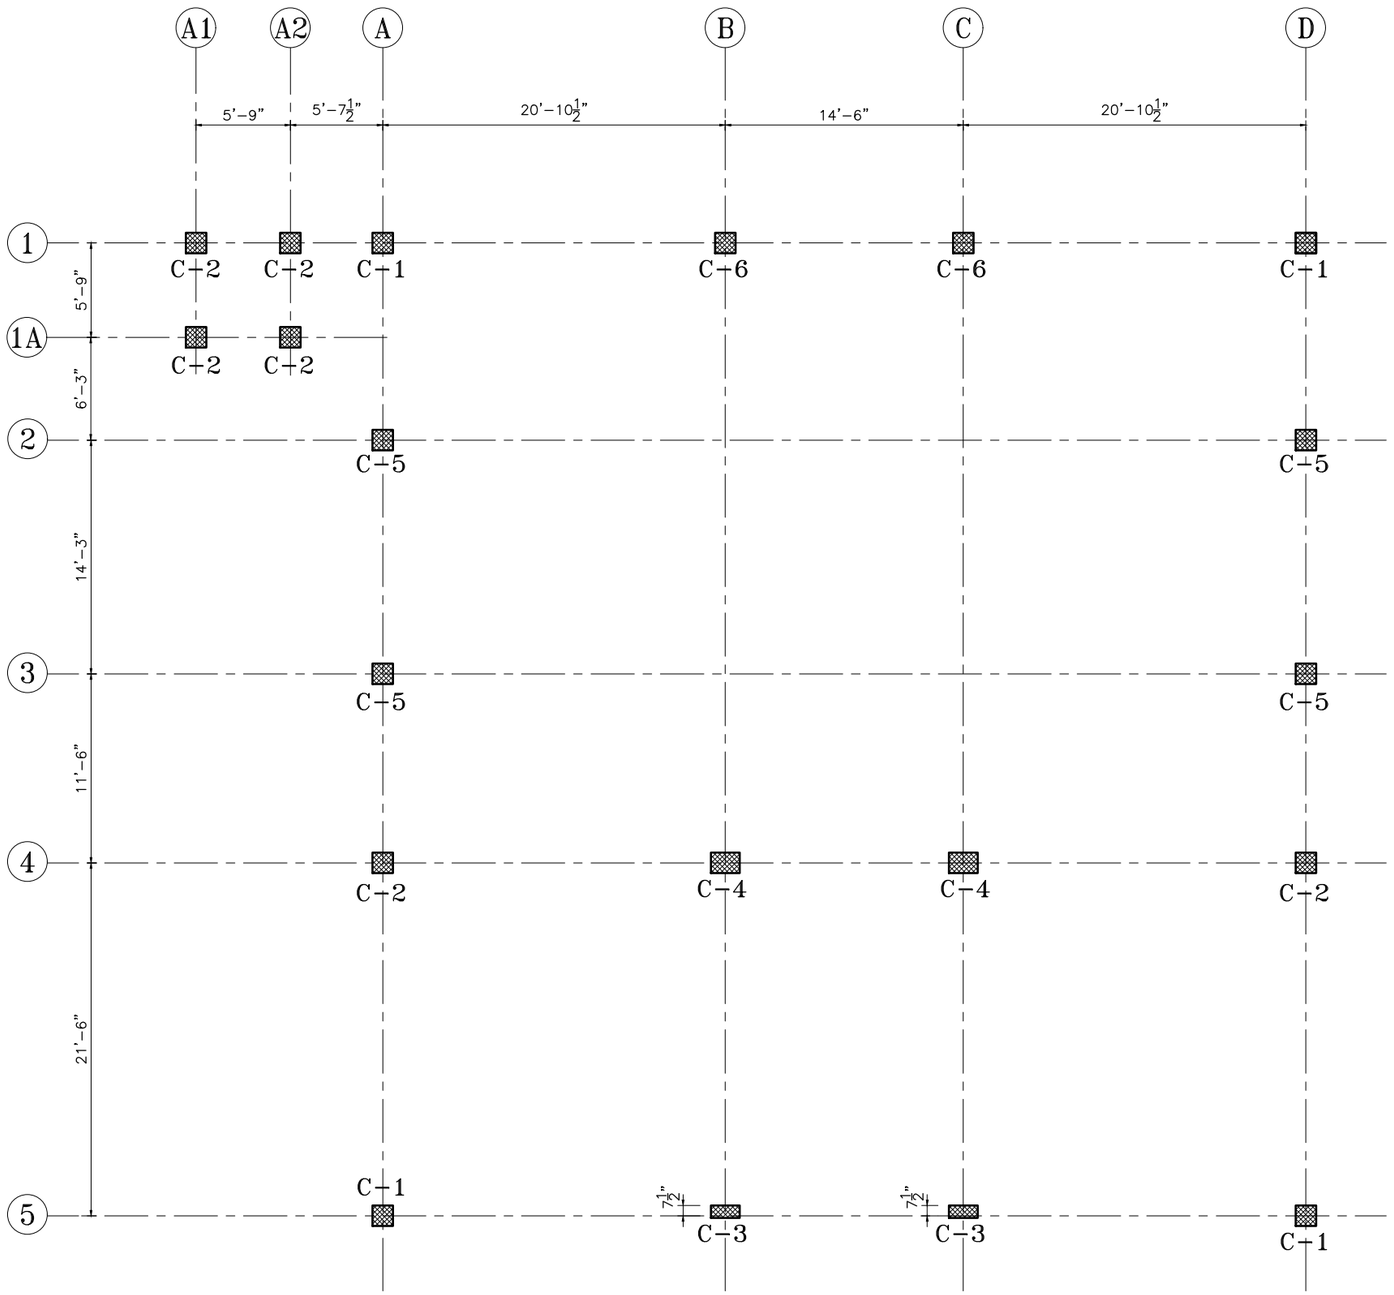


COLUMN LAYOUT PLAN

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.


ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: COLUMN LAYOUT PLAN |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-02 — REV. 0 |
| DATE: 11-03-25 | |

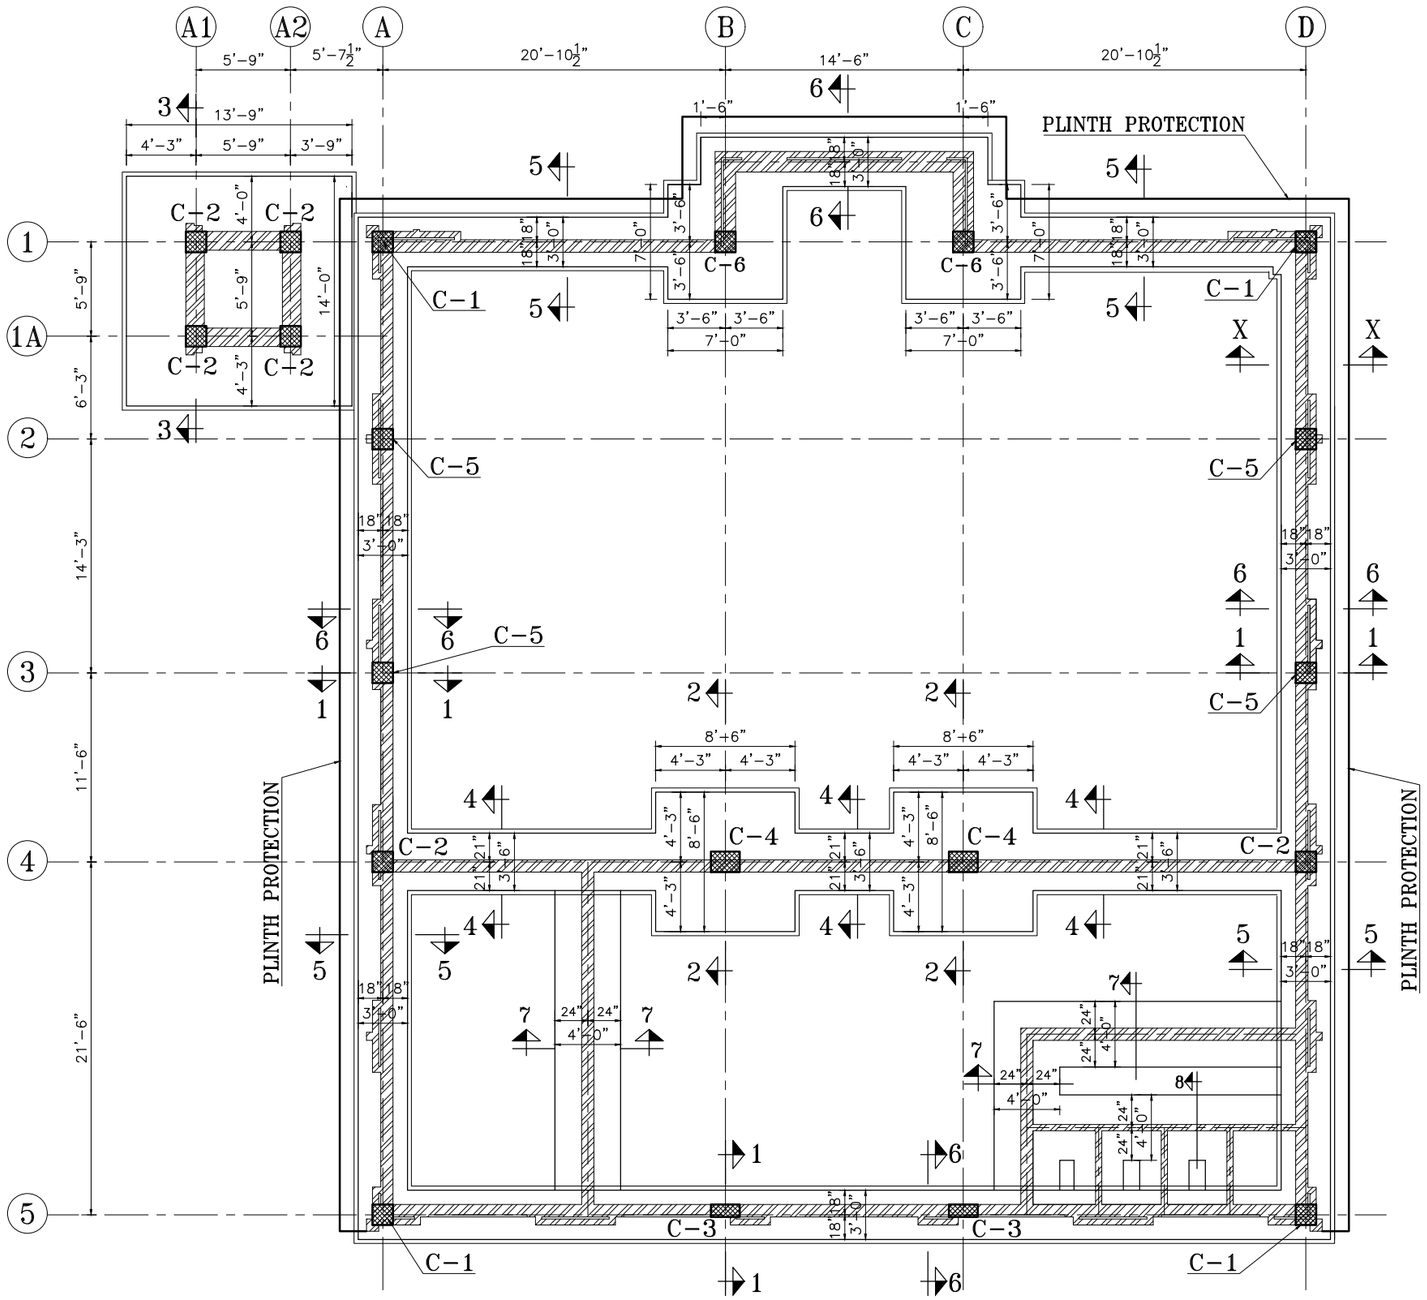


FOUNDATION LAYOUT PLAN

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.
5. SECTION 1-1/8-8 SEE DWG # STR-DWG-05 TO 06
6. COLUMN SECTION SEE STR-DWG-06

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |


REVISIONS

CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: FOUNDATION LAYOUT PLAN |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-03 |
| DATE: 11-03-25 | REV. 0 |

NOTES:


1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

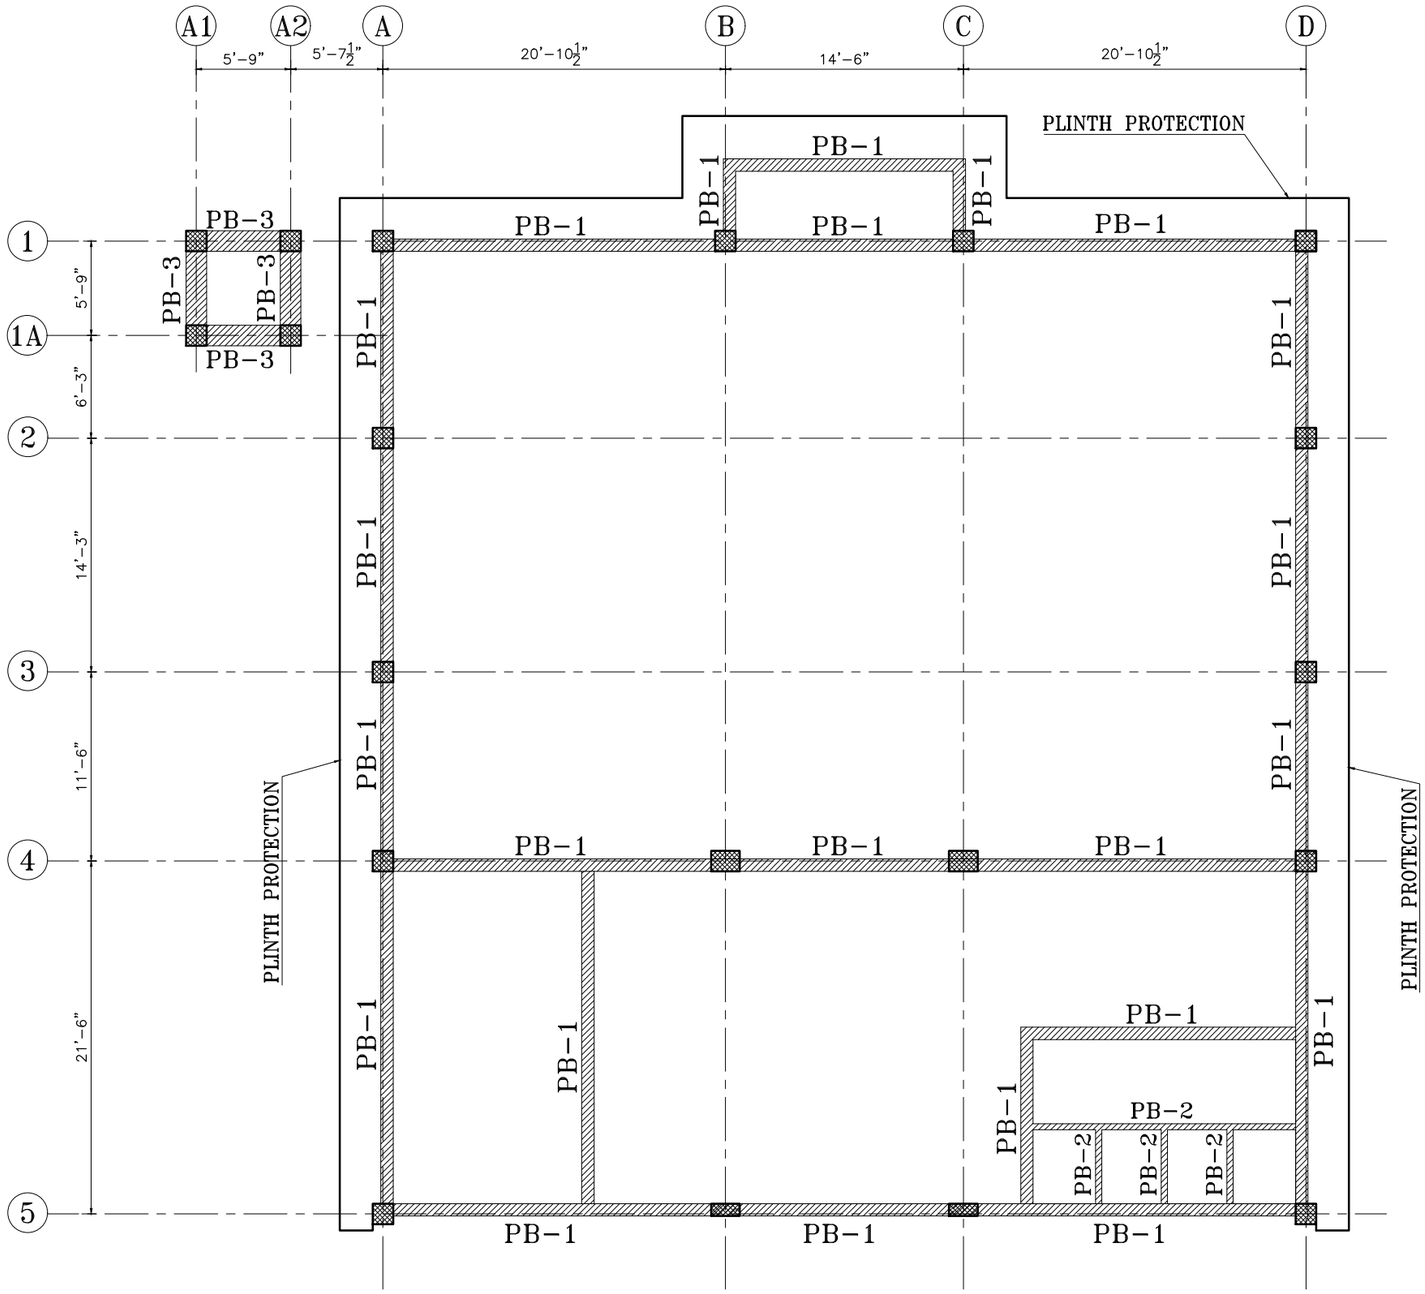



PLINTH BEAMS LAYOUT PLAN

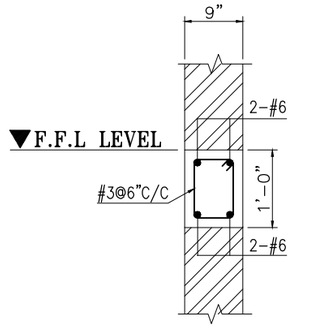


PLINTH BEAM PB-1

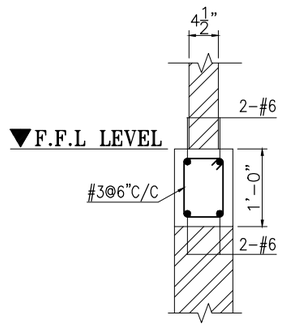


PLINTH BEAM PB-2

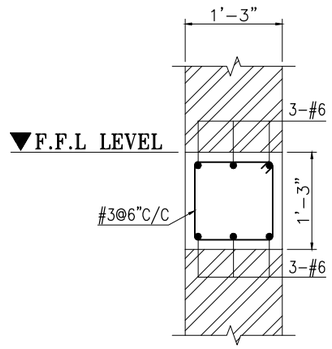


PLINTH BEAM PB-3


ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |


REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com



| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: PLINTH BEAMS LAYOUT PLAN |
| SCALE: N.T.S. | DRAWING NO. STRUCTURE DWG-04 |
| SHEET SIZE: A3 | REV. 0 |
| DATE: 11-03-25 | |

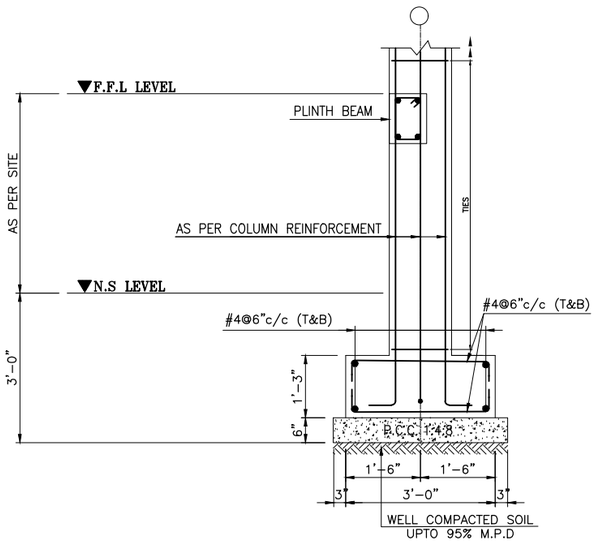



SECTION 1-1

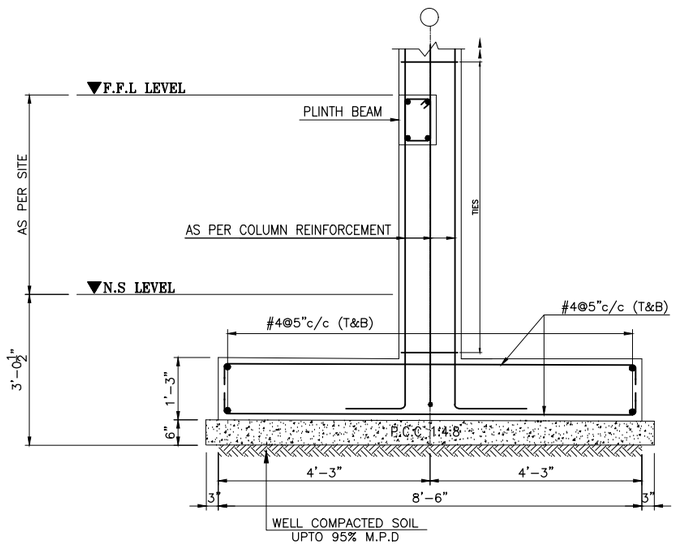



SECTION 2-2

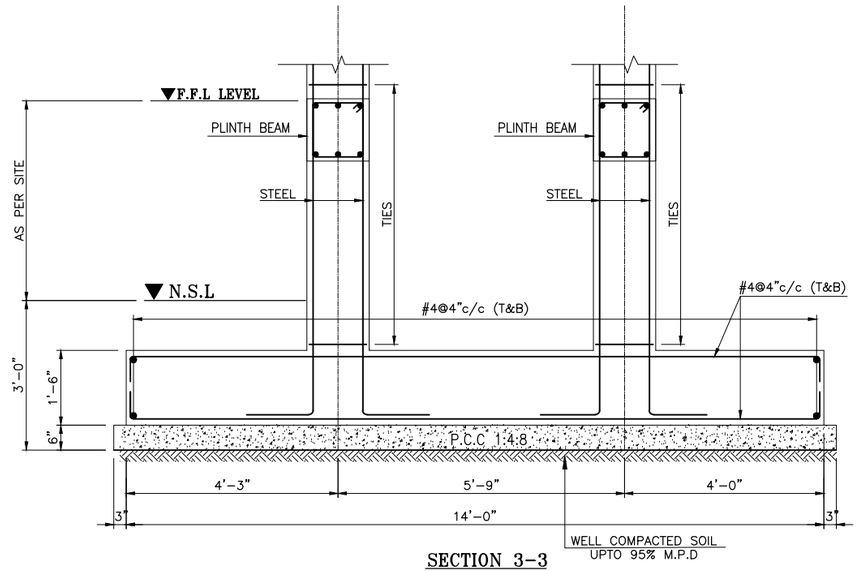



SECTION 3-3

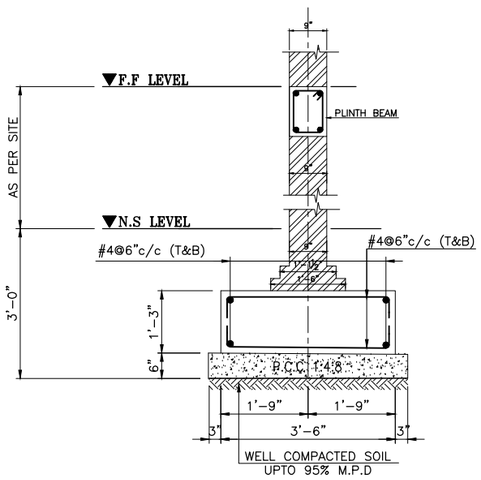


(TYP) 9" THICK WALL
SECTION 4-4

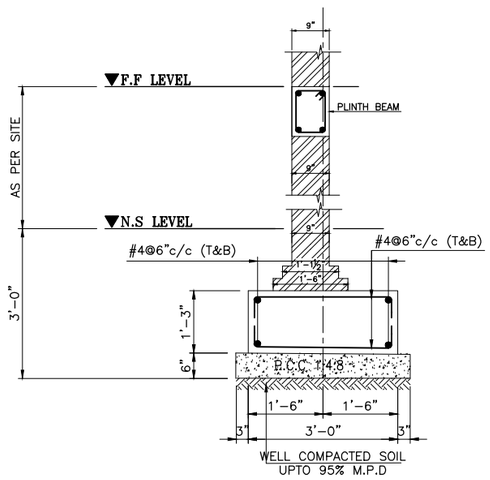


(TYP) 9" THICK WALL
SECTION 5-5

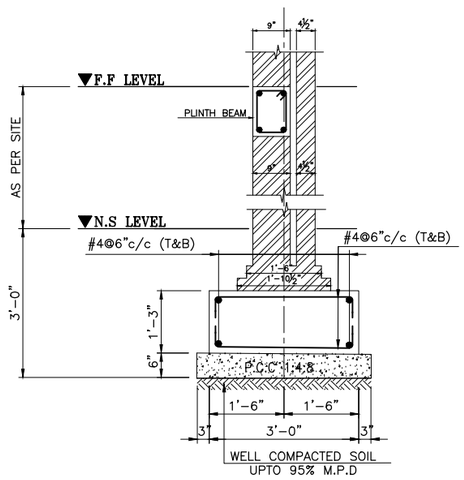


(TYP) 9"/4½" THICK CAVITY WALL
SECTION 6-6

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.


ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |


REVISIONS

CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: FOOTING SECTIONAL REINFORCEMENT DETAILS |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-05 |
| DATE: 11-03-25 | REV. 0 |

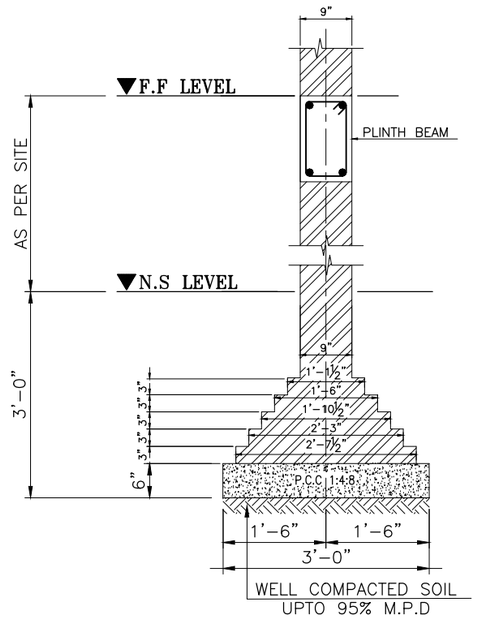



9" THICK WALL
SECTION 7-7

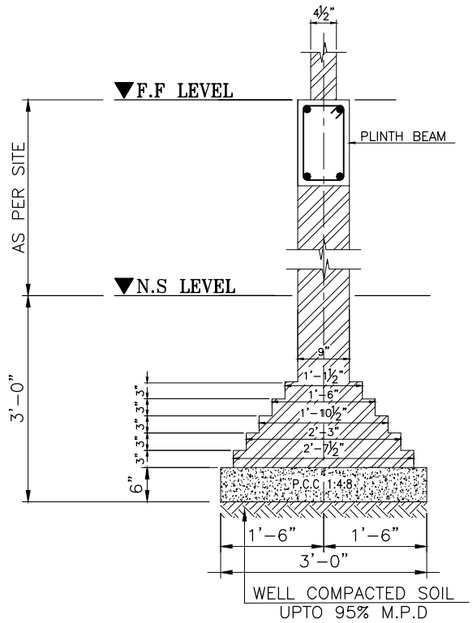



4½" THICK WALL
SECTION 8-8

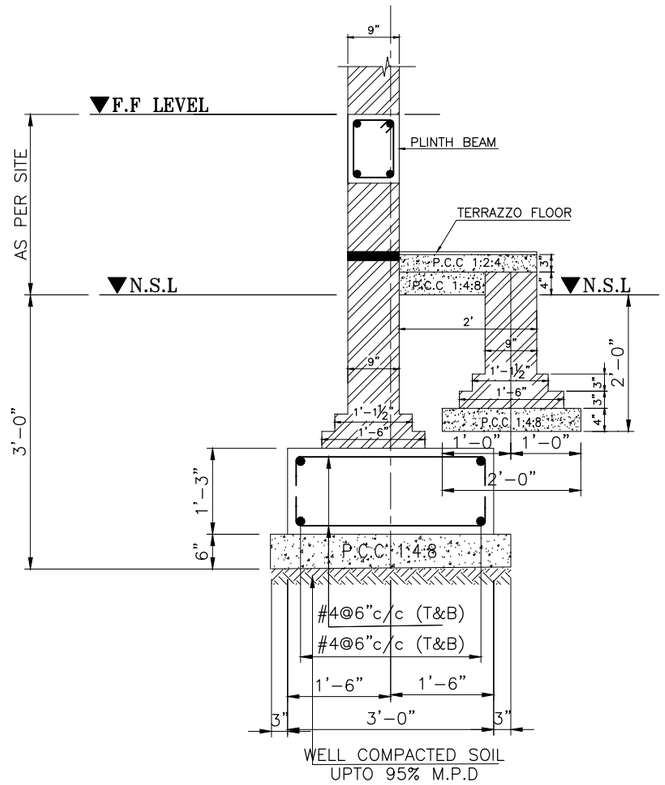



SECTION X-X
TYPICAL PLINTH PROTECTION DETAIL
(FOR ALL AROUND OUTER WALL)





C-1





C-2





C-3

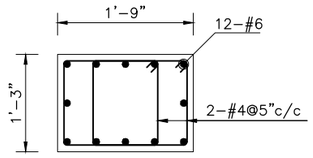


C-4




C-5




C-6

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:

SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com

| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | |
| CHECKED BY: ENGR. SHAHZAD AYUB | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: FOOTING SECTIONAL REINFORCEMENT DETAILS |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-06 |
| DATE: 11-03-25 | REV. 0 |

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

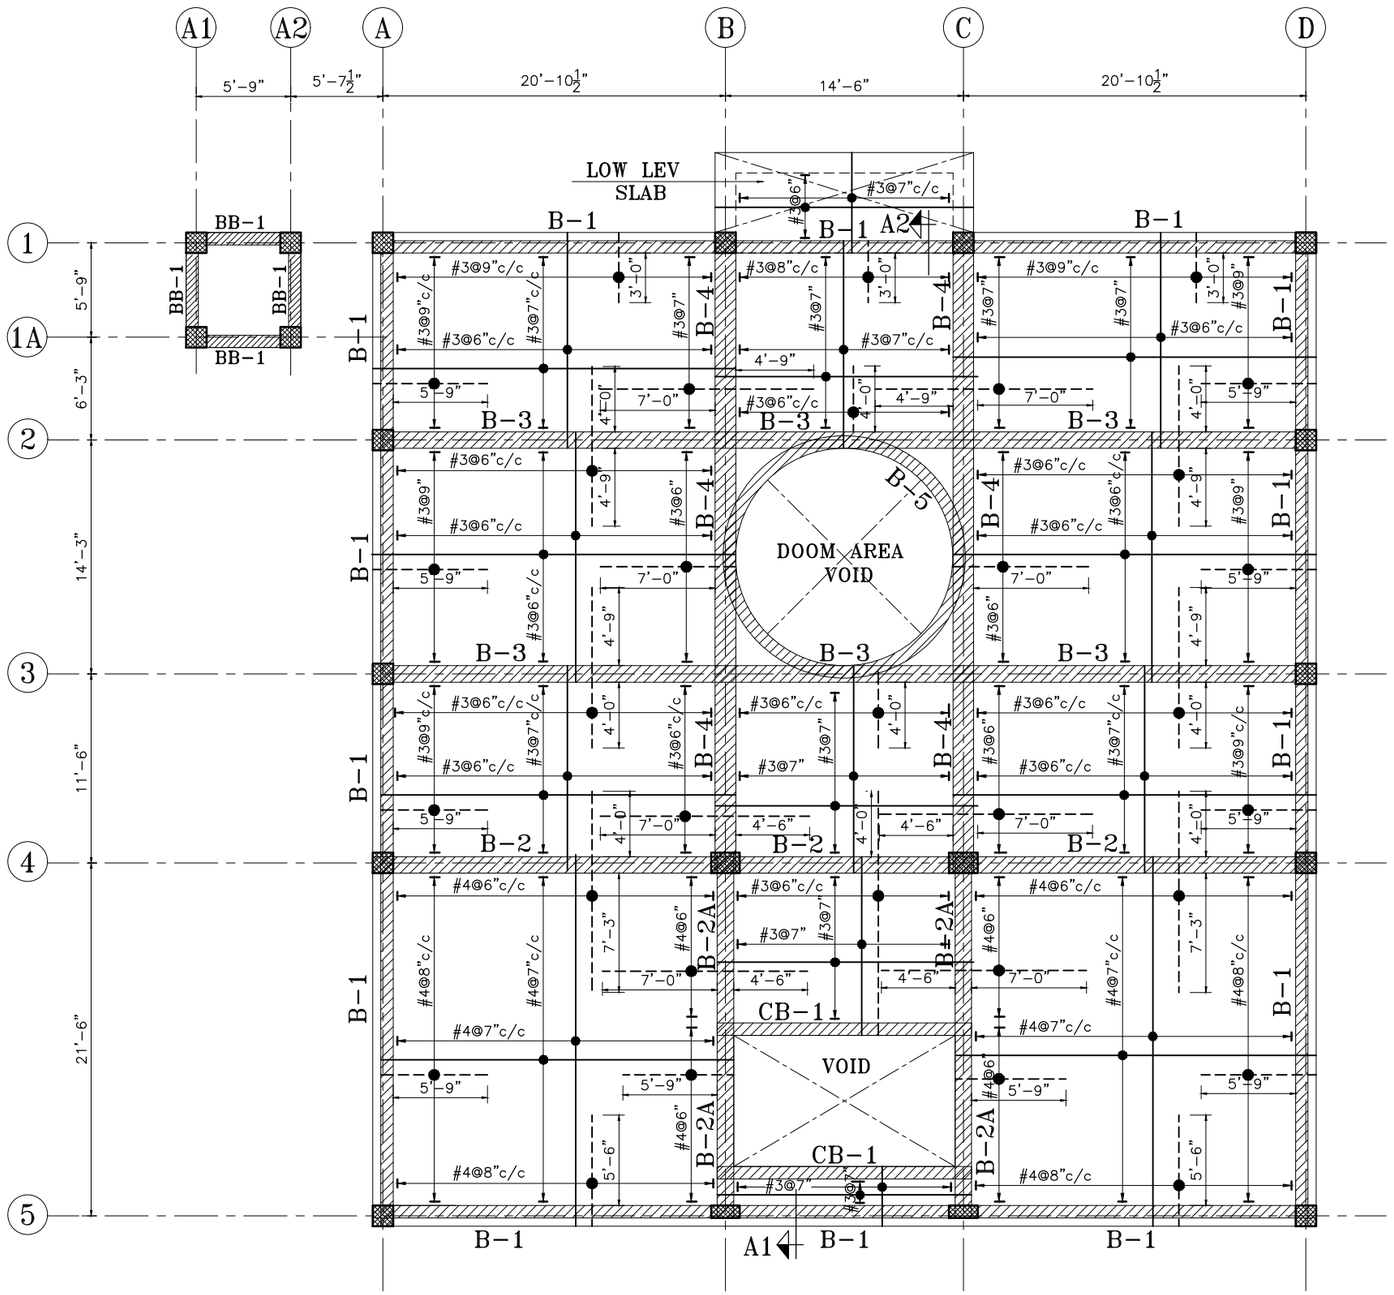


ROOF SLAB REINFORCEMENT DETAIL

ALL SLABS SHALL BE 6" THICK UNLESS OTHERWISE SPECIFIED

ISSUED FOR CONSTRUCTION



















| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS



CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: ROOF SLAB REINFORCEMENT DETAILS |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-07 |
| DATE: 11-03-25 | REV. 0 |


# SCHEDULE OF BEAMS & REINFORCEMENT DETAILS (3000 Psi)

| BEAM NO. | SIZE (BxH) | BEAM REINFORCEMENT (A) TOP REBARS AT DISCONTINUOUS END | BEAM REINFORCEMENT (B) MID TOP | BEAM REINFORCEMENT (B) MID BOTTOM | BEAM REINFORCEMENT (C) TOP REBARS AT CONTINUOUS END | BEAM RINGS (D) DISCONTINUOUS SPAN RINGS | BEAM RINGS (E) MID SPAN RINGS | BEAM RINGS (F) CONTINUOUS SPAN RINGS | (G) SIDE BAR | SECTIONS X DISCONTINUOUS END | SECTIONS Y MID | SECTIONS Z CONTINUOUS END |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| B–1 | 9”x15” | 4–#6 | 2–#6 | 3–#6 | 4–#6 | #3@4”c/c | #3@6”c/c | #3@4”c/c | – |  |  |  |
| B–2 | 12”x18” | 4–#6 | 2–#6 | 4–#6 | 4–#6 | #3@4”c/c | #3@6”c/c | #3@4”c/c | – |  |  |  |
| B–2A | 12”x18” | 4–#6 | 2–#6 | 4–#6 | 4–#8 | #3@4”c/c | #3@6”c/c | #3@4”c/c | – |  |  |  |
| B–3 | 12”x18” | 4–#6 | 2–#6 | 3–#6 | 4–#6 | #3@5”c/c | #3@7”c/c | #3@5”c/c | – |  |  |  |
| B–4 | 15”x30” | 8–#8 | 8–#8 | 8–#8 | 8–#8 | #4@4”c/c | #4@4”c/c | #4@4”c/c | 1” DIA SPACER BAR 4–#4 |  |  |  |
| B–5 | 9”x15” | 4–#6 | 4–#6 | 4–#6 | 4–#6 | #3@5”c/c | #3@5”c/c | #3@5”c/c | – |  |  |  |

NOTES:
1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG–GEN–001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

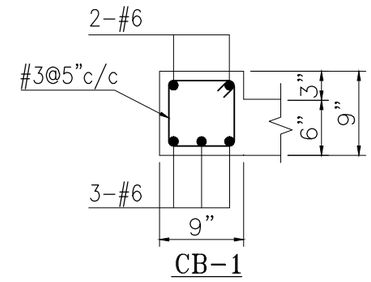


CB–1

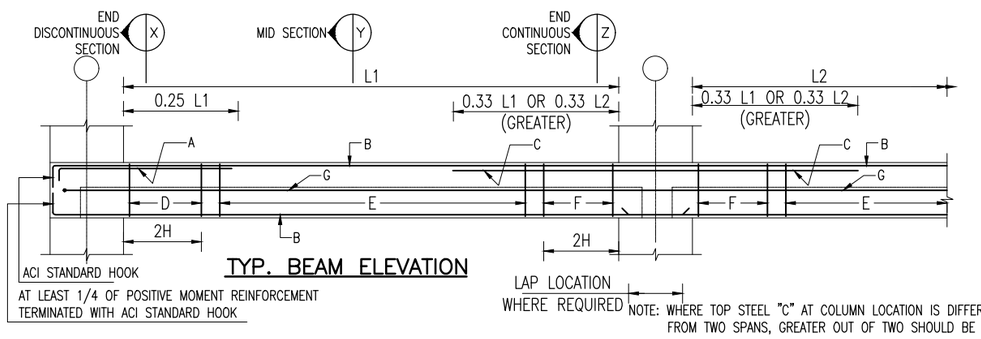

TYP. BEAM ELEVATION


AT LEAST 1/4 OF POSITIVE MOMENT REINFORCEMENT TERMINATED WITH ACI STANDARD HOOK

NOTE: WHERE TOP STEEL "C" AT COLUMN LOCATION IS DIFFERENT, FROM TWO SPANS, GREATER OUT OF TWO SHOULD BE USED.

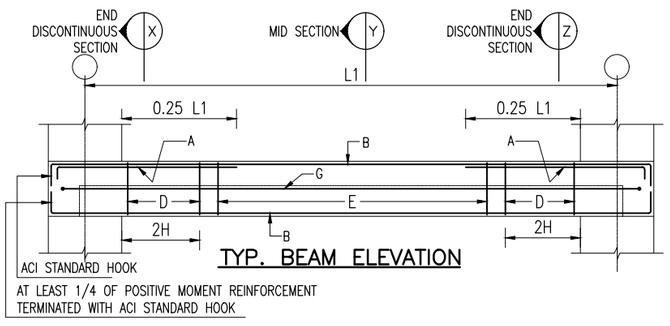

TYP. BEAM ELEVATION

AT LEAST 1/4 OF POSITIVE MOMENT REINFORCEMENT TERMINATED WITH ACI STANDARD HOOK



TYP. BEAM SEC.

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11–03–25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P–1, VALANCIA TOWN, LAHORE
CELL: 042–111000722
E–mail: info@shahzadayub.com


DESIGNED BY: ENGR. USAMA KHAN
DRAWN BY: SIKANDAR ALI
CHECKED BY: ENGR. SHAHZAD AYUB
APPROVED BY: ENGR. SHAHZAD AYUB
SCALE: N.T.S.
SHEET SIZE: A3
DATE: 11–03–25


CLIENT: NEW METRO CITY

PROJECT: AMBER MOSQUE AT NMC LAHORE


TITLE: ROOF SLAB BEAMS SCHEDULES AND REINFORCEMENT SECTIONAL DETAIL

DRAWING NO. STRUCTURE DWG–08


REV. 0

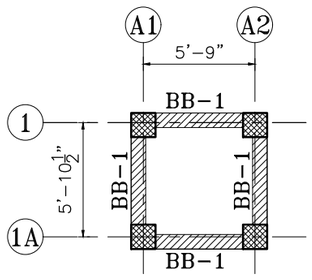



BRACING BEAM FRAMING PLAN
AT 20'-0" LEV

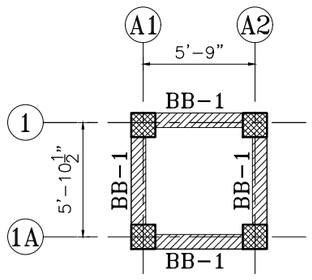



BRACING BEAM FRAMING PLAN
AT 40'-0" LEV

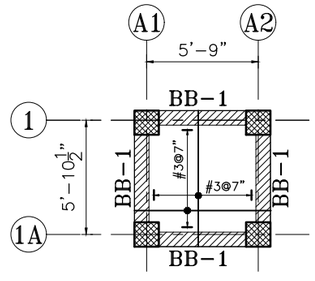



BRACING BEAM FRAMING PLAN
AT 61'-0" LEV
ALL SLABS 6" THICK

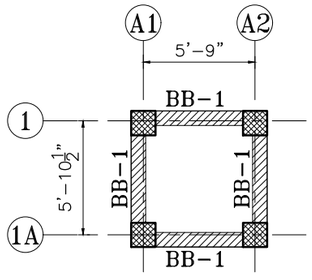



BRACING BEAM FRAMING PLAN
AT 10'-0" LEV

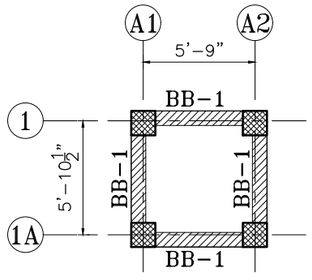


BRACING BEAM FRAMING PLAN
AT 30'-0" LEV

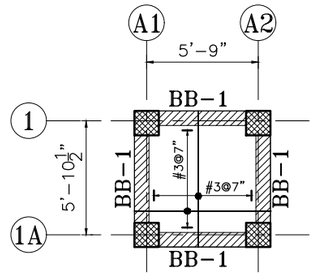


BRACING BEAM FRAMING PLAN
AT 52'-0" LEV
ALL SLABS 6" THICK

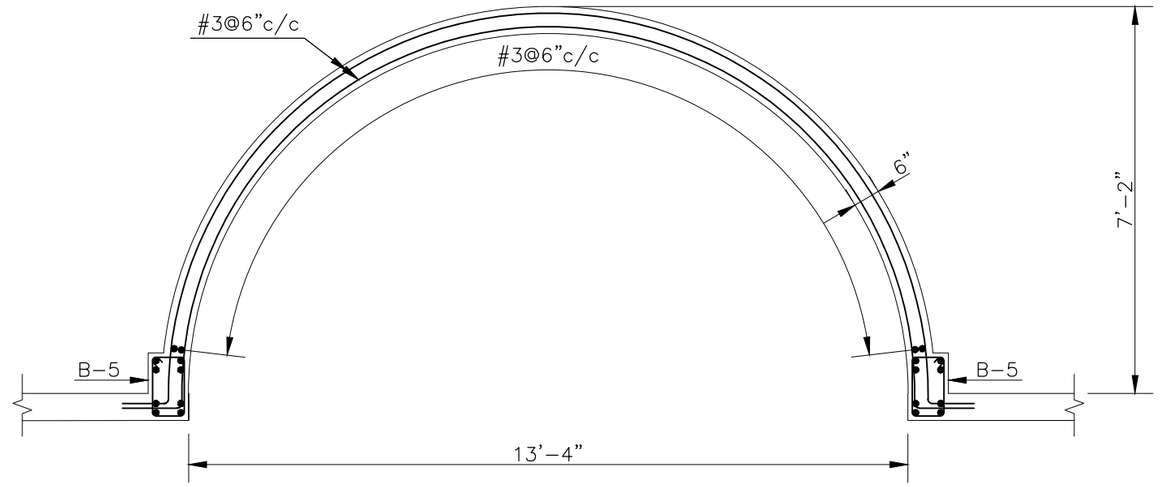



DOME SECTION
REINFORCEMENT DETAIL

# SCHEDULE OF BEAMS & REINFORCEMENT DETAILS (3000 Psi)


| BEAM NO. | SIZE (BxH) | (A) TOP REBARS AT DISCONTINUOUS END | (B) TOP | (C) TOP REBARS AT CONTINUOUS END | (D) BOTTOM | (E) SUPPORT SPAN RINGS | (F) MID SPAN RINGS | (G) CONTINUOUS SPAN RINGS | (H) SIDE BAR | SECTIONS | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | | | | | | | | X | Y | Z |
| | | | | | | | | | | END DISCONTINUOUS | MID | END CONTINUOUS |
| BB-1 | 9"x12" | 3-#6 | 3-#6 | 3-#6 | 3-#6 | #3@6"c/c | #3@6"c/c | #3@6"c/c | – |  |  |  |



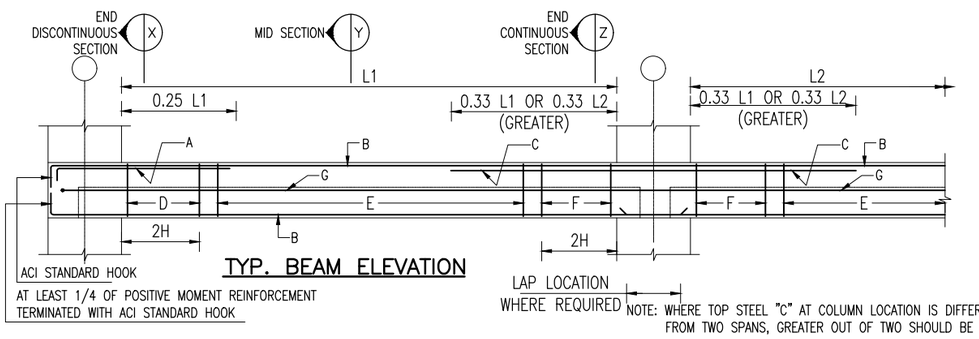



TYP. BEAM ELEVATION

NOTE: WHERE TOP STEEL "C" AT COLUMN LOCATION IS DIFFERENT, FROM TWO SPANS, GREATER OUT OF TWO SHOULD BE USED.

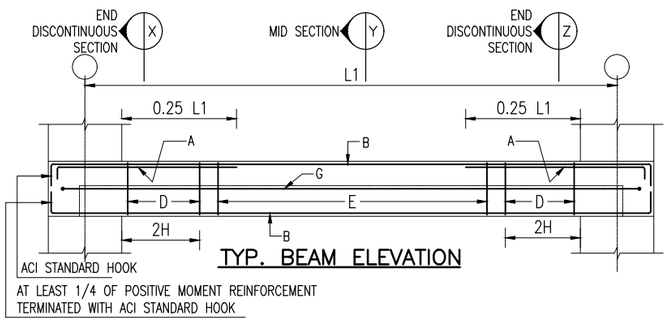


TYP. BEAM ELEVATION




TYP. BEAM SEC.

NOTES:
1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS

CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com

DESIGNED BY: ENGR. USAMA KHAN
DRAWN BY: SIKANDAR ALI
CHECKED BY: ENGR. SHAHZAD AYUB
APPROVED BY: ENGR. SHAHZAD AYUB
SCALE: N.T.S.
SHEET SIZE: A3
DATE: 11-03-25


CLIENT: NEW METRO CITY

PROJECT: AMBER MOSQUE AT NMC LAHORE


TITLE: MINARET BRACING BEAMS PLAN AND REINFORCEMENT SECTION DETAILS

DRAWING NO.: STRUCTURE DWG-09


REV.: 0

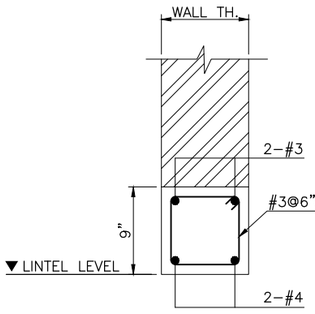



FOR SPAN
UPTO 5'-0"

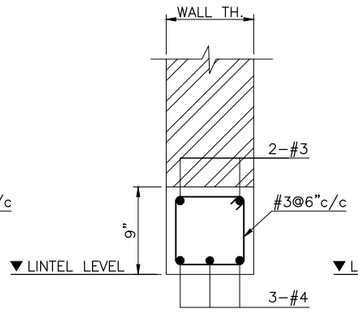



FOR SPAN
05' TO 08'

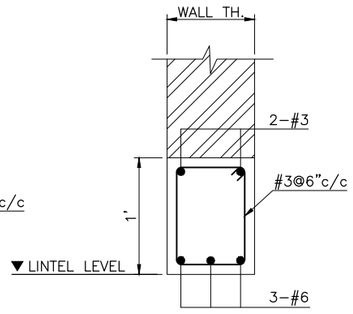



FOR SPAN
08' TO 10'

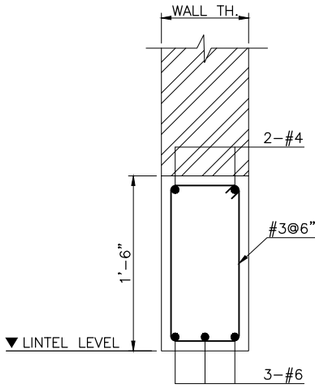



FOR SPAN
10' TO 12'

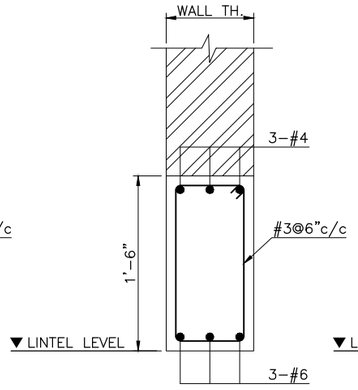


FOR SPAN
12' TO 14'

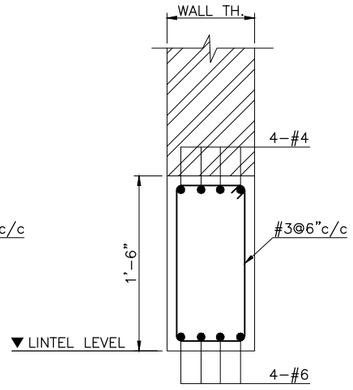



FOR SPAN
14' TO 16'

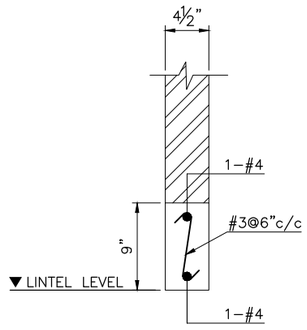



FOR SPAN
UPTO 10'-0"

NOTES:

1. FOR GENERAL NOTES REFER TO GENERAL NOTE STRUCTURE DWG-GEN-001.
2. REFER TO ARCHITECTURAL DRAWING & OTHER SPECIALITIES DRAWING FOR FURTHER DETAIL.
3. READ THIS DRAWING IN CONJUNCTION WITH ALL RELEVANT DRAWINGS.
4. ALL THE DIMENSIONS ARE IN FEET & INCHES.

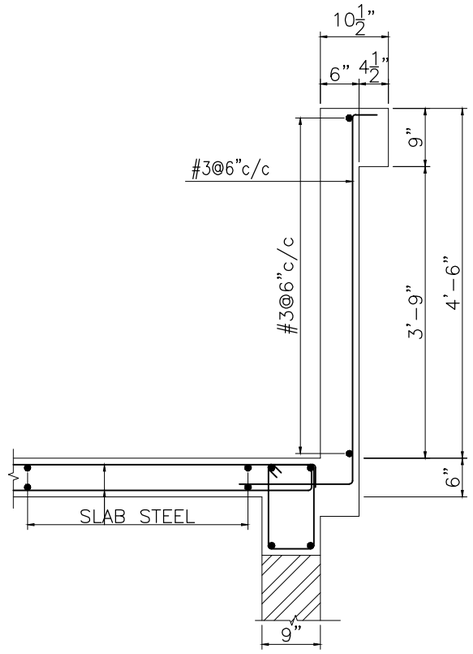


TYPICAL PARAPET DETAIL
SECTION A1-A1

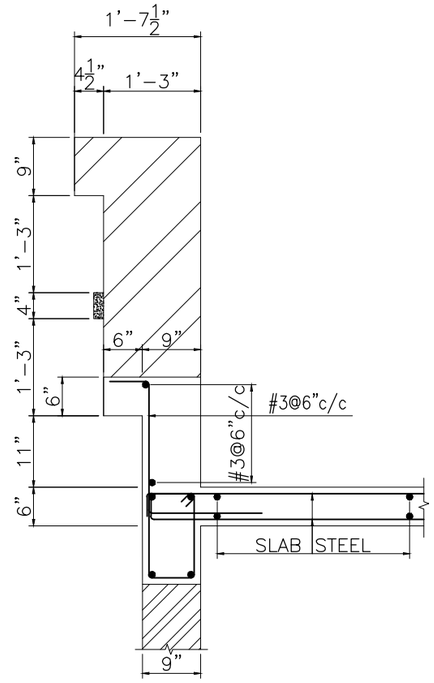


TYPICAL PARAPET DETAIL
SECTION A2-A2

ISSUED FOR CONSTRUCTION

| REV. | DESCRIPTION | DATE | BY | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 11-03-25 | SK | S.A | S.A |

REVISIONS


CONSULTANT:
SHAHZAD AYUB ASSOCIATES
ARCHITECTS, ENGINEERS & PROJECT MANAGERS
34 P-1, VALANCIA TOWN, LAHORE
CELL: 042-111000722
E-mail: info@shahzadayub.com


| | |
|---|---|
| DESIGNED BY: ENGR. USAMA KHAN | CLIENT: NEW METRO CITY |
| DRAWN BY: SIKANDAR ALI | PROJECT: AMBER MOSQUE AT NMC LAHORE |
| CHECKED BY: ENGR. SHAHZAD AYUB | |
| APPROVED BY: ENGR. SHAHZAD AYUB | TITLE: TYPICAL LINTEL BEAMS AND PARAPET REINFORCEMENT SECTIONAL DETAILS |
| SCALE: N.T.S. | |
| SHEET SIZE: A3 | DRAWING NO. STRUCTURE DWG-10 — REV. 0 |
| DATE: 11-03-25 | |