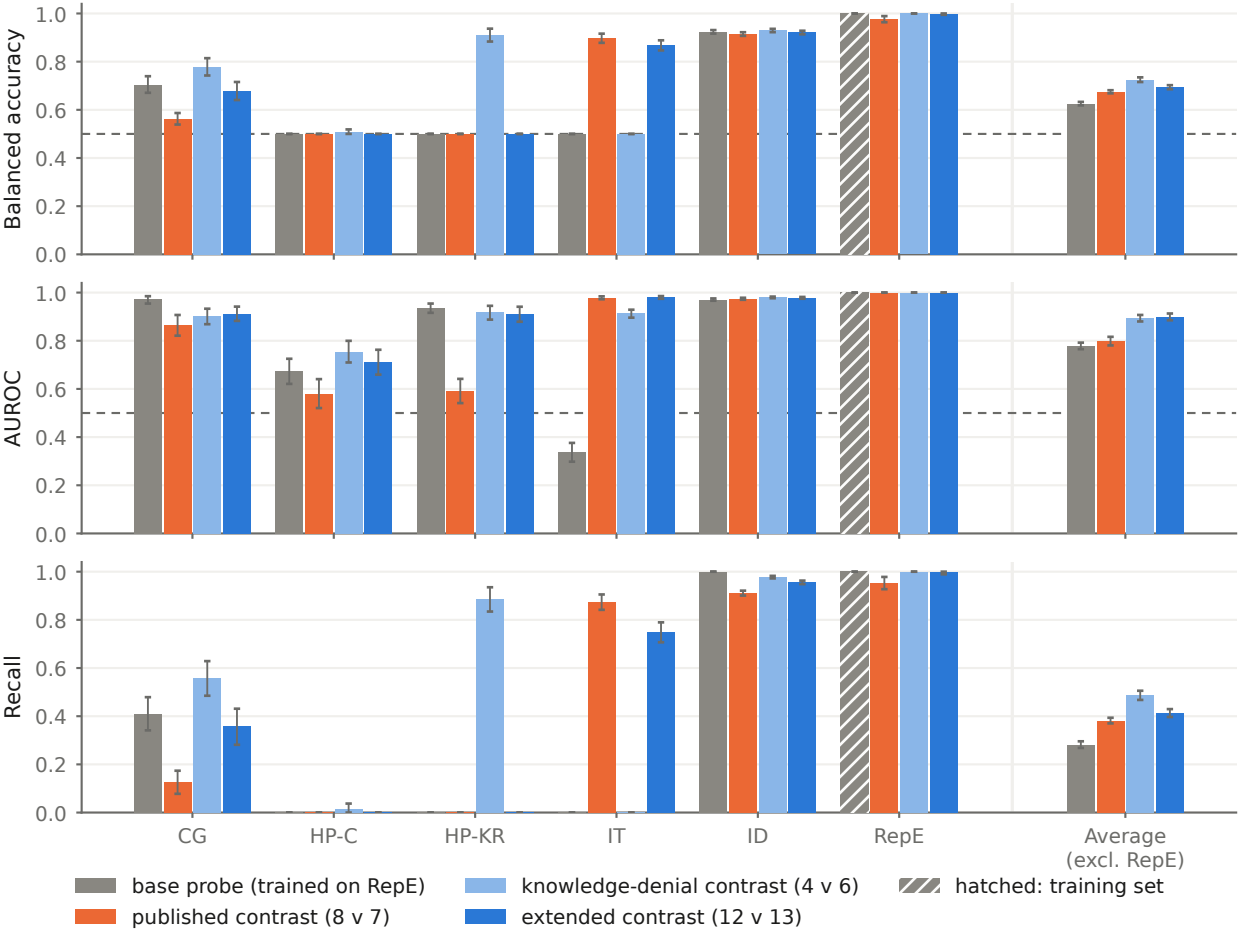
Balanced accuracy
AUROC
Recall
1.0
0.8
0.6
0.4
0.2
0.0
CG
HP-C
HP-KR
IT
ID
RepE
Average
(excl. RepE)
base probe (trained on RepE)
published contrast (8 v 7)
knowledge-denial contrast (4 v 6)
extended contrast (12 v 13)
hatched: training set