SUPPLY BRIDGE ASIA · COMPANY PROFILE 2026

Power equipment from China, delivered when your project needs it.

Distribution transformers, compact substations, ring main units and diesel generator sets for private contractors, project owners and distributors.

- Type-tested transformer designs
- Factory tests witnessed
- Balance paid after inspection



Hangzhou Supply Bridge Asia Supply Chain Co., Ltd.
杭州亚供桥供应链有限公司 · Hangzhou, China

zane@supplybridgeasia.com
WhatsApp +86 177 5731 2044
supplybridgeasia.com

WHO WE ARE

Your contracted supplier in China


We are a sourcing and export company, not a manufacturer. Your quotation, sales contract and invoice come from our company. We select the manufacturer, check the specification, organise inspection and ship the goods.

Company record

Legal name	Hangzhou Supply Bridge Asia Supply Chain Co., Ltd. 杭州亚供桥供应链有限公司
Unified Social Credit Code	91330102MAKM13YP8D
Registered address	Room 1202-16, No. 18 Jiefang Road, Shangcheng District, Hangzhou, Zhejiang, China
Customs registration	Import and export consignor, Qianjiang Customs, Hangzhou · Customs code 3301960NBT
Established	September 2026
Bank	Industrial and Commercial Bank of China, Hangzhou Zhijiang Branch · SWIFT ICBKCNBJZJP. Account details only on contract and proforma invoice.

Check us yourself

- Search our credit code on China's National Enterprise Credit Information Publicity System: gsxt.gov.cn
- Check our customs registration on the China Customs Enterprise Credit Information System: credit.customs.gov.cn
- Ask for a video call. We show you who you are dealing with.
- Customs registration certificate (No. 25554, Qianjiang Customs) available on request.
- Our bank details never change by email. If you receive a change notice, call us before paying.



Zane Zhou
Founder & Managing Director
zane@supplybridgeasia.com
WhatsApp +86 177 5731 2044

One point of contact from enquiry to delivery. We reply to every enquiry within one working day.

Who we work for

Private electrical contractors & EPC subcontractors · Commercial & industrial solar and storage installers · Mines, factories, industrial parks, site camps · Generator dealers & rental fleets · Electrical distributors · Panel builders

DISTRIBUTION TRANSFORMERS

Oil-immersed transformers, 11 kV and 33 kV, 630–2,500 kVA

Built to IEC 60076, 50 Hz, Dyn11, ONAN, designed for 50 °C ambient. Copper or aluminium windings. Losses and impedance are stated in every quote.

11 / 0.415 kV

RATING	NO-LOAD LOSS	LOAD LOSS	IMPEDANCE
630 kVA	810 W	6,200 W	4.0 %
1,000 kVA	1,150 W	10,300 W	4.0 %
1,600 kVA	1,640 W	14,500 W	4.0 %
2,500 kVA	2,290 W	21,200 W	4.0 %

33 / 0.415 kV

RATING	NO-LOAD LOSS	LOAD LOSS	IMPEDANCE
630 kVA	830 W	7,860 W	6.5 %
1,000 kVA	1,150 W	11,500 W	6.5 %
1,600 kVA	1,690 W	16,600 W	6.5 %
2,500 kVA	2,360 W	23,200 W	6.5 %

Typical design values. Loss tolerance +15 % per IEC 60076-1. Final guaranteed values, tapping range, insulation levels, weights and dimensions are stated in the quote for your exact specification. Other ratings and voltages on request.

With every unit

- Routine test report: ratio and vector group, winding resistance, insulation resistance, applied and induced voltage, no-load and load loss, impedance
- Packing list; English nameplate on request
- Export wooden case or seaworthy packing

Type tests

Our transformer manufacturing partners hold type test reports from CNAS / ILAC-MRA accredited laboratories for ratings inside this range, including **2,500 kVA 33 kV** and **1,250 kVA 11 kV** oil-immersed designs. See page 5. Full reports are shared at quotation stage.



Oil-immersed distribution transformers on a partner factory floor.

THE REST OF THE PACKAGE

Substations, switchgear, cable and standby power

Buy the transformer and everything that connects to it from one supplier, under one contract and one shipment.

Compact substations

MV switchgear, transformer and LV board in one enclosure, for solar plants, mines and industrial sites. Configured to your single-line diagram.

Ring main units

Gas-insulated RMUs for distribution networks and plant substations, configured from your single-line diagram. Partner design type-tested to IEC 62271-200 (24 kV).

Power cables

MV and LV power cables to your specification, with the package or on their own. Standard and test reports confirmed in the quote; cut lengths and drums to your schedule.

Diesel generator sets

Open, silent and trailer-mounted sets for prime and standby duty, with ATS and paralleling panels. Engine and alternator makes, rating basis and standard stated in the quote.

What we confirm before you order

- Exact model, rating basis and applicable standard
- Which test reports apply to your equipment, and which tests are done before shipment
- Lead time, confirmed against the manufacturer's schedule
- Warranty terms, written into the sales contract

Example scope for a site connection

33 kV RMU
Incoming and outgoing feeders

→

1,600 kVA compact substation
33 / 0.415 kV

→

LV board
Built to your single-line diagram

→

Standby genset + ATS
Sized to your critical load

Illustration of a typical package. Every scope is quoted from your own single-line diagram; MV and LV cables can be added.

Also available for site projects

Steel-structure buildings and container camps can be added to a power package for site owners and contractors.


EVIDENCE

Test reports and certificates

Documents held by our manufacturing partners. Manufacturer names and report numbers are withheld on public material; full copies are shared with buyers at quotation stage.



Type test · S11-M-2500/33
Oil-immersed, 2,500 kVA, 33 kV. Gansu ZhongCe GuoXin Calibration and Testing, CNAS L16271.

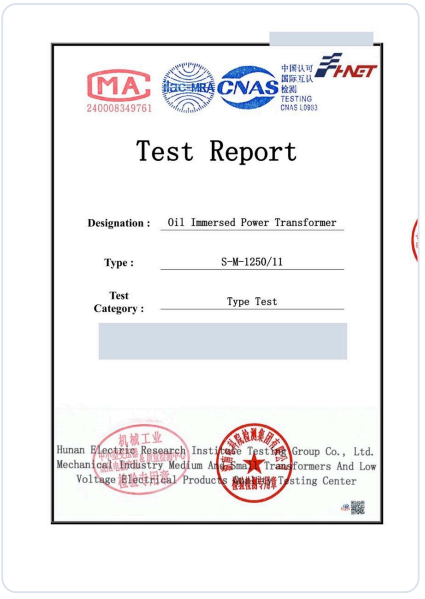


Type test · S-M-1250/11
Oil-immersed, 1,250 kVA, 11 kV. Hunan Electric Research Institute Testing Group, CNAS L0983.



IECEE CB test certificate
35 kV class power transformer, 31,500 kVA. IEC 60076-1, -2, -3, -5, -10. Issued 2026-03-09 by TÜV Rheinland as NCB.



Type test · Ring main unit
Fully insulated SF6 RMU, 24 kV, 630 A, 20 kA. IEC 62271-200:2021, -100, -102. Guangdong Testing Institute of Product Quality Supervision, CNAS L0153.

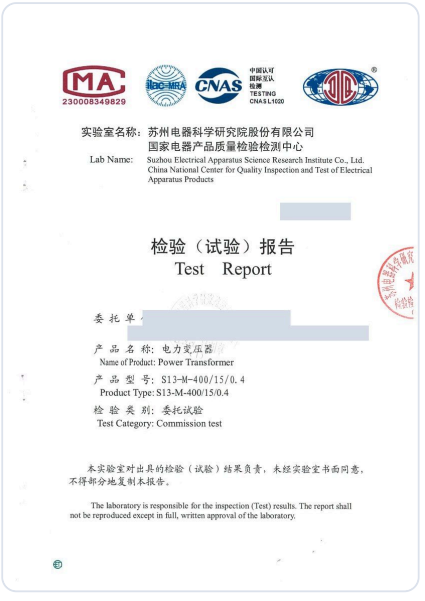

Test report · S13-M-400/15/0.4
Routine and type tests incl. temperature rise, to IEC 60076-1/-2/-3/-10. China National Center for Quality Inspection and Test of Electrical Apparatus Products.



ISO 9001:2015
Manufacture of transformers and HV / LV switchgear assemblies. Valid 8 July 2026 – 7 July 2029. ISO 14001 and ISO 45001 also held.

FROM THE FACTORY TO YOUR SITE

Built, packed and shipped



Transformer sealed and packed in its export case.



Export cases delivered to site.



Unloading at destination with the case lifting points.



Lifting the case by its marked sling points.

Where our transformer manufacturing partner has exported (2023–2025)

South Africa · Ethiopia · Nigeria · Ghana · Guinea · Senegal · Angola · Zimbabwe · Congo · Kazakhstan · Uzbekistan · Kyrgyzstan · Tajikistan · Philippines · Indonesia · Thailand · Cambodia · Palau · Chile · Dominican Republic · Romania

Photos and destinations are from our manufacturing partners' export records, not Supply Bridge Asia deliveries.

HOW AN ORDER WORKS

You see the evidence before you pay the balance

1

Send your requirement

Rating, voltage, quantity, destination and deadline. A single-line diagram or specification helps.

2

Quote within two working days

Price, technical data sheet, applicable test reports and a lead time confirmed against the manufacturer's schedule.

3

See the factory before you commit

On request we send a recorded video from the factory showing the production line and equipment of your specification.

4

Contract and deposit

The sales contract and proforma invoice state the specification, inspection scope, acceptance criteria, warranty and payment schedule. You pay our company account.

5

Production and factory tests

Production photos at agreed stages. Routine tests witnessed live by video, or by your own third-party inspector (SGS, BV, Intertek or your nominee).

6

Balance, then shipment

You review the test report, photos and video, then pay the balance. Packing, export documents and shipping follow; original documents or telex release after cleared payment.

How you pay

Bank transfer (T/T) to our company account: a deposit with the order, the balance after you review the inspection evidence and before shipment. Sight letters of credit may be considered for larger orders. The exact schedule is written into each proforma invoice.

Trial orders welcome

Start with one unit and check the quality before you place a larger order.

Tell us what your project needs

Send the rating, voltage, quantity, destination and deadline. We reply within one working day with what is available and when it can ship.

Contact	Zane Zhou, Founder & Managing Director
Email	zane@supplybridgeasia.com
WhatsApp	+86 177 5731 2044
Website	supplybridgeasia.com
Company	Hangzhou Supply Bridge Asia Supply Chain Co., Ltd. Room 1202-16, No. 18 Jiefang Road, Shangcheng District, Hangzhou, China