

PVsyst - Simulation report

Grid-Connected System

Project: **BATTERY (3)**

Variant: **12.6**

No 3D scene defined, no shadings

System power: **12.60** kWp

Kampung Chuang - Malaysia

Author

NORTHERN SOLAR SDN. BHD. (Malaysia)



Project: BATTERY (3)

Variant: 12.6

PVsyst V8.1.3

VC0, Simulation date:
with V8.1.3

NORTHERN SOLAR SDN. BHD. (Malaysia)

Project summary

Geographical Site

Kampung Chuang

Malaysia

Situation

Latitude 3.4869 °(N)

Longitude 101.6284 °(E)

Altitude 22 m

Time zone UTC+8

Project settings

Albedo 0.20

Weather data

Kampung Chuang

Meteonorm 9.0 dll, Sat=100% - Synthetic

System summary

Grid-Connected System

Simulation for year no 1

No 3D scene defined, no shadings

Orientation #1

Fixed plane

Tilt/Azimuth 20 / 90 °

Orientation #2

Fixed plane

Tilt/Azimuth 20 / -90 °

Orientation #3

Fixed plane

Tilt/Azimuth 20 / 0 °

Near Shadings

no Shadings

User's needs

Monthly values

System information

PV Array

Nb. of modules 20 units

Pnom total 12.60 kWp

Inverters

Nb. of units 1 unit

Total power 10 kWac

Pnom ratio 1.26

Battery pack

Storage strategy: Self-consumption

Nb. of units 1 unit

Voltage 51 V

Capacity 314 Ah

Results summary

Simulation step Hourly

Produced Energy 16922 kWh/year

Used Energy 9670 kWh/year

Specific production 1343 kWh/kWp/year

Perf. Ratio PR 77.84 %

Solar Fraction SF 87.28 %

Table of contents

Project and results summary	2
General parameters, PV Array Characteristics, System losses	3
Main results	6
Loss diagram	7
Predef. graphs	8
P50 - P90 evaluation	9

Project: **BATTERY (3)**Variant: **12.6****PVsyst V8.1.3**VC0, Simulation date:
with V8.1.3

NORTHERN SOLAR SDN. BHD. (Malaysia)

General parameters**Grid-Connected System****No 3D scene defined, no shadings****Simulation step**

Hourly

Orientation #1**Fixed plane**Tilt/Azimuth **20 / 90 °****Orientation #2****Fixed plane**Tilt/Azimuth **20 / -90 °****Orientation #3****Fixed plane**Tilt/Azimuth **20 / 0 °****Models used**

Transposition Perez

Diffuse Perez, Meteonorm

Circumsolar separate

Horizon

Average Height 2.6 °

Near Shadings

no Shadings

Storage

Kind Self-consumption

User's needs

Monthly values

Jan.	Feb.	Mar.	Apr.	May	June	July	Aug.	Sep.	Oct.	Nov.	Dec.	Year	
													kWh/mth

PV Array Characteristics**PV module**Manufacturer **Astronergy**Model **CHSM66RN(DG)/F-BH-630**

(Custom parameters definition)

CHSM66RN(DG)F-BH-630.PANUnit Nom. Power **630 Wp****Inverter**

Manufacturer

Hoymiles

Model

HIT-10L-G3

(Custom parameters definition)

Unit Nom. Power **10.00 kWac****Array #1 - PV Array**

Orientation 1

Tilt/Azimuth **20/90 °**Number of PV modules **10 units**Nominal (STC) **4410 Wp**Modules 1 unit x **10** In series**At operating cond. (50°C)**Pmpp **5.88 kWp**U mpp **377 V**

I mpp 16 A

Number of inverters 1 * MPPT **33%** **0.3** unitTotal power **3.3 kWac**Operating voltage **125-900 V**Pnom ratio (DC:AC) **1.89****Array #2 - Sub-array #2**

Orientation 2

Tilt/Azimuth **20/-90 °**Number of PV modules **5 units**Nominal (STC) **3150 Wp**Modules 1 unit x **5** In series**At operating cond. (50°C)**Pmpp **2940 Wp**U mpp **189 V**

I mpp 16 A

Number of inverters 1 * MPPT **33%** **0.3** unitTotal power **3.3 kWac**Operating voltage **125-900 V**Pnom ratio (DC:AC) **0.95**

**PV Array Characteristics****Array #3 - Sub-array #3**

Orientation	3		
Tilt/Azimuth	20/0 °		
Number of PV modules	5 units	Number of inverters	1 * MPPT 33% 0.3 unit
Nominal (STC)	3150 Wp	Total power	3.3 kWac
Modules	1 unit x 5 In series	Operating voltage	125-900 V
At operating cond. (50°C)		Pnom ratio (DC:AC)	0.95
Pmpp	2940 Wp		
U mpp	189 V		
I mpp	16 A		
Total PV power		Total inverter power	
Nominal (STC)	13 kWp	Total power	10 kWac
Total	20 modules	Number of inverters	1 unit
Module area	54.0 m²	Pnom ratio	1.26
Cell area	50.5 m²	No power sharing	

Grid storage - Self-consumption**Battery**

Manufacturer	Hoymiles
Model	LB-16D-G3

Battery pack

Nb. of units	1 unit
Voltage	51 V
Nominal Capacity (C10)	314 Ah
Nominal energy	16.1 kWh
Operating SOC limits	95.0 / 20.0 %
Useable energy	12.1 kWh
Operating temperature	Fixed 20 °C

Battery input charger

Model	Generic
Max. charging power	8.00 kWdc
Max./Euro effic.	98.0 / 96.5 %

Battery to Grid inverter

Model	Generic
Max. discharging power	1.35 kWac
Max./Euro effic.	98.0 / 96.5 %

Array losses**Array Soiling Losses**

Loss Fraction	1.5 %
---------------	-------

Thermal Loss factor

Module temperature according to irradiance	
Uc (const)	20.0 W/m²K
Uv (wind)	0.0 W/m²K/m/s

LID - Light Induced Degradation

Loss Fraction	1.45 %
---------------	--------

Module Quality Loss

Loss Fraction	-0.75 %
---------------	---------

Module mismatch losses

Loss Fraction	1.00 % at MPP
---------------	---------------

Module average degradation

Year no	1
Loss factor	0.55 %/year
Imp / Vmp contributions	80% / 20%

Mismatch due to degradation

Imp RMS dispersion	0.4 %/year
Vmp RMS dispersion	0.4 %/year

IAM loss factor

ASHRAE Param.: IAM = 1 - bo (1/cosi -1)	
bo Param.	0.05



DC wiring losses

Global wiring resistance 10 mΩ

Loss Fraction **2.00** % at STC

Array #1 - PV Array

Global array res. **786** mΩ

Loss Fraction **3.00** % at STC

Array #3 - Sub-array #3

Global array res. **196** mΩ

Loss Fraction **1.50** % at STC

Array #2 - Sub-array #2

Global array res. **196** mΩ

Loss Fraction **1.50** % at STC

System losses

Unavailability of the system

Time fraction 1.0 %

3.7 days,
3 periods

AC wiring losses

Inv. output line up to injection point

Inverter voltage **400** Vac tri

Loss Fraction 1.00 % at STC

Global System

Wire section Copper **3 x 4** mm²

Wires length **28** m



Project: BATTERY (3)

Variant: 12.6

PVsyst V8.1.3

VC0, Simulation date:
with V8.1.3

NORTHERN SOLAR SDN. BHD. (Malaysia)

Main results

Simulation step

Hourly

System Production

Produced Energy **16922** kWh/year

Used Energy **9670** kWh/year

Specific production

1343 kWh/kWp/year

Perf. Ratio PR

77.84 %

Solar Fraction SF

87.28 %


Battery ageing (State of Wear)

Cycles SOW 66.1 %


Static SOW 90.0 %

Battery lifetime 2.9 years

Normalized productions (per installed kWp)

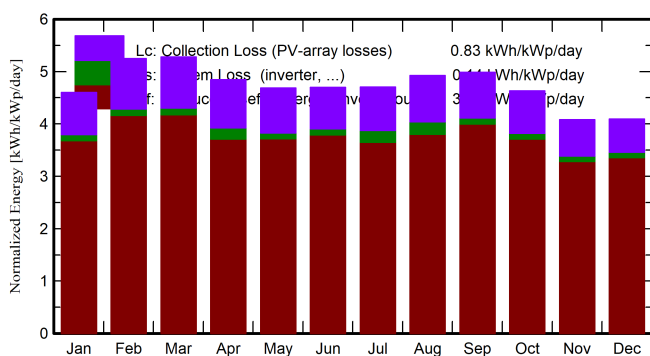

Performance Ratio PR

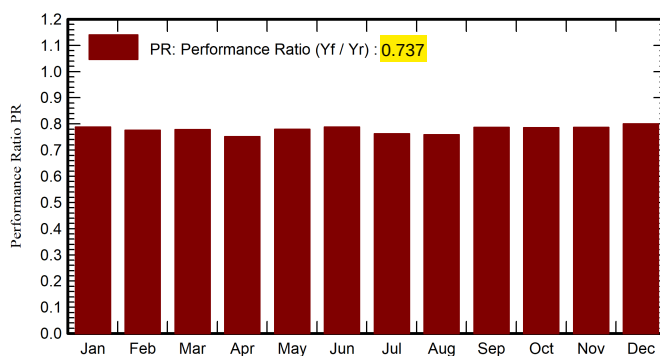

Balances and main results

	GlobHor kWh/m ²	DiffHor kWh/m ²	T_Amb °C	GlobInc kWh/m ²	GlobEff kWh/m ²	EArray kWh	E_User kWh	E_Solar kWh	E_Grid kWh	EFrGrid kWh
January										
February										
March										
April										
May										
June										
July										
August										
September										
October										
November										
December										
Year										

Legends

GlobHor Global horizontal irradiation

DiffHor Horizontal diffuse irradiation

T_Amb Ambient Temperature

GlobInc Global incident in coll. plane

GlobEff Effective Global, corr. for IAM and shadings


EArray Effective energy at the output of the array

E_User Energy supplied to the user

E_Solar Energy from the sun

E_Grid Energy injected into grid


EFrGrid Energy from the grid

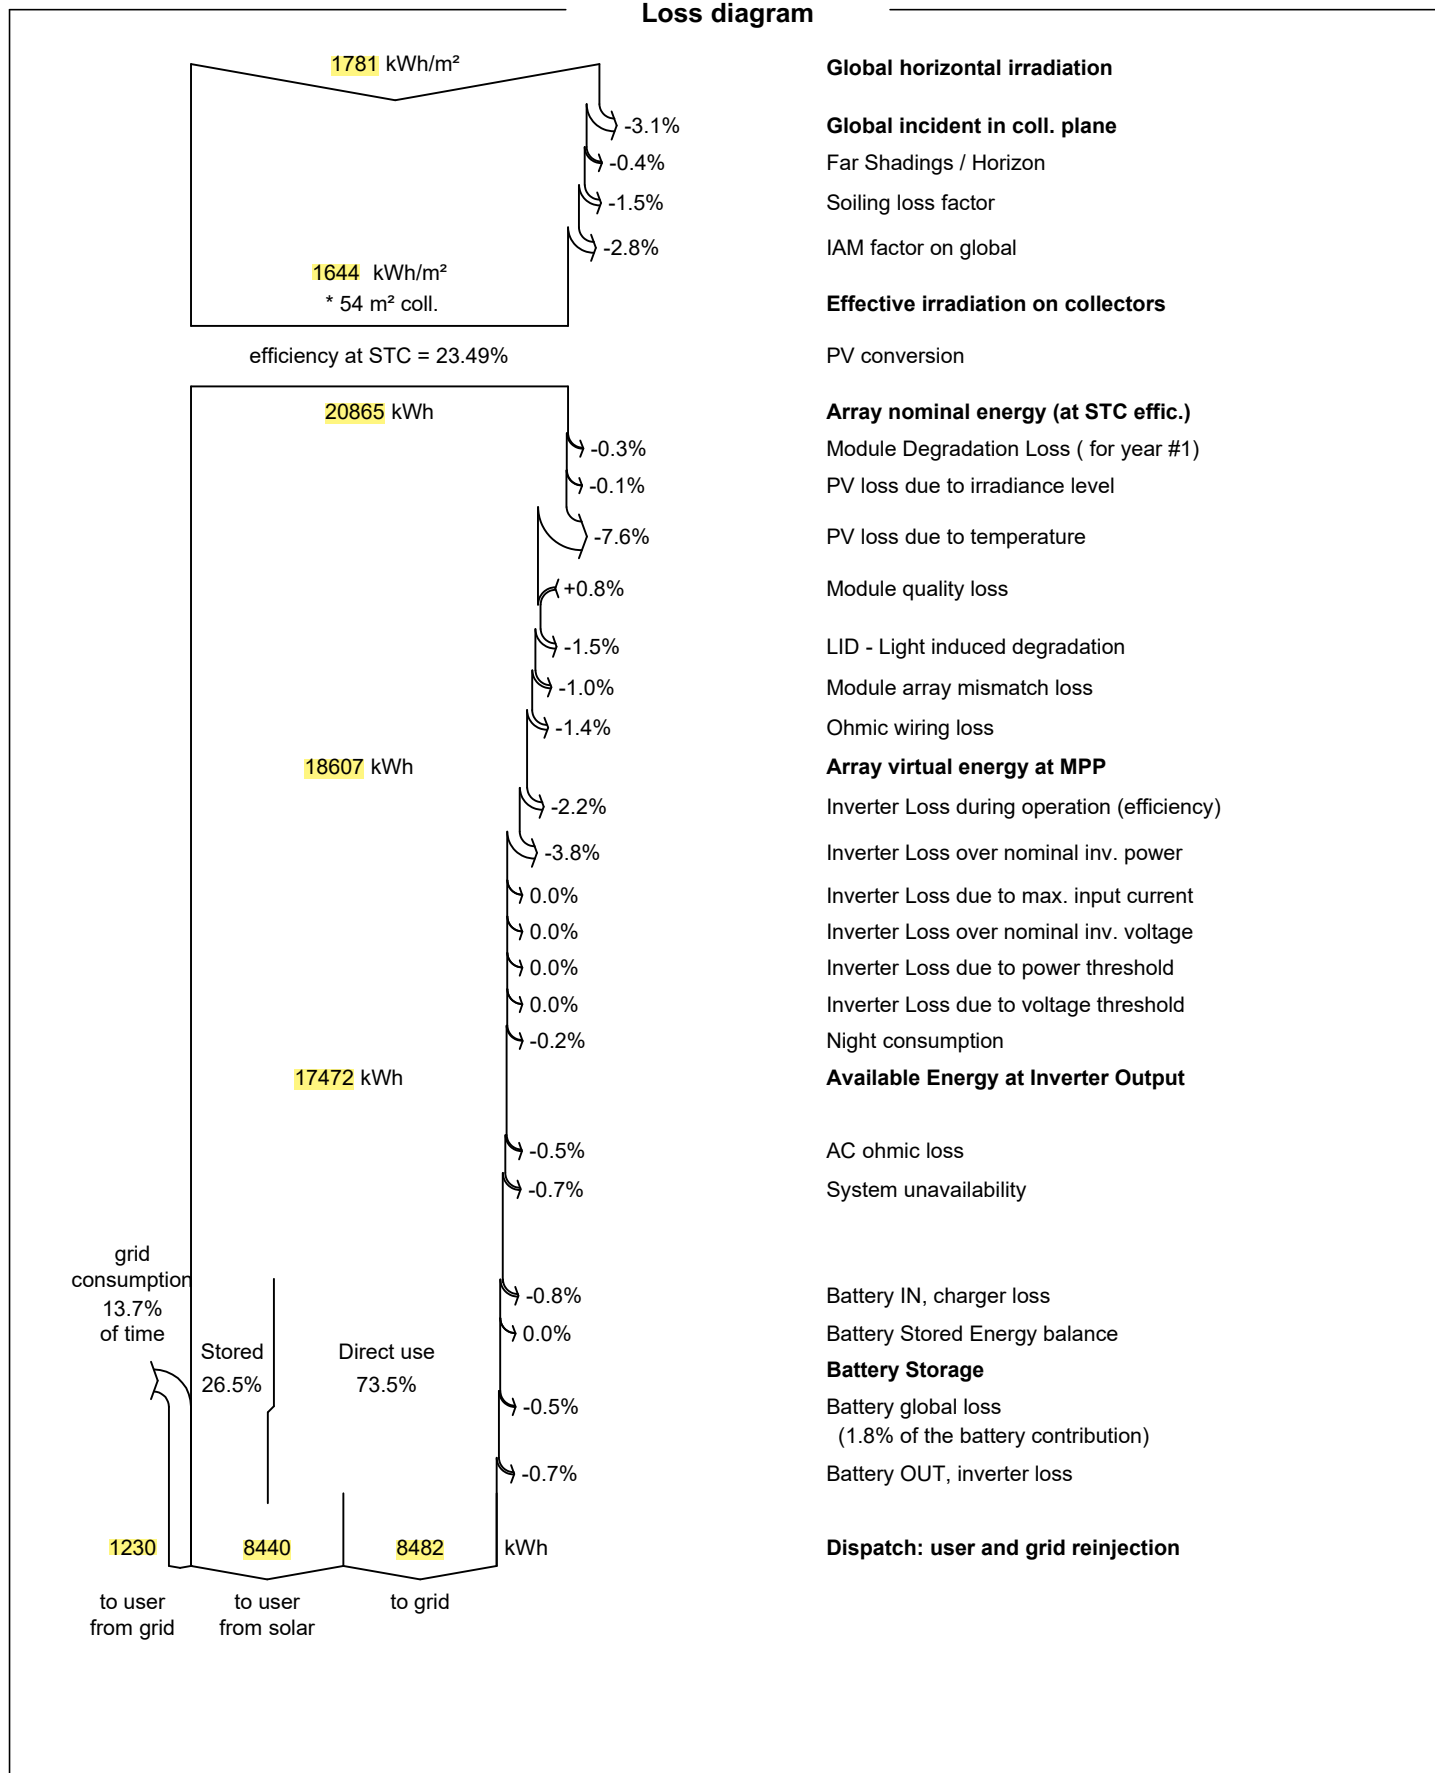**Loss diagram**




Predef. graphs

Daily Input/Output diagram

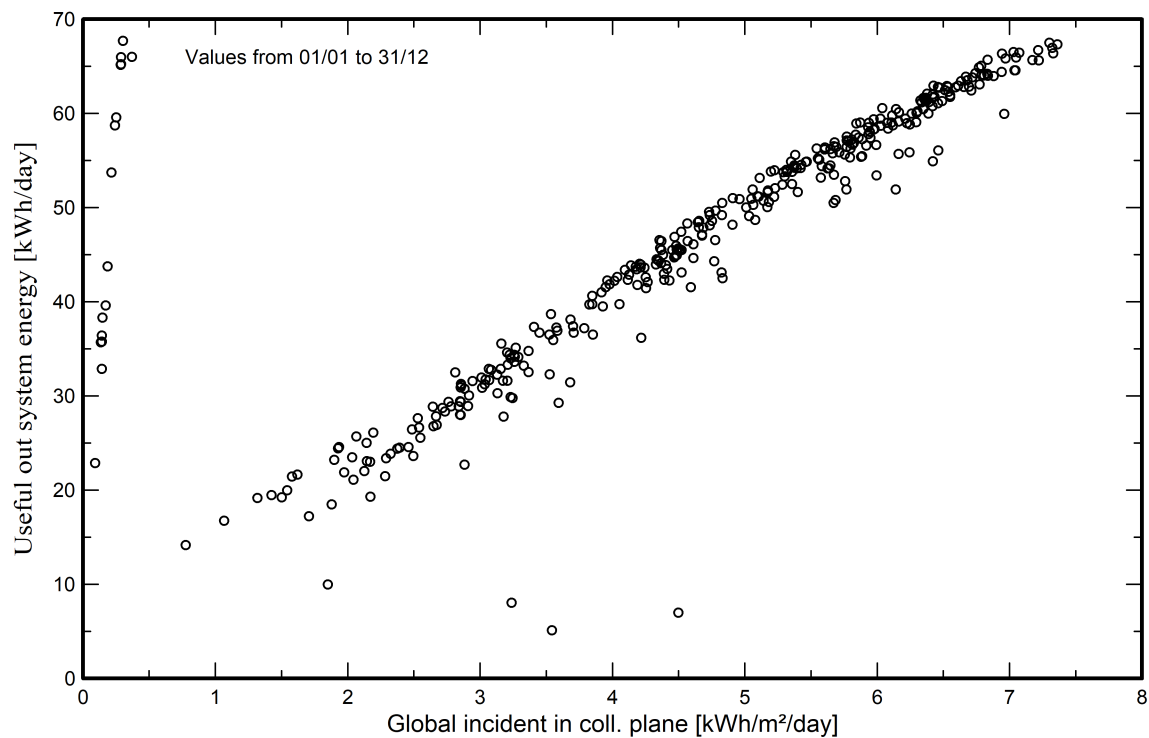

System Output Power Distribution

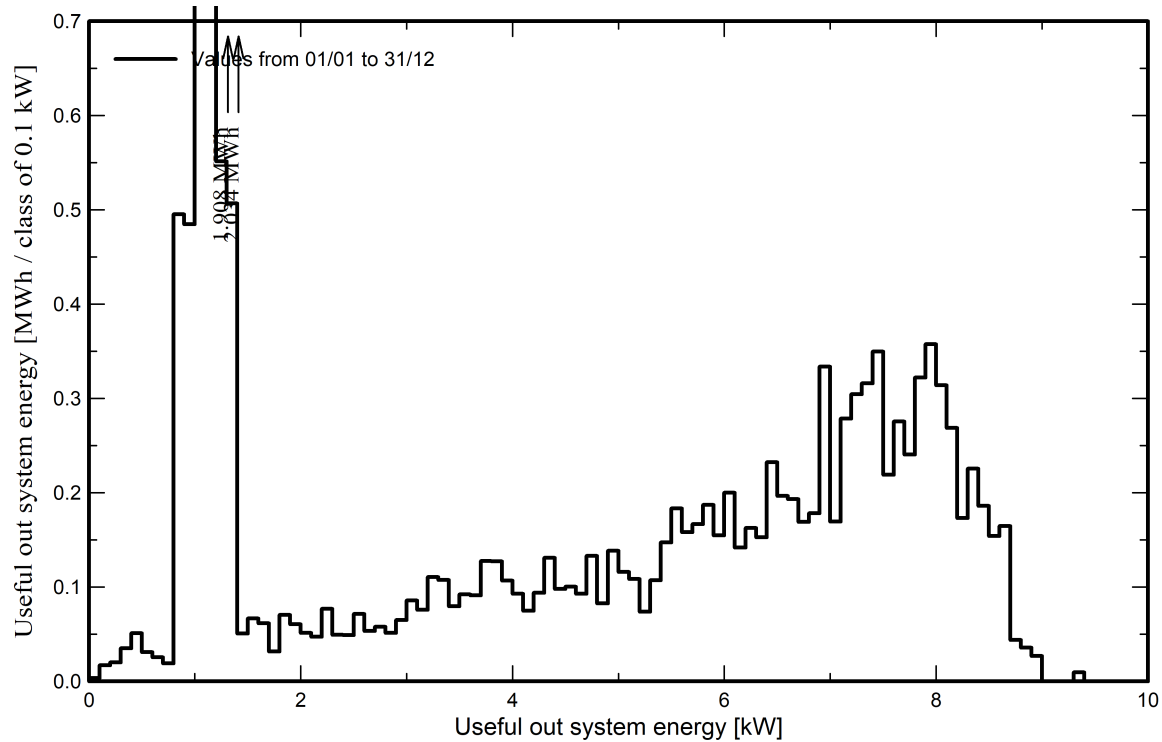



P50 - P90 evaluation

Weather data

Source	Meteonorm 9.0 dll, Sat=100%
Kind	Specific year
Year	Synthetic
Year-to-year variability(Variance)	4.0 %
Specified Deviation	
Year deviation from average	0.0 %

Global variability (weather data + system)

Variability (Quadratic sum)	5.9 %
-----------------------------	-------

Simulation and parameters uncertainties

PV module modelling/parameters	1.0 %
Inverter efficiency uncertainty	0.5 %
Soiling and mismatch uncertainties	1.0 %
Degradation uncertainty	1.0 %
Custom variability	4.0 %

Annual production probability

Variability	1004 kWh
P50	16922 kWh
P90	15635 kWh
P75	16245 kWh

Probability distribution

