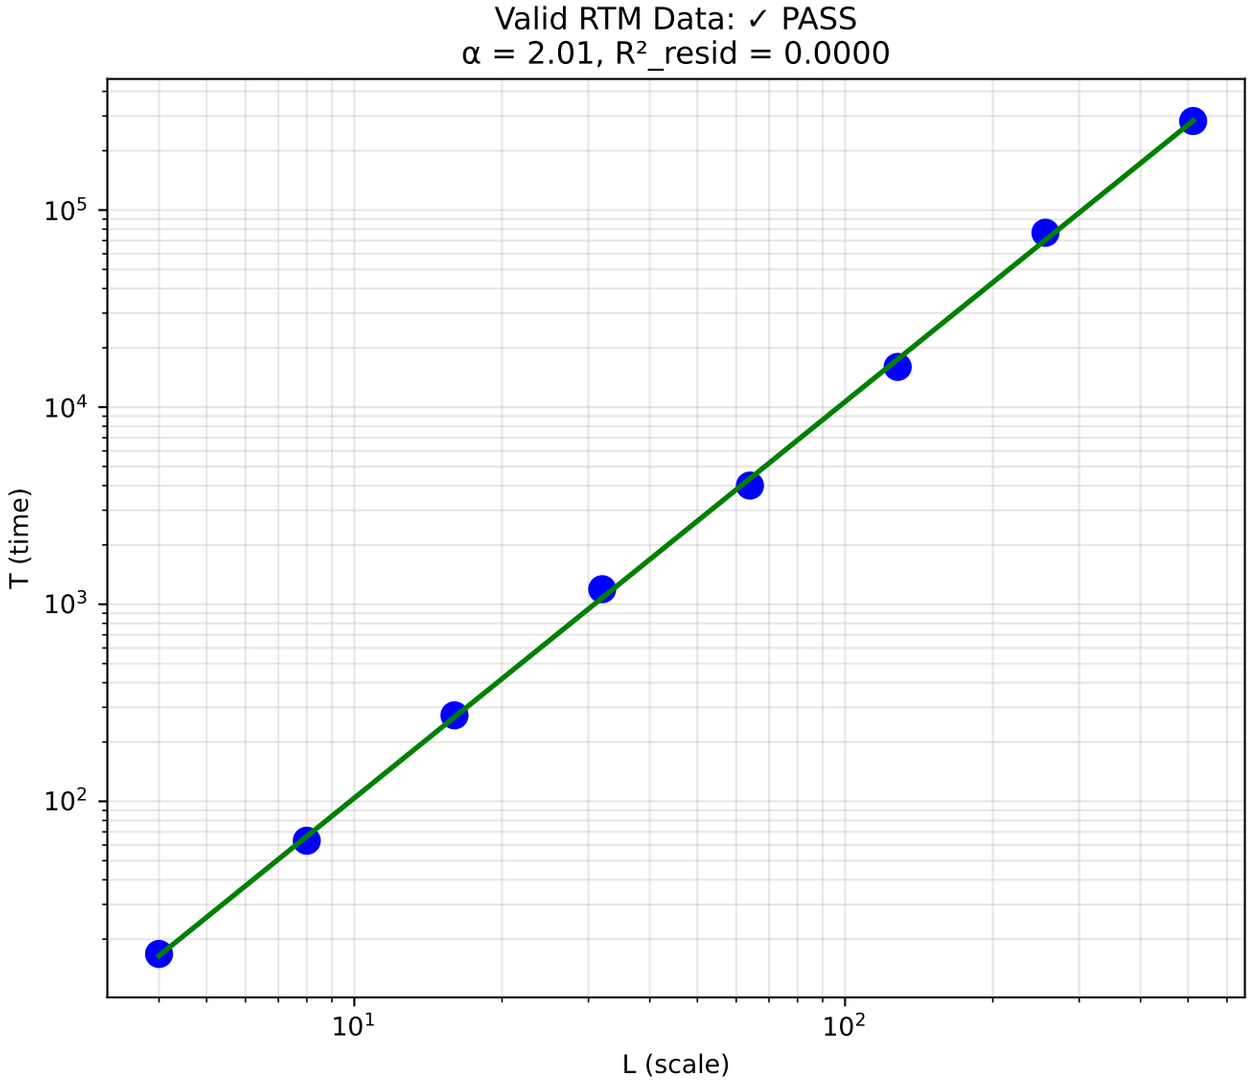
Valid RTM Data: ✓ PASS
α = 2.01, R²_resid = 0.0000
T (time)
L (scale)

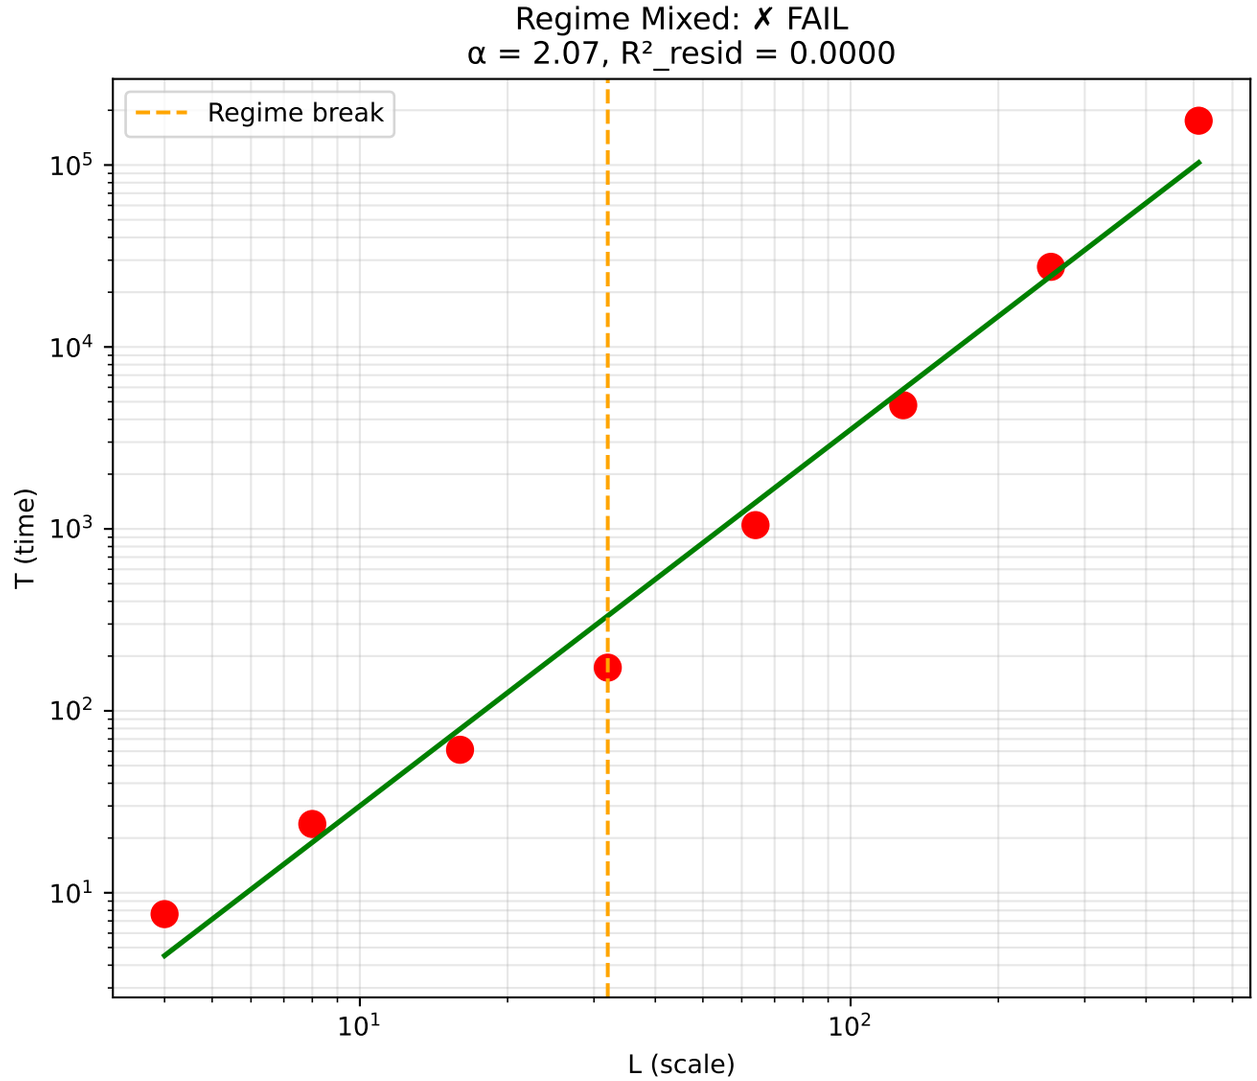
Regime Mixed: ✗ FAIL
α = 2.07, R²_resid = 0.0000
Regime break
T (time)
L (scale)

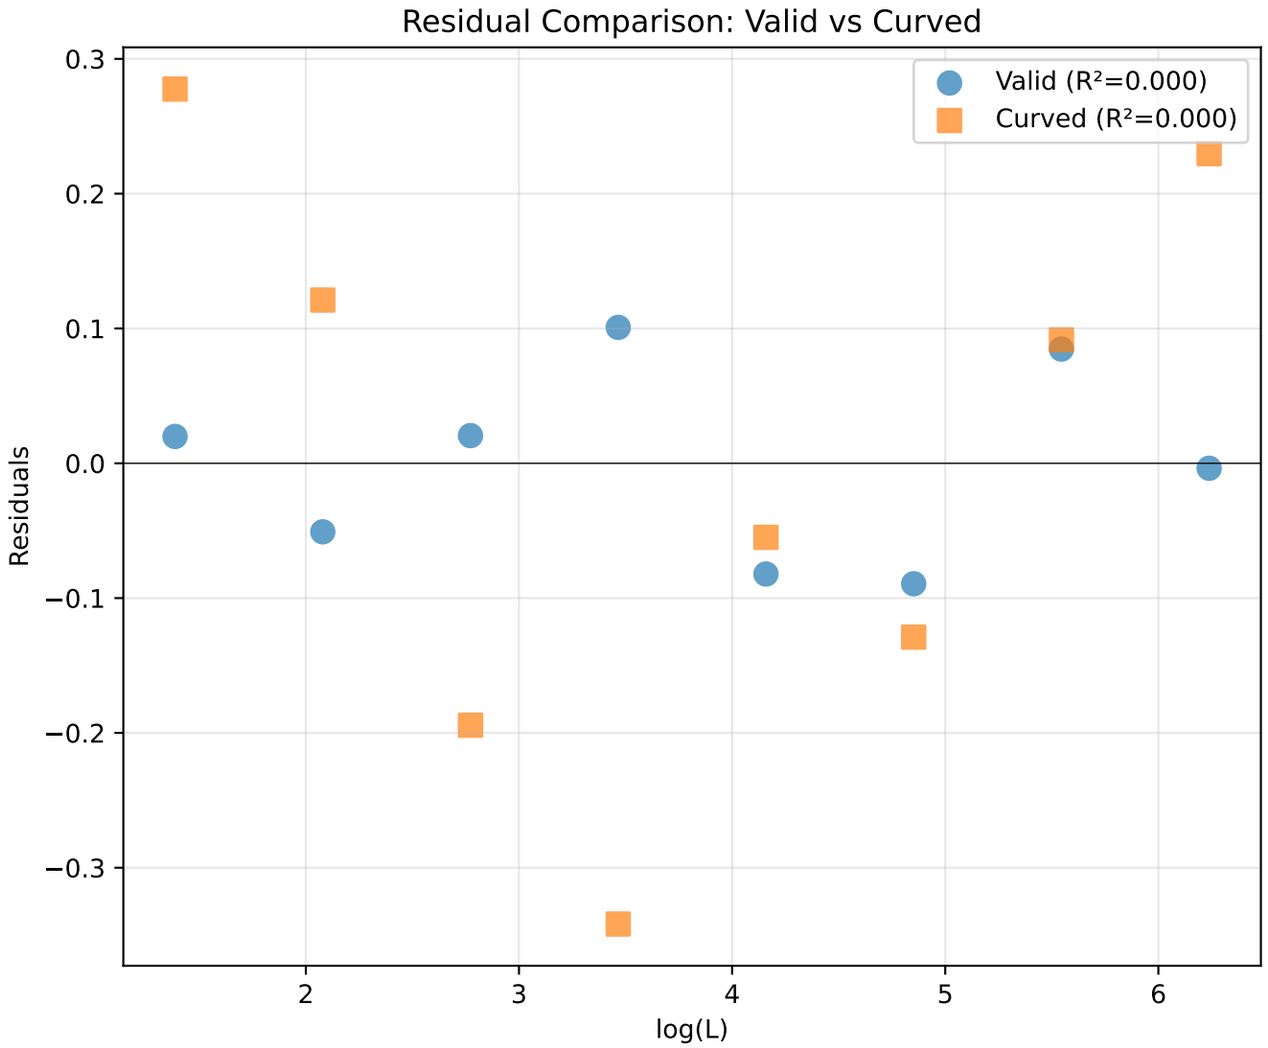
Residual Comparison: Valid vs Curved
Valid (R²=0.000)
Curved (R²=0.000)
Residuals
log(L)

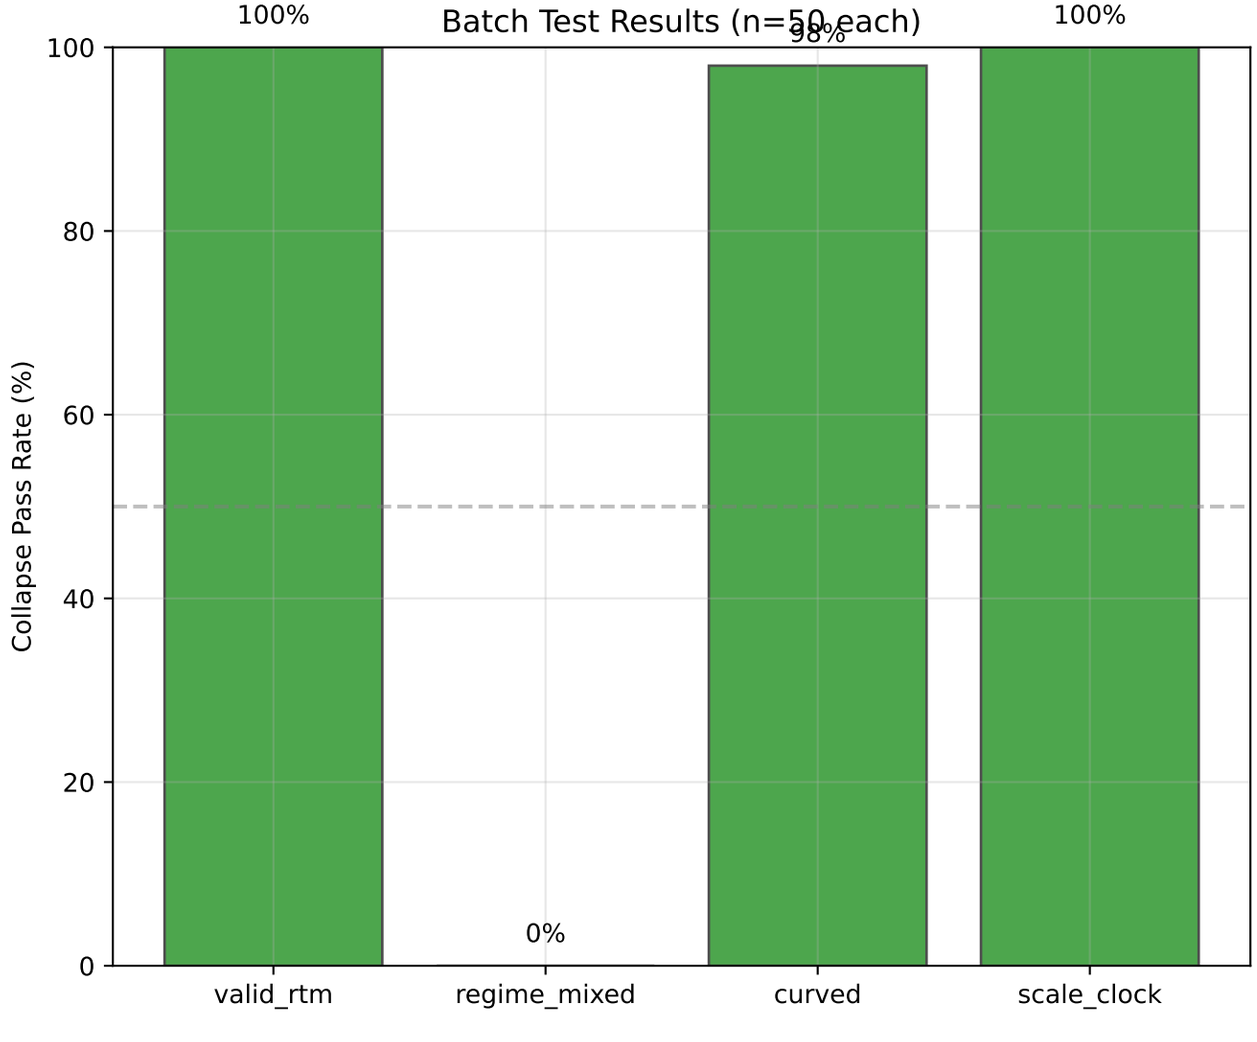
Batch Test Results (n=50 each)
100%
98%
100%
0%
Collapse Pass Rate (%)
valid_rtm
regime_mixed
curved
scale_clock