

WARNING NAMEPLATE DETAIL

S-L CONTROLS, DWG D32384-40  
VOLTAGE: 120VAC, 60HZ, SINGLE PHASE  
AMPS: 0.369

SHORT CIRCUIT CURRENT: N/A

ENCLOSURE RATING: UL TYPE 4X

CAUTION: MULTIPLE POWER SOURCES ARE PROVIDED FROM FIELD  
TERMINALS. EACH SOURCE SHOULD BE DISCONNECTED FOR  
SERVICING.

WARNING: TO MAINTAIN OVERCURRENT, SHORT CIRCUIT, AND  
GROUND FAULT PROTECTION, THE MANUFACTURER'S INSTRUCTIONS  
FOR SELECTING CURRENT ELEMENTS MUST BE FOLLOWED

NAMEPLATES SIZED AS REQUIRED

NAME PLATE LEGEND TABLE

ITEM	QTY	DESCRIPTION
1	1	SECONDARY CONTROL PANEL
2	1	CONTROL POWER
3	1	SECONDARY CONTROL / ACTIVE
4	1	FAULT RESET
5	1	PUMP DOWN / FAILURE

ADDITIONAL PANEL LABELS:



A\* = "INTRINSICALLY SAFE FIELD WIRING TERMIANLS"  
B\* = "WARNING - EXPLOSION HAZARD - SUBSTITUTION OF  
COMPONENTS MAY IMPAIR INTRINSIC SAFETY"  
C\* = "INTRINSICALLY SAFE CIRCUITS" (TO BE PLACED BY  
CONTRACTOR AT CONDUIT OPENING)

NOTES:

ALL PLATES SHALL BE ENGRAVED ON WHITE BACKGROUND WITH  
BLACK CHARACTERS EXCEPT WARNING NAMEPLATES WHICH SHALL  
BE ENGRAVED ON RED BACKGROUND WITH WHITE CHARACTERS.  
LETTER HEIGHT SHOULD BE MINIMUM 1/4".

WIRING:


- 1) □ - INDICATES CABINET TERMINAL BLOCK
- 2) DASHED LINES INDICATE WIRING REMOTE TO CONTROL PANEL.
- 3) PROVIDE 20% SPARE TERMINALS
- 4) UL APPROVED NO. TO BE PROVIDED AT TIME OF MANUFACTURING
- 5) ELECTRICAL CONNECTION TORQUES:  
TERMINAL: 12 INCH POUNDS  
CIRCUIT BREAKER: 45 INCH POUNDS

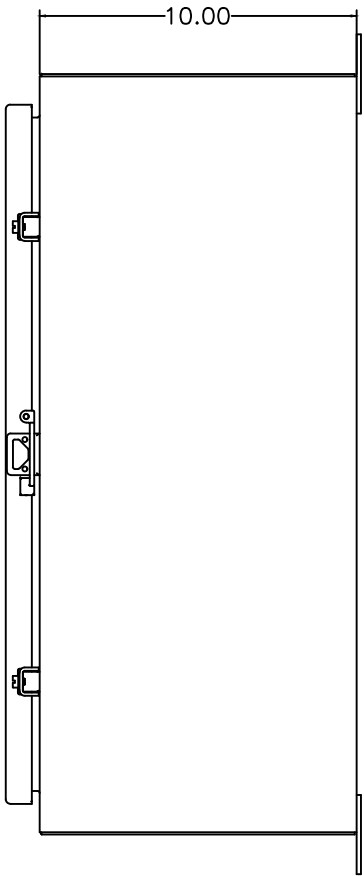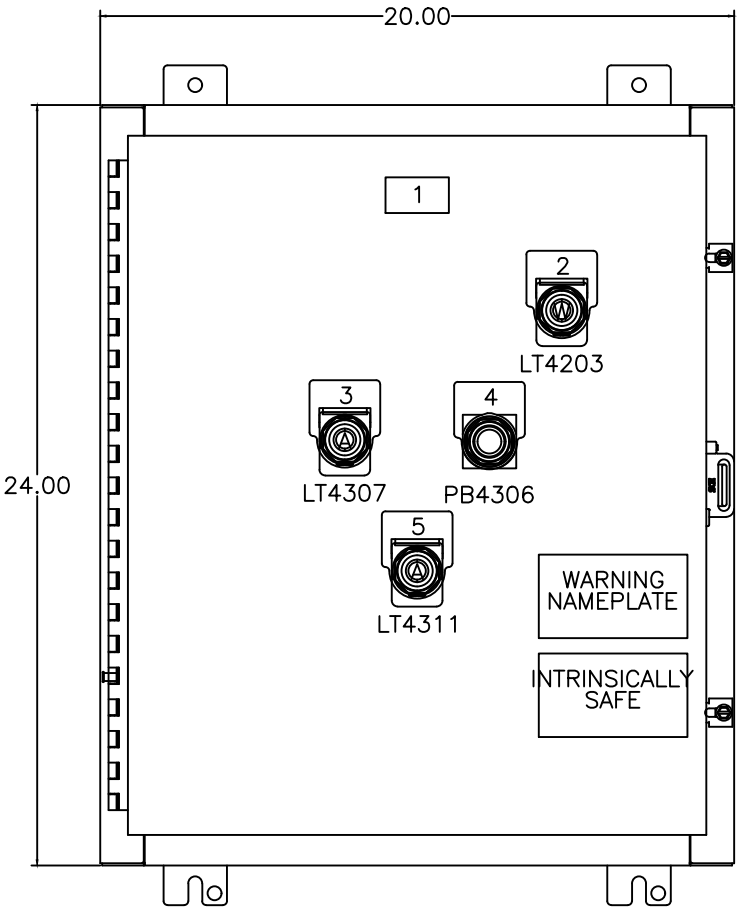

PANEL WIRING



AREA	VOLTAGE	NOUN NAME	ID	GAGE	COLOR	TYPE
INTERNAL	120VAC	HOT	(L1), (1)	14	BLACK	MTW
INTERNAL	120VAC	NEUTRAL	(N)	14	WHITE	MTW
CONTROL	120VAC	HOT	VARIOUS	16	RED	MTW
CONTROL	120VAC	NEUTRAL	N	16	WHITE	MTW


TOLERANCES	REVISIONS			POMONKEY PUMP STATION SECONDARY CP		
	NO.	DATE	BY	ENCLOSURE EXT. LAYOUT		
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 01-26-2026	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	D32384-40
	6					



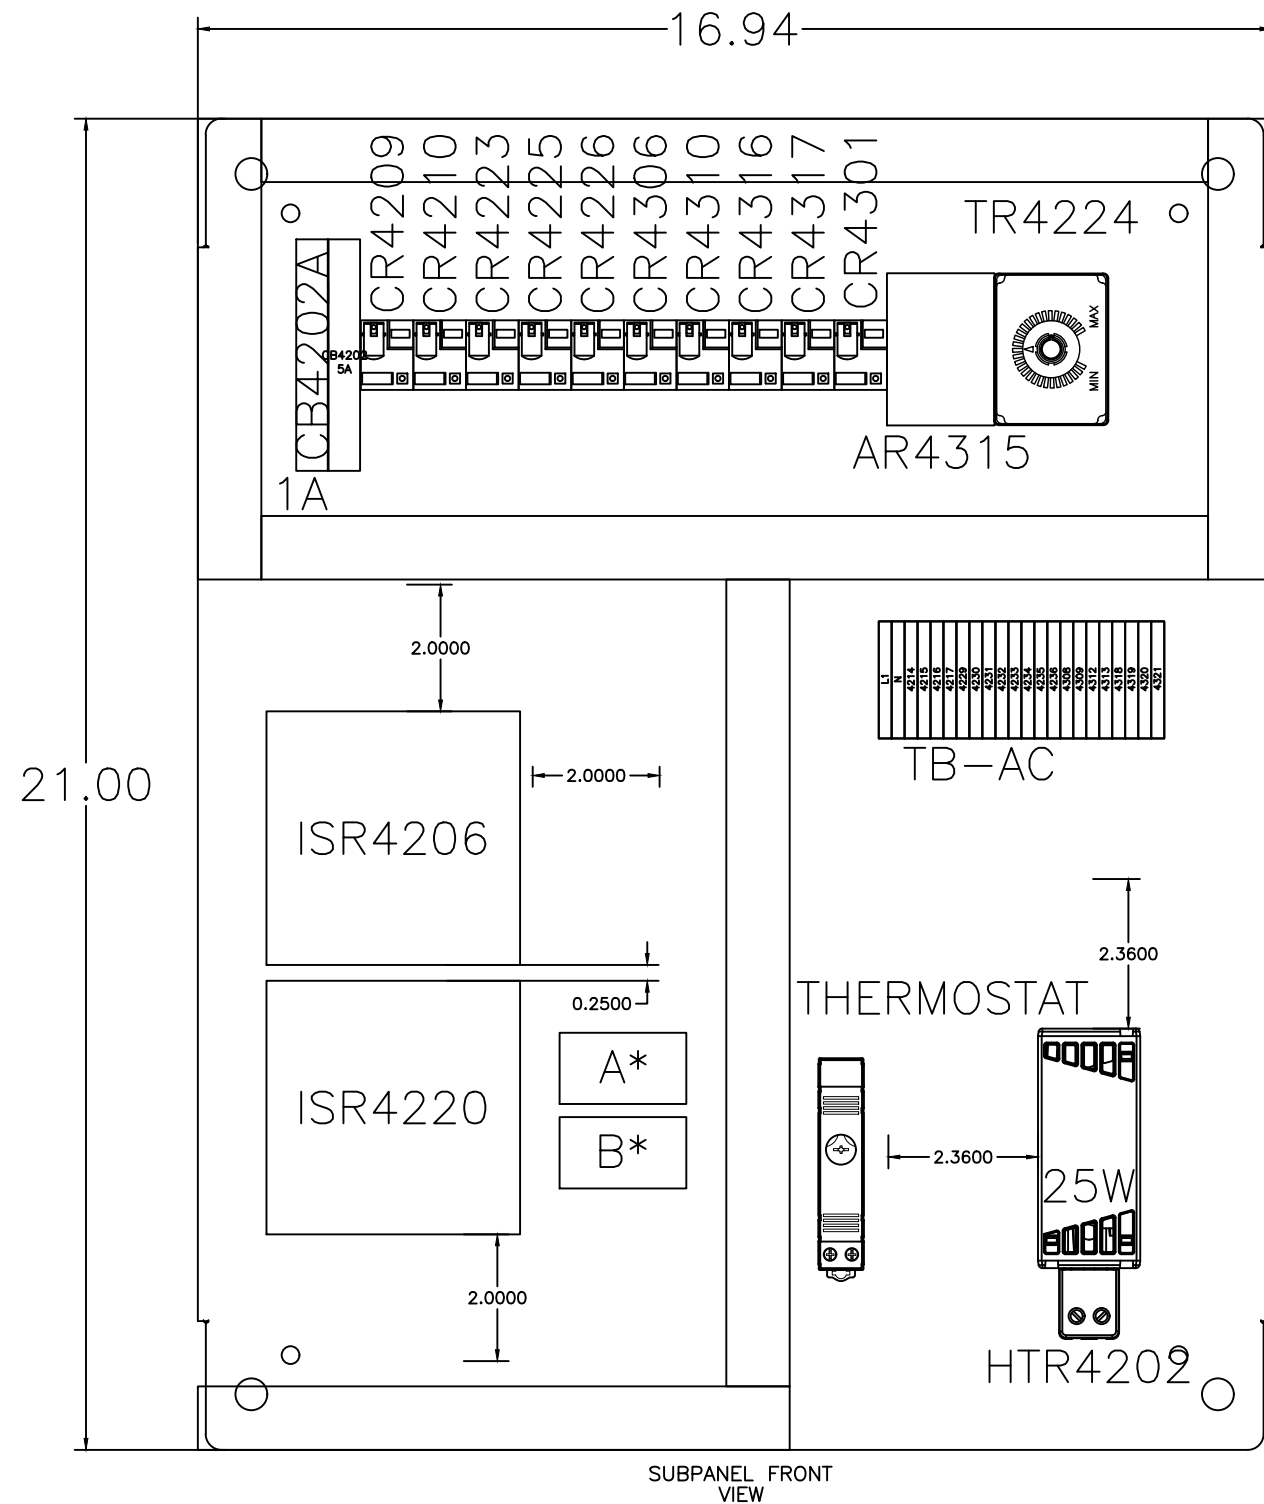



TAGS	QTY	CATALOG	DESCRIPTION	MANUFACTURER
ENC	1	SCE-24H2010SS6LP	WALL MOUNT ENCLOSURE – NEMA 4X	SCE
ENC	1	SCE-24P20	ENCLOSURE BACKPANEL	SCE
LT4203	1	9001SKT38LWW31	PTT LIGHT, 120VAC LED, WHITE	SCHNEIDER ELECTRIC
LT4307, LT4311	2	9001SKT38LYA31	PTT LIGHT, 120VAC LED, AMBER	SCHNEIDER ELECTRIC
PB4306	1	9001SKR1B	PUSHBUTTON, BLACK	SCHNEIDER ELECTRIC
PB4306	1	9001KA3	1 NC CONTACT	SCHNEIDER ELECTRIC
CB4202	1	7940102575	CIRCUIT BREAKER, 120VAC, 5A	WEIDMULLER
CB4202A	1	7940125379	CIRCUIT BREAKER, 120VAC, 1A	WEIDMULLER
CR4209, CR4210, CR4223, CR4225, CR4226, CR4306, CR4310, CR4316, CR4317	9	RXM2AB2F7	MINIATURE RELAY, 120VAC, 8 BLADE	SCHNEIDER ELECTRIC
CR4209, CR4210, CR4223, CR4225, CR4226, CR4306, CR4310, CR4316, CR4317	9	RXZE2M114	MINIATURE RELAY SOCKET, 8 BLADE, DIN	SCHNEIDER ELECTRIC
CR4301	1	RXM3AB2F7	MINIATURE RELAY, 120VAC, 11 BLADE	SCHNEIDER ELECTRIC
CR4301	1	RXZE2S111M	MINIATURE RELAY, 11 BLADE, DIN	SCHNEIDER ELECTRIC
TR4224	1	9050JCK16V20	TIMING RELAY, 0–10 MIN, 120VAC, 8 PIN OCTAL, DPDT	SQUARE D
TR4224	1	8501NR1	RELAY SOCKET, 8 PIN, DIN	SQUARE D
ISR4206, ISR4220	2	ISO-120-AAE	INTRINSICALLY SAFE RELAY	DIVERSIFIED
AR4315	1	D851LA	ALTERNATING RELAY	EATON
AR4315	1	D3PA2	ALTERNATING RELAY SOCKET	EATON
HTR4202	1	SCE-TSH25	ENCLOSURE HEATER	SCE
THERMOSTAT	1	7T.81.0.000.2403	ENCLOSURE HEATER THERMOSTAT, NC	FINDER
TB-AC	22	3044076	UNIVERSAL TERMINAL BLOCK – UT 2,5	PHOENIX CONTACT
TB-AC	A/R	3047028	TERMINAL END BARRIER	PHOENIX CONTACT
TB-AC	A/R	3044092	GROUNDING TERMINAL BLOCK	PHOENIX CONTACT
TB-AC	A/R	0800886	TERMINAL ANCHOR	PHOENIX CONTACT

TOLERANCES		REVISIONS			POMONKEY PUMP STATION SECONDARY CP ENCLOSURE INT. LAYOUT		
		NO.	DATE	BY			
DECIMAL	1						
	2						
FRACTIONAL	3				DRAWN BY ZBB	SCALE NONE	MATERIAL
	4				CHK'D MN	DATE 01-26-2026	DRAWING NUMBER
ANGULAR	5				TRACED	APP'D	D32384-41
	6						

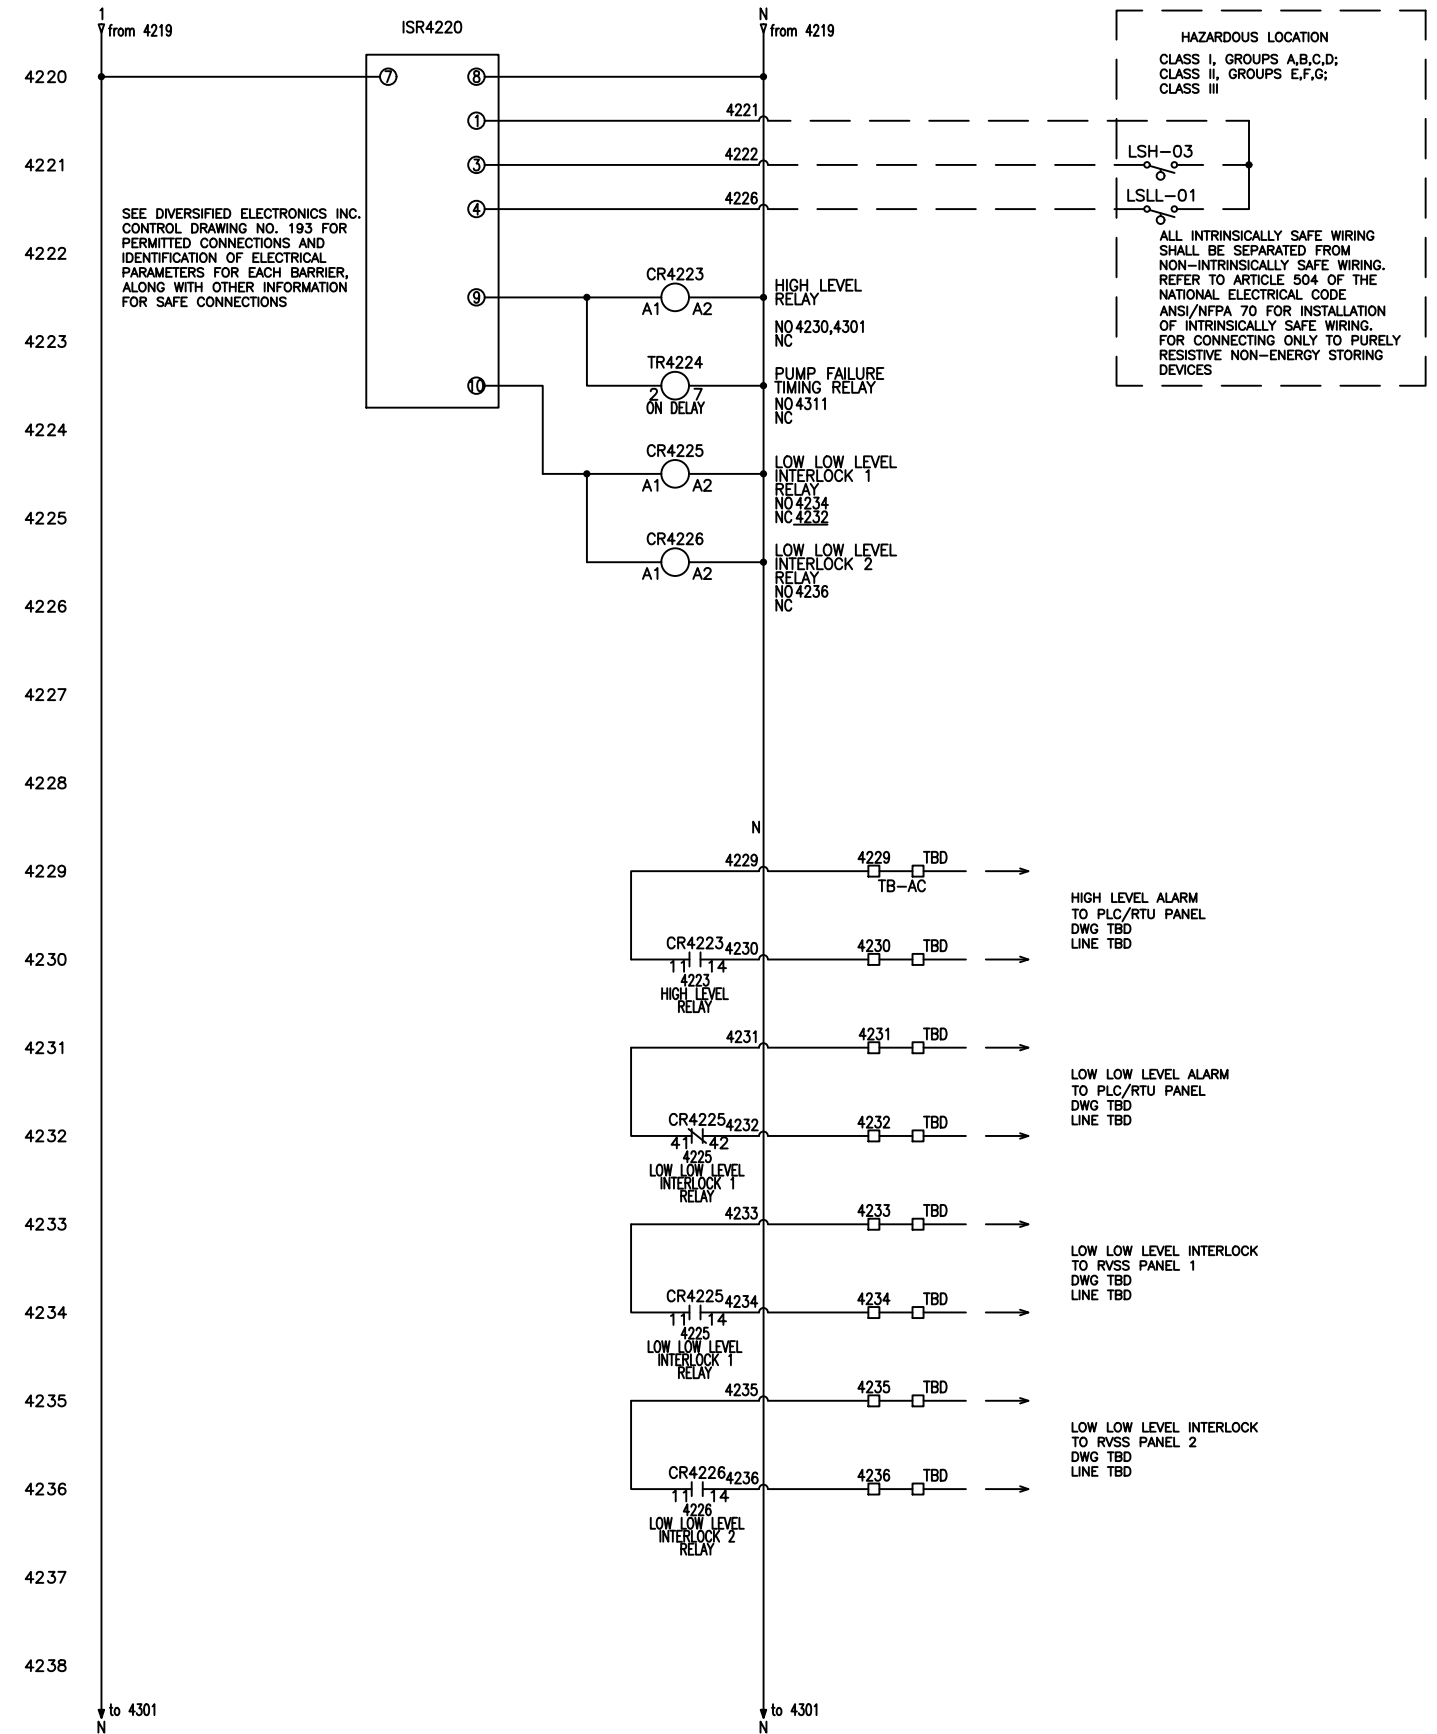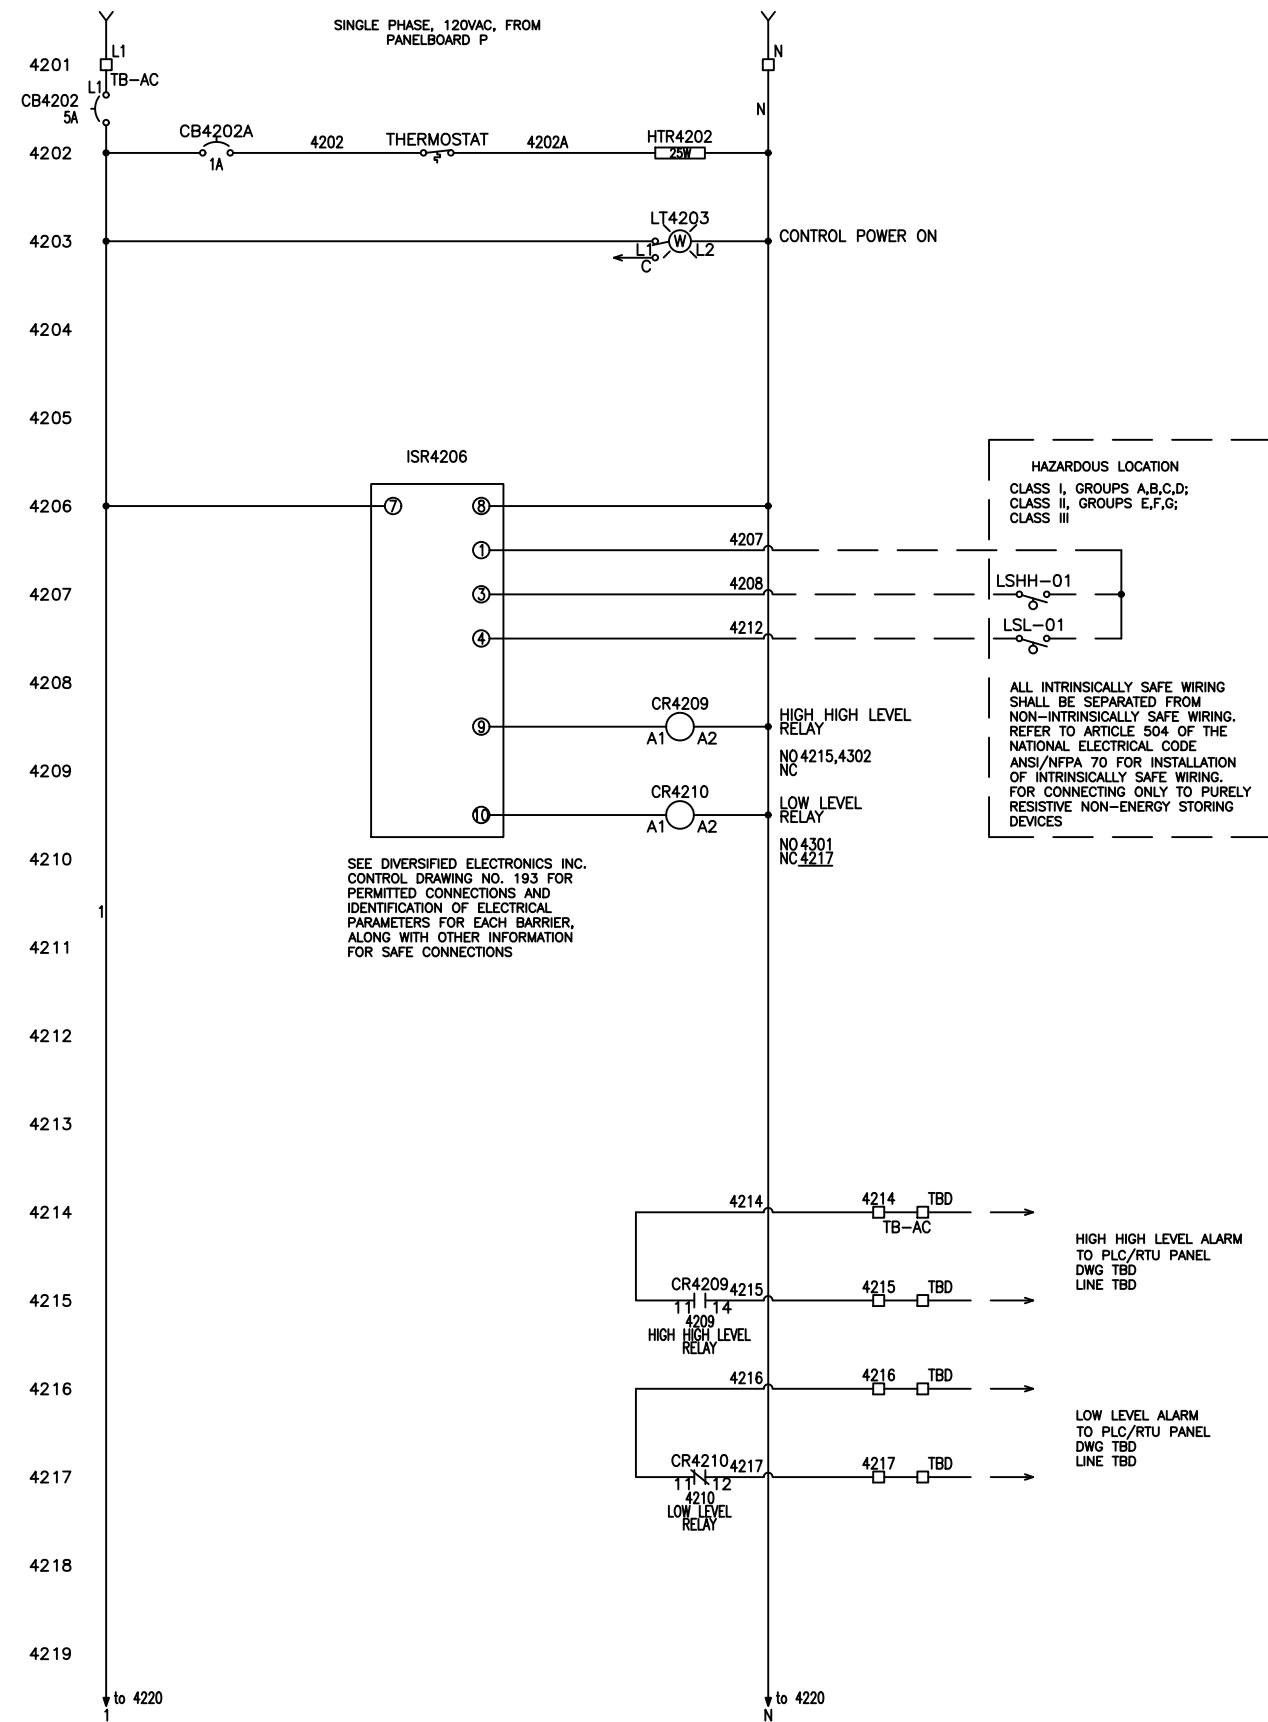

TOLERANCES	REVISIONS			POMONKEY PUMP STATION SECONDARY CP 120VAC WIRING DIAGRAM				
	NO.	DATE	BY					
DECIMAL	1							
	2							
FRACTIONAL	3			DRAWN BY	ZBB	SCALE	NONE	MATERIAL
	4			CHK'D	MN	DATE	01-26-2026	DRAWING NUMBER
ANGULAR	5			TRACED		APP'D		D32384-42
	6							

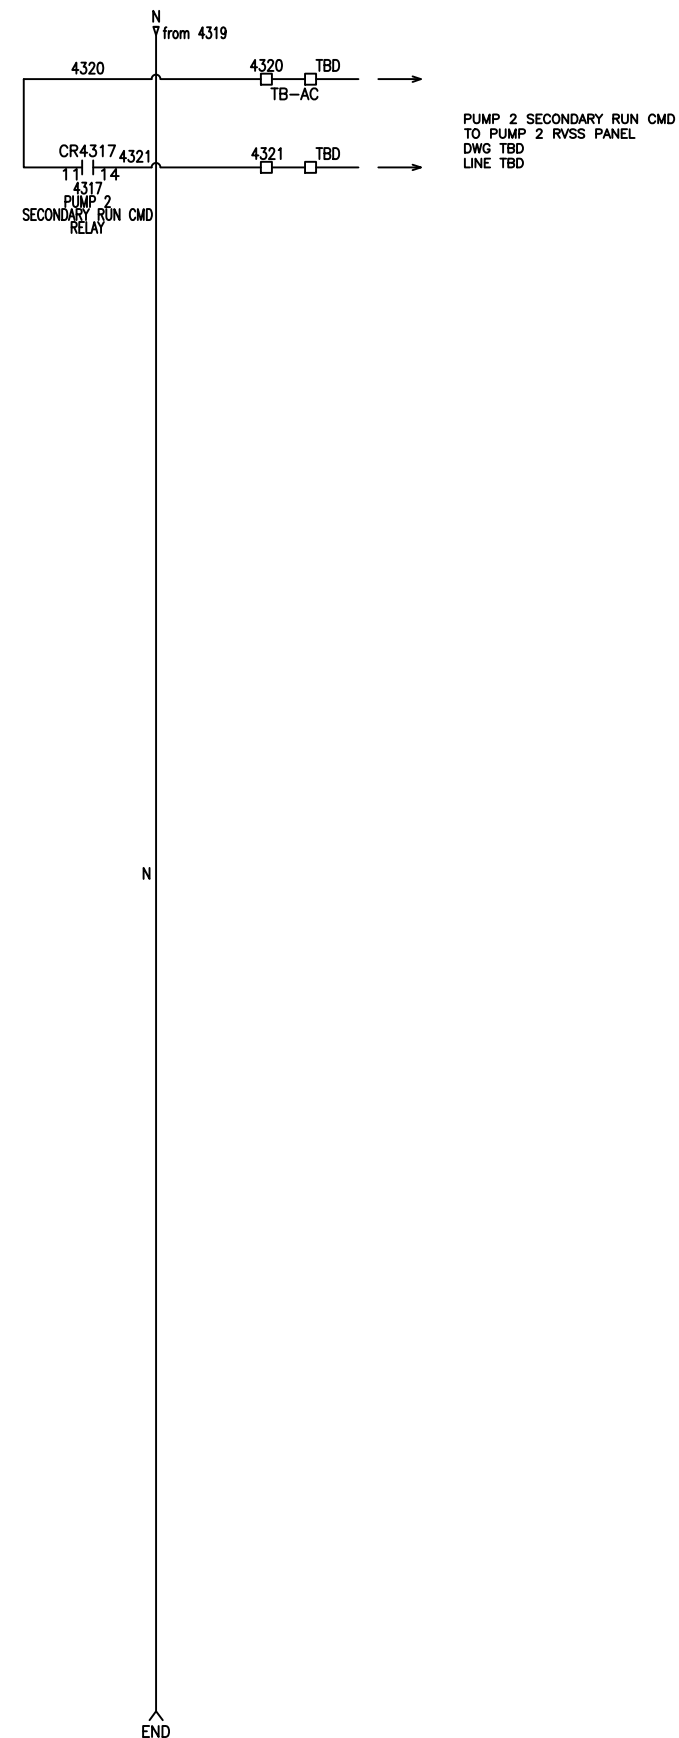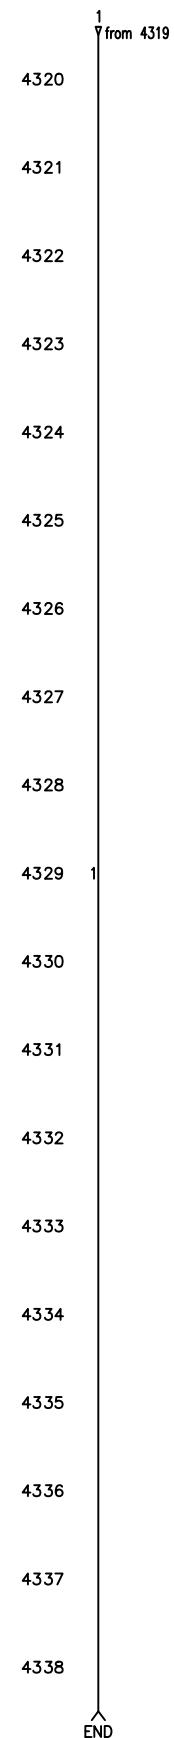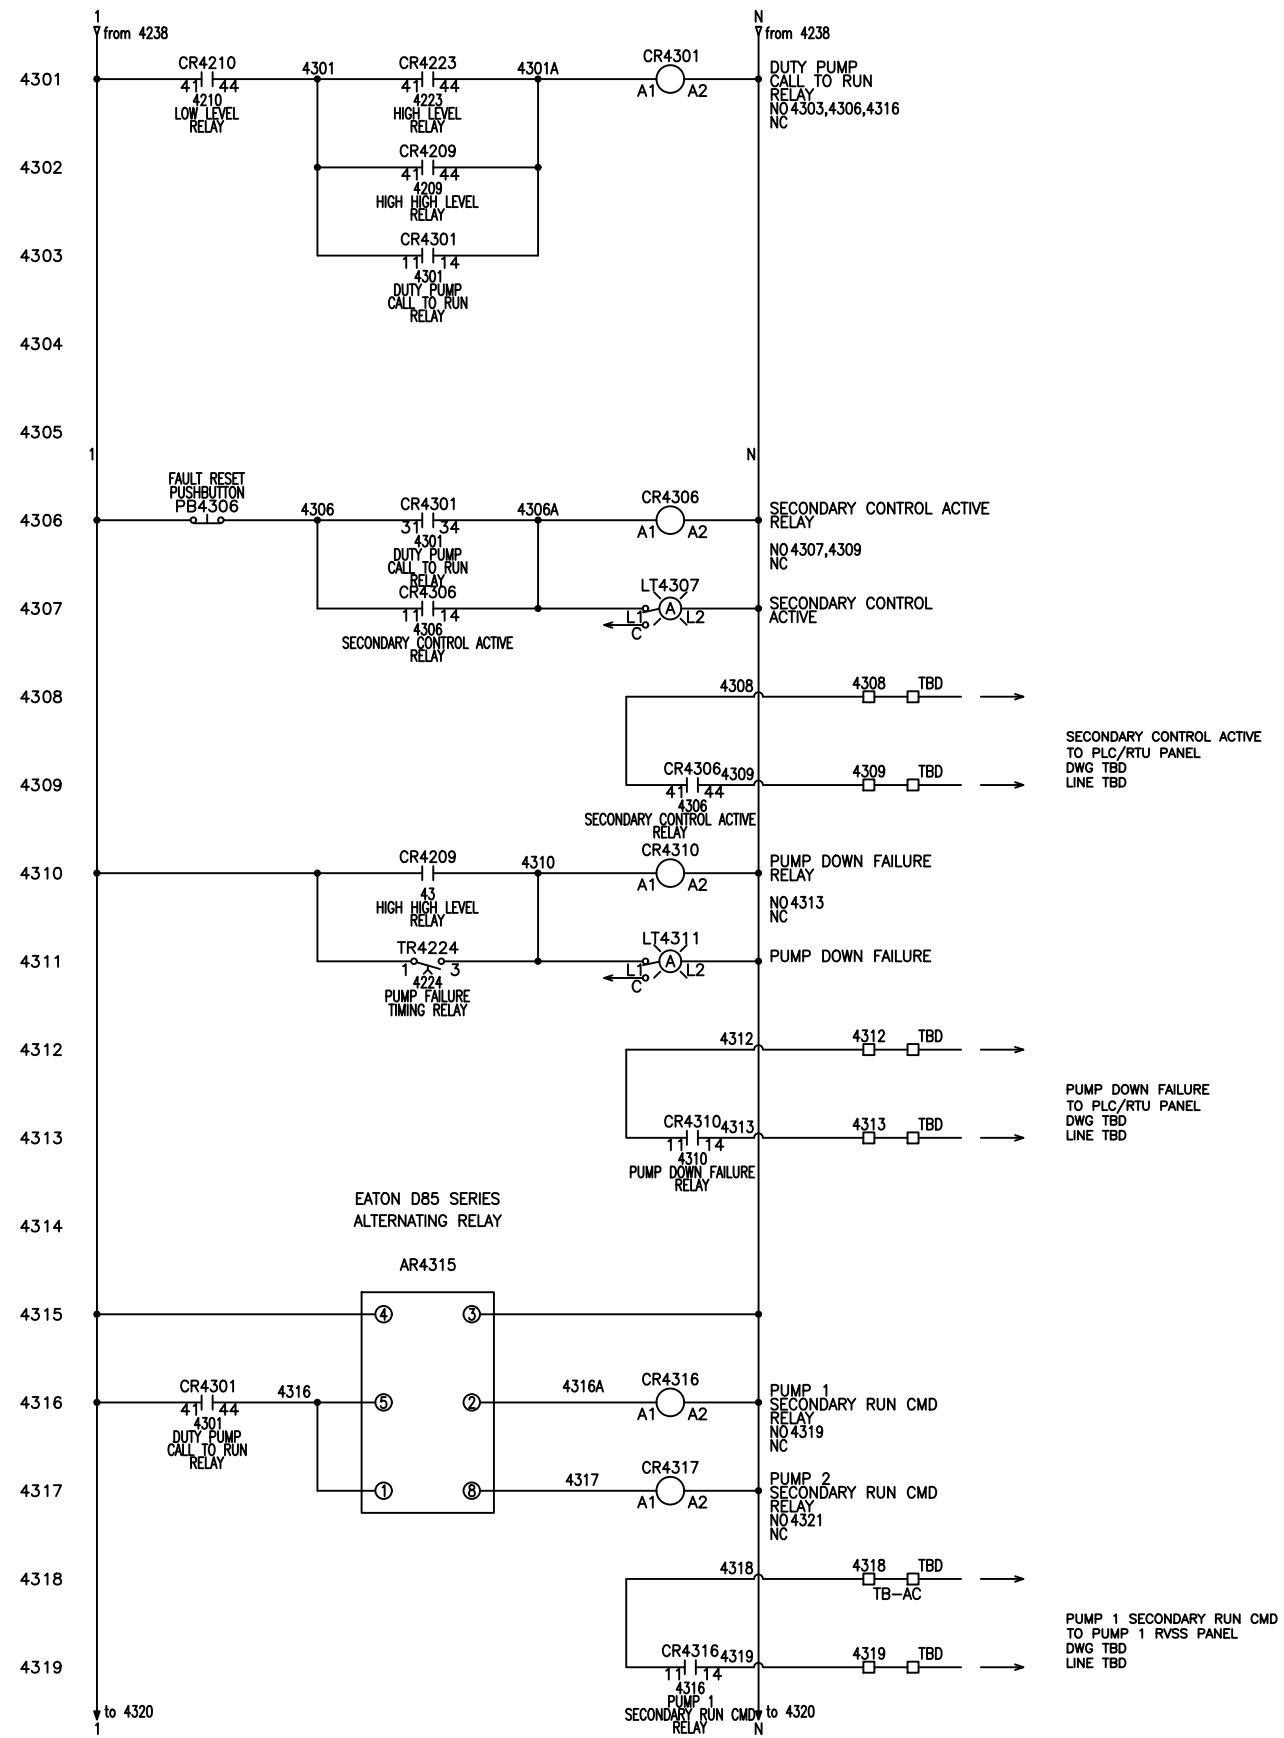

TOLERANCES		REVISIONS			POMONKEY PUMP STATION SECONDARY CP 120VAC WIRING DIAGRAM		
DECIMAL	NO.	DATE	BY				
	1						
FRACTIONAL	2						
	3						
ANGULAR	4				DRAWN BY ZBB	SCALE NONE	MATERIAL
	5				CHK'D MN	DATE 01-26-2026	DRAWING NUMBER
	6				TRACED	APP'D	D32384-43