


Runtime: SRT1000XLA

APC Smart-UPS On-Line, 1000VA, Tower, 120V, 6x 5-15R NEMA outlets, SmartSlot, Extended runtime, W/O rail kit

APC Smart-UPS On-Line

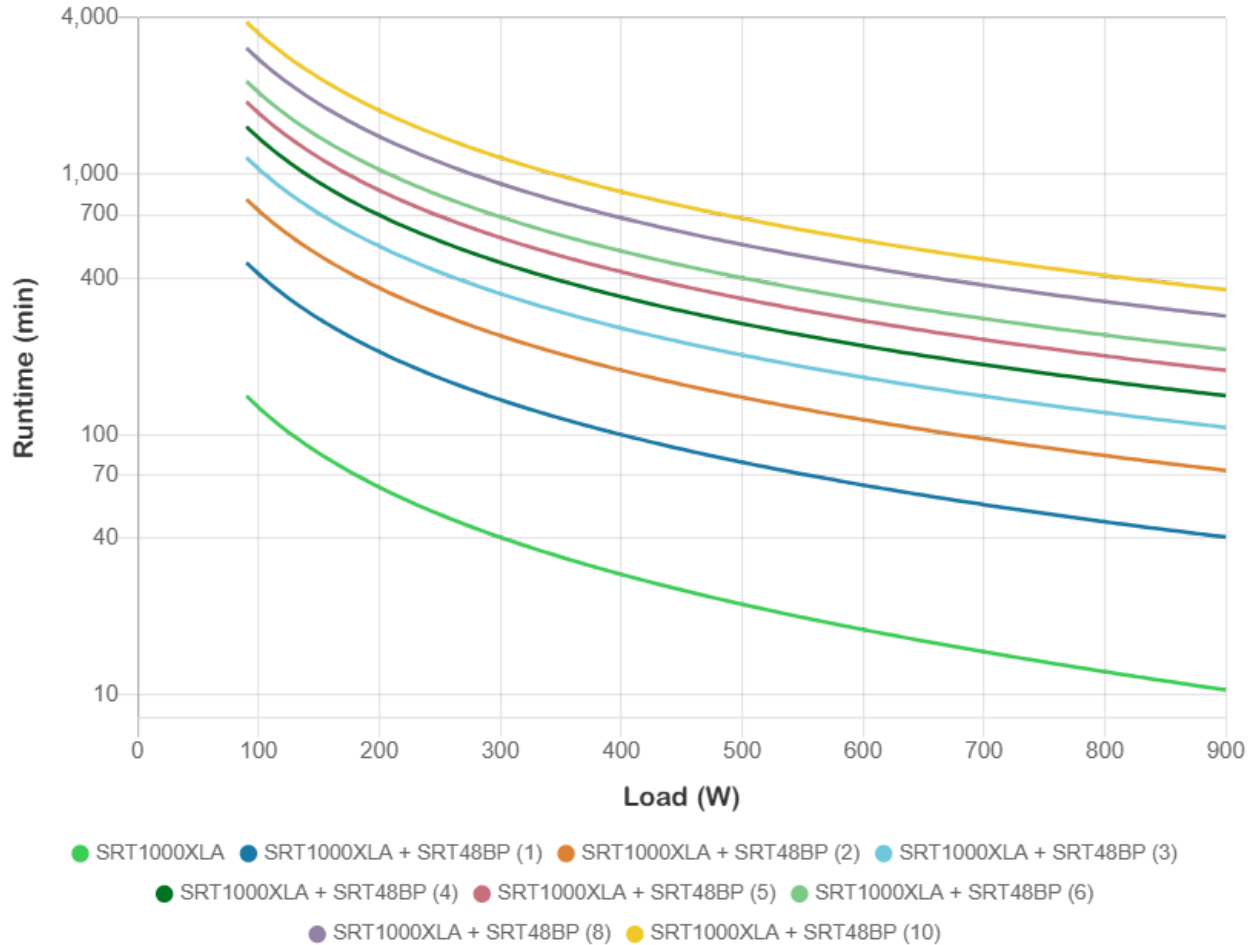

Curve fit to measured runtime data. All measurements taken with new, fully charged batteries, at typical environmental conditions, with no electrical input and balanced resistive load (PF = 1.0) output.

Load / Runtime	90 W	100 W	200 W	300 W	400 W	500 W	600 W	700 W	800 W	900 W
SRT1000XLA	2 h 21 min	2 h 7 min	1 h 2 min	40 min	29 min 7 sec	22 min 21 sec	17 min 52 sec	14 min 41 sec	12 min 19 sec	10 min 29 sec
1x SRT1000XLA	7 h 39 min	6 h 55 min	3 h 28 min	2 h 16 min	1 h 40 min	1 h 18 min	1 h 4 min	53 min	46 min	40 min
1x SRT48BP										
1x SRT1000XLA	13 h 24 min	12 h 7 min	6 h 6 min	4 h	2 h 57 min	2 h 19 min	1 h 54 min	1 h 36 min	1 h 23 min	1 h 13 min
2x SRT48BP										
1x SRT1000XLA	19 h 21 min	17 h 31 min	8 h 50 min	5 h 48 min	4 h 17 min	3 h 22 min	2 h 46 min	2 h 20 min	2 h 1 min	1 h 46 min
3x SRT48BP										
1x SRT1000XLA	25 h 28 min	23 h 4 min	11 h 38 min	7 h 39 min	5 h 39 min	4 h 27 min	3 h 39 min	3 h 6 min	2 h 40 min	2 h 21 min
4x SRT48BP										
1x SRT1000XLA	31 h 43 min	28 h 43 min	14 h 29 min	9 h 32 min	7 h 3 min	5 h 33 min	4 h 34 min	3 h 52 min	3 h 21 min	2 h 56 min
5x SRT48BP										
1x SRT1000XLA	38 h 4 min	34 h 28 min	17 h 24 min	11 h 27 min	8 h 28 min	6 h 41 min	5 h 29 min	4 h 39 min	4 h 1 min	3 h 32 min
6x SRT48BP										
1x SRT1000XLA	51 h 1 min	46 h 12 min	23 h 20 min	15 h 22 min	11 h 22 min	8 h 58 min	7 h 23 min	6 h 15 min	5 h 25 min	4 h 46 min
8x SRT48BP										
1x SRT1000XLA	64 h 14 min	58 h 10 min	29 h 23 min	19 h 21 min	14 h 19 min	11 h 18 min	9 h 18 min	7 h 53 min	6 h 50 min	6 h 1 min
10x SRT48BP										

<https://www.se.com/us/en/products-runtime-graph/SRT1000XLA/apc-smartups-online-1000va-tower-120v-6x-515r-nema-outlets-smartslot-extended-runtime-w-o-rail-kit/>