

WARNING NAMEPLATE DETAIL

S-L CONTROLS, DWG D32384-10
VOLTAGE: 120VAC, 60HZ, SINGLE PHASE
AMPS: 0.93A

SHORT CIRCUIT CURRENT: N/A

ENCLOSURE RATING: UL TYPE 4X

CAUTION: MULTIPLE POWER SOURCES ARE PROVIDED FROM FIELD
TERMINALS. EACH SOURCE SHOULD BE DISCONNECTED FOR
SERVICING.

WARNING: TO MAINTAIN OVERCURRENT, SHORT CIRCUIT, AND
GROUND FAULT PROTECTION, THE MANUFACTURER'S INSTRUCTIONS
FOR SELECTING CURRENT ELEMENTS MUST BE FOLLOWED

NAMEPLATES SIZED AS REQUIRED

NAME PLATE LEGEND TABLE


ITEM	QTY	DESCRIPTION
1	2	PLC/RTU / CONTROL PANEL
2	2	CONTROL POWER
3	2	ALARM TEST

NOTES:



ALL PLATES SHALL BE ENGRAVED ON WHITE BACKGROUND WITH
BLACK CHARACTERS. LETTER HEIGHT SHOULD BE MINIMUM 1/4"

WIRING:

- 1) □ - INDICATES CABINET TERMINAL BLOCK
2) DASHED LINES INDICATE WIRING REMOTE TO CONTROL PANEL.
3) PROVIDE 20% SPARE TERMINALS
4) UL APPROVED NO. TO BE PROVIDED AT TIME OF MANUFACTURING
5) ELECTRICAL CONNECTION TORQUES:
TERMINAL: 12 INCH POUNDS
CIRCUIT BREAKER: 45 INCH POUNDS

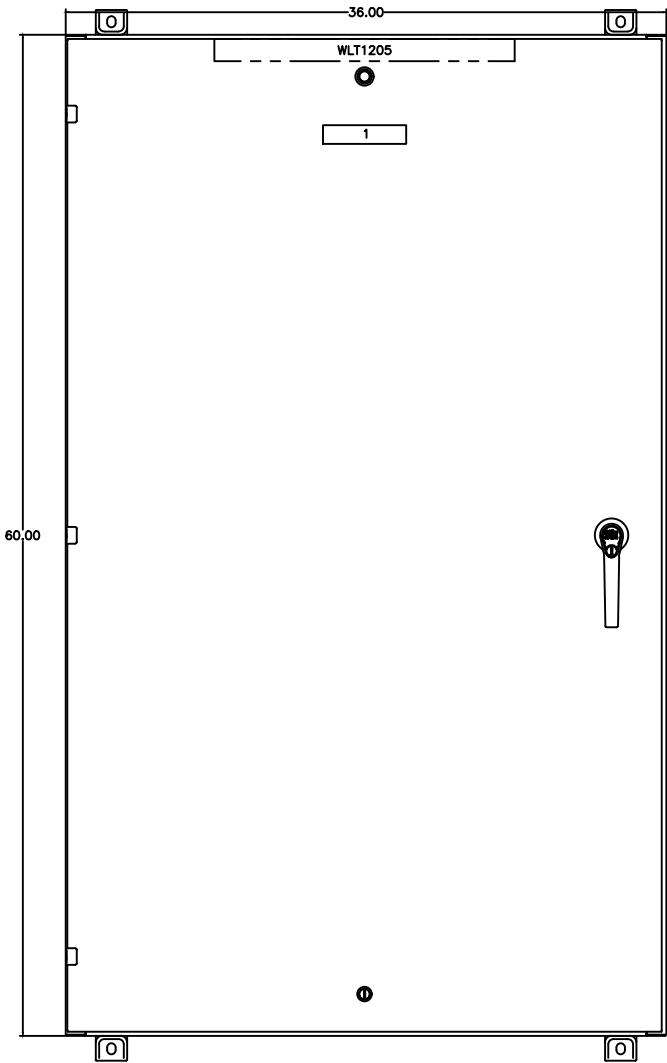

FRONT
VIEW

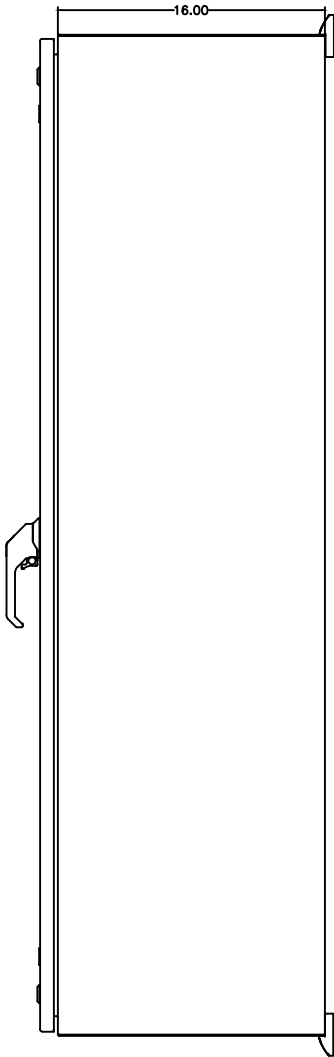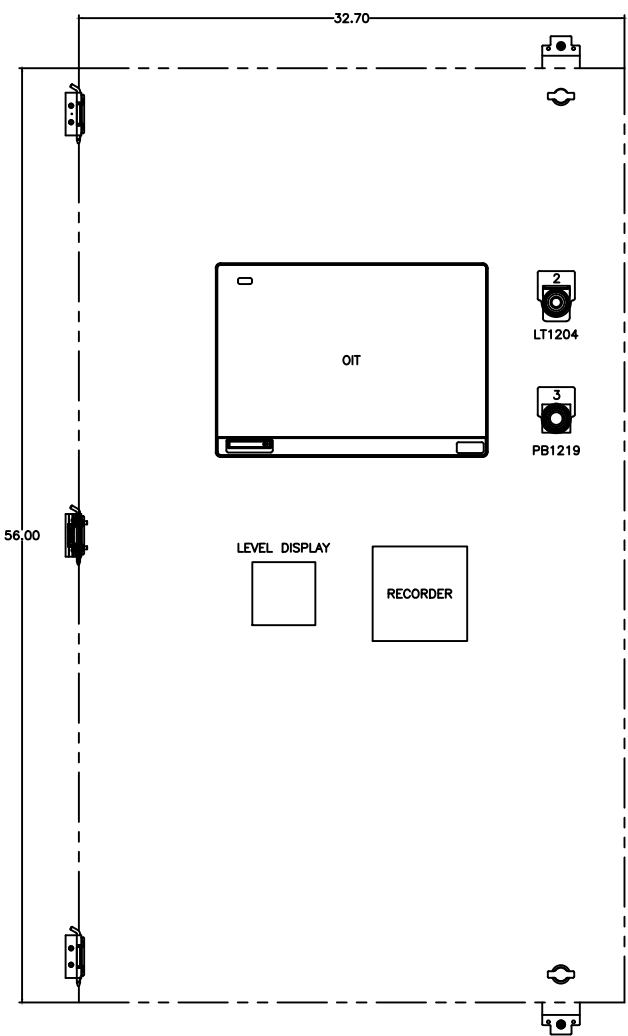


RIGHT SIDE
VIEW

PANEL WIRING



AREA	VOLTAGE	NOUN NAME	ID	GAGE	COLOR	TYPE
POWER	480VAC 3PH	A PHASE	(L1), (1L1), (H1)	12	BROWN	MTW
POWER	480VAC 3PH	B PHASE	(L2), (1L2), (H2)	12	ORANGE	MTW
POWER	480VAC 3PH	C PHASE	(L3), (1L3)	12	YELLOW	MTW
INTERNAL	120VAC	HOT	(1), (1A), (X1)	14	BLACK	MTW
INTERNAL	120VAC	NEUTRAL	(N)	14	WHITE	MTW
CONTROL	120VAC	HOT	VARIOUS	16	RED	MTW
CONTROL	120VAC	NEUTRAL	N	16	WHITE	MTW

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS PLC/RTU CONTROL PANEL EXT. LAYOUT		
	NO.	DATE	BY			
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 12-01-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-10
	6					


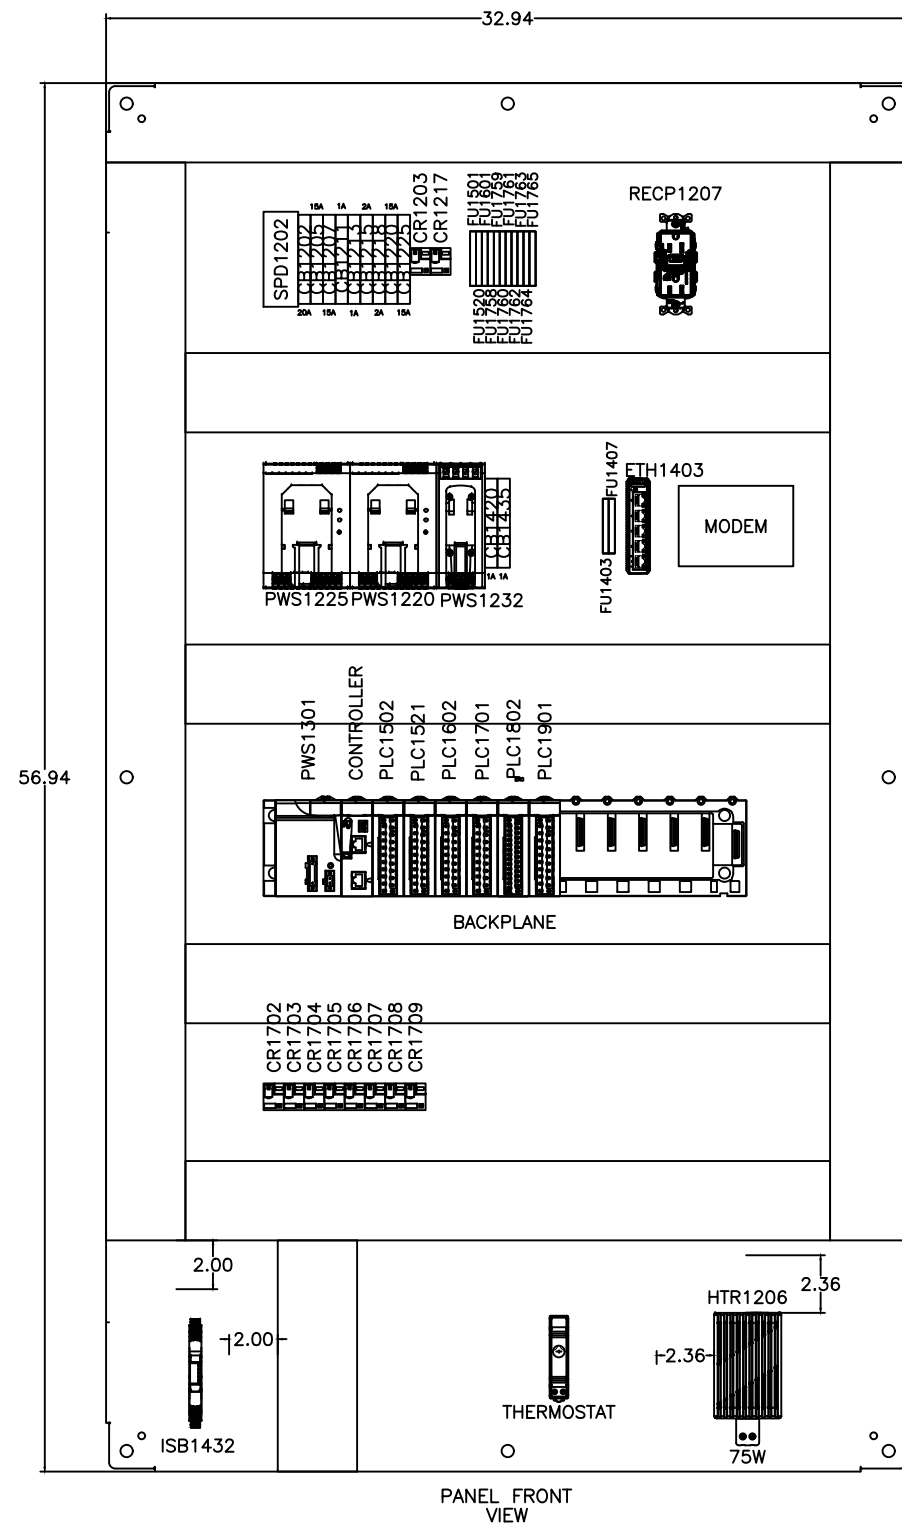


TAGS	QTY	CATALOG	DESCRIPTION	MANUFACTURER
ENC	1	SCE-60EL3616SS6LPPL	NEMA 4X WALL MOUNT ENCLOSURE	SCE
ENC	1	SCE-DF60EL36LP	DEAD FRONT PANEL	SCE
ENC	1	SCE-60P36	ENCLOSURE BACK PANEL	SCE
ENC	1	SCE-ELMFK4	WALL MOUNT FOOT KIT	SCE
WLT1205	1	26741	LED LIGHT FIXTURE	JASCO
LT1204	1	9001SKT38LWW31	PTT LIGHT, 120VAC LED, WHITE	SCHNEIDER ELECTRIC
PB1219	1	9001KA2	1 NO CONTACT	SCHNEIDER ELECTRIC
PB1219	1	9001SKR1B	PUSHBUTTON, BLACK	SCHNEIDER ELECTRIC
SPD1202	1	DS42S-120/G	TRANS. VOLTAGE SURGE SUPPRESSOR	CITEL
PWS1220, PWS1225	2	2866776	24VDC POWER SUPPLY	PHOENIX CONTACT
PWS1232	1	2320157	24VDC POWER SUPPLY REDUNDANCY MODULE	PHOENIX CONTACT
CB1202	1	7940102584	CIRCUIT BREAKER, 120VAC, 20A	WEIDMULLER
CB1205, CB1207, CB1220, CB1225	4	7940102582	CIRCUIT BREAKER, 120VAC, 15A	WEIDMULLER
CB1215, CB1218	2	7940102572	CIRCUIT BREAKER, 120VAC, 2A	WEIDMULLER
CB1211, CB1213	2	7940125379	CIRCUIT BREAKER, 120VAC, 1A	WEIDMULLER
CB1420, CB1435	2	7940102624	CIRCUIT BREAKER, 24VDC, 1A	WEIDMULLER
RECP1207	1	GFRST15W	DUPLEX GFCI RECEPTACLE, 15A	HUBBEL
CR1203, CR1217, CR1702, CR1703, CR1704, CR1705, CR1706, CR1707, CR1708, CR1709	10	RXM2AB2F7	MINIATURE RELAY, 120VAC, 8 BLADE	SCHNEIDER ELECTRIC
CR1203, CR1217, CR1702, CR1703, CR1704, CR1705, CR1706, CR1707, CR1708, CR1709	10	RXZE2M114	MINIATURE RELAY SOCKET, 120VAC, DIN	SCHNEIDER ELECTRIC
LEVEL DISPLAY	1	RIA452-C211A11A	DIGITAL PROCESS METER	E+H
RECORDER	1	RSG35-1C84+C1	DIGITAL CHART RECORDER	E+H
ANTENNA	1	T09060010006HM	CELLULAR ANTENNA	VENTEV
ETH1403	1	EDS-205	UNMANAGED ETHERNET SWITCH, 5 PORT	MOXA
FU1758, FU1759, FU1760, FU1761, FU1762, FU1763, FU1764, FU1765	8	GGM3	FAST BLOW FUSE, 3A	MERSEN
FU1501, FU1520, FU1601	3	MI5HF25V0.5/100	MINIATURE FUSE, FAST ACTING, 0.5A	MERSEN
FU1403, FU1407	2	MI5HF25V2/100	MINIATURE FUSE, FAST ACTING, 2A	MERSEN
FU1403, FU1407, FU1501, FU1520, FU1601, FU1758, FU1759, FU1760, FU1761, FU1762, FU1763, FU1764, FU1765	13	3046100	FUSE TERMINAL BLOCK, 120VAC	PHOENIX CONTACT
LS1205, LS1218	2	ALFSWD	REMOTE DOOR SWITCH	HOFFMAN
PWS1301	1	BMXCPS3500H	POWER SUPPLY MODULE	MODICON
OIT	1	HMIDT752	OPERATOR INTERFACE TERMINAL	SCHNEIDER ELECTRIC
OIT	1	HMIG2U	DISPLAY BASE UNIT	SCHNEIDER ELECTRIC
CONTROLLER	1	BMXP342020H	PROCESSOR	MODICON
BACKPLANE	1	BMXXBP1200H	BACKPLANE, 12 SLOTS	MODICON
PLC1502, PLC1701	2	BMXFTB2000	TERMINAL BLOCK, 20 PIN	MODICON
PLC1502, PLC1521, PLC1602	3	BMXDAI1604H	DISCRETE INPUT MODULE	MODICON
PLC1701	1	BMXDRA0815H	DISCRETE OUTPUT MODULE	MODICON
PLC1802	1	BMXAMI0810H	ANALOG INPUT MODULE	MODICON
PLC1901	1	BMXAMOO410H	ANALOG OUTPUT MODULE	MODICON
ISB1432	1	2865366	IS BARRIER / SPLITTER	PHOENIX CONTACT
SP1402	1	IS-50NX-C2	COAXIAL RF SURGE PROTECTOR	POLYPHASER
CB11402A	1	LDF4-50A	COAXIAL CABLE	AMPHENOL
CB11402	1	LMR195NMSM-6	SMA JUMPER CABLE	VENTEV
THERMOSTAT	1	7T.81.0.000.2403	ENCLOSURE HEATER THERMOSTAT, NC	FINDER
HTR1206	1	SCE-TSH75	ENCLOSURE HEATER	SCE
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	165	3044076	UNIVERSAL TERMINAL BLOCK - UT 2,5	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	3047028	TERMINAL END BARRIER	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	3044092	GROUNDING TERMINAL BLOCK	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	0800886	TERMINAL ANCHOR	PHOENIX CONTACT



TOLERANCES	REVISES			POMONKEY PUMP STATION IMPROVEMENTS PLC/RTU CONTROL PANEL INT. LAYOUT		
DECIMAL	NO.	DATE	BY			
	1					
FRACTIONAL	2			DRAWN BY ZBB SCALE NONE MATERIAL		
	3					
ANGULAR	4			CH'D MN DATE 12-01-2025 DRAWING NUMBER		
	5					
	6			TRACED APP'D 32384-11		

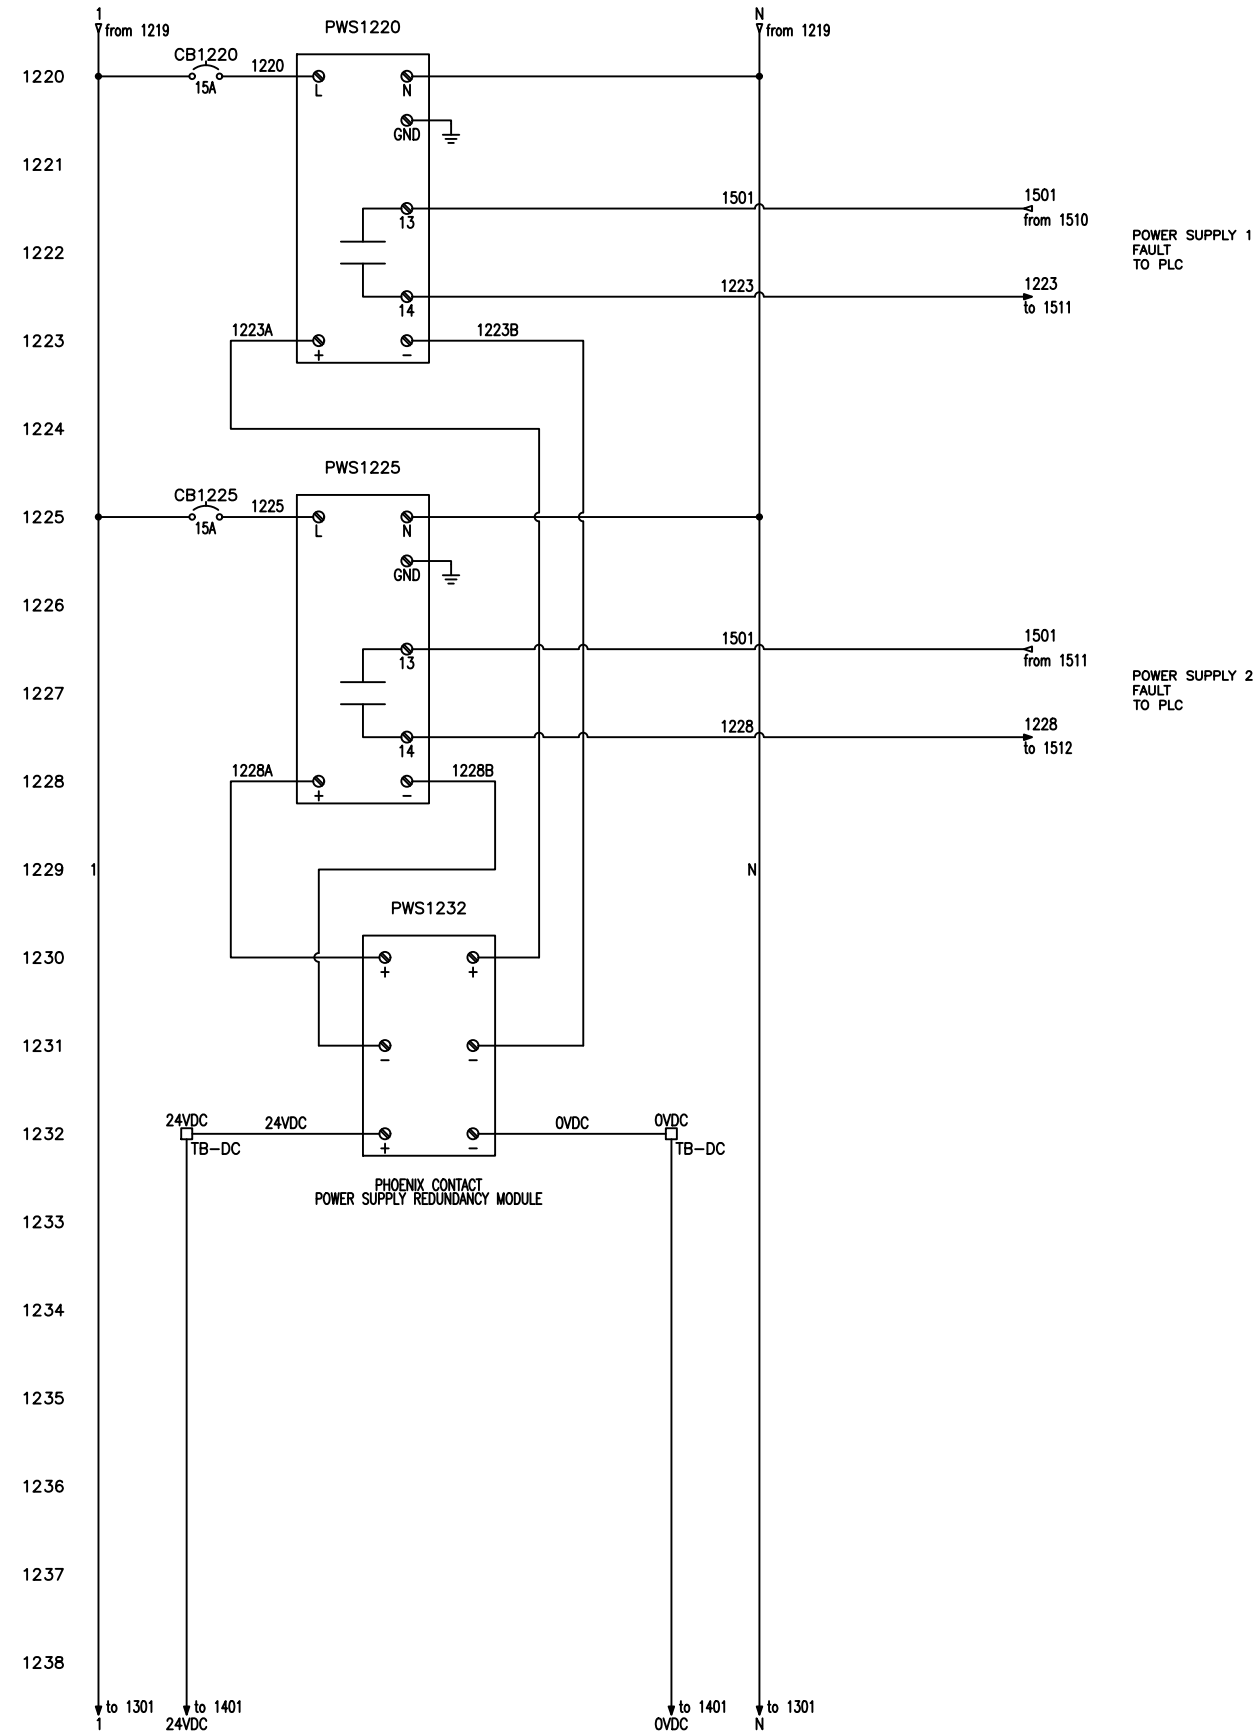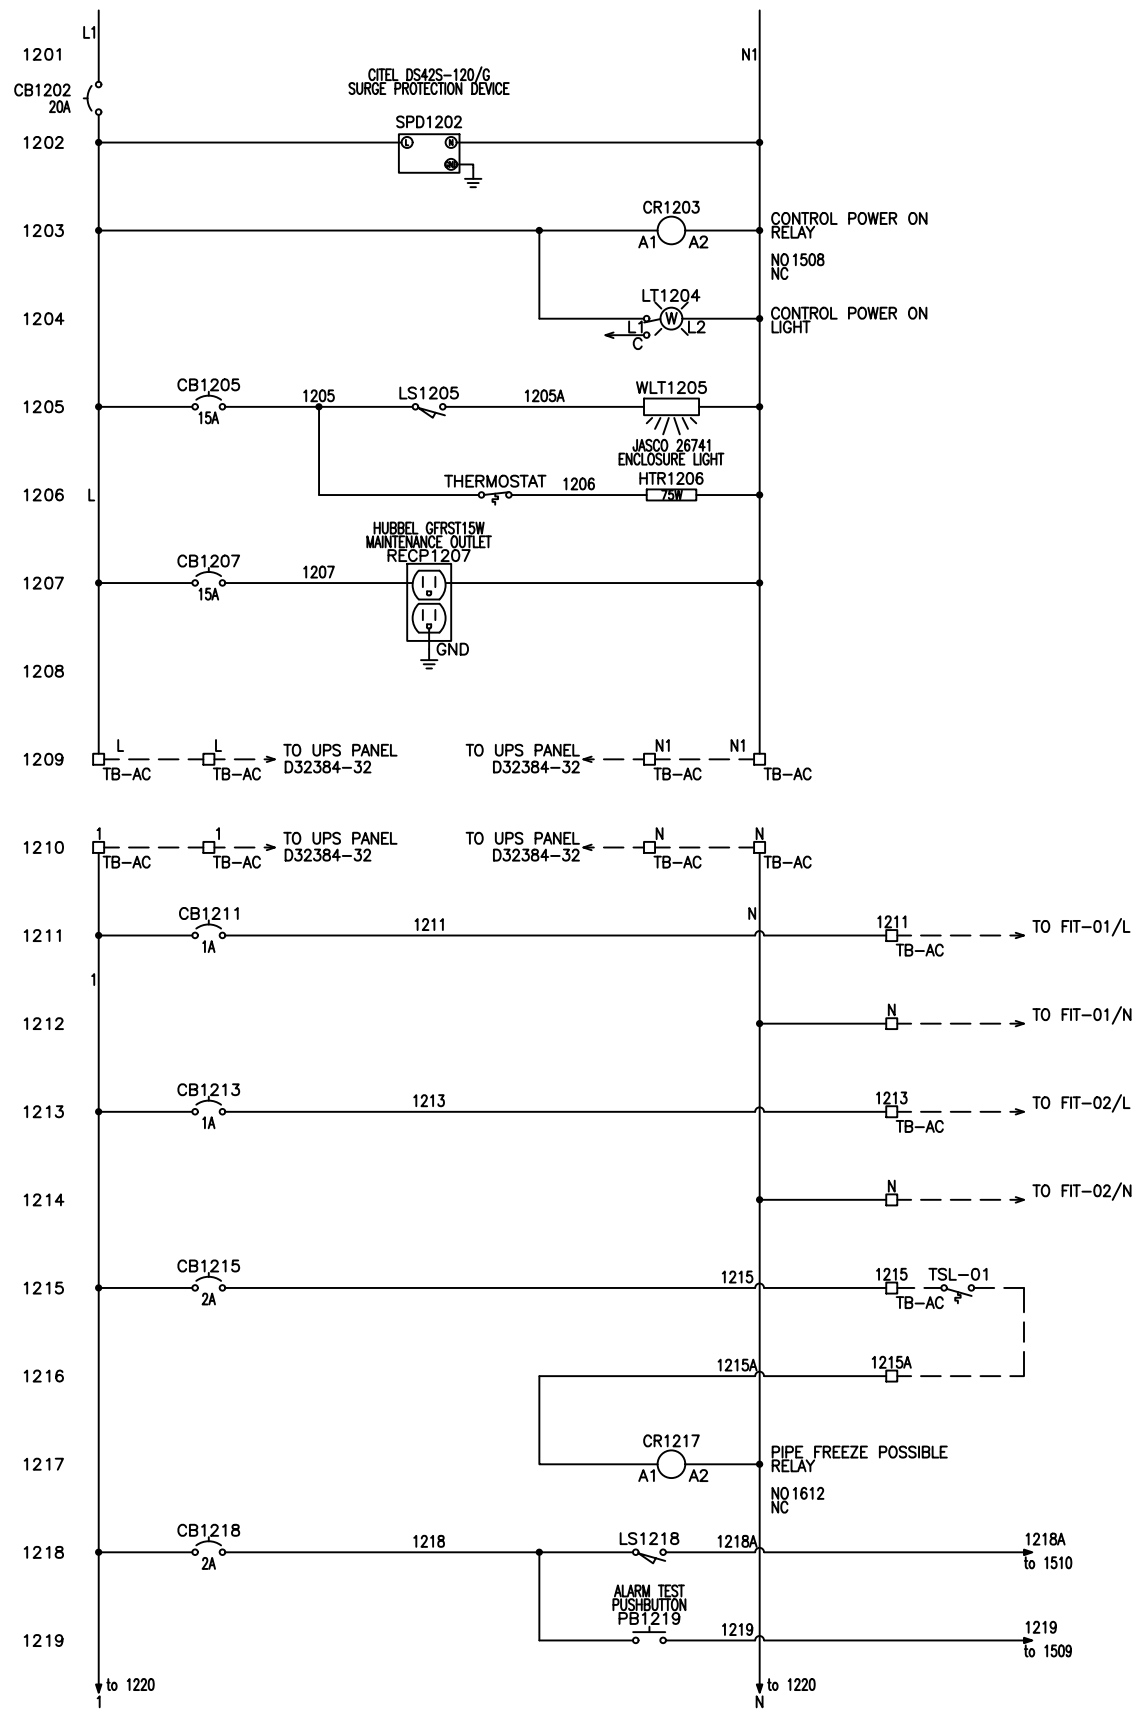



TOLERANCES		REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS 120VAC WIRING DIAGRAM		
		NO.	DATE	BY			
DECIMAL	1						
	2						
FRACTIONAL	3				DRAWN BY ZBB	SCALE NONE	MATERIAL
	4				CHK'D MN	DATE 12-01-2025	DRAWING NUMBER
ANGULAR	5				TRACED	APP'D	32384-12
	6						

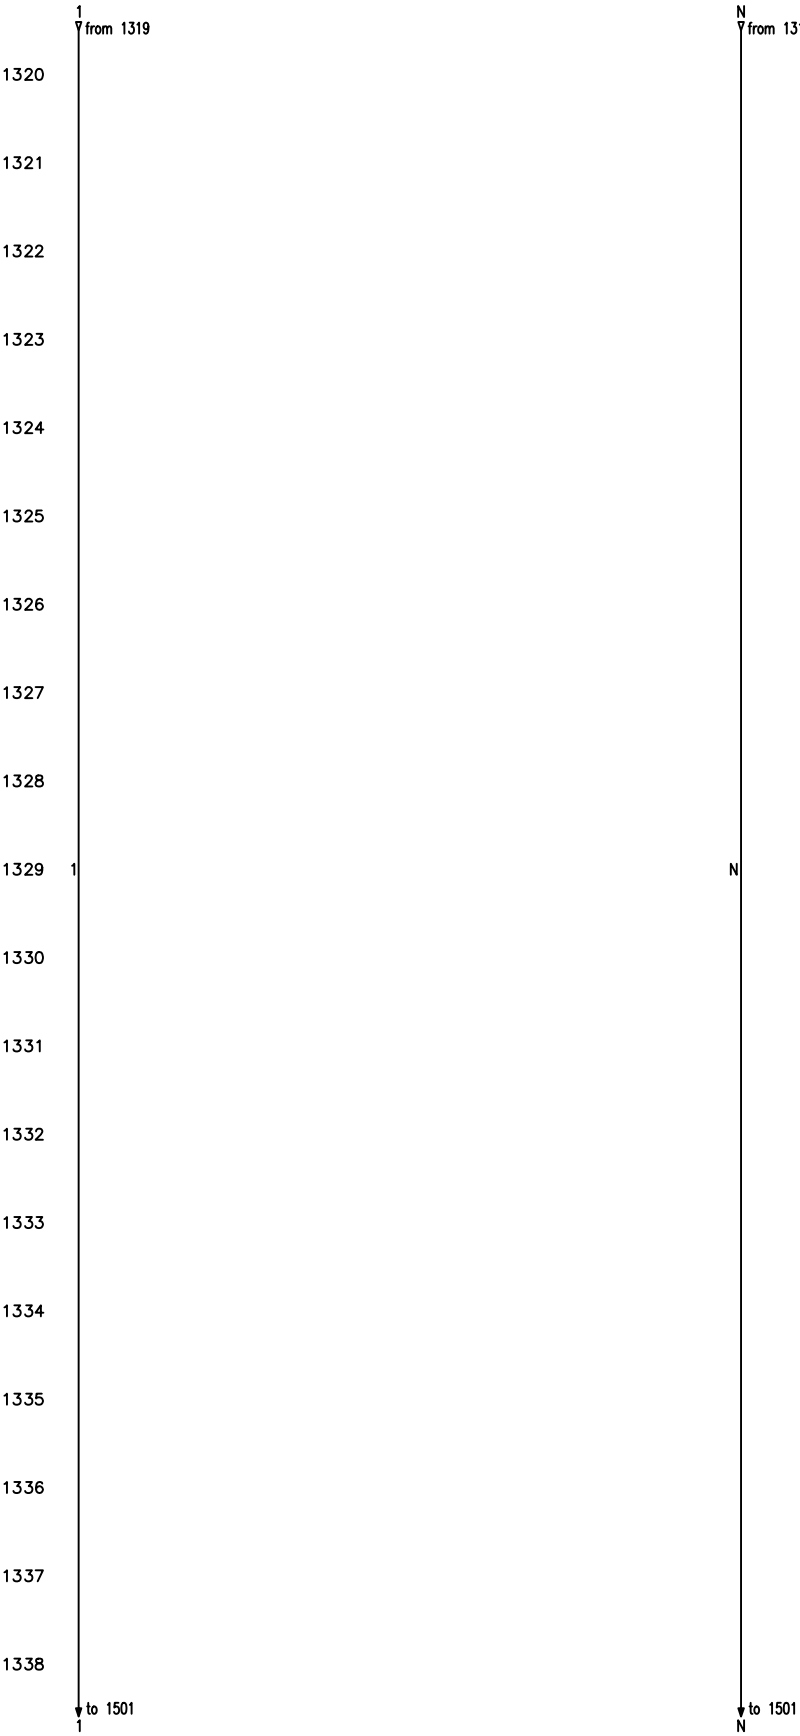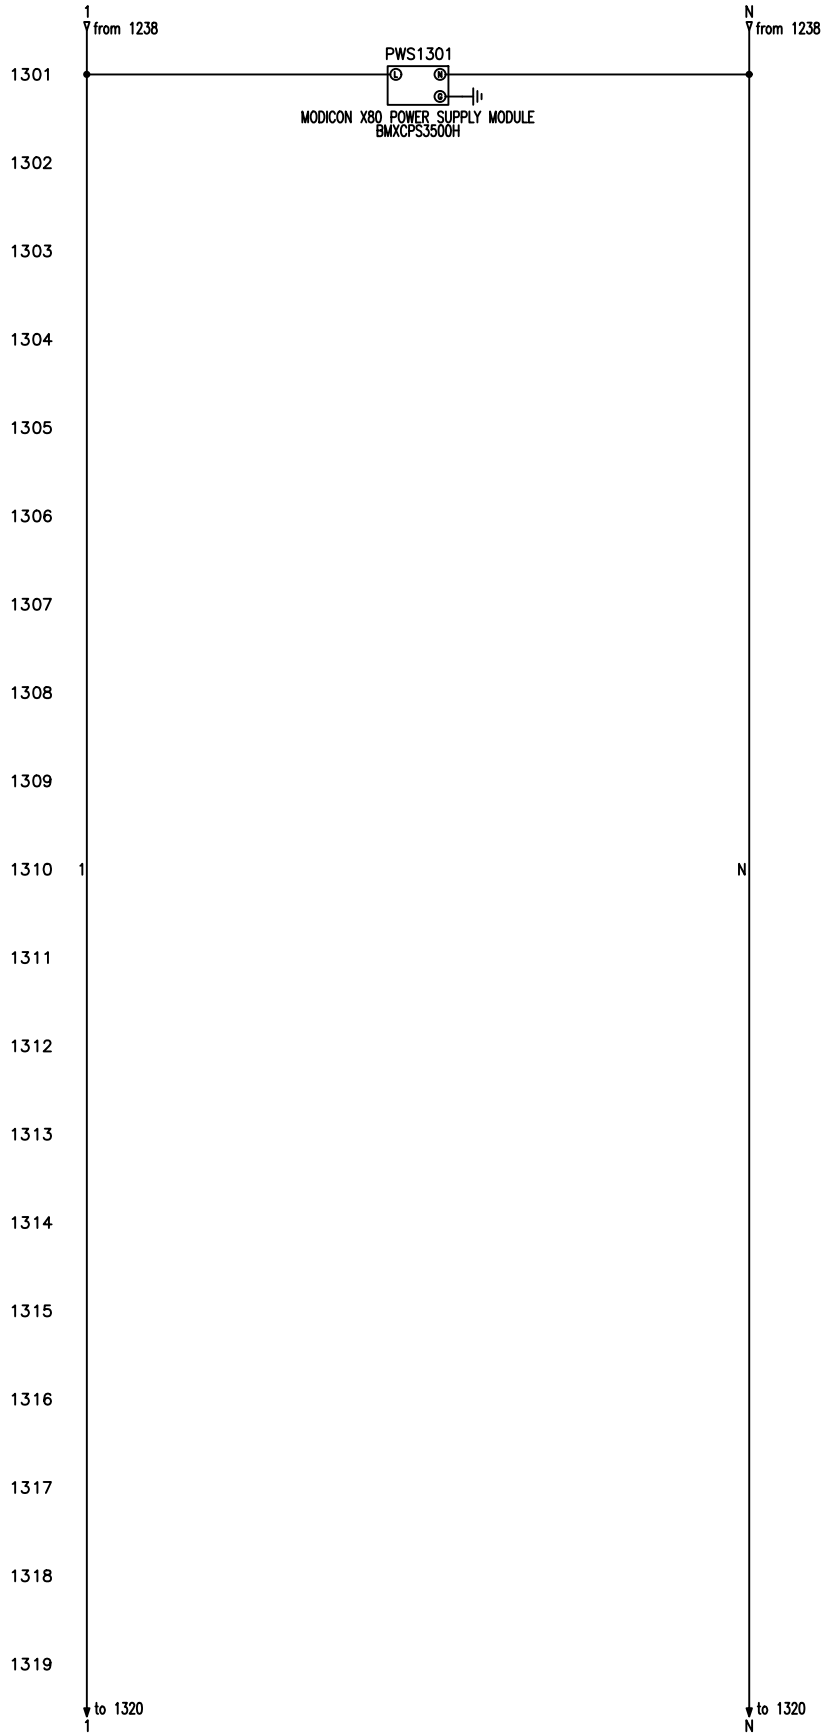


TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS		
	NO.	DATE	BY	120VAC WIRING DIAGRAM		
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 12-03-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-13
	6					

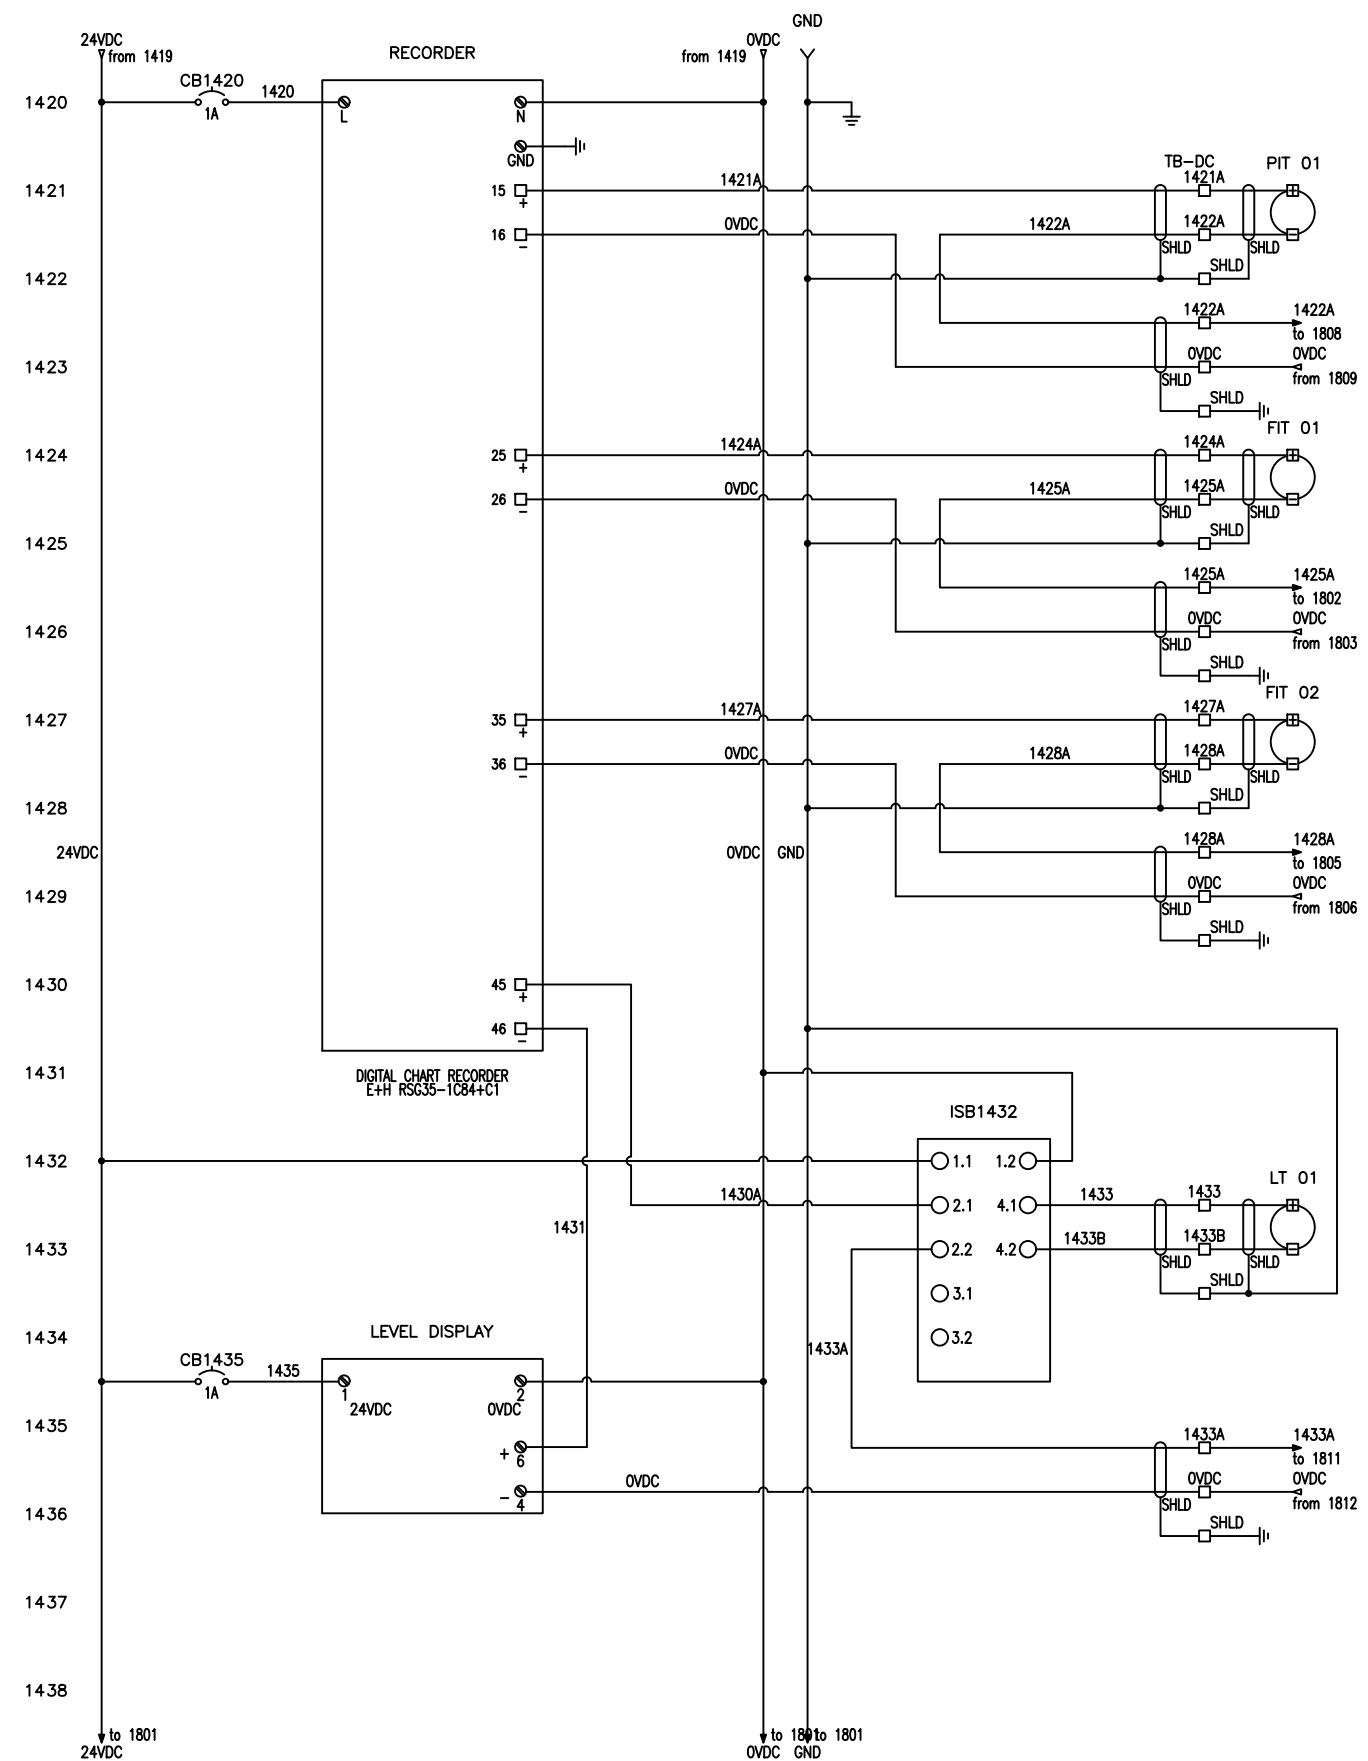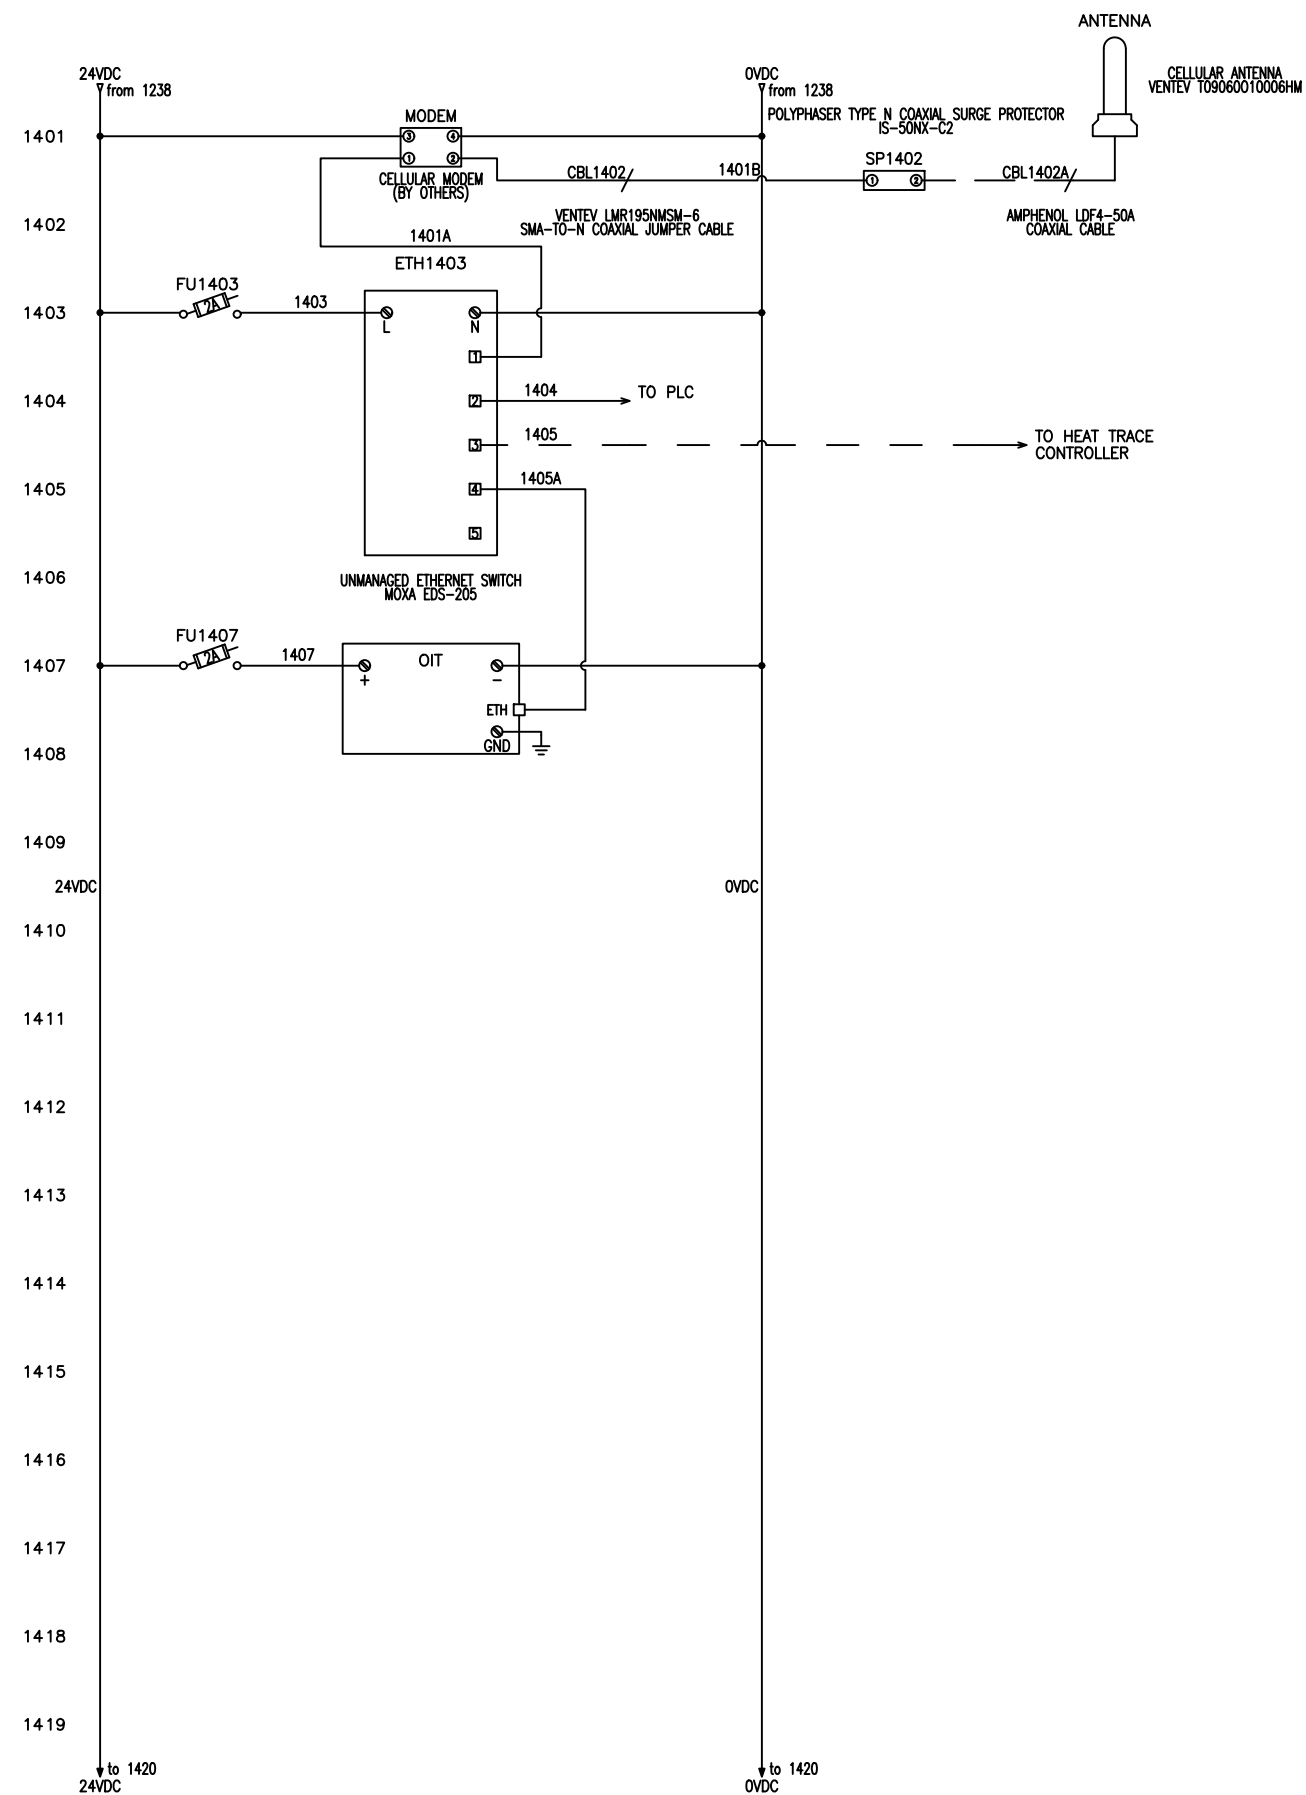

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS		
	NO.	DATE	BY	24VDC WIRING DIAGRAM		
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB		
	4			SCALE	NONE	MATERIAL
ANGULAR	5			CHK'D	MN	DATE 12-03-2025
	6			TRACED	APP'D	DRAWING NUMBER
	8			32384-14		

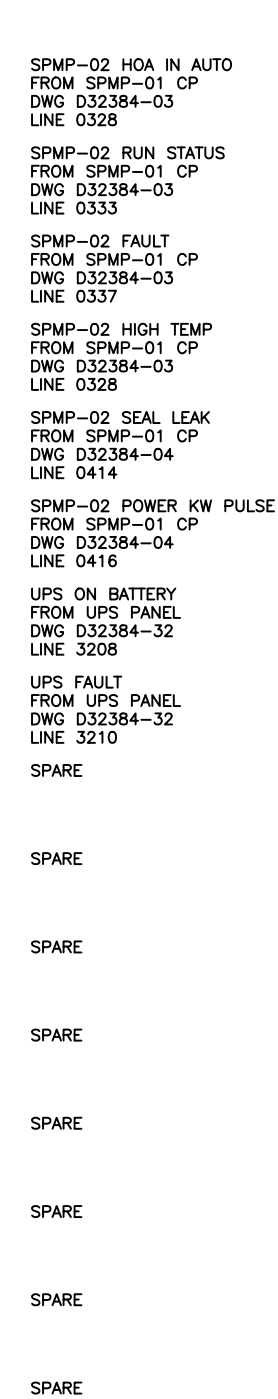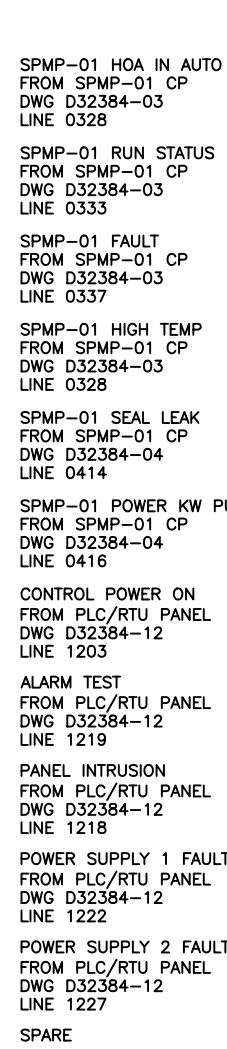

TOLERANCES	REVISONS			POMONKEY PUMP STATION IMPROVEMENTS		
	NO.	DATE	BY	DIGITAL INPUT WIRING DIAGRAM		
DECIMAL	1					
	2					
FRACTIONAL	3			DRWN BY ZBB	SCALE NONE	MATERIAL
	4			CH'D MN	DATE 12-05-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-15
	6					

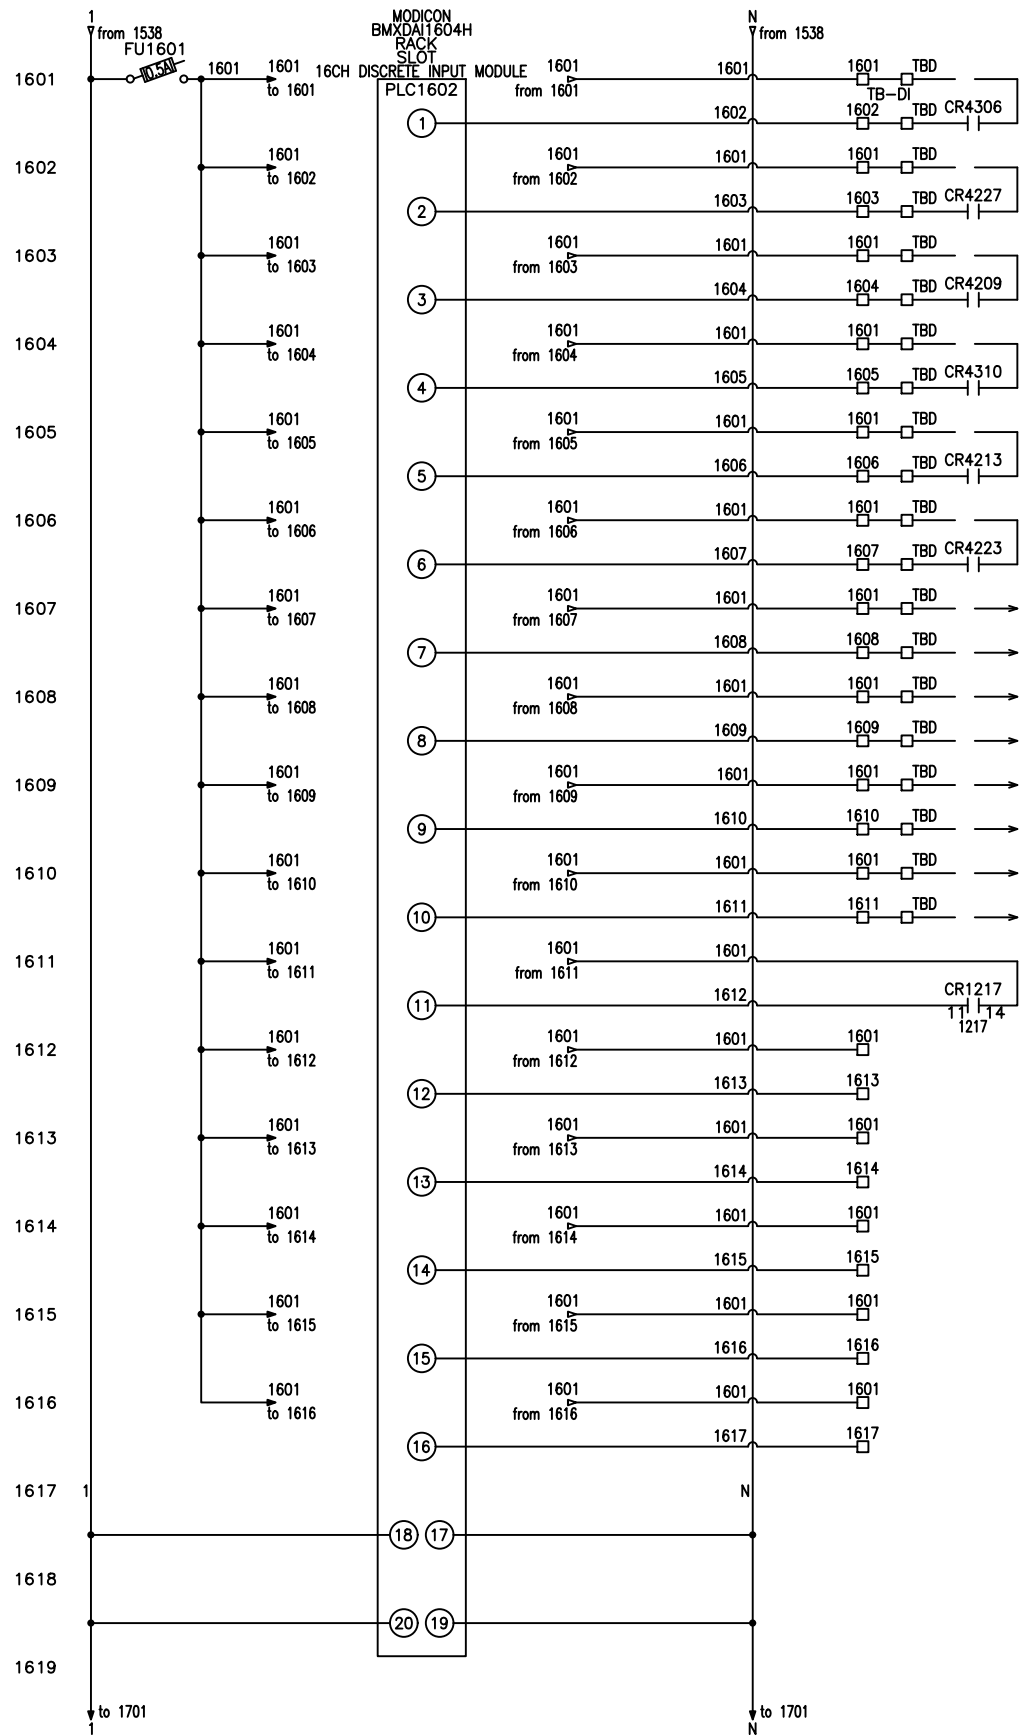

SECONDARY CONTROL ACTIVE
FROM SECONDARY CONTROL PANEL
DWG D32384-43
LINE 4308

LOW LOW LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4231

HIGH HIGH LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4214

PUMP DOWN FAILURE
FROM SECONDARY CONTROL PANEL
DWG D32384-43
LINE 4318

LOW LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4216

HIGH LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4229

STANDBY DIESEL BYPASS PUMP
RUN STATUS
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
FAULT
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
LOW FUEL
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
NOT IN AUTO
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

VALVE ENCLOSURE PIPE FREEZE POSSIBLE
FROM PLC/RTU PANEL
DWG
(BY OTHERS)

SPARE


SPARE

SPARE



SPARE

SPARE


TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS DIGITAL INPUT WIRING DIAGRAM		
	NO.	DATE	BY			
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 12-08-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-16
	6					

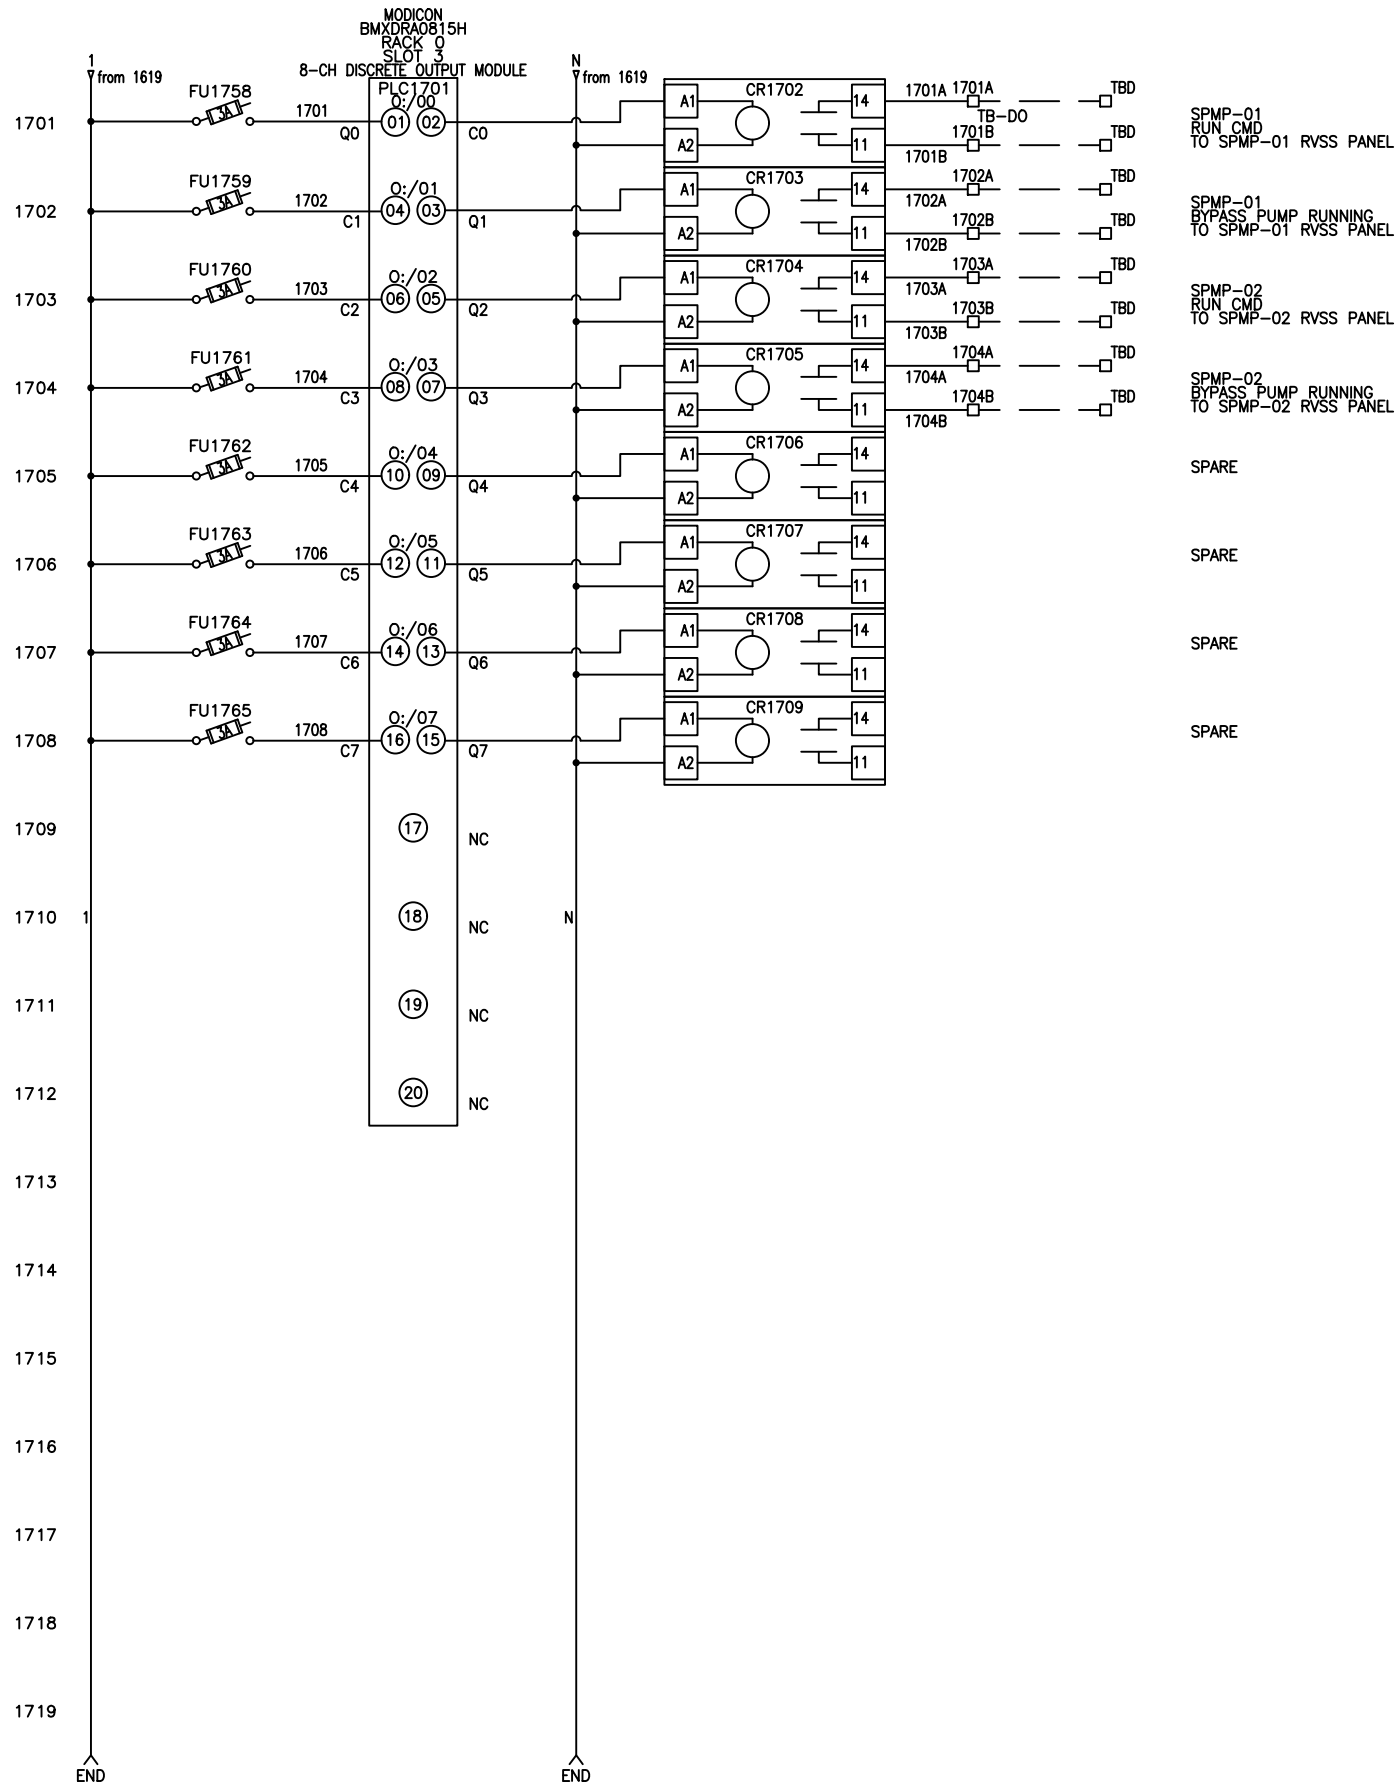

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS		
	NO.	DATE	BY	DIGITAL INPUT WIRING DIAGRAM		
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 12-08-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-17
	6					

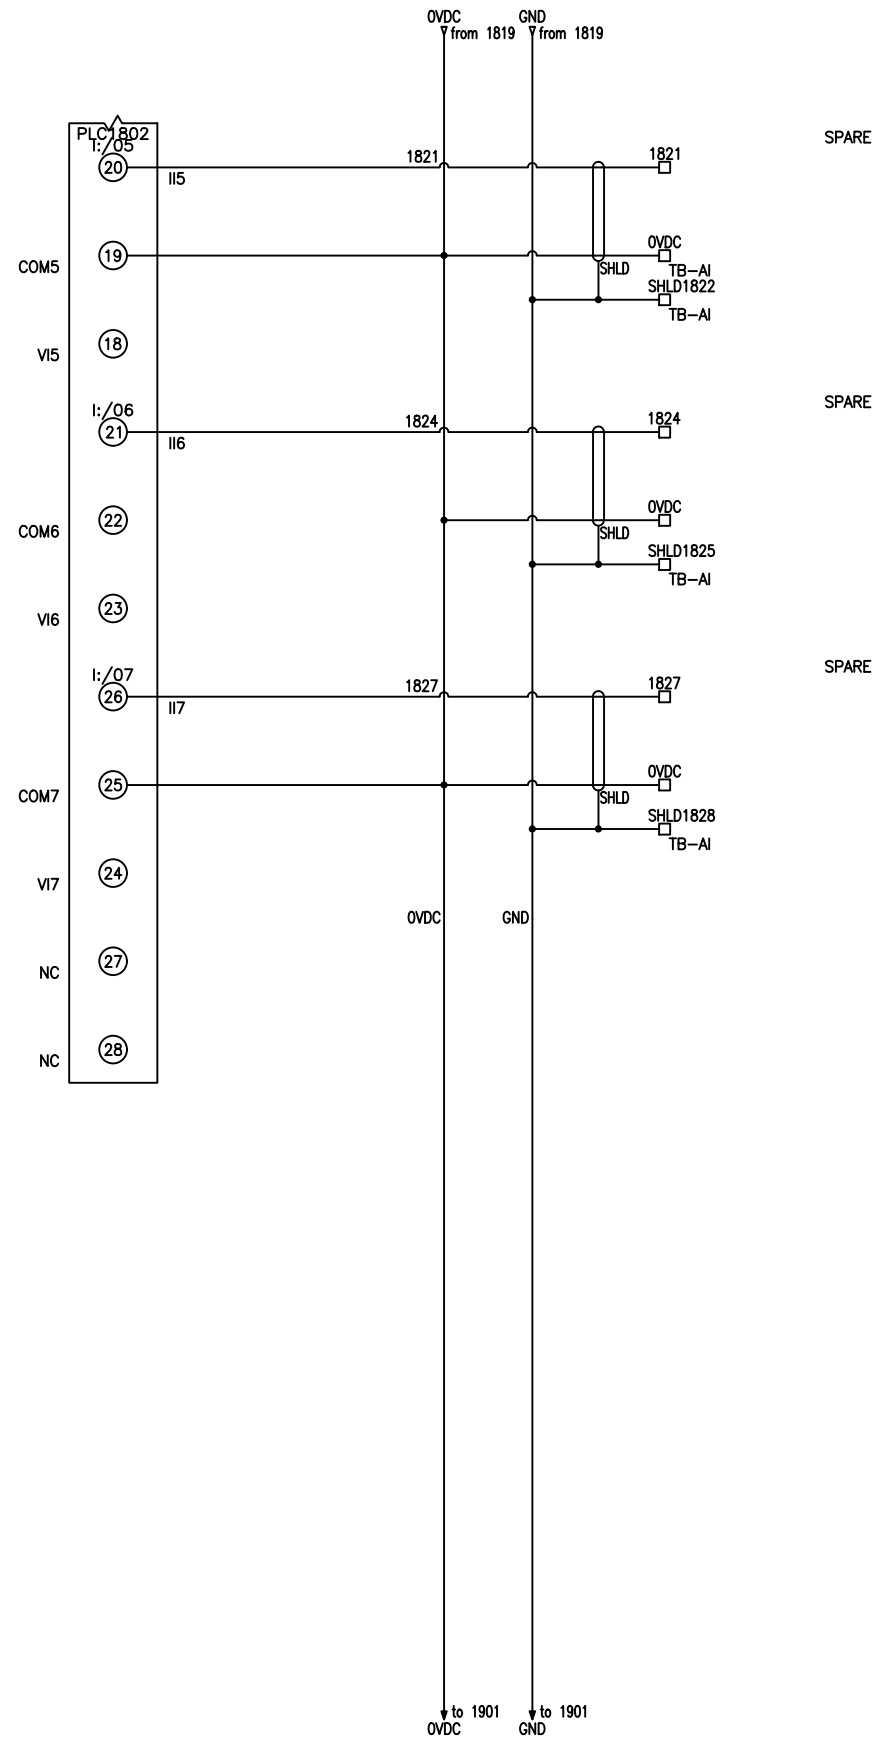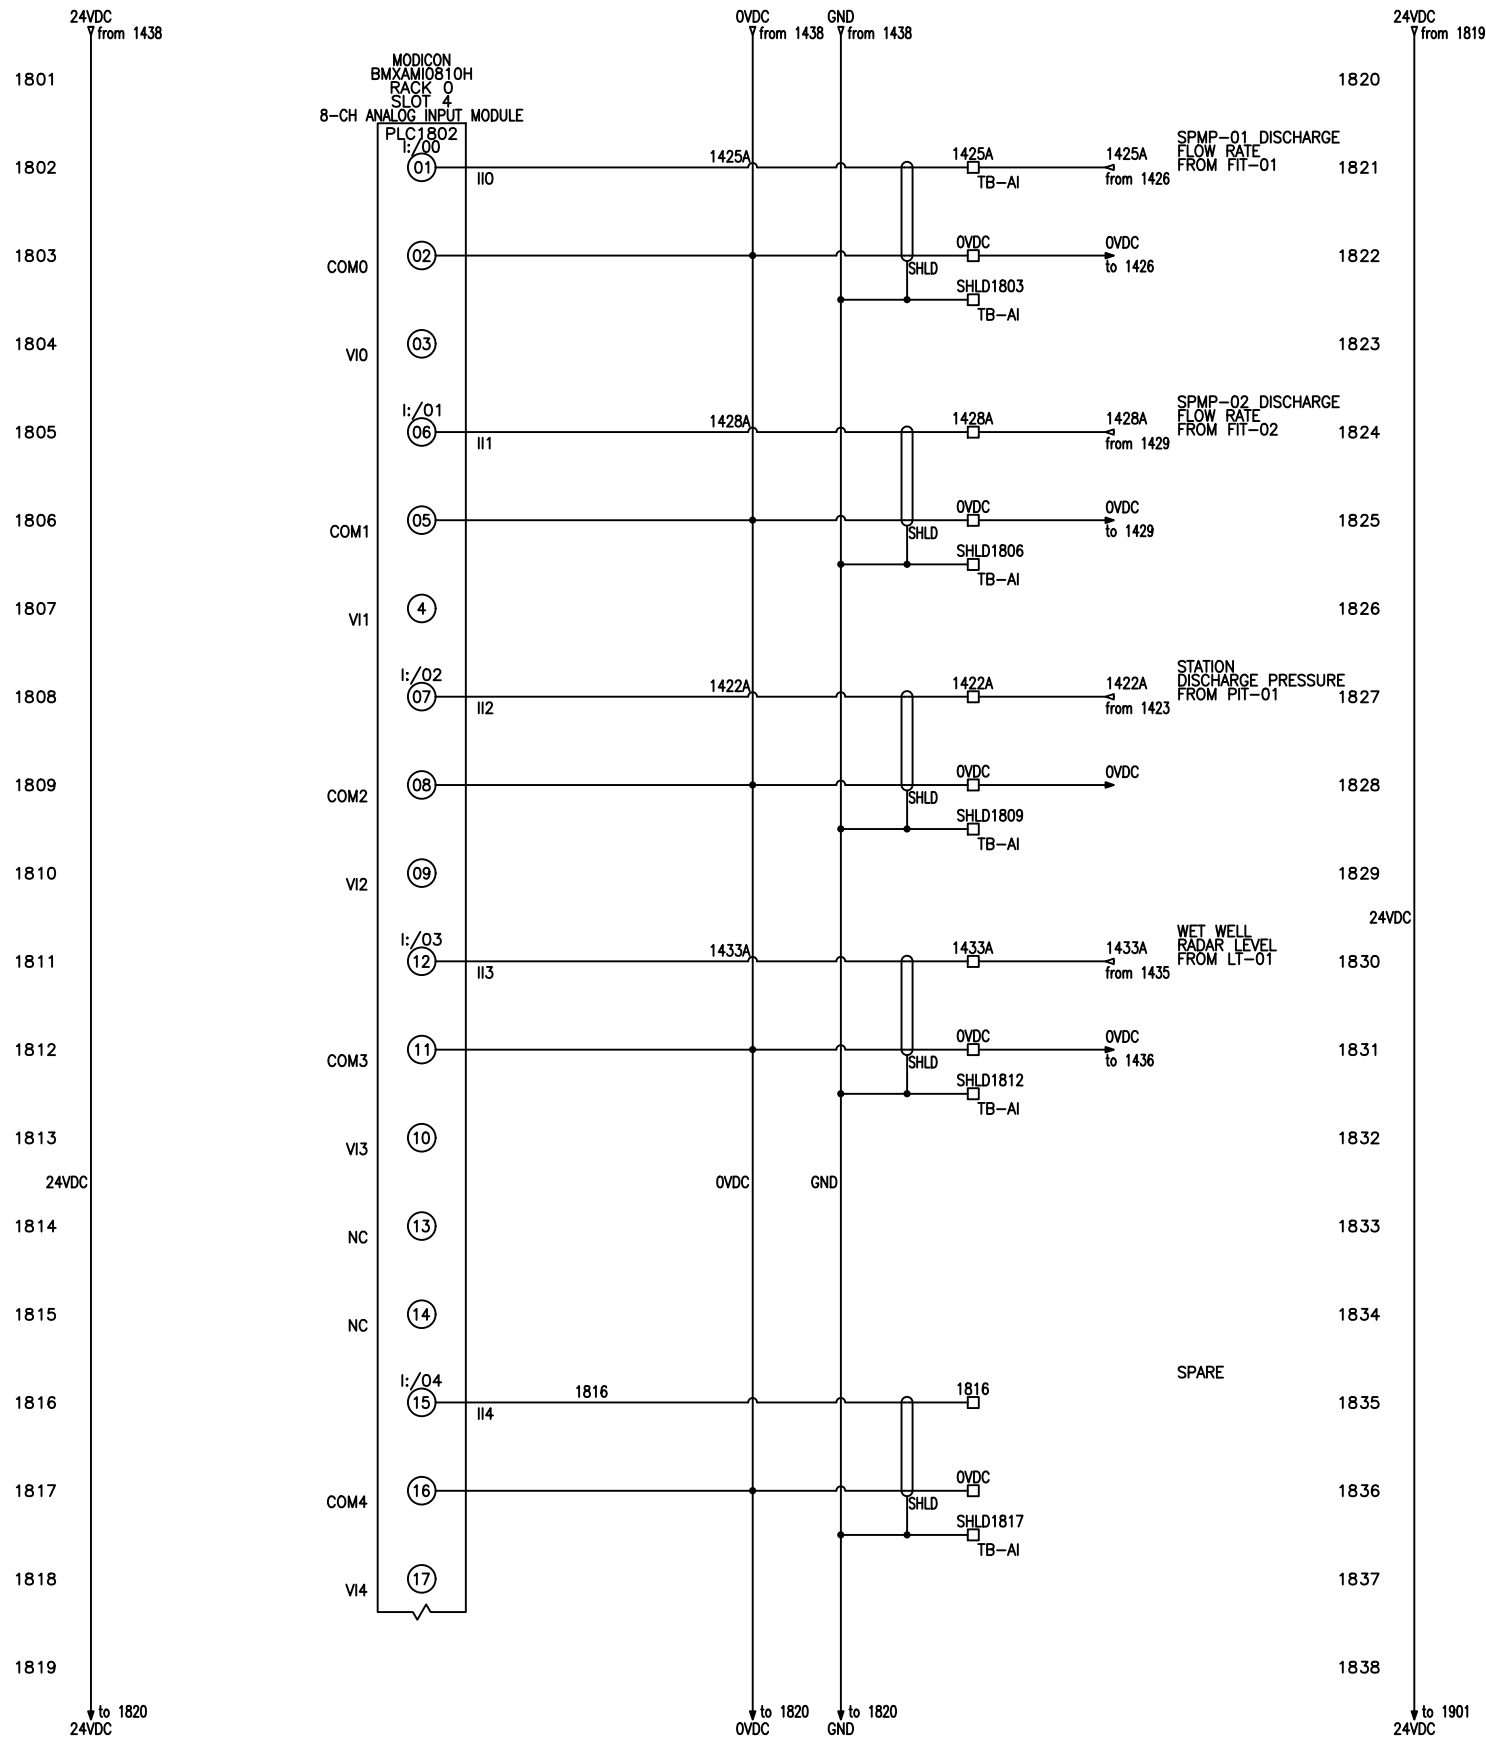

TOLERANCES		REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS ANALOG INPUT WIRING DIAGRAM		
		NO.	DATE	BY			
DECIMAL	1						
	2						
FRACTIONAL	3				DRAWN BY ZBB	SCALE NONE	MATERIAL
	4				CHK'D MN	DATE 12-12-2025	DRAWING NUMBER
ANGULAR	5				TRACED	APP'D	32384-18
	6						

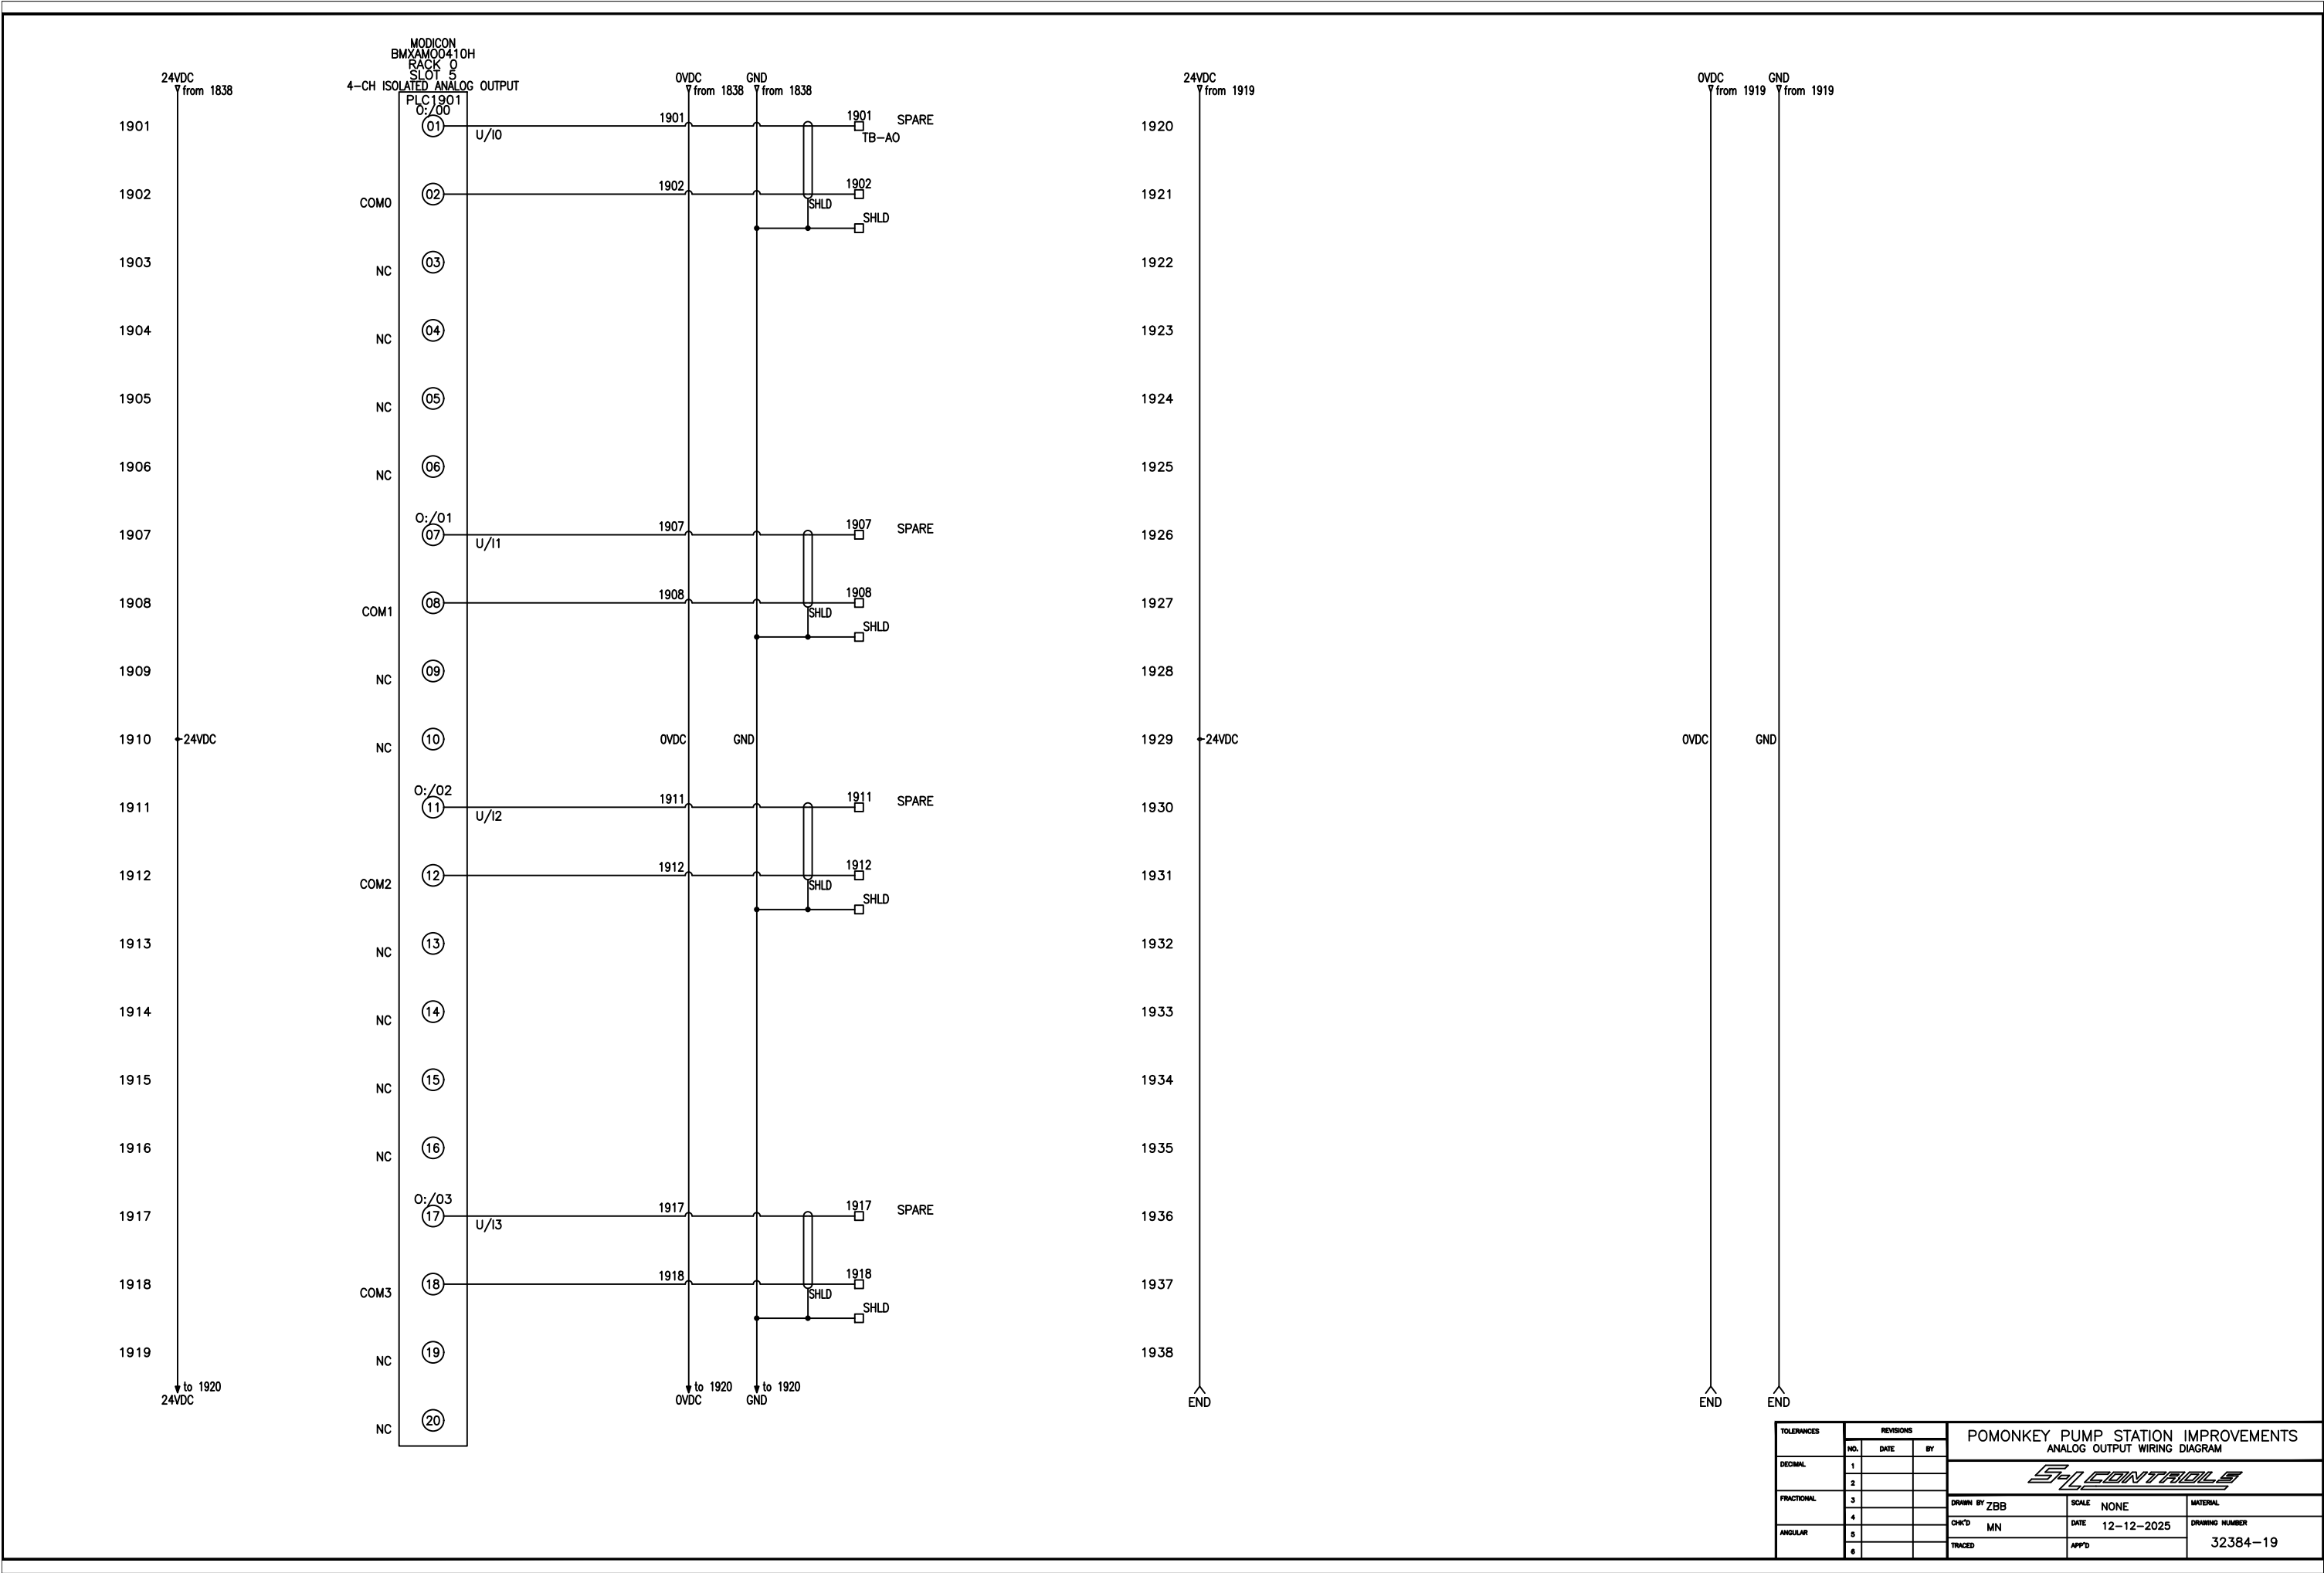

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS ANALOG OUTPUT WIRING DIAGRAM		
	NO.	DATE	BY			
DECIMAL	1					
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 12-12-2025	DRAWING NUMBER
ANGULAR	5			TRACED	APP'D	32384-19
	6					