WARNING NAMEPLATE DETAIL

S-L CONTROLS, DWG D32384-10
VOLTAGE: 120VAC, 60HZ, SINGLE PHASE
AMPS: 0.93A

SHORT CIRCUIT CURRENT: N/A

ENCLOSURE RATING: UL TYPE 4X

CAUTION: MULTIPLE POWER SOURCES ARE PROVIDED FROM FIELD TERMINALS. EACH SOURCE SHOULD BE DISCONNECTED FOR SERVICING.

WARNING: TO MAINTAIN OVERCURRENT, SHORT CIRCUIT, AND GROUND FAULT PROTECTION, THE MANUFACTURER'S INSTRUCTIONS FOR SELECTING CURRENT ELEMENTS MUST BE FOLLOWED

NAMEPLATES SIZED AS REQUIRED

NAME PLATE LEGEND TABLE


ITEM	QTY	DESCRIPTION
1	1	PLC/RTU / CONTROL PANEL
2	1	CONTROL POWER
3	1	ALARM TEST
4	1	FU1501, FU1520, FU1601: MERSEN MI5HF25V0.5/100 0.5A FU1758, FU1759, FU1760, FU1761, FU1762, FU1763, FU1764, FU1765: MERSEN GGM3 3A
5	1	FU1401, FU1405, FU1407: MERSEN MI5HF25V2/100 2A

NOTES:
ALL PLATES SHALL BE ENGRAVED ON WHITE BACKGROUND WITH BLACK CHARACTERS. LETTER HEIGHT SHOULD BE MINIMUM 1/4"


WIRING:
1) □ – INDICATES CABINET TERMINAL BLOCK
2) DASHED LINES INDICATE WIRING REMOTE TO CONTROL PANEL.
3) PROVIDE 20% SPARE TERMINALS
4) UL APPROVED NO. TO BE PROVIDED AT TIME OF MANUFACTURING
5) ELECTRICAL CONNECTION TORQUES:
   TERMINAL: 12 INCH POUNDS
   CIRCUIT BREAKER: 45 INCH POUNDS


ADDITIONAL PANEL LABELS:

A* = "INTRINSICALLY SAFE FIELD WIRING TERMIANLS"
B* = "WARNING – EXPLOSION HAZARD – SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY"
C* = "INTRINSICALLY SAFE CIRCUITS" (TO BE PLACED BY CONTRACTOR AT CONDUIT OPENING)
D* = "WARNING – EXPLOSION HAZARD, TO PREVENT IGNITION OF FLAMMABLE OR COMBUSTIBLE ATMOSPHERES, DISCONNECT POWER BEFORE SERVICING.

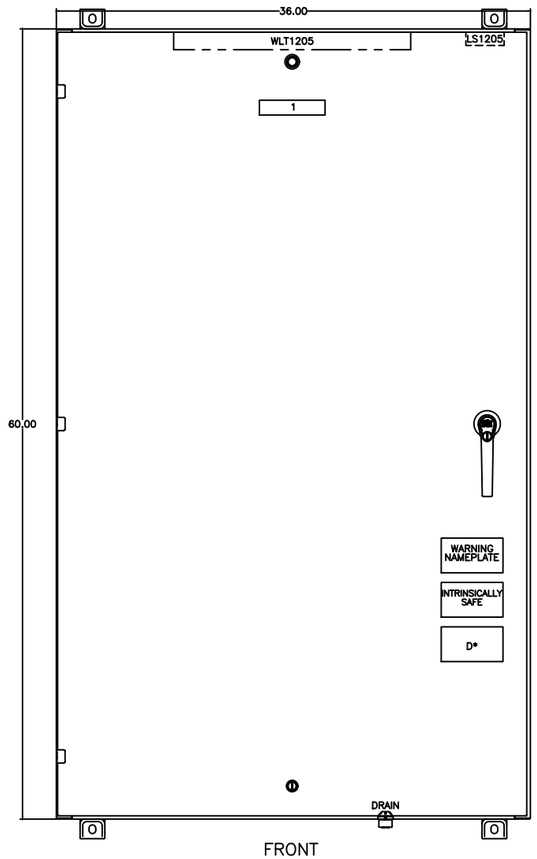

FRONT VIEW

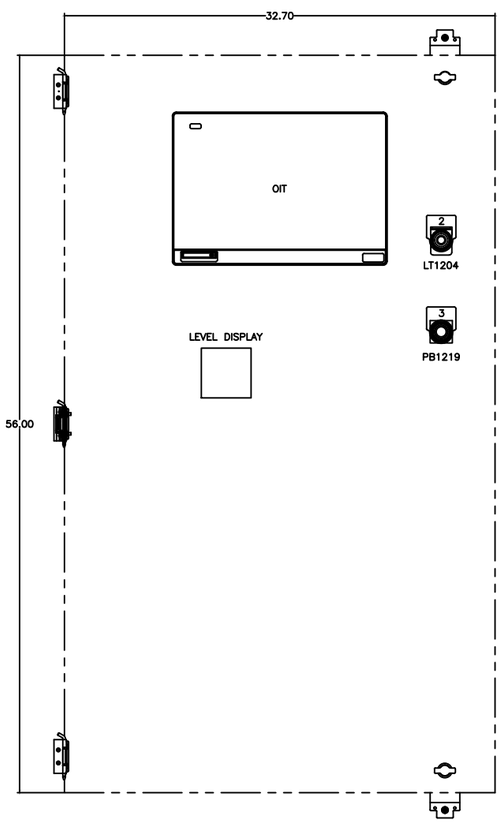

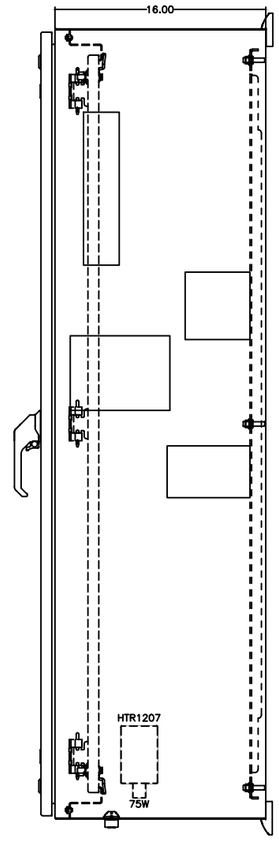


RIGHT SIDE VIEW

PANEL WIRING

AREA	VOLTAGE	NOUN NAME	ID	GAGE	COLOR	TYPE
INTERNAL	120VAC	HOT	(1), (1A), (X1)	14	BLACK	MTW
INTERNAL	120VAC	NEUTRAL	(N)	14	WHITE	MTW
CONTROL	120VAC	HOT	VARIOUS	16	RED	MTW
CONTROL	120VAC	NEUTRAL	N	16	WHITE	MTW
CONTROL	DC	DC+	VARIOUS	16	BLUE	MTW
CONTROL	DC	DC–	VARIOUS	16	BLUE W/ WHITE STRIPE	MTW
EXTERNALLY ENERGIZED		HOT	VARIOUS	16	YELLOW	MTW
ANALOG	24VDC	4–20MA	VARIOUS	18	BLACK/RED	TSP

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS PLC/RTU CONTROL PANEL EXT. LAYOUT		
	NO.	DATE	BY	S-L CONTROLS		
DECIMAL	1					
	2					
FRACTIONAL	3					
	4					
ANGULAR	5					
	6					
				DRAWN BY ZBB	SCALE NONE	MATERIAL
				CH'K'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-10
				TRACED	APP'D	

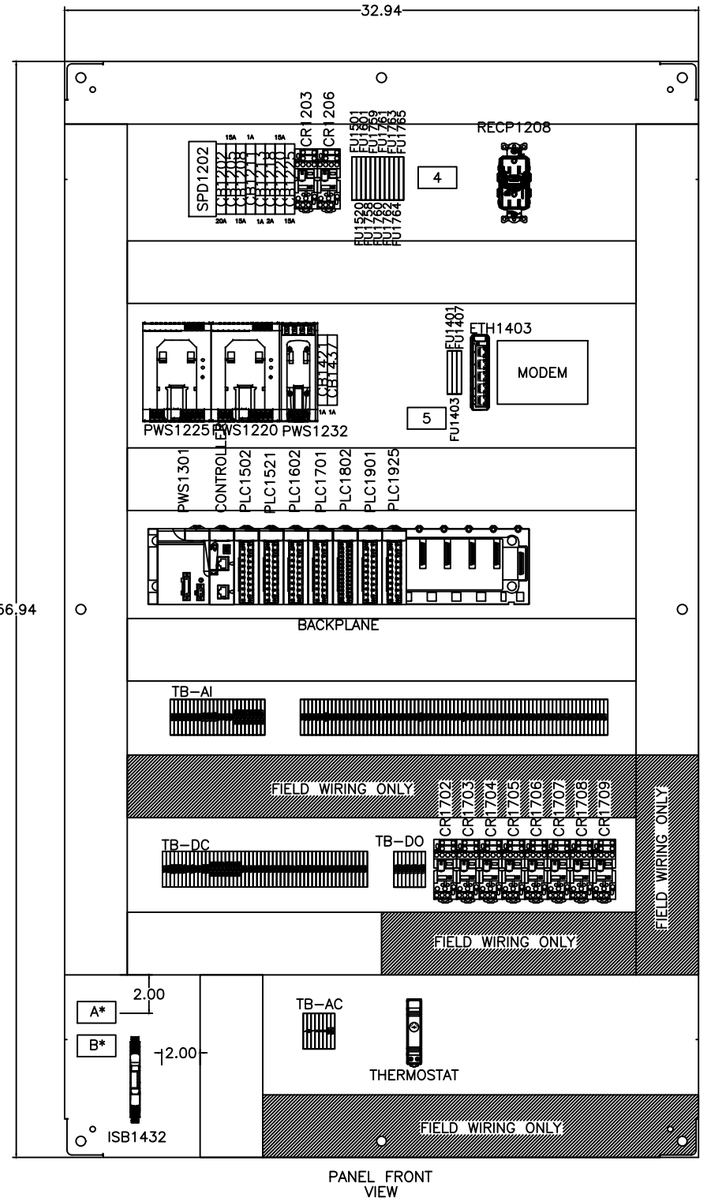

TAGS	QTY	CATALOG	DESCRIPTION	MANUFACTURER
ENC	1	SCE-60EL3616SS6LPPL	NEMA 4X WALL MOUNT ENCLOSURE	SCE
ENC	1	SCE-DF60EL36LP	DEAD FRONT PANEL	SCE
ENC	1	SCE-60P36	ENCLOSURE BACK PANEL	SCE
ENC	1	SCE-ELMFK4	WALL MOUNT FOOT KIT	SCE
DRAIN	1	SCE-BVKD	NEMA 4X VENT/DRAIN	SCE
WLT1205	1	26741	LED LIGHT FIXTURE	JASCO
LT1204	1	9001SKT38LWW31	PTT LIGHT, 120VAC LED, WHITE	SCHNEIDER ELECTRIC
PB1219	1	9001SKR1B	PUSHBUTTON, BLACK	SCHNEIDER ELECTRIC
PB1219	1	9001KA2	1 NO CONTACT	SCHNEIDER ELECTRIC
SPD1202	1	DS42S-120/G	TRANS. VOLTAGE SURGE SUPRESSOR	CITEL
PWS1220, PWS1225	2	2866776	24VDC POWER SUPPLY	PHOENIX CONTACT
PWS1232	1	2320157	24VDC POWER SUPPLY REDUNDANCY MODULE	PHOENIX CONTACT
CB1202	1	7940102584	CIRCUIT BREAKER, 120VAC, 20A	WEIDMULLER
CB1211, CB1213	2	7940125379	CIRCUIT BREAKER, 120VAC, 1A	WEIDMULLER
CB1205, CB1208, CB1220, CB1225	4	7940102582	CIRCUIT BREAKER, 120VAC, 15A	WEIDMULLER
CB1218	1	7940102572	CIRCUIT BREAKER, 120VAC, 2A	WEIDMULLER
CB1421, CB1437	2	7940102624	CIRCUIT BREAKER, 24VDC, 1A	WEIDMULLER
RECP1208	1	GFRST15W	DUPLEX GFCI RECEPTACLE, 15A	HUBBEL
CR1203, CR1206, CR1702, CR1703, CR1704, CR1705, CR1706, CR1707, CR1708, CR1709	10	RXM2AB2F7	MINIATURE RELAY, 120VAC, 8 BLADE	SCHNEIDER ELECTRIC
CR1203, CR1206, CR1702, CR1703, CR1704, CR1705, CR1706, CR1707, CR1708, CR1709	10	RXZE2M114	MINIATURE RELAY SOCKET, 120VAC, DIN	SCHNEIDER ELECTRIC
LEVEL DISPLAY	1	RIA452-C211A11A	DIGITAL PROCESS METER	E+H
ANTENNA	1	T09060010006HM	CELLULAR ANTENNA	VENTEV
ETH1403	1	EDS-205	UNMANAGED ETHERNET SWITCH, 5 PORT	MOXA
FU1403, FU1407	2	MI5HF25V2/100	MINIATURE FUSE, FAST ACTING, 2A	MERSEN
FU1501, FU1520, FU1601, FU1920	4	MI5HF25V0.5/100	MINIATURE FUSE, FAST ACTING, 0.5A	MERSEN
FU1758, FU1759, FU1760, FU1761, FU1762, FU1763, FU1764, FU1765	8	GGM3	FAST BLOW FUSE, 3A	MERSEN
FU1403, FU1407, FU1501, FU1520, FU1601, FU1758, FU1759, FU1760, FU1761, FU1762, FU1763, FU1764, FU1765, FU1920	14	3046100	FUSE TERMINAL BLOCK, 120VAC	PHOENIX CONTACT
LS1205	1	ALFSWD	REMOTE DOOR SWITCH	HOFFMAN
PWS1301	1	BMXCPS3500H	POWER SUPPLY MODULE	MODICON
OIT	1	HMIDT752	OPERATOR INTERFACE TERMINAL	SCHNEIDER ELECTRIC
OIT	1	HMIG2U	DISPLAY BASE UNIT	SCHNEIDER ELECTRIC
CONTROLLER	1	BMXP342020H	PROCESSOR	MODICON
BACKPLANE	1	BMXXBP1200H	BACKPLANE, 12 SLOTS	MODICON
PLC1502, PLC1521, PLC1602, PLC1701, PLC1901, PLC1925	6	BMXFTB2000	TERMINAL BLOCK, 20 PIN	MODICON
PLC1802	1	BMXFTB2800	TERMINAL BLOCK, 28 PIN	MODICON
PLC1502, PLC1521, PLC1602	3	BMXDAI1604H	DISCRETE INPUT MODULE, 120VAC	MODICON
PLC1701	1	BMXDRA0815H	DISCRETE OUTPUT MODULE	MODICON
PLC1802	1	BMXAMI0810H	ANALOG INPUT MODULE	MODICON
PLC1901	1	BMXAMO0410H	ANALOG OUTPUT MODULE	MODICON
PLC1925	1	BMXDDI1602H	DISCRETE INPUT MODULE, 24VDC	MODICON
ISB1432	1	2865366	IS BARRIER / SPLITTER	PHOENIX CONTACT
SP1402	1	IS-50NX-C2	COAXIAL RF SURGE PROTECTOR	POLYPHASER
CBL1402	1	LMR195NMSM-6	SMA JUMPER CABLE	VENTEV
CBL1402A	1	LDF4-50A	COAXIAL CABLE	AMPHENOL
THERMOSTAT	1	7T.81.0.000.2403	ENCLOSURE HEATER THERMOSTAT, NC	FINDER
HTR1207	1	SCE-TSH75	ENCLOSURE HEATER	SCE
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	163	3044076	UNIVERSAL TERMINAL BLOCK – UT 2,5	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	3047028	TERMINAL END BARRIER	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	3044092	GROUNDING TERMINAL BLOCK	PHOENIX CONTACT
TB-AC, TB-AI, TB-AO, TB-DC, TB-DI, TB-DO	A/R	0800886	TERMINAL ANCHOR	PHOENIX CONTACT


TOLERANCES
DECIMAL
FRACTIONAL
ANGULAR


REVISIONS			
NO.	DATE	BY
1		
2		
3		
4		
5		
6		

POMONKEY PUMP STATION IMPROVEMENTS
PLC/RTU CONTROL PANEL INT. LAYOUT


S4 CONTROLS


DRAWN BY ZBB	SCALE NONE	MATERIAL
CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-11
TRACED	APP'D	

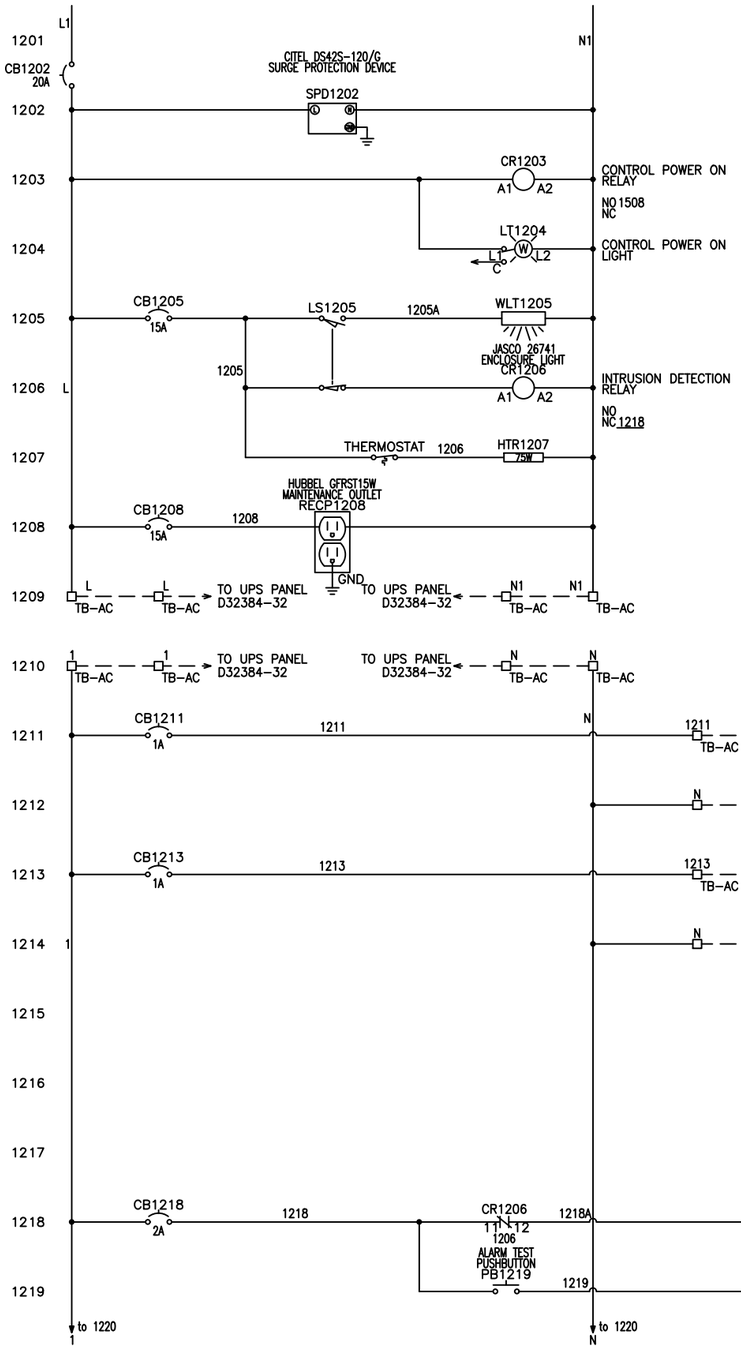

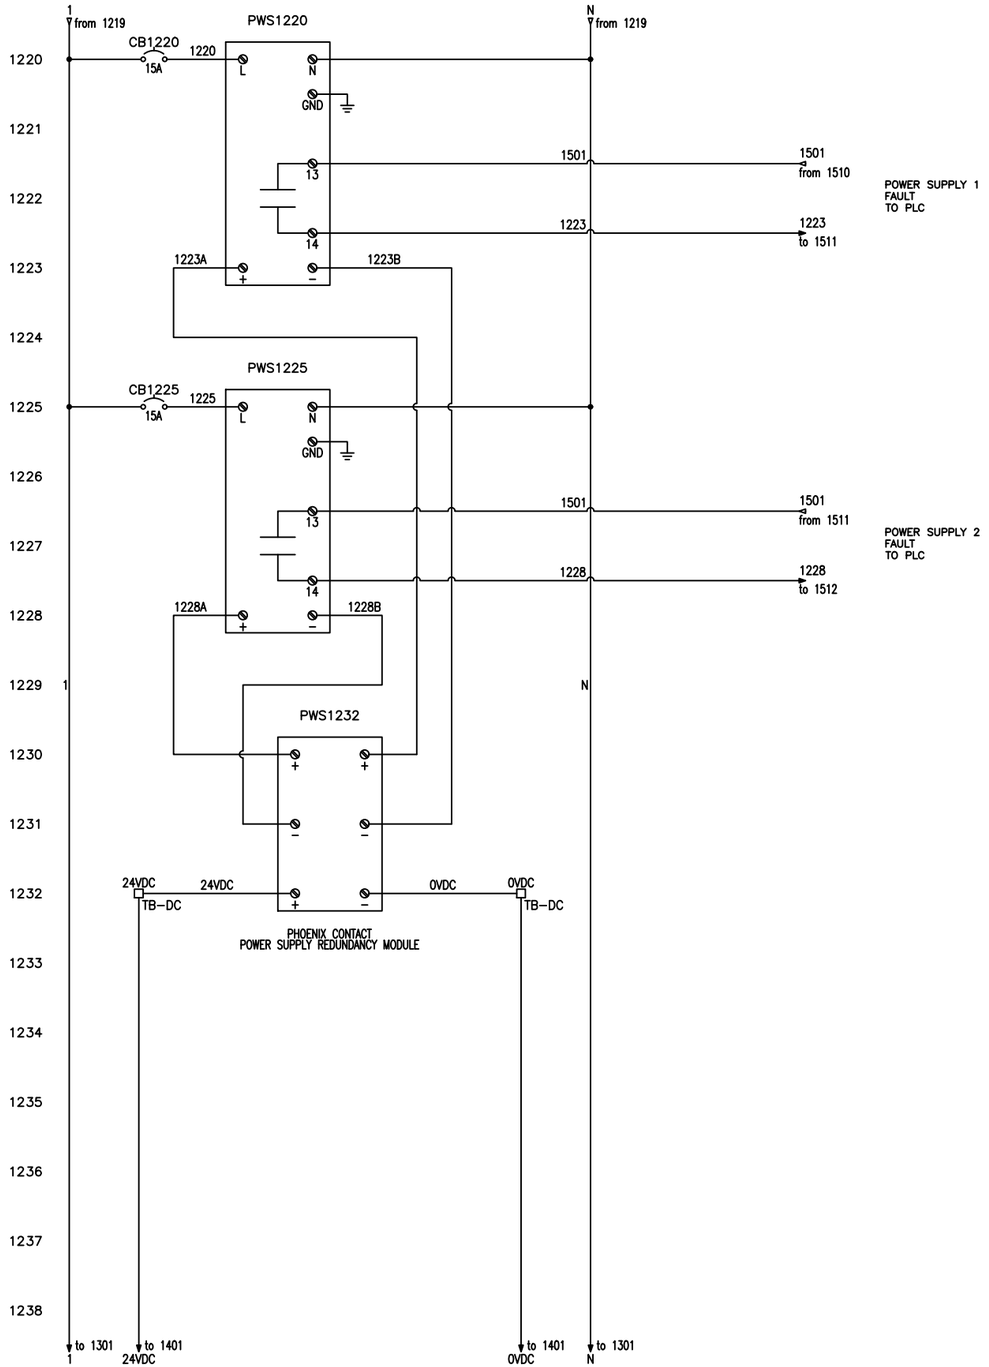



TOLERANCES	REVISIONS		POMONKEY PUMP STATION IMPROVEMENTS
	NO.	DATE	BY	120VAC WIRING DIAGRAM
DECIMAL	1			S-L CONTROLS
	2			
FRACTIONAL	3			DRAWN BY ZBB / SCALE NONE / MATERIAL
	4			CHK'D MN / DATE 11-11-2026 / DRAWING NUMBER
ANGULAR	5			TRACED / APP'D / 32384-12
	6			

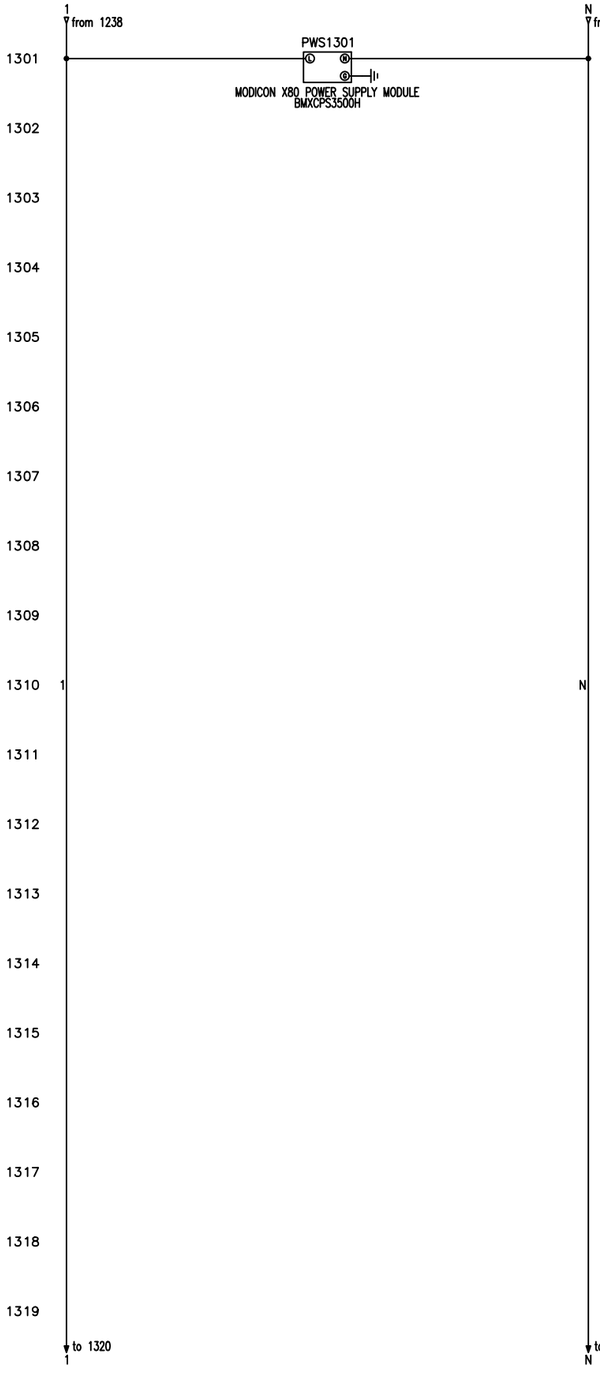

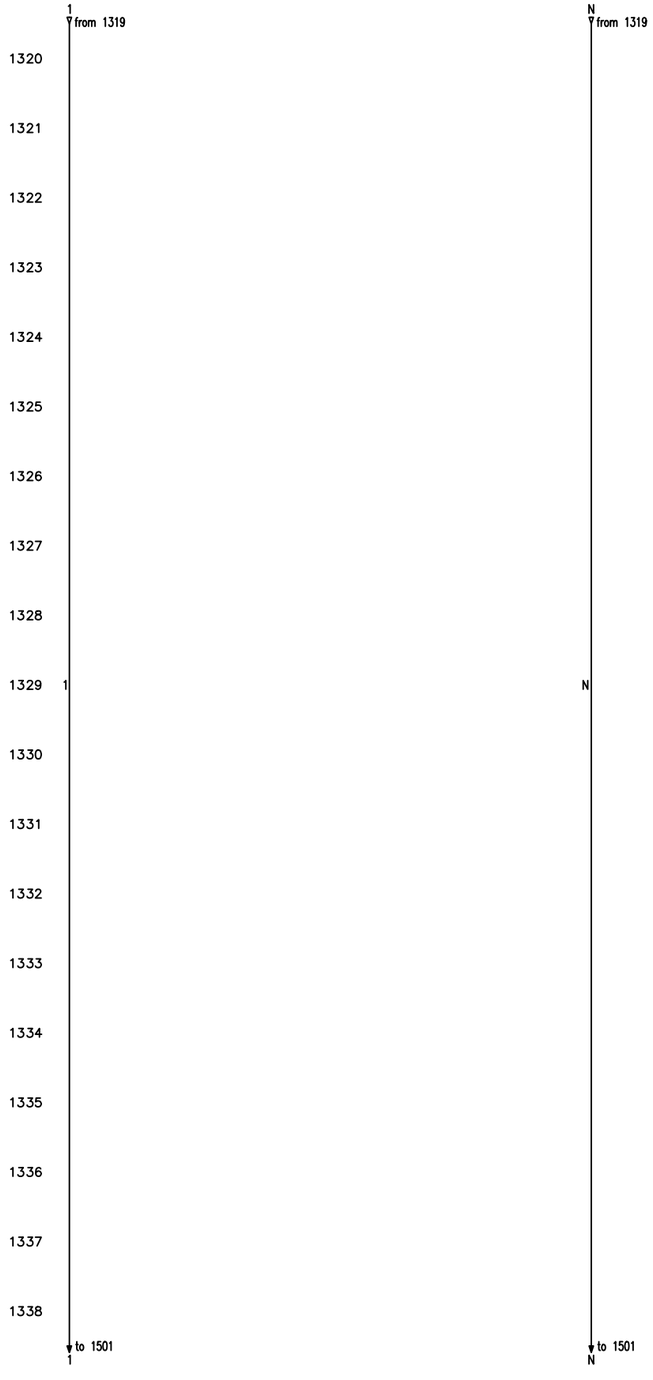

TOLERANCES	REVISIONS	POMONKEY PUMP STATION IMPROVEMENTS 120VAC WIRING DIAGRAM	
DECIMAL	NO. DATE BY 1 2	S-L CONTROLS	
FRACTIONAL	3 4	DRAWN BY ZBB	SCALE NONE
ANGULAR	5 6	CHK'D MN	DATE 11-11-2026
		TRACED	APP'D
		MATERIAL	DRAWING NUMBER 32384-13

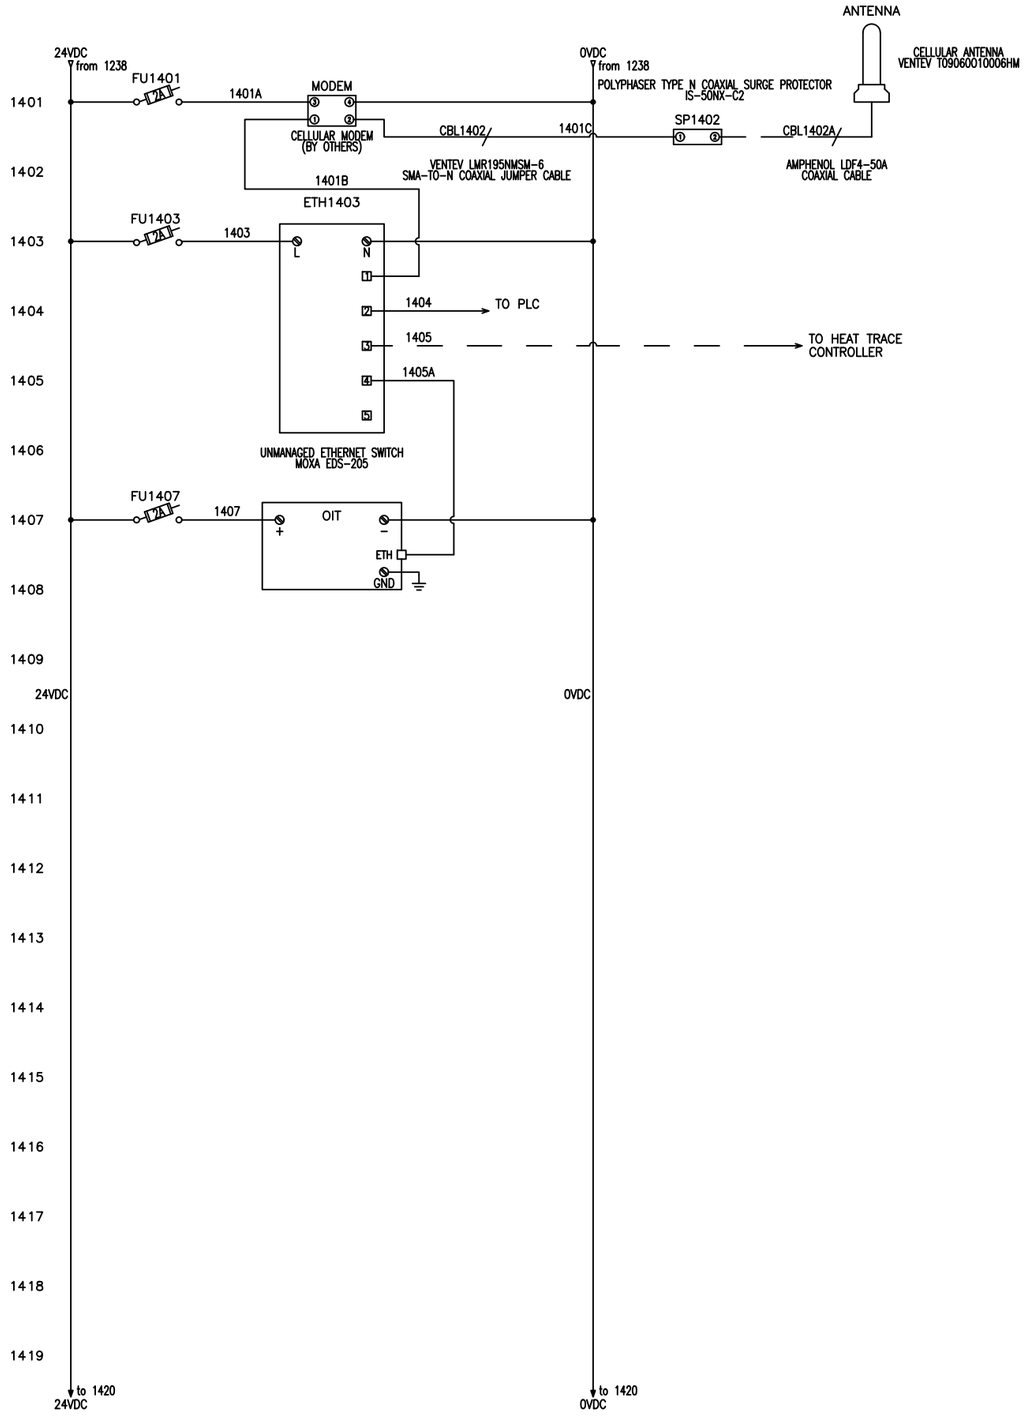

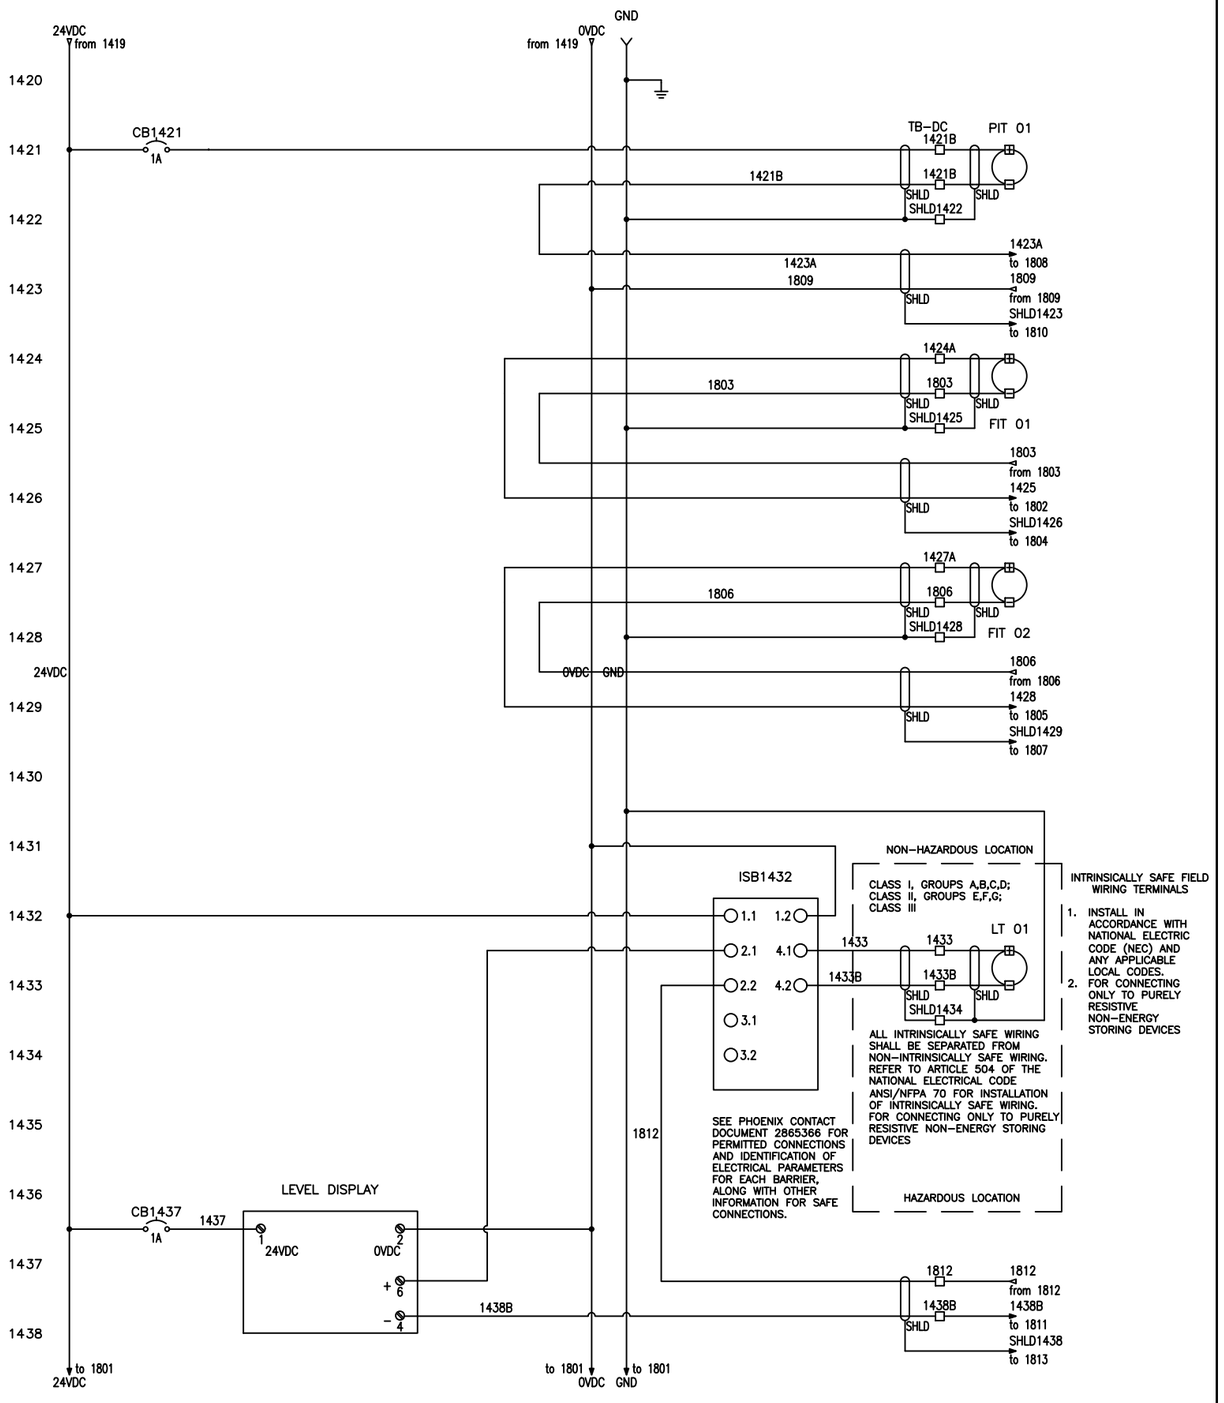


TOLERANCES	REVISIONS		
	NO.	DATE	BY
DECIMAL	1		
	2		
FRACTIONAL	3		
	4		
ANGULAR	5		
	6		

POMONKEY PUMP STATION IMPROVEMENTS
24VDC WIRING DIAGRAM

S-L CONTROLS

DRAWN BY ZBB	SCALE NONE	MATERIAL
CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-14
TRACED	APP'D	

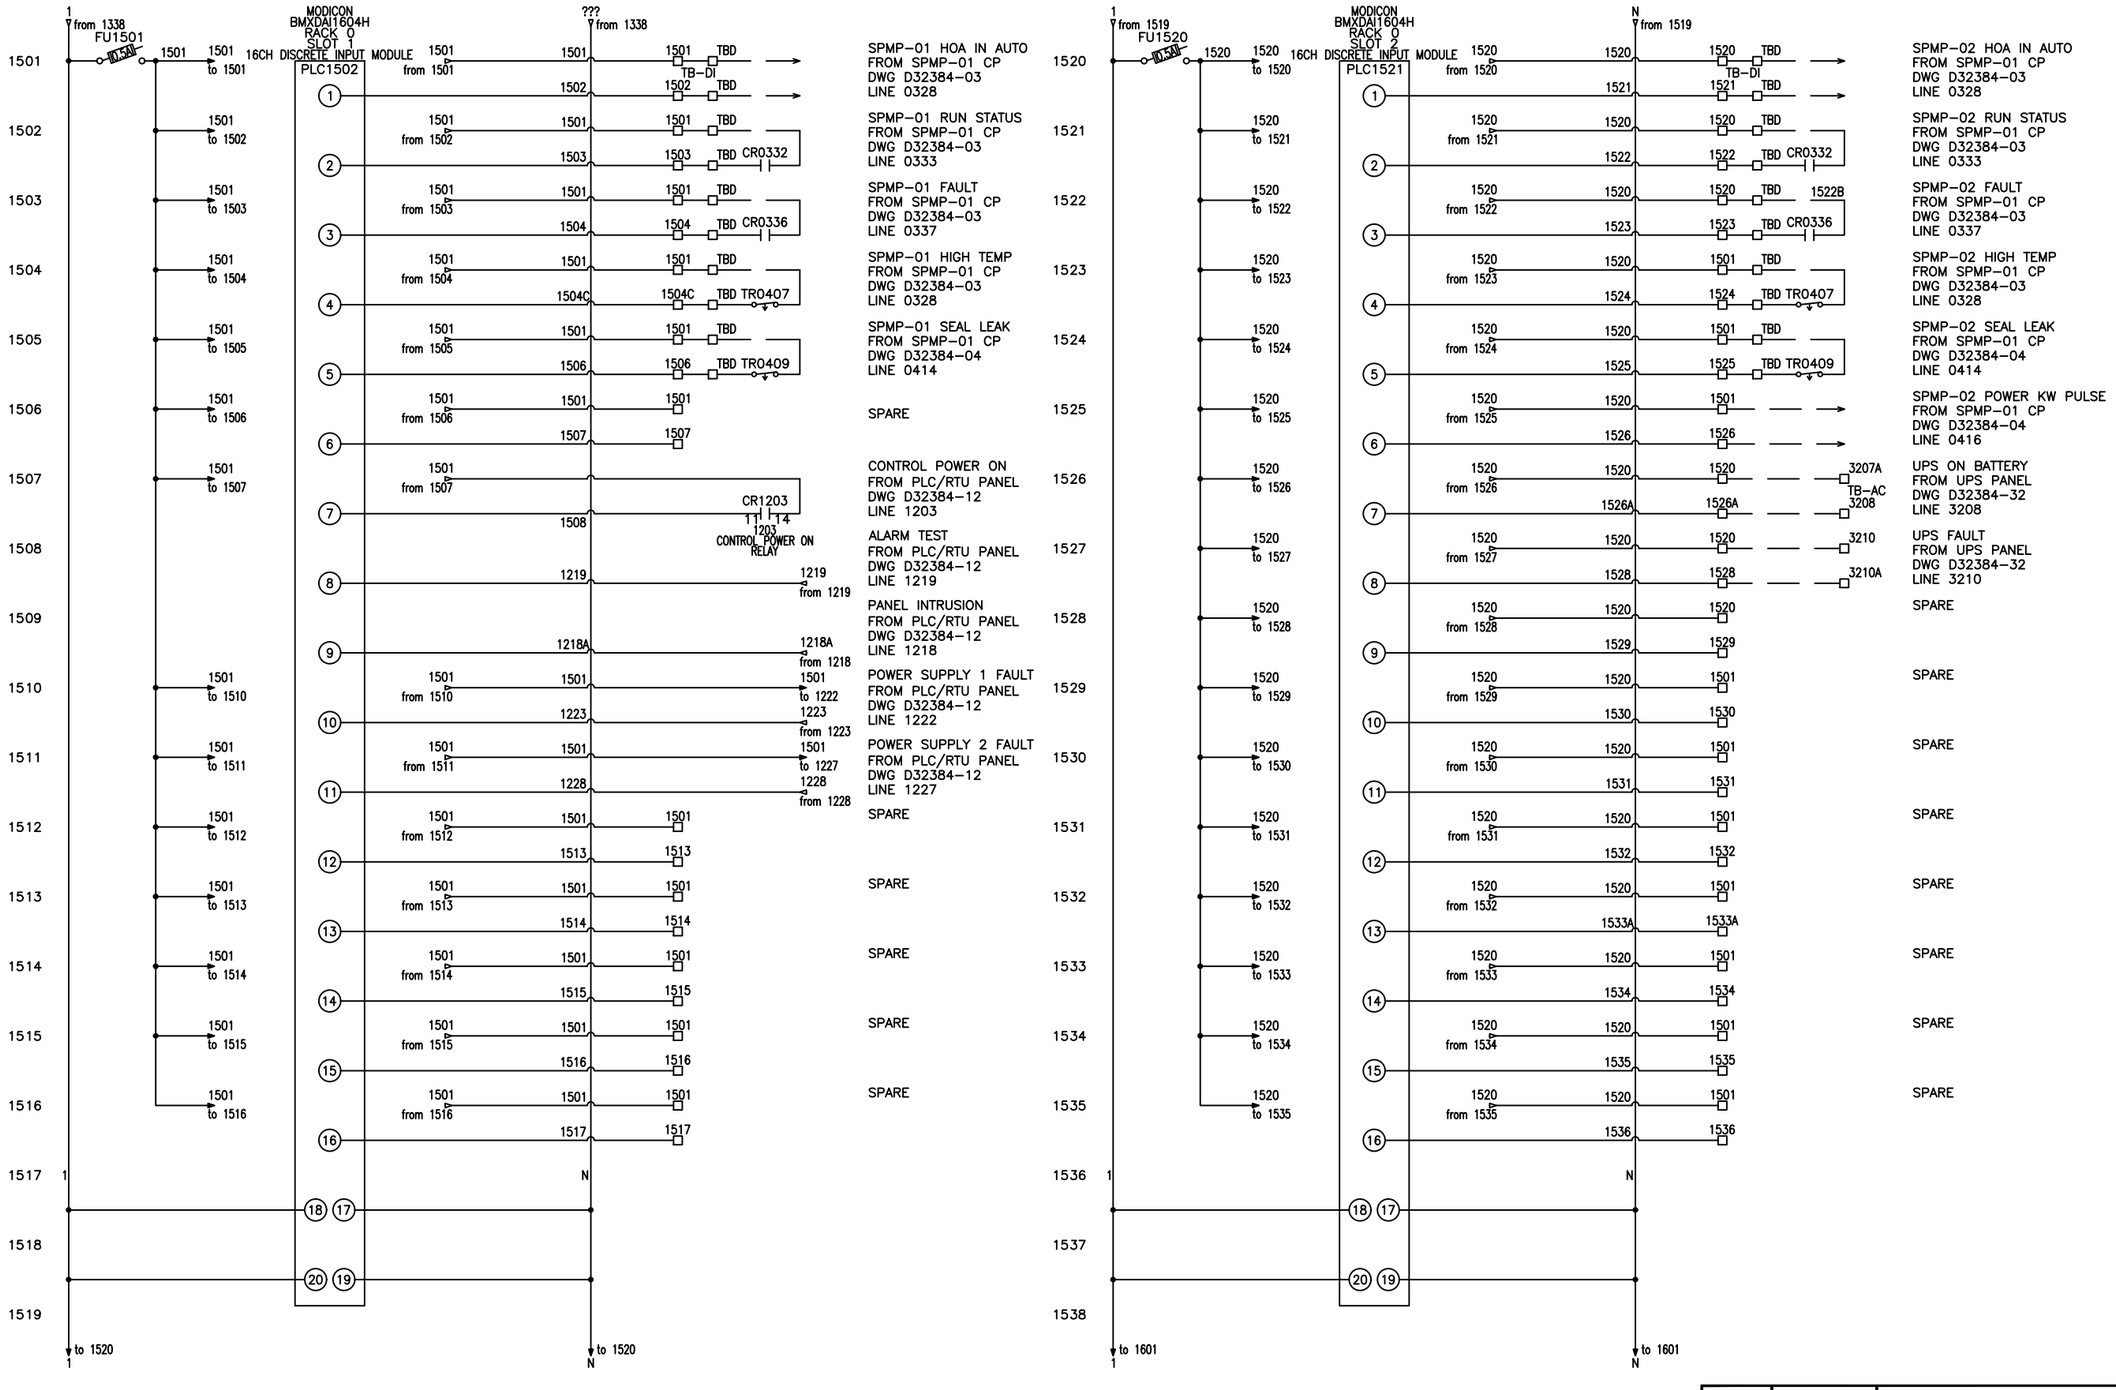


TOLERANCES	REVISIONS NO.	DATE	BY
DECIMAL	1		
	2		
FRACTIONAL	3		
	4		
ANGULAR	5		
	6		

POMONKEY PUMP STATION IMPROVEMENTS
DIGITAL INPUT WIRING DIAGRAM

SJ CONTROLS

DRAWN BY ZBB	SCALE NONE	MATERIAL
CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-15
TRACED	APP'D	

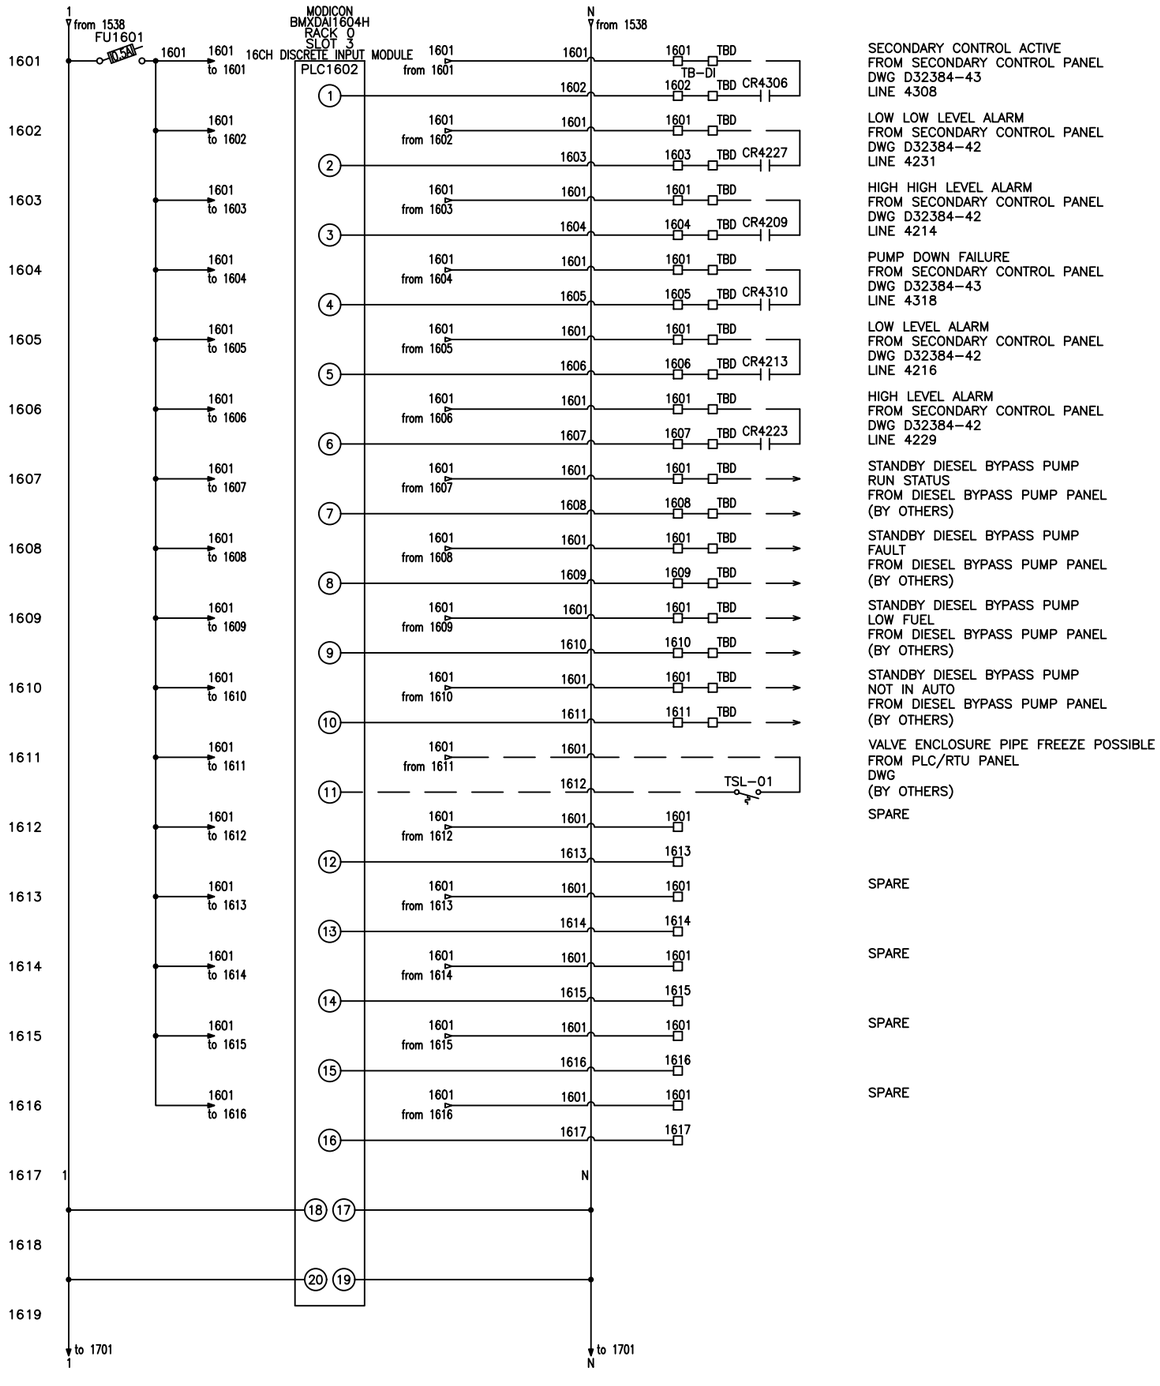

SECONDARY CONTROL ACTIVE
FROM SECONDARY CONTROL PANEL
DWG D32384-43
LINE 4308

LOW LOW LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4231

HIGH HIGH LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4214

PUMP DOWN FAILURE
FROM SECONDARY CONTROL PANEL
DWG D32384-43
LINE 4318

LOW LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4216

HIGH LEVEL ALARM
FROM SECONDARY CONTROL PANEL
DWG D32384-42
LINE 4229

STANDBY DIESEL BYPASS PUMP
RUN STATUS
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
FAULT
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
LOW FUEL
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

STANDBY DIESEL BYPASS PUMP
NOT IN AUTO
FROM DIESEL BYPASS PUMP PANEL
(BY OTHERS)

VALVE ENCLOSURE PIPE FREEZE POSSIBLE
FROM PLC/RTU PANEL
DWG
(BY OTHERS)

SPARE


SPARE

SPARE

SPARE

SPARE

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS DIGITAL INPUT WIRING DIAGRAM	
	NO.	DATE	BY		
DECIMAL	1			SJL CONTROLS	
	2				
FRACTIONAL	3				
	4				
ANGULAR	5				
	6				
	DRAWN BY ZBB	SCALE NONE	MATERIAL		
	CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-16		
	TRACED	APP'D			

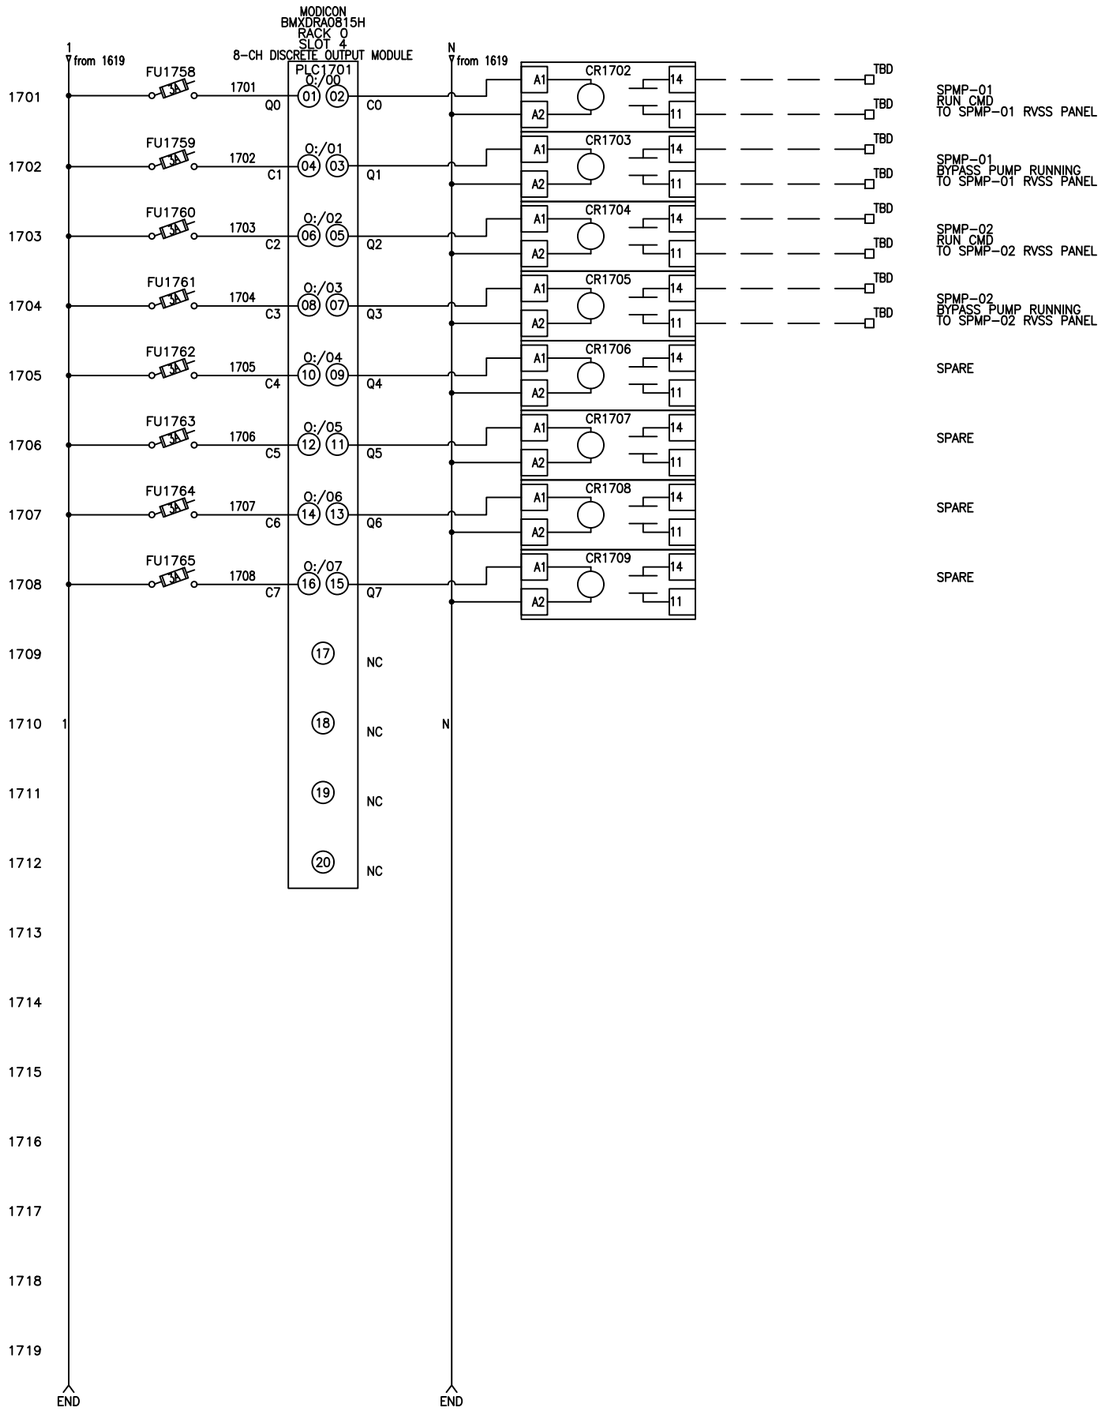


TOLERANCES	REVISIONS		
	NO.	DATE	BY
DECIMAL	1		
	2		
FRACTIONAL	3		
	4		
ANGULAR	5		
	6		

POMONKEY PUMP STATION IMPROVEMENTS
DIGITAL OUTPUT WIRING DIAGRAM

SJ CONTROLS

DRAWN BY	SCALE	MATERIAL
ZBB	NONE	
CHK'D	DATE	DRAWING NUMBER
MN	11-11-2026	32384-17
TRACED	APP'D	

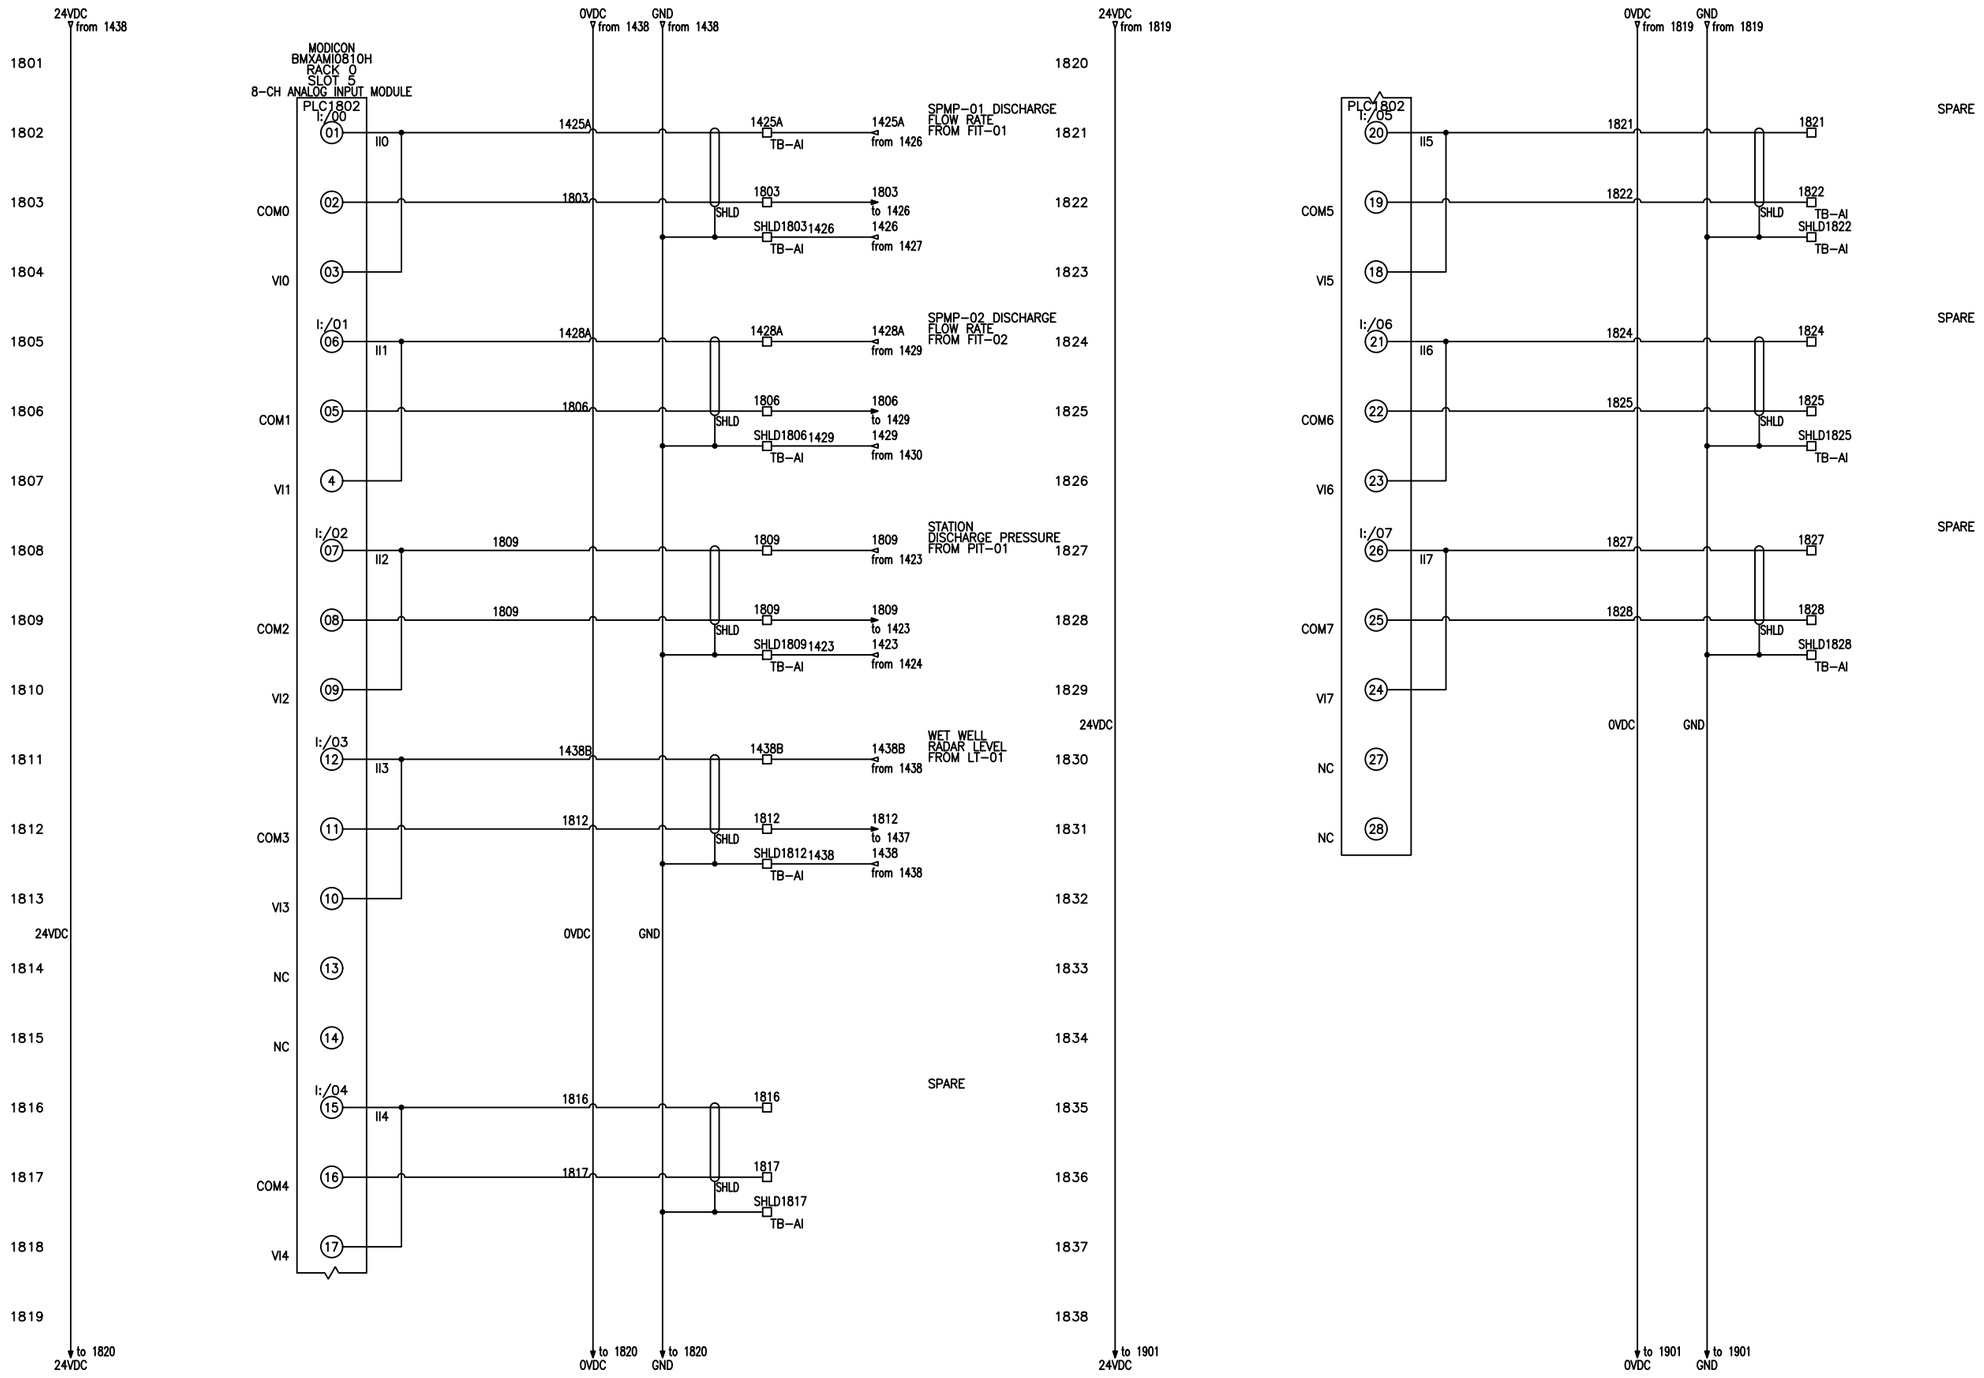



TOLERANCES	REVISIONS		
	NO.	DATE	BY
DECIMAL	1		
	2		
FRACTIONAL	3		
	4		
ANGULAR	5		
	6		

POMONKEY PUMP STATION IMPROVEMENTS
ANALOG INPUT WIRING DIAGRAM

S-1 CONTROLS

DRAWN BY ZBB	SCALE NONE	MATERIAL
CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-18
TRACED	APP'D	

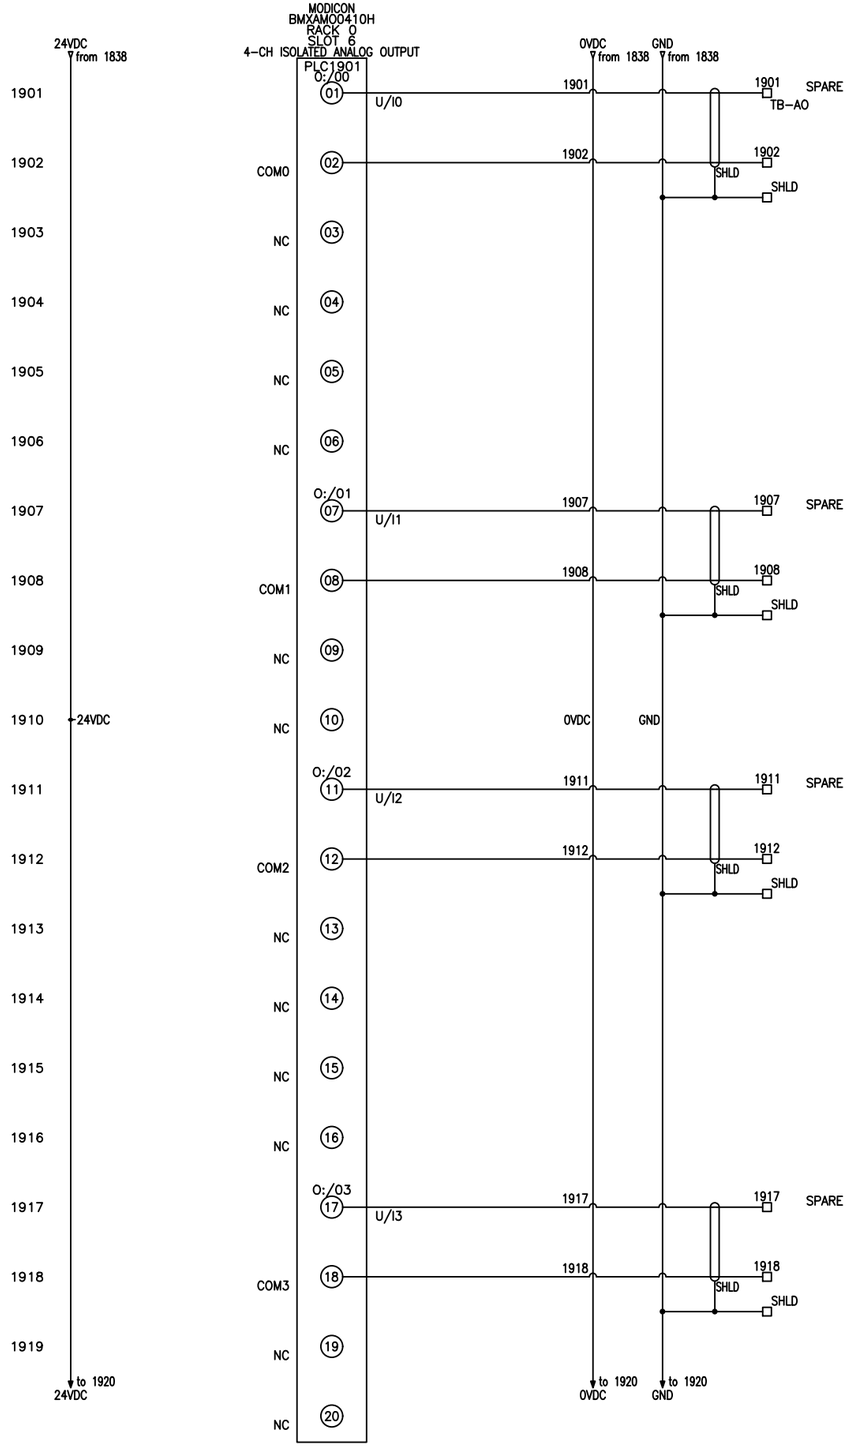

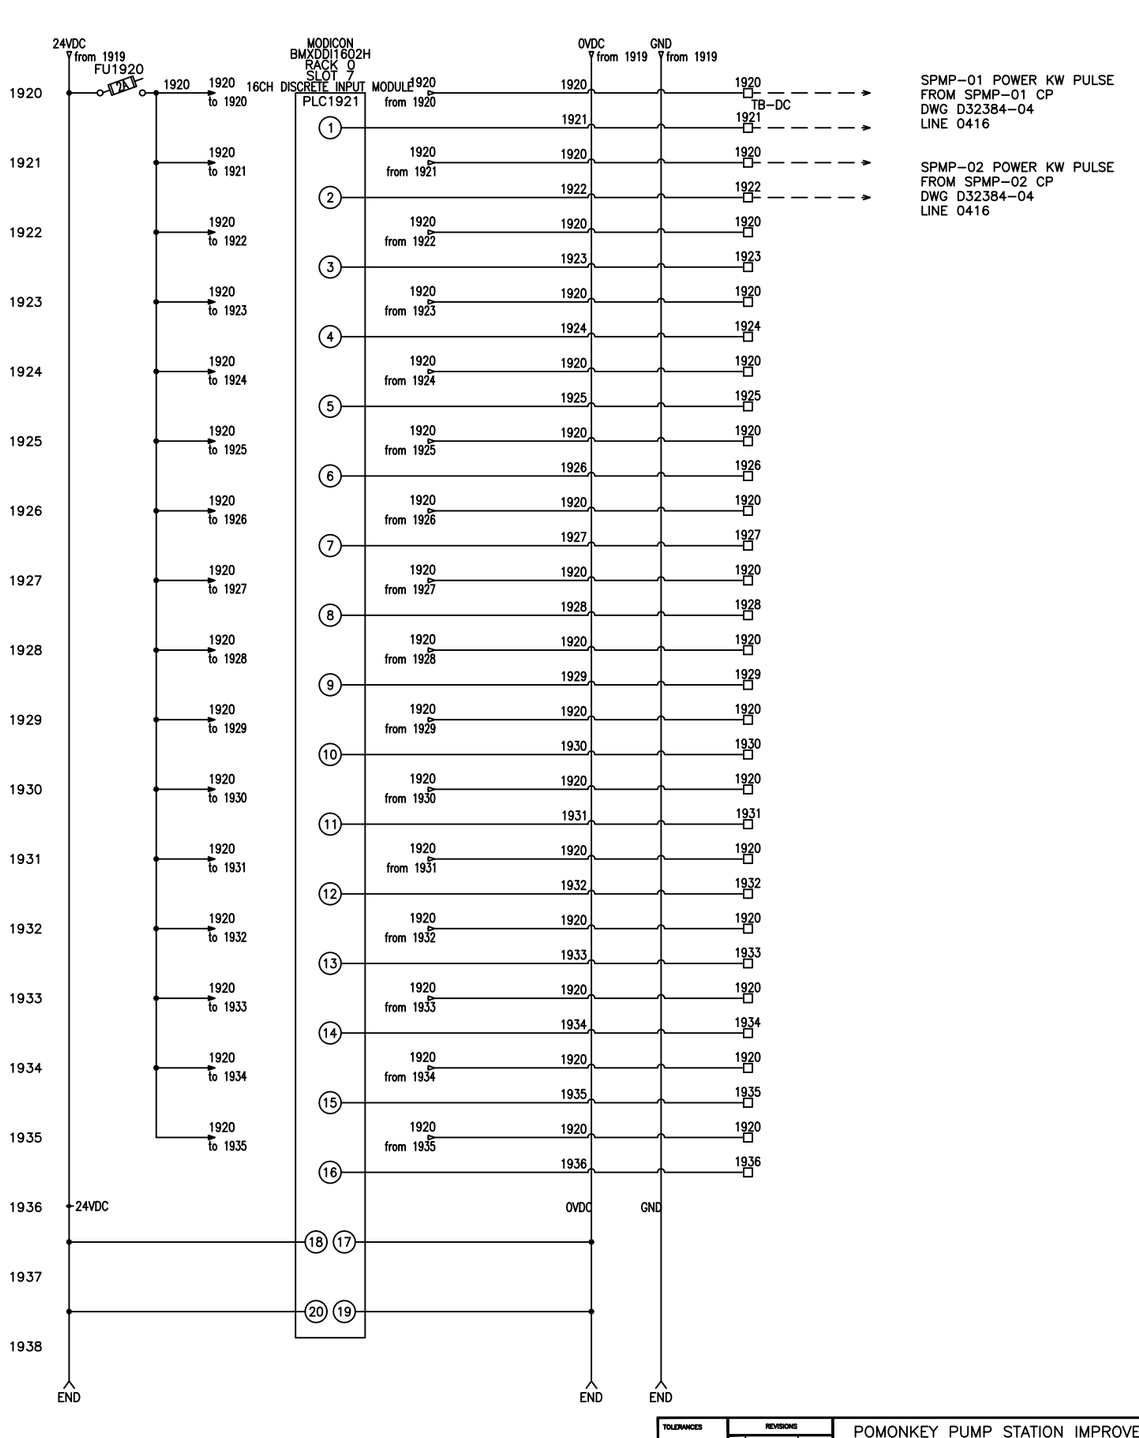

TOLERANCES	REVISIONS			POMONKEY PUMP STATION IMPROVEMENTS		
	NO.	DATE	BY	ANALOG OUTPUT WIRING DIAGRAM		
DECIMAL	1			S&L CONTROLS		
	2					
FRACTIONAL	3			DRAWN BY ZBB	SCALE NONE	MATERIAL
	4			CHK'D MN	DATE 11-11-2026	DRAWING NUMBER 32384-19
ANGULAR	5			TRACED	APP'D	
	6					