


NOTE THAT THE BACKPLATE MAY  
HAVE TO BE EXTENDED ABOVE THE  
PLC/RTU PANEL FOR MOUNTING THE  
TOP OF THE ENCLOSURE

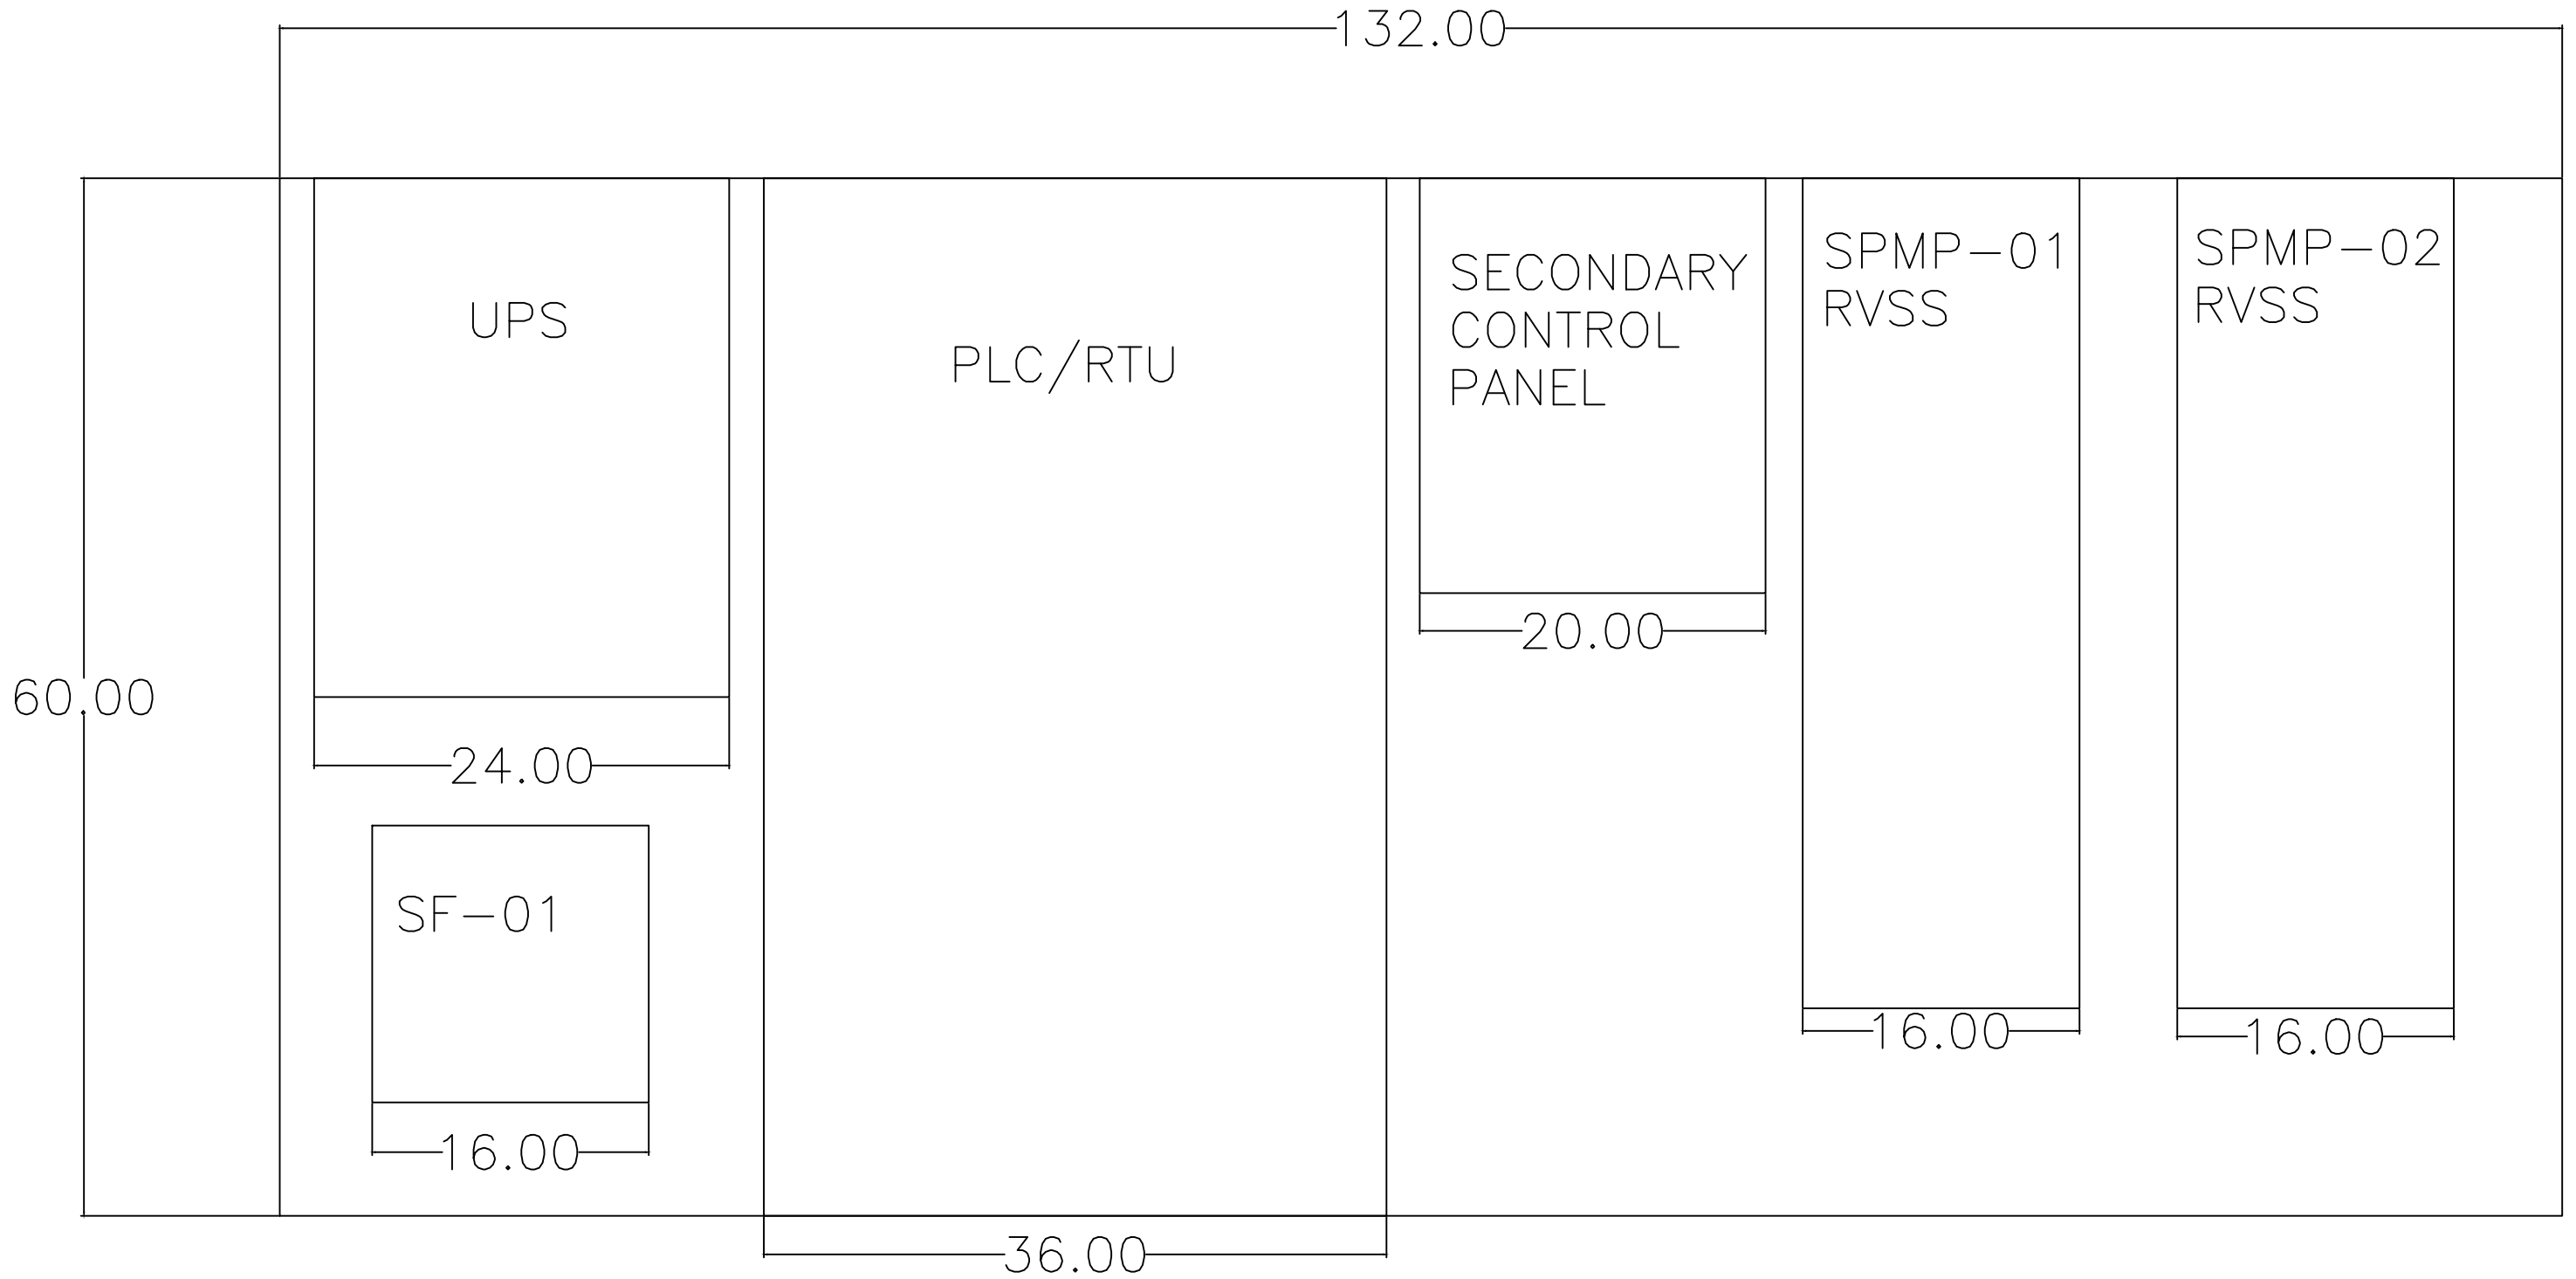

| TOLERANCES | REVISIONS |      |    | <div>SH CONTROLS</div> |            |                |
|------------|-----------|------|----|------------------------|------------|----------------|
|            | NO.       | DATE | BY |                        |            |                |
| DECIMAL    | 1         |      |    | <div>SH CONTROLS</div> |            |                |
|            | 2         |      |    |                        |            |                |
| FRACTIONAL | 3         |      |    | DRAWN BY ZBB           | SCALE NONE | MATERIAL       |
|            | 4         |      |    |                        |            |                |
| ANGULAR    | 5         |      |    | CHK'D                  | DATE       | DRAWING NUMBER |
|            | 6         |      |    |                        |            |                |
|            |           |      |    | TRACED                 | APP'D      | —              |