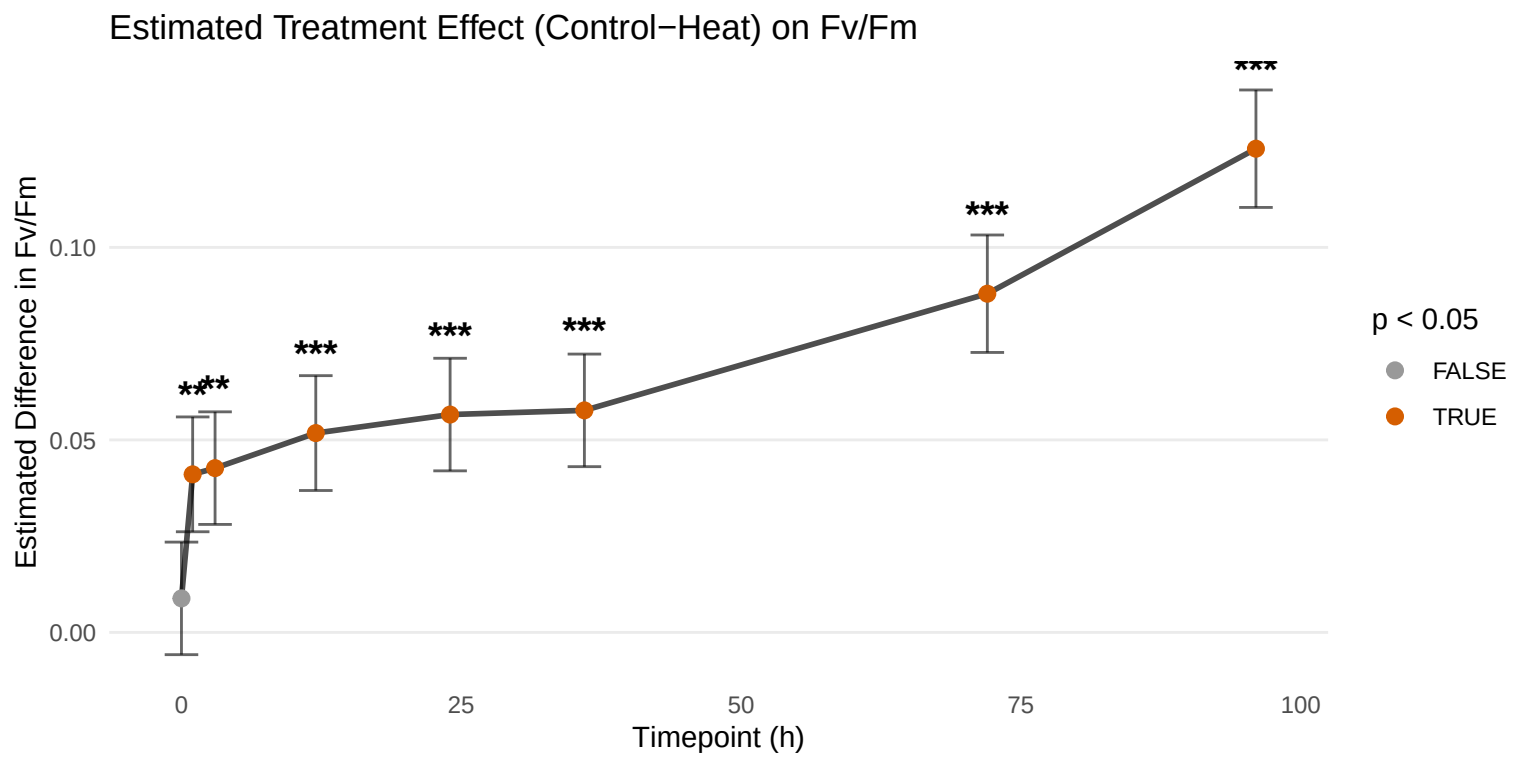
Estimated Treatment Effect (Control−Heat) on Fv/Fm
Estimated Difference in Fv/Fm
0.00
0.05
0.10
0
25
50
75
100
Timepoint (h)
**
**
***
***
***
***
***
p < 0.05
FALSE
TRUE