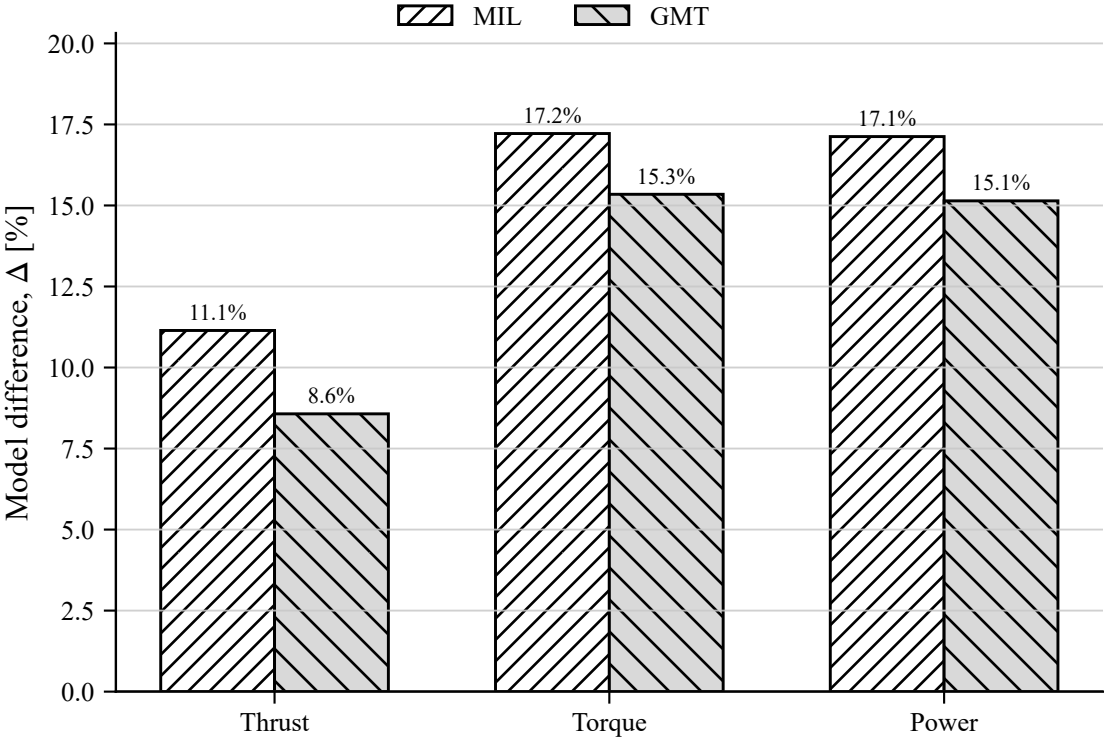

Positive Δ indicates XROTOR is lower than BEMT.