




Y/N Task sub-601 HT stim accuracy

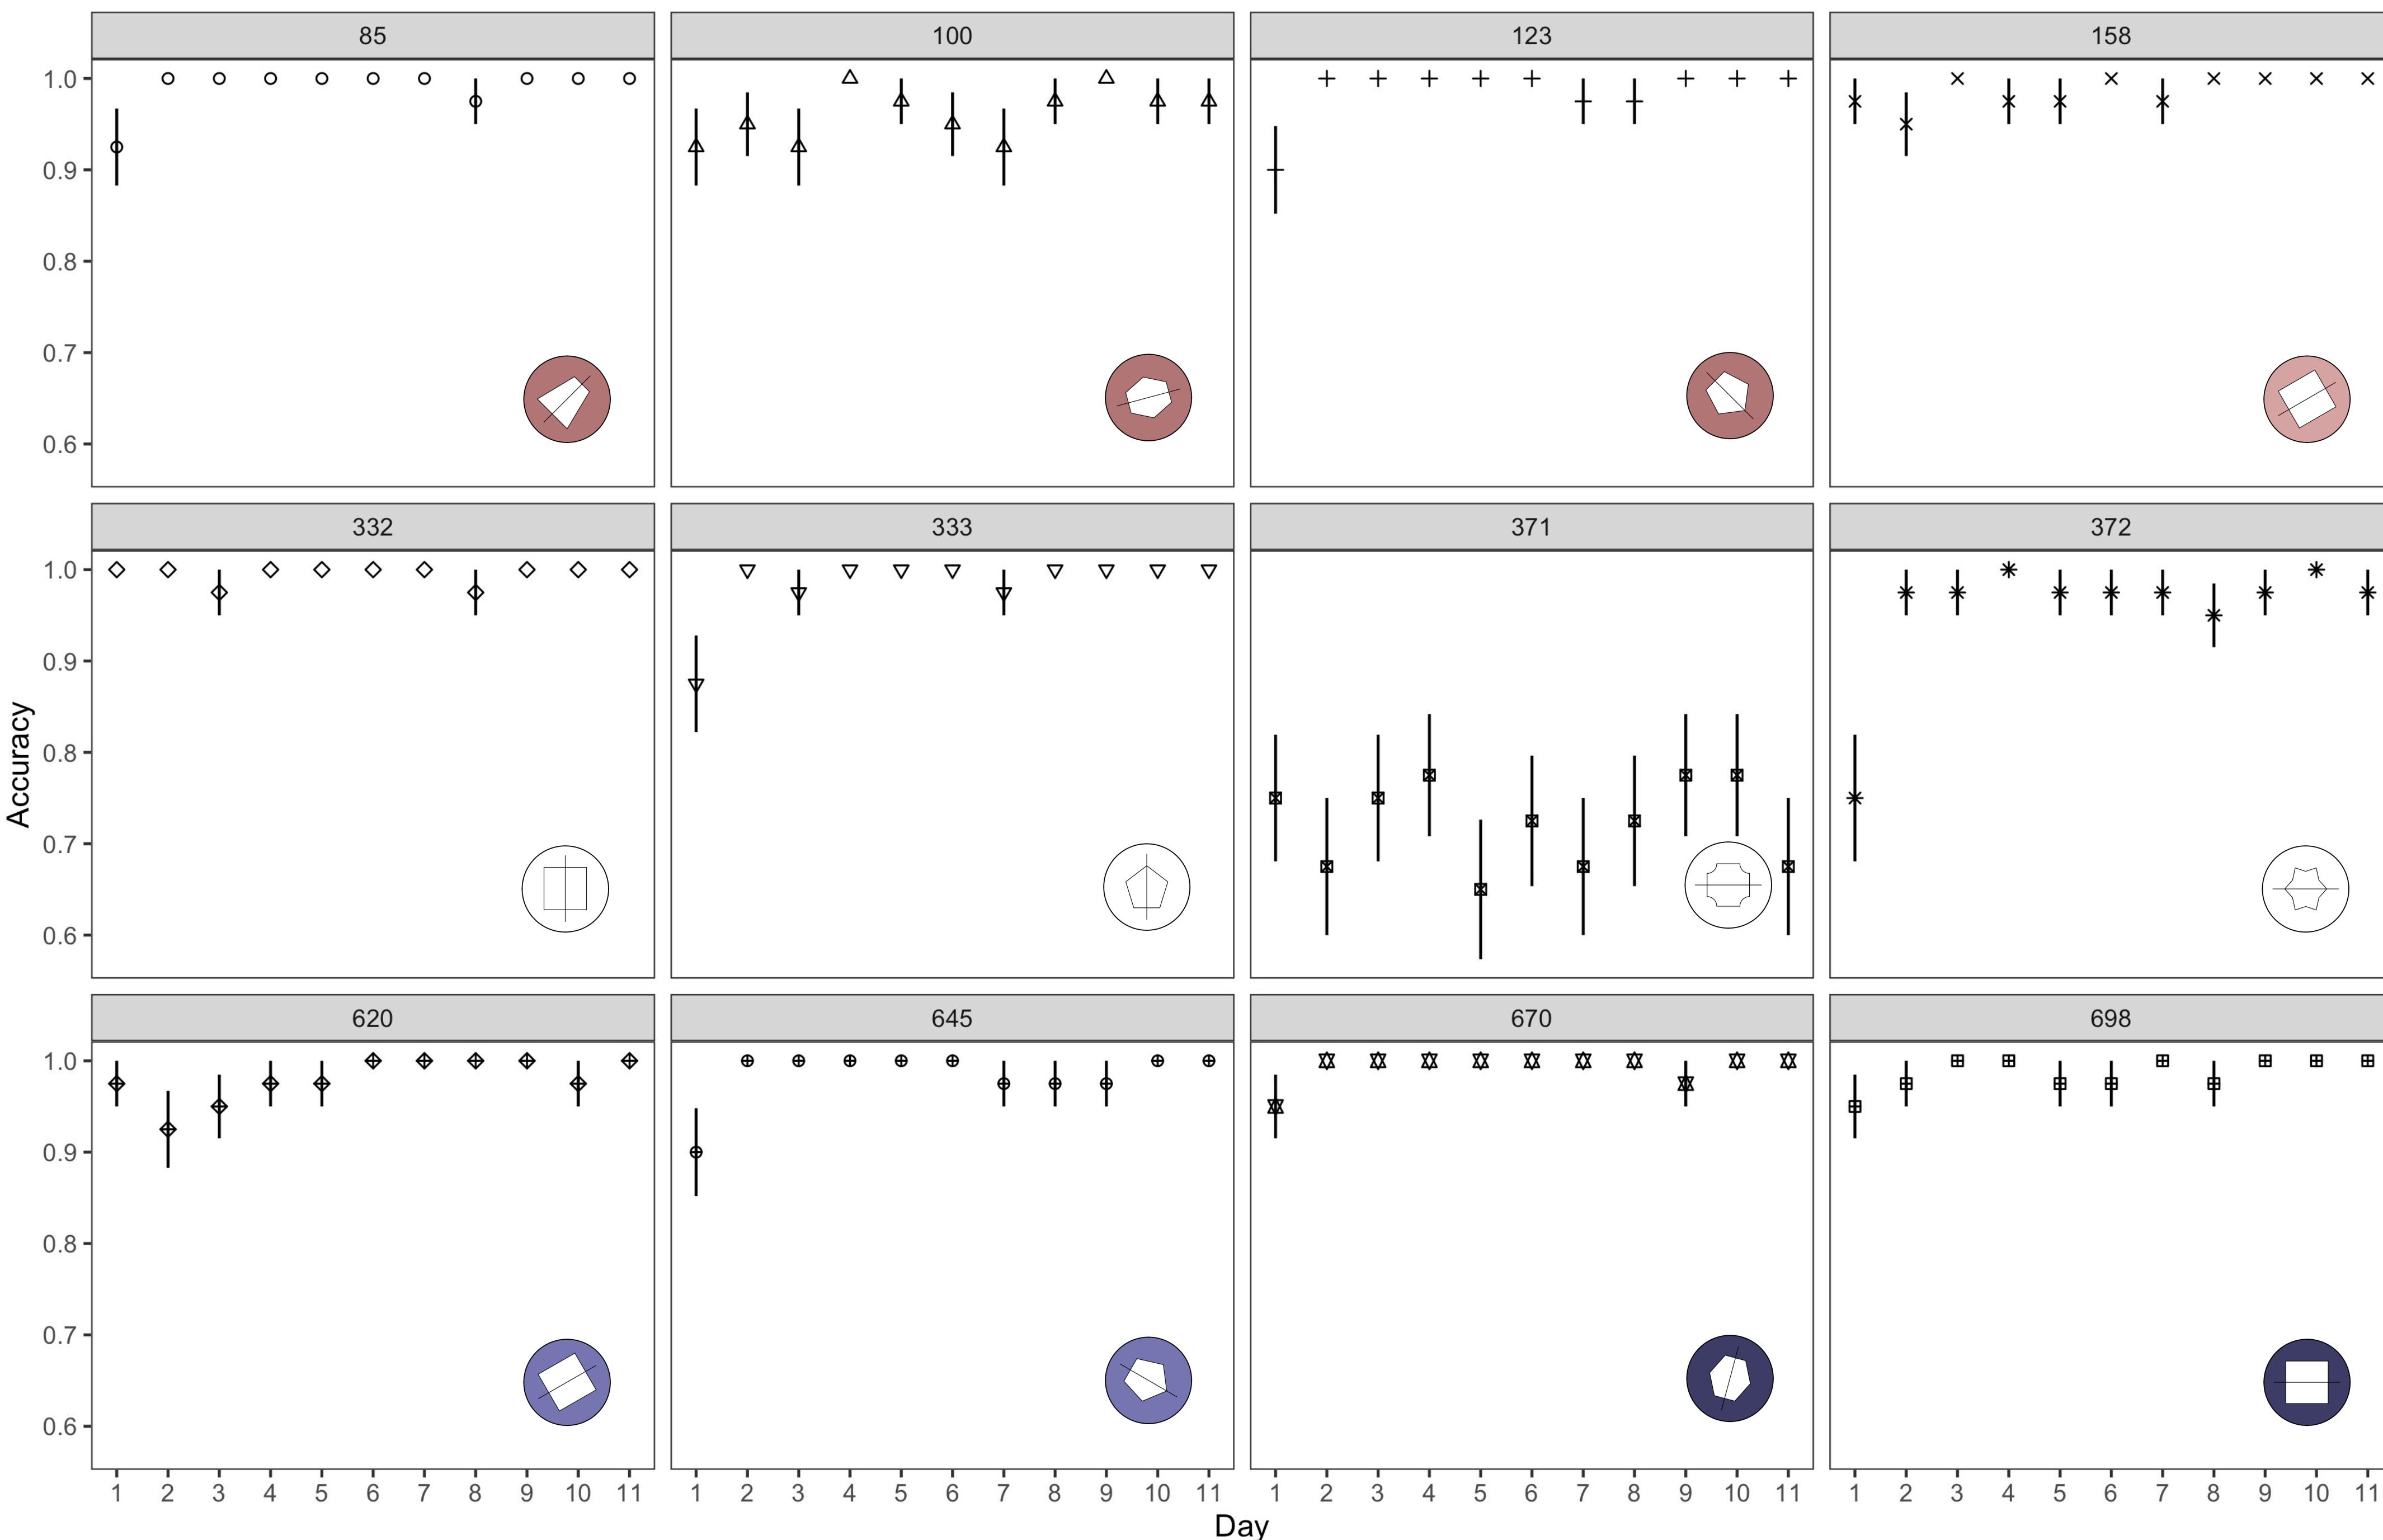


Y/N Task sub-601 HT stim mean log RT

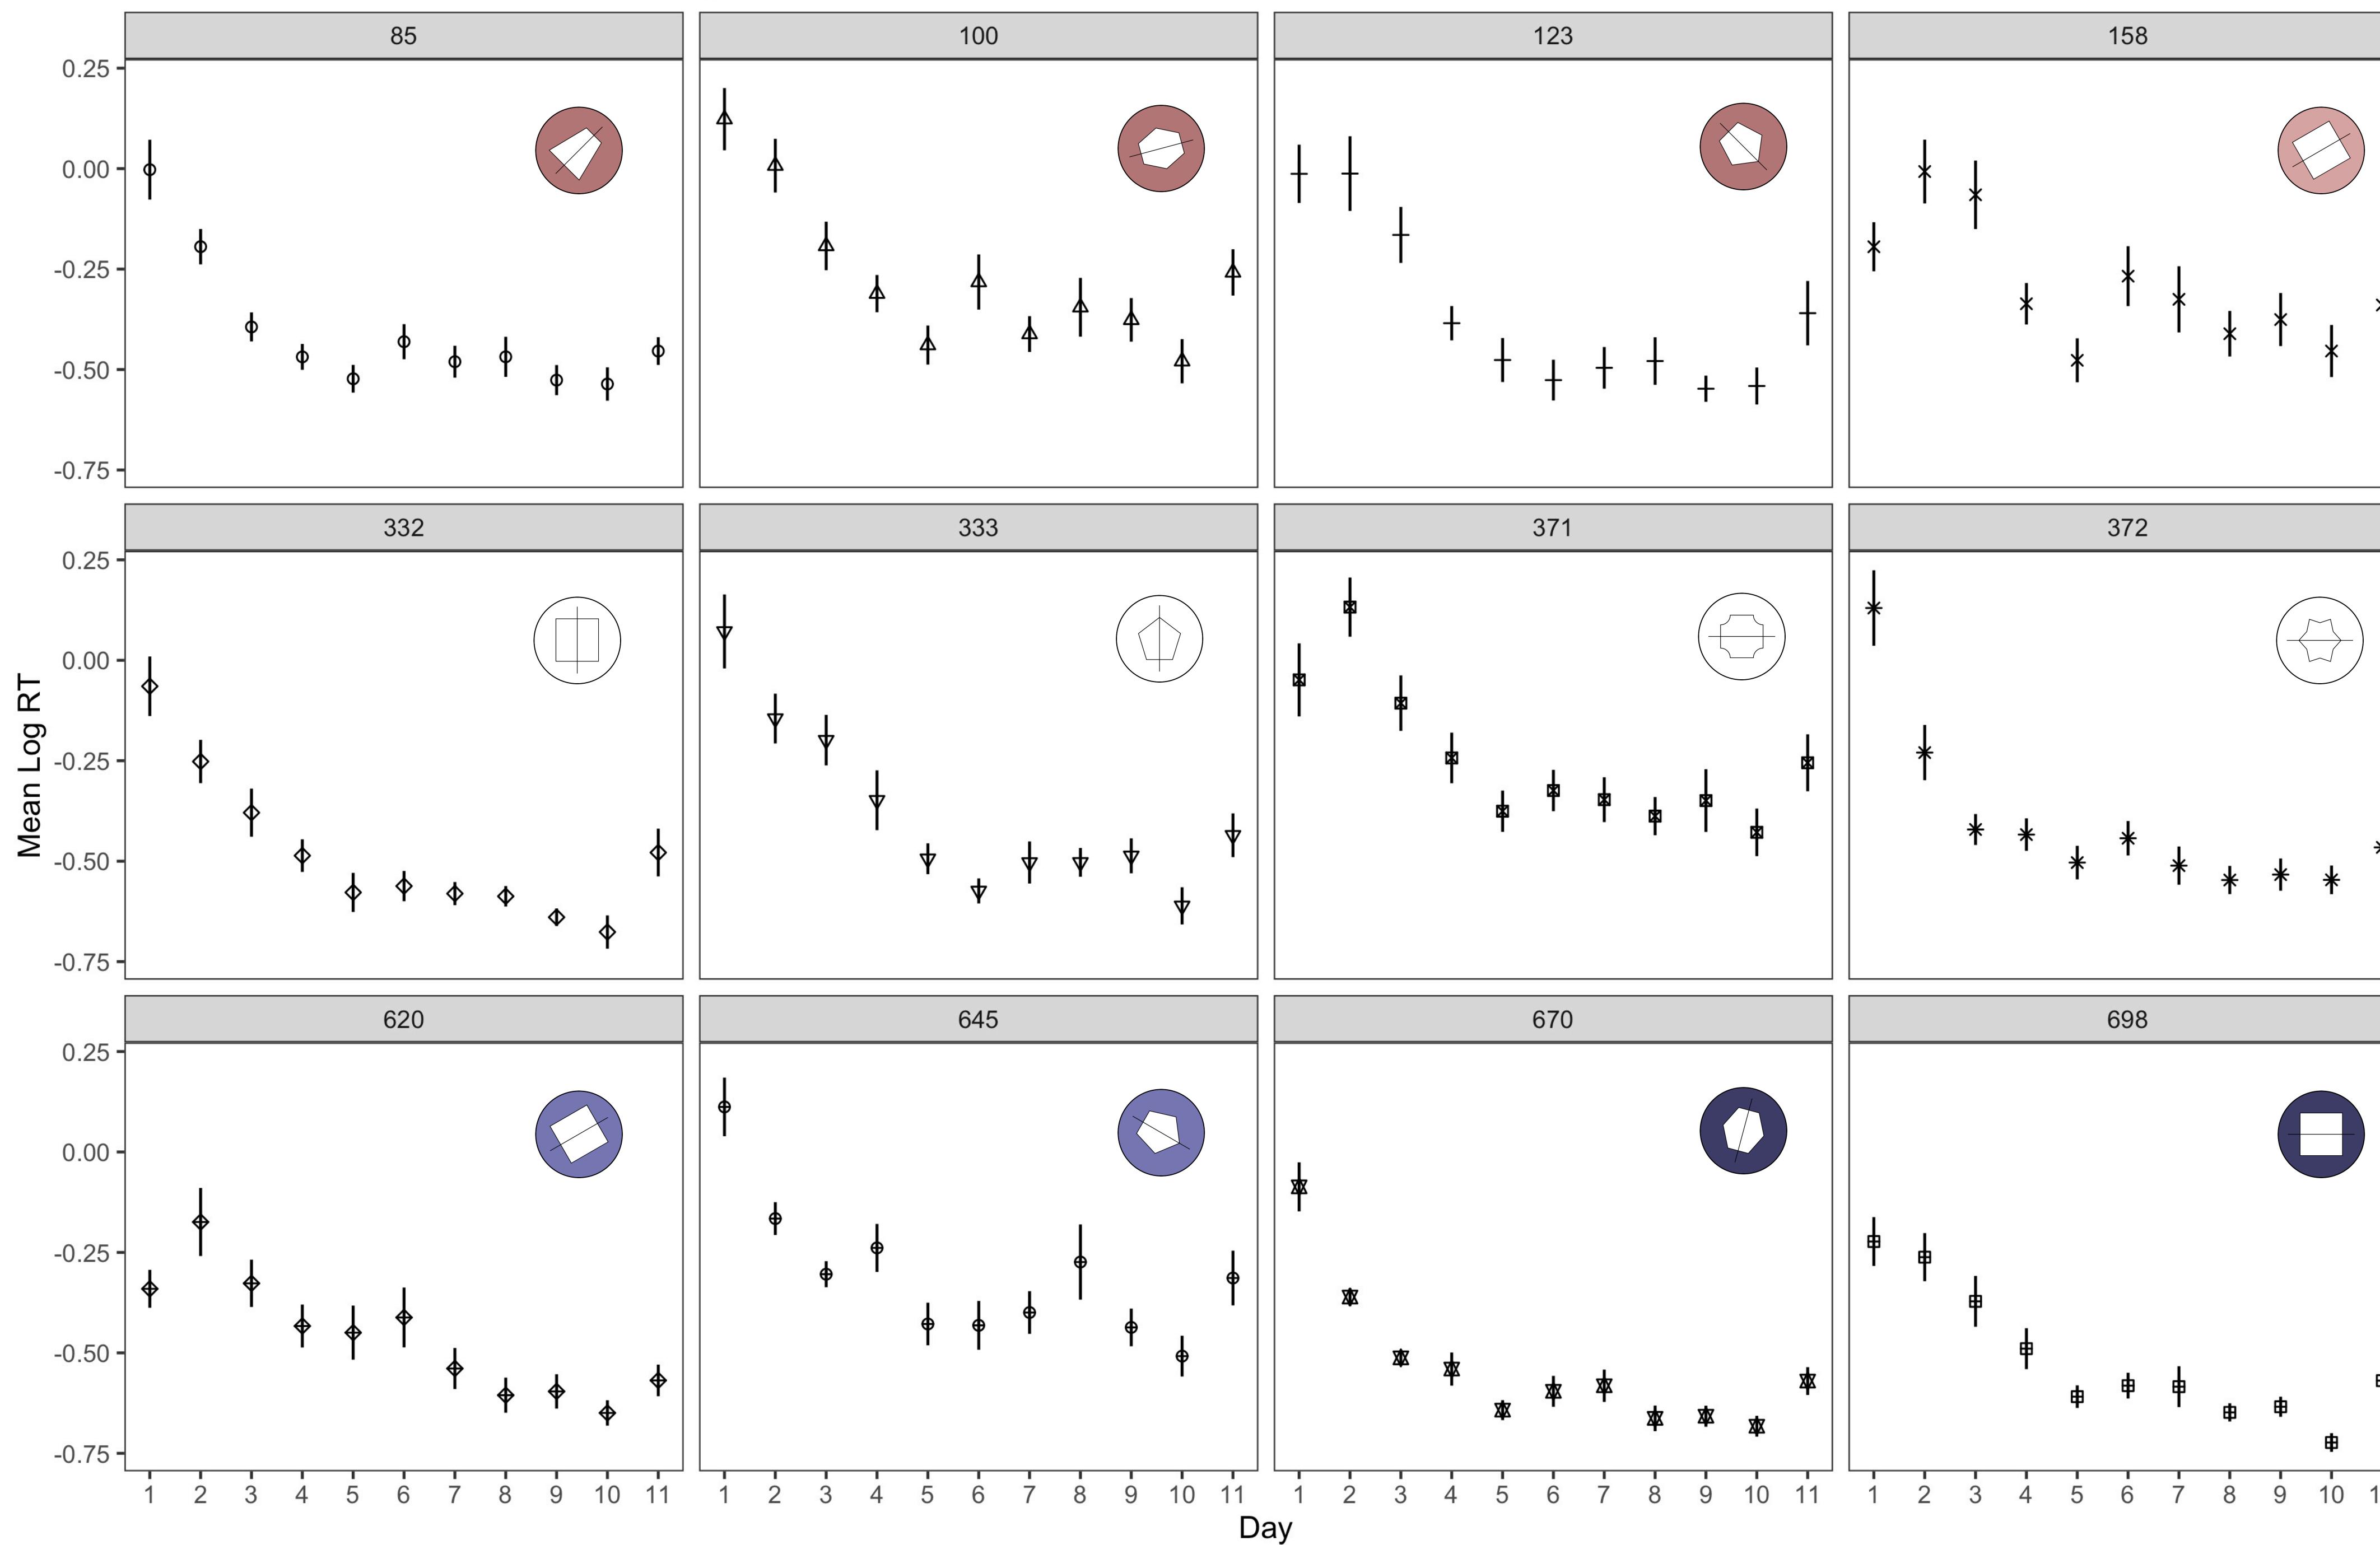


Y/N Task sub-609 HT stim accuracy

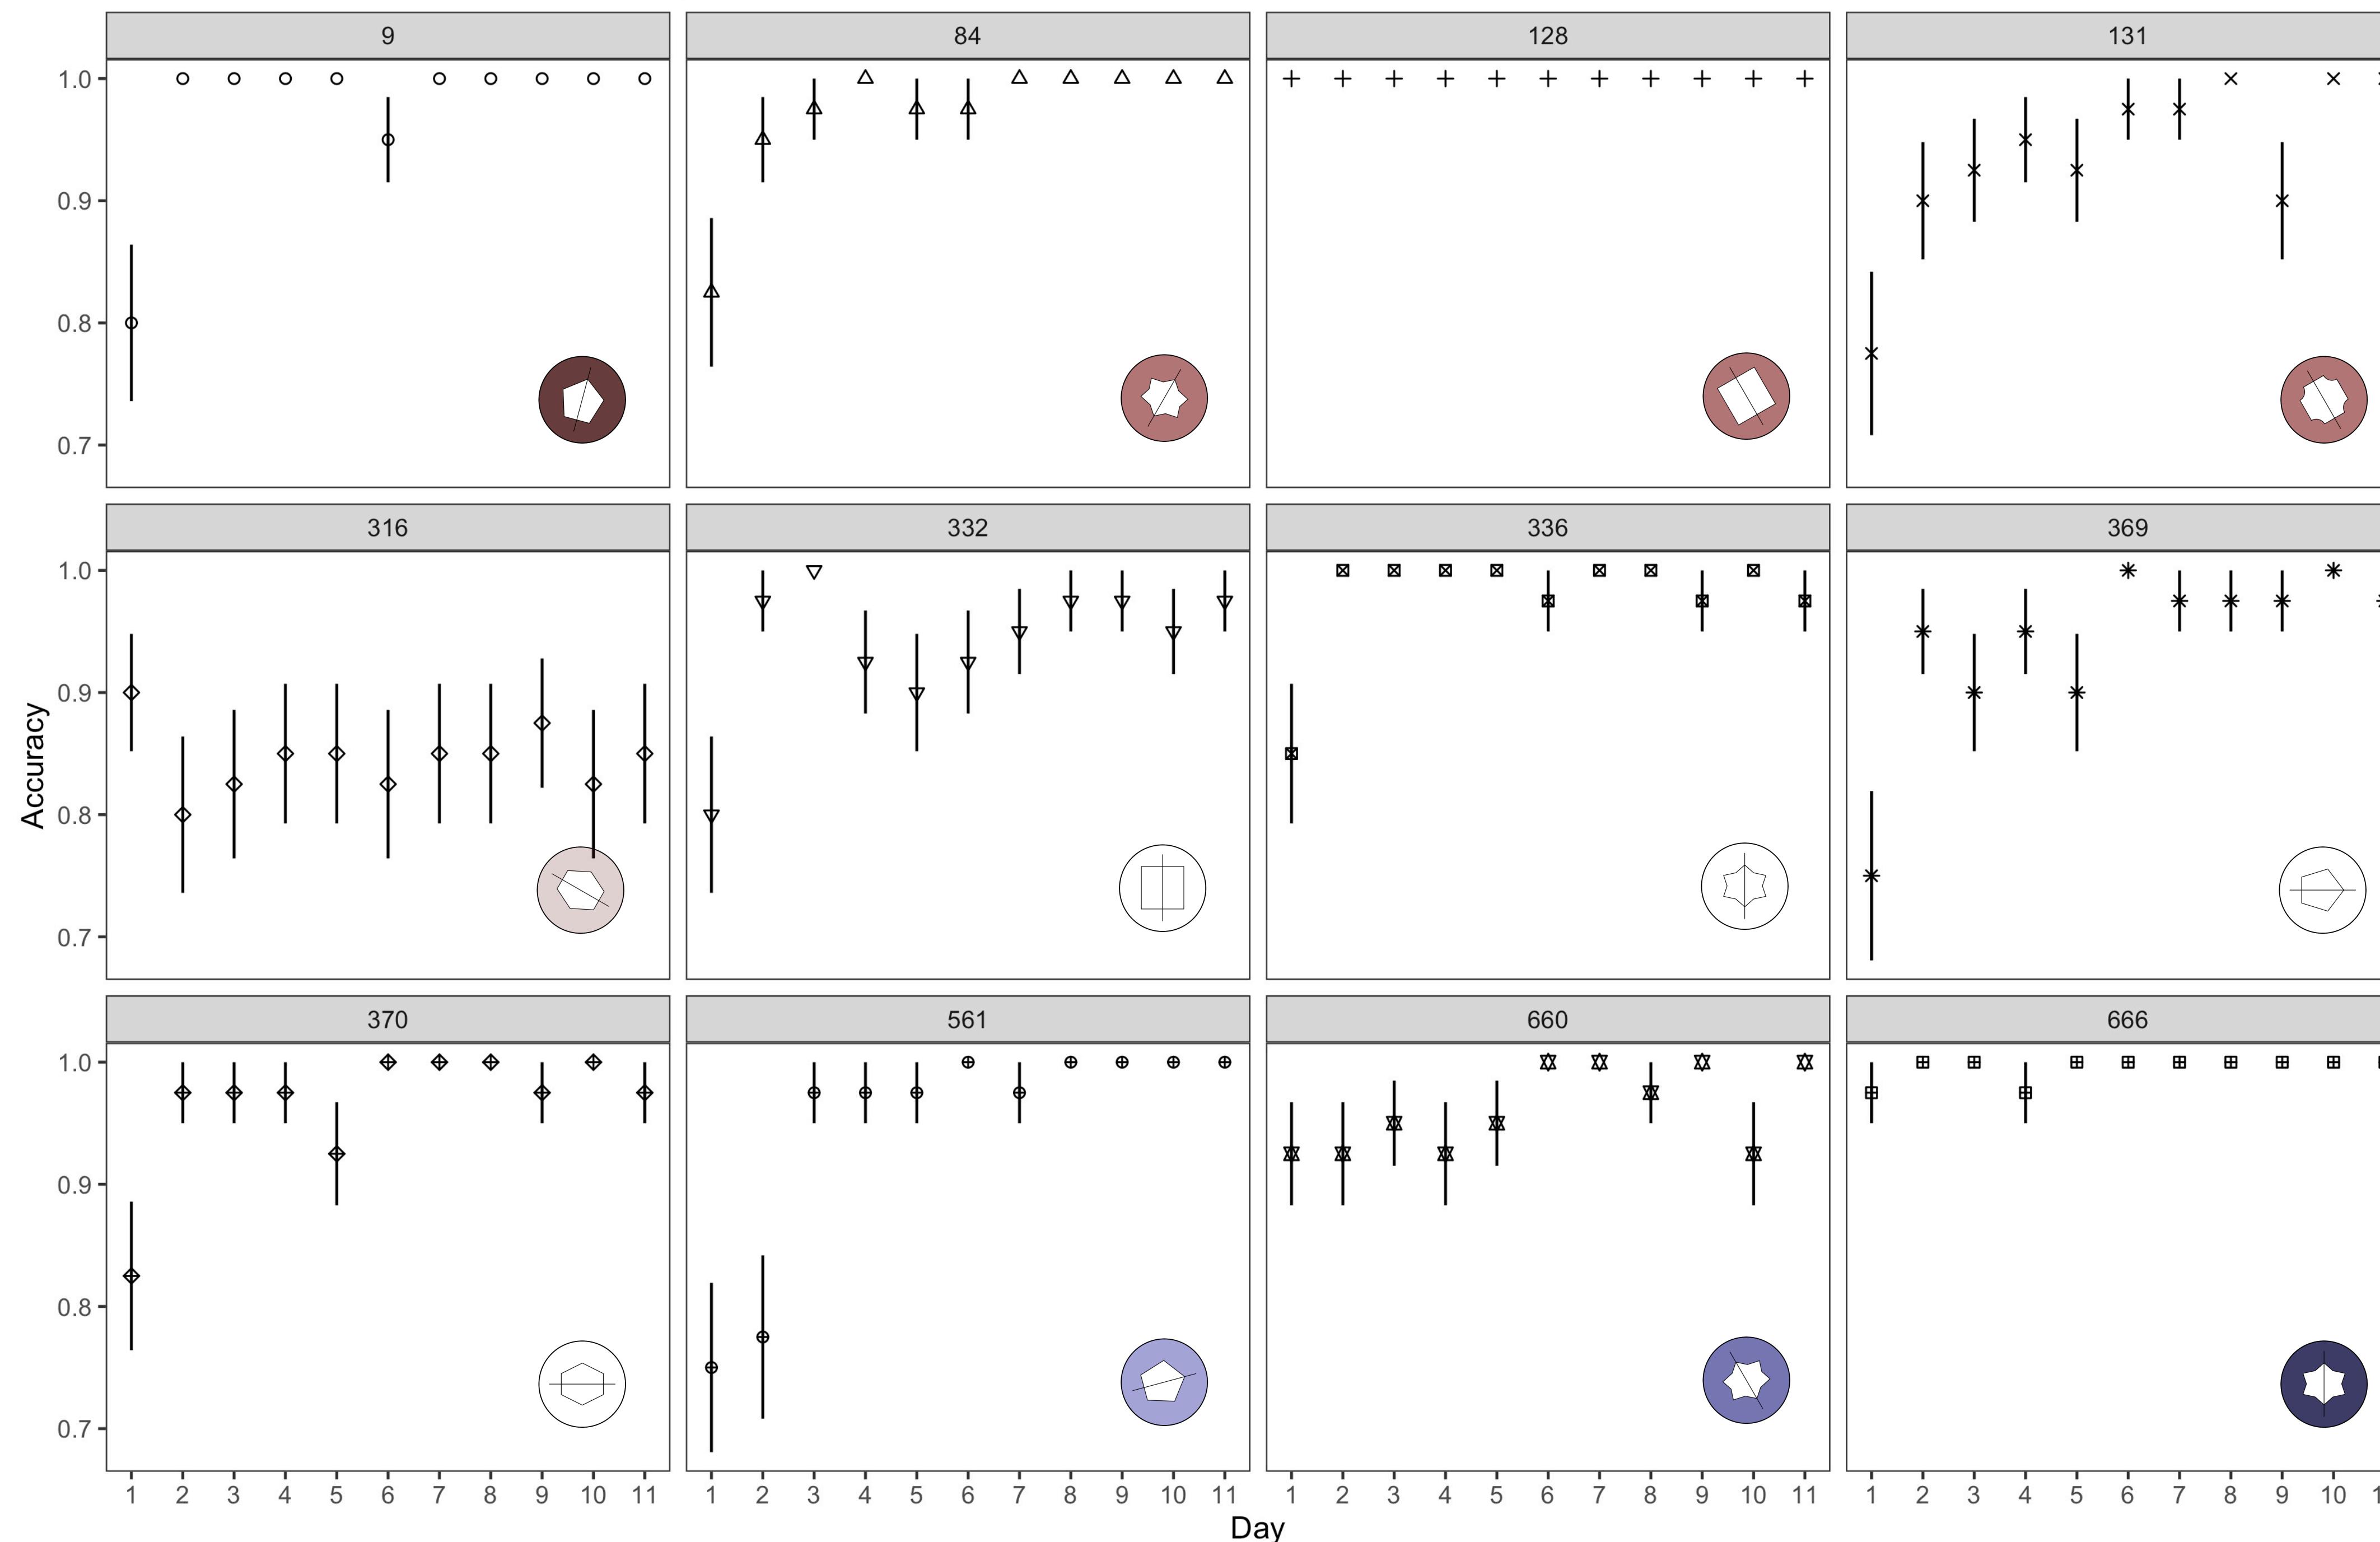


Y/N Task sub-609 HT stim mean log RT

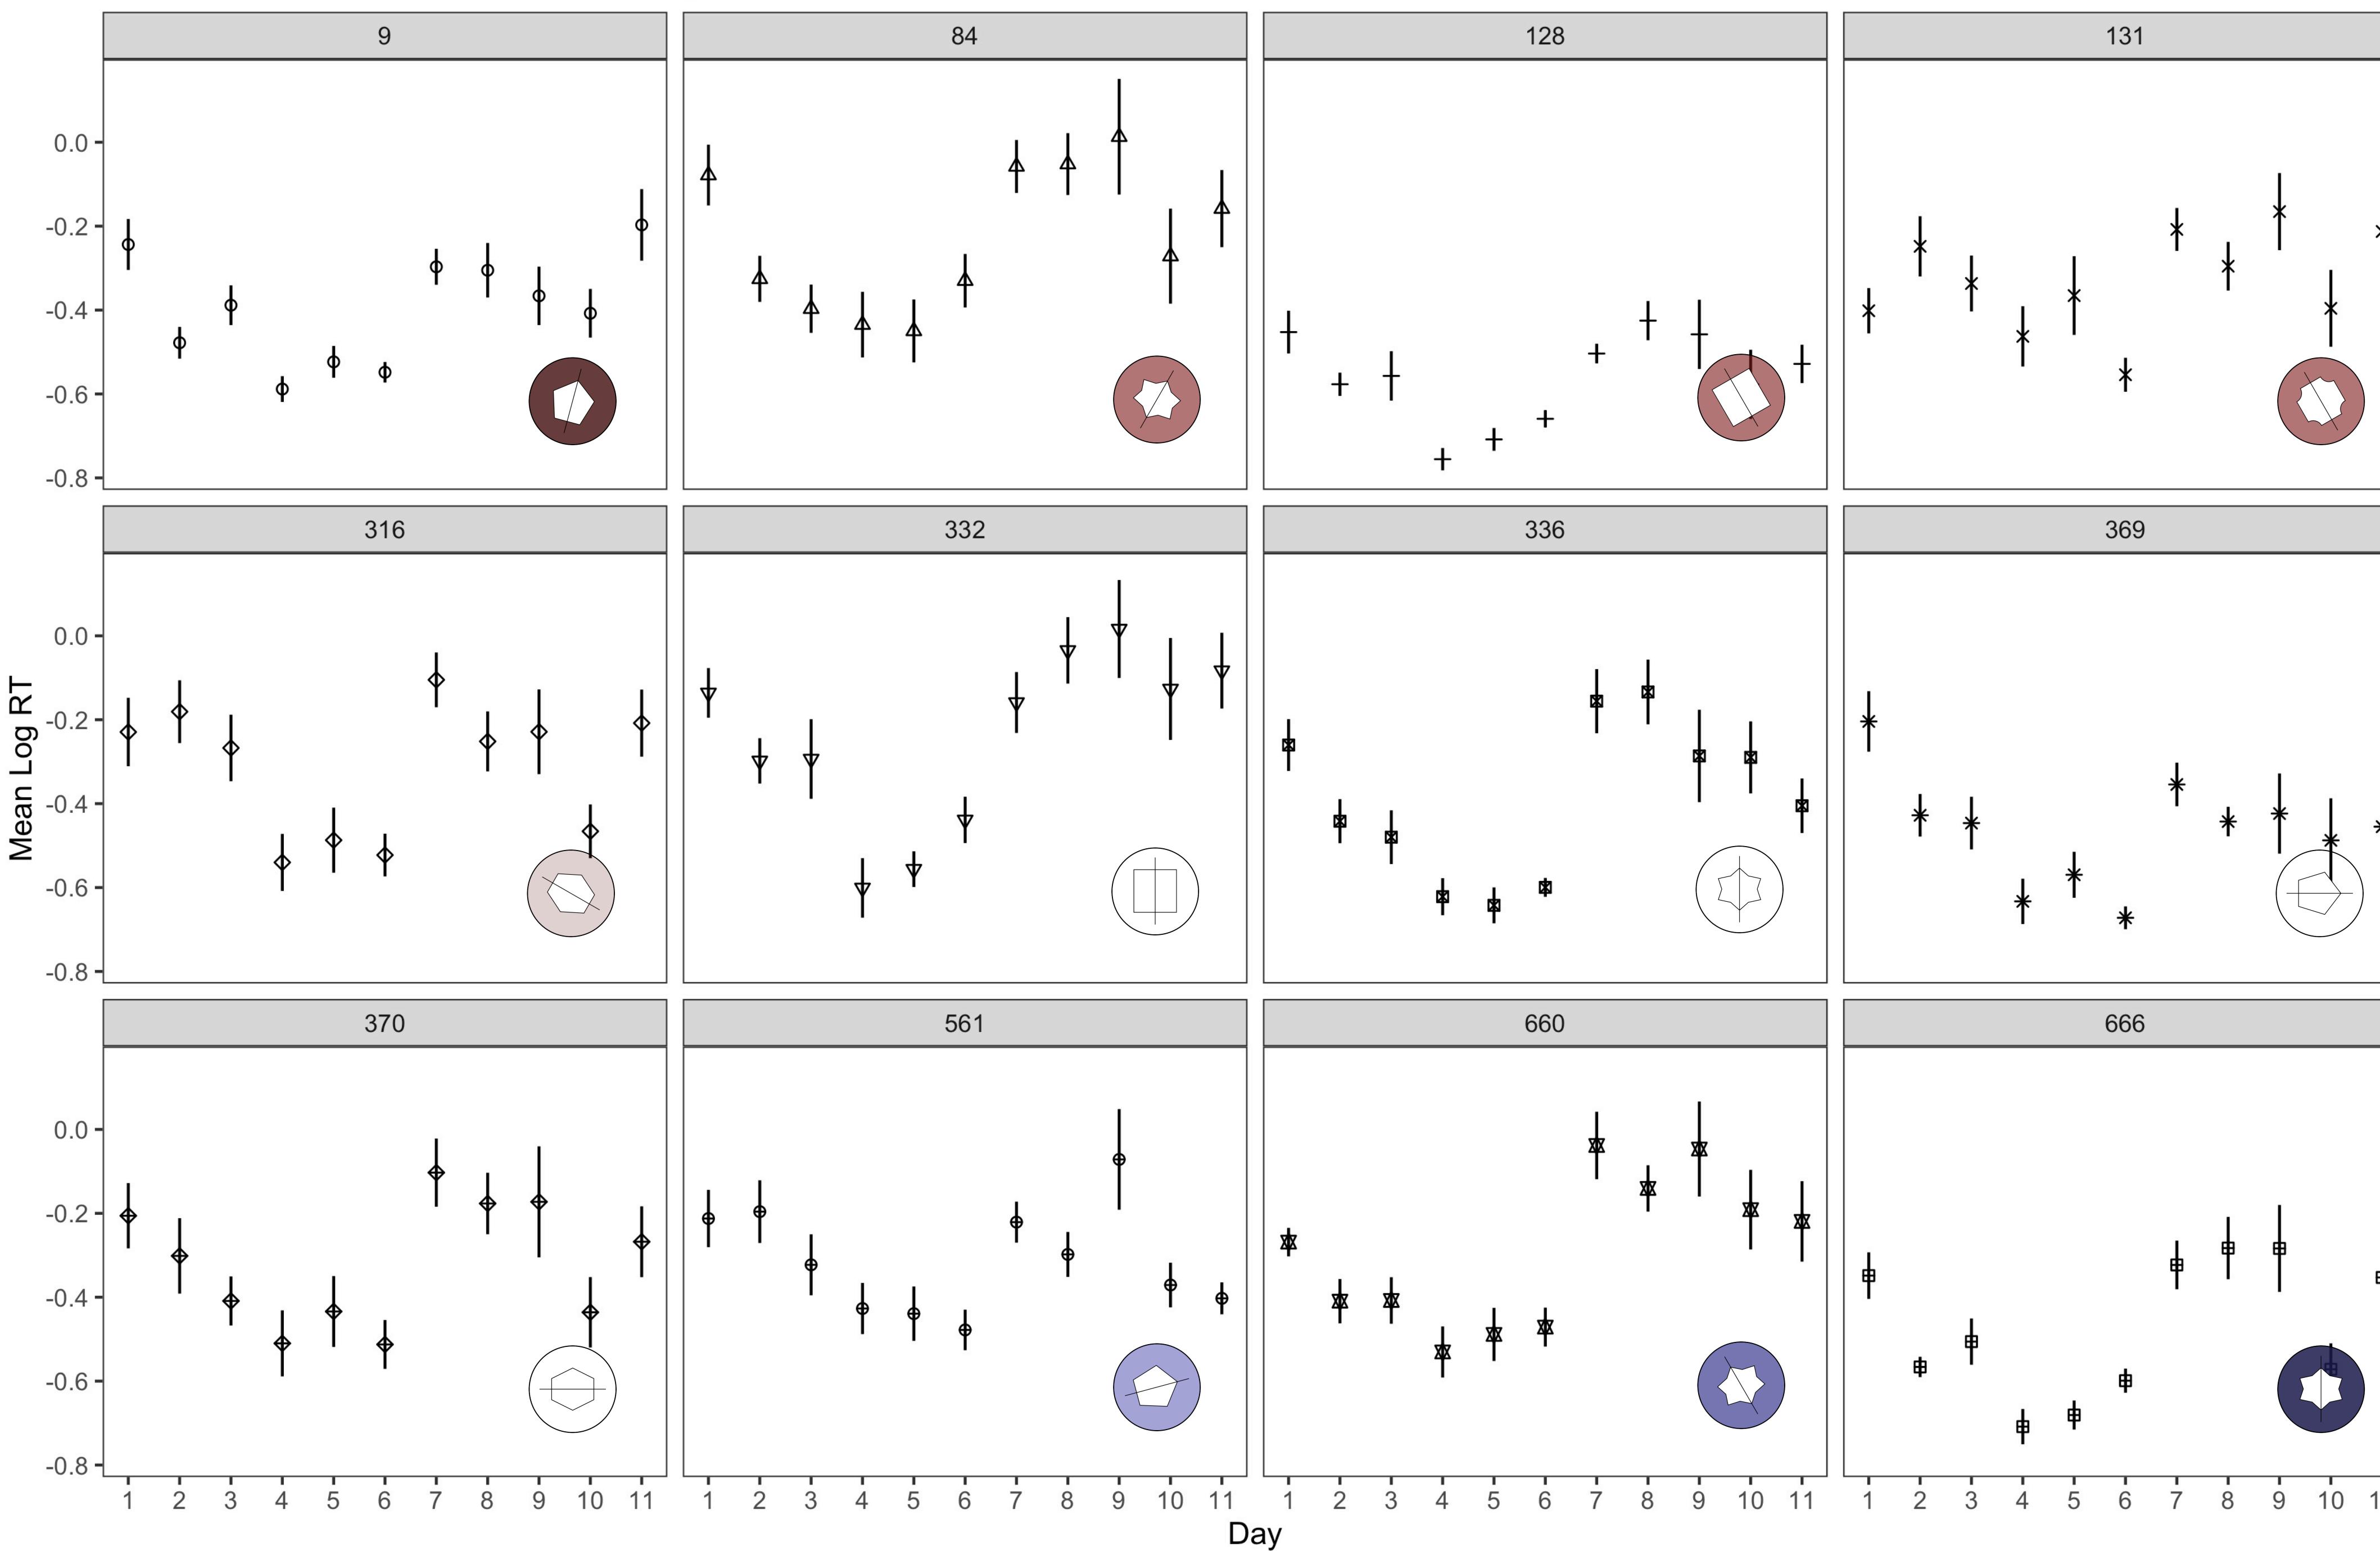


Y/N Task sub-611 HT stim accuracy

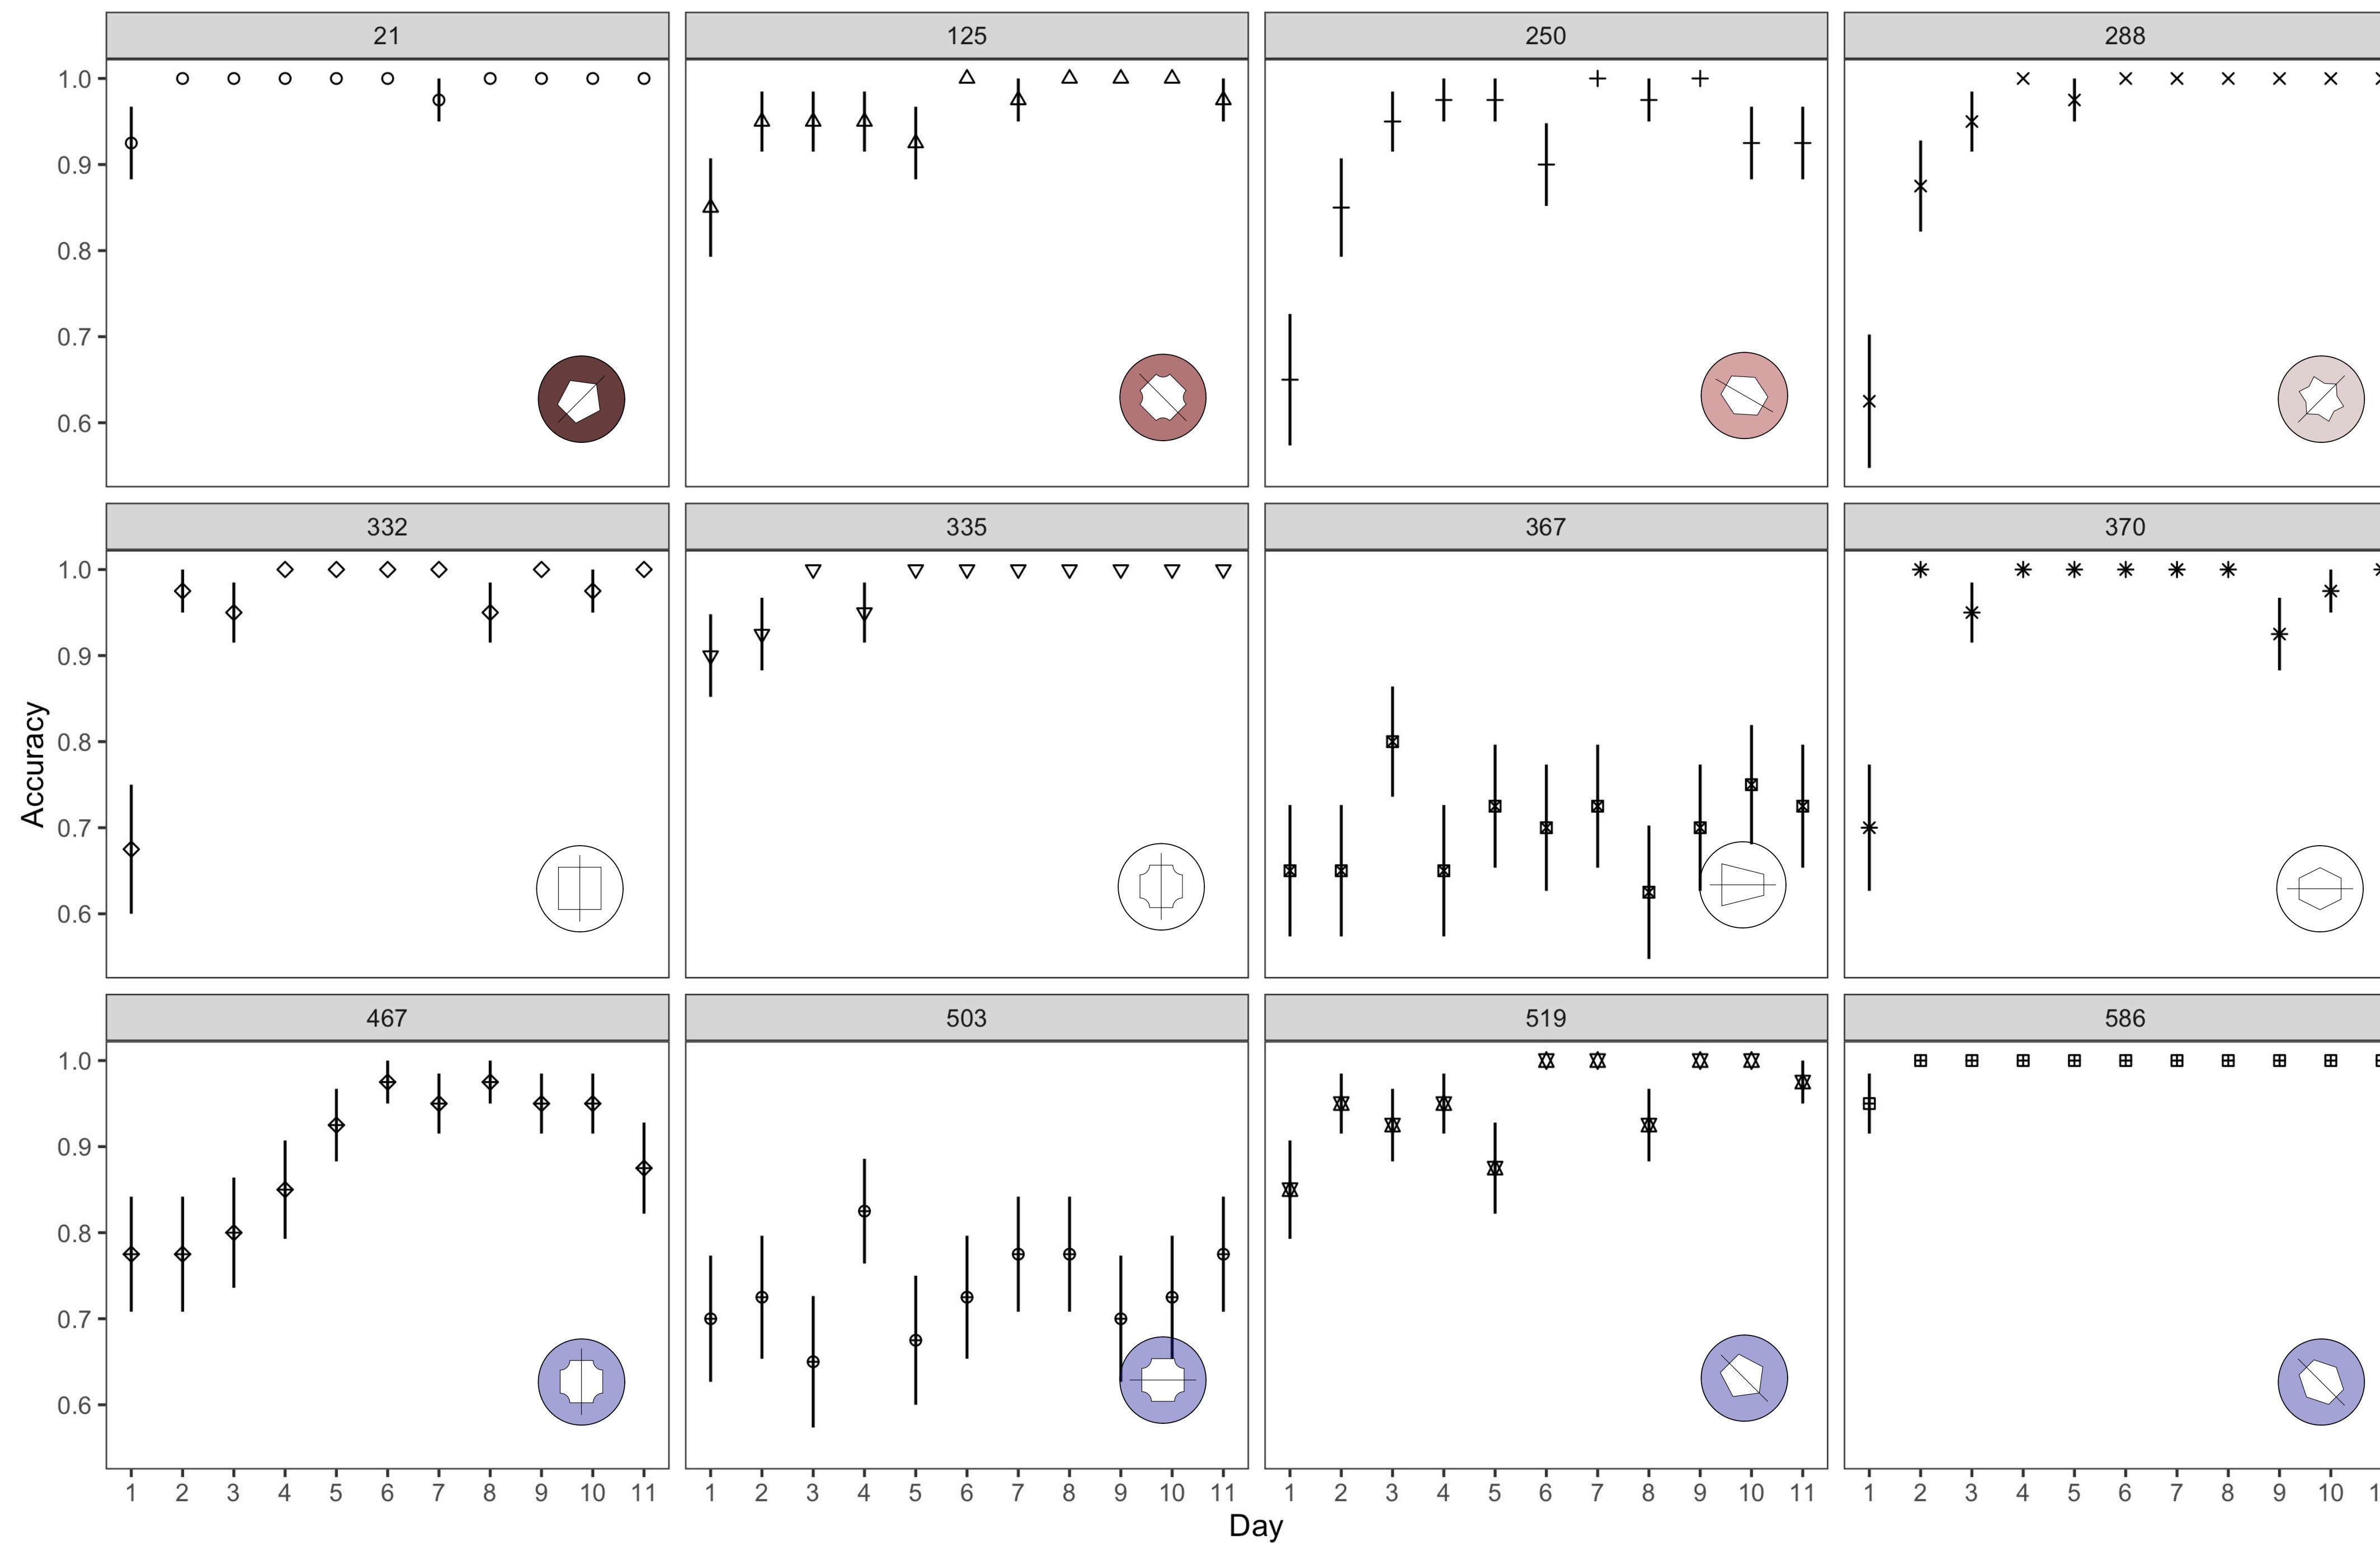


Y/N Task sub-611 HT stim mean log RT

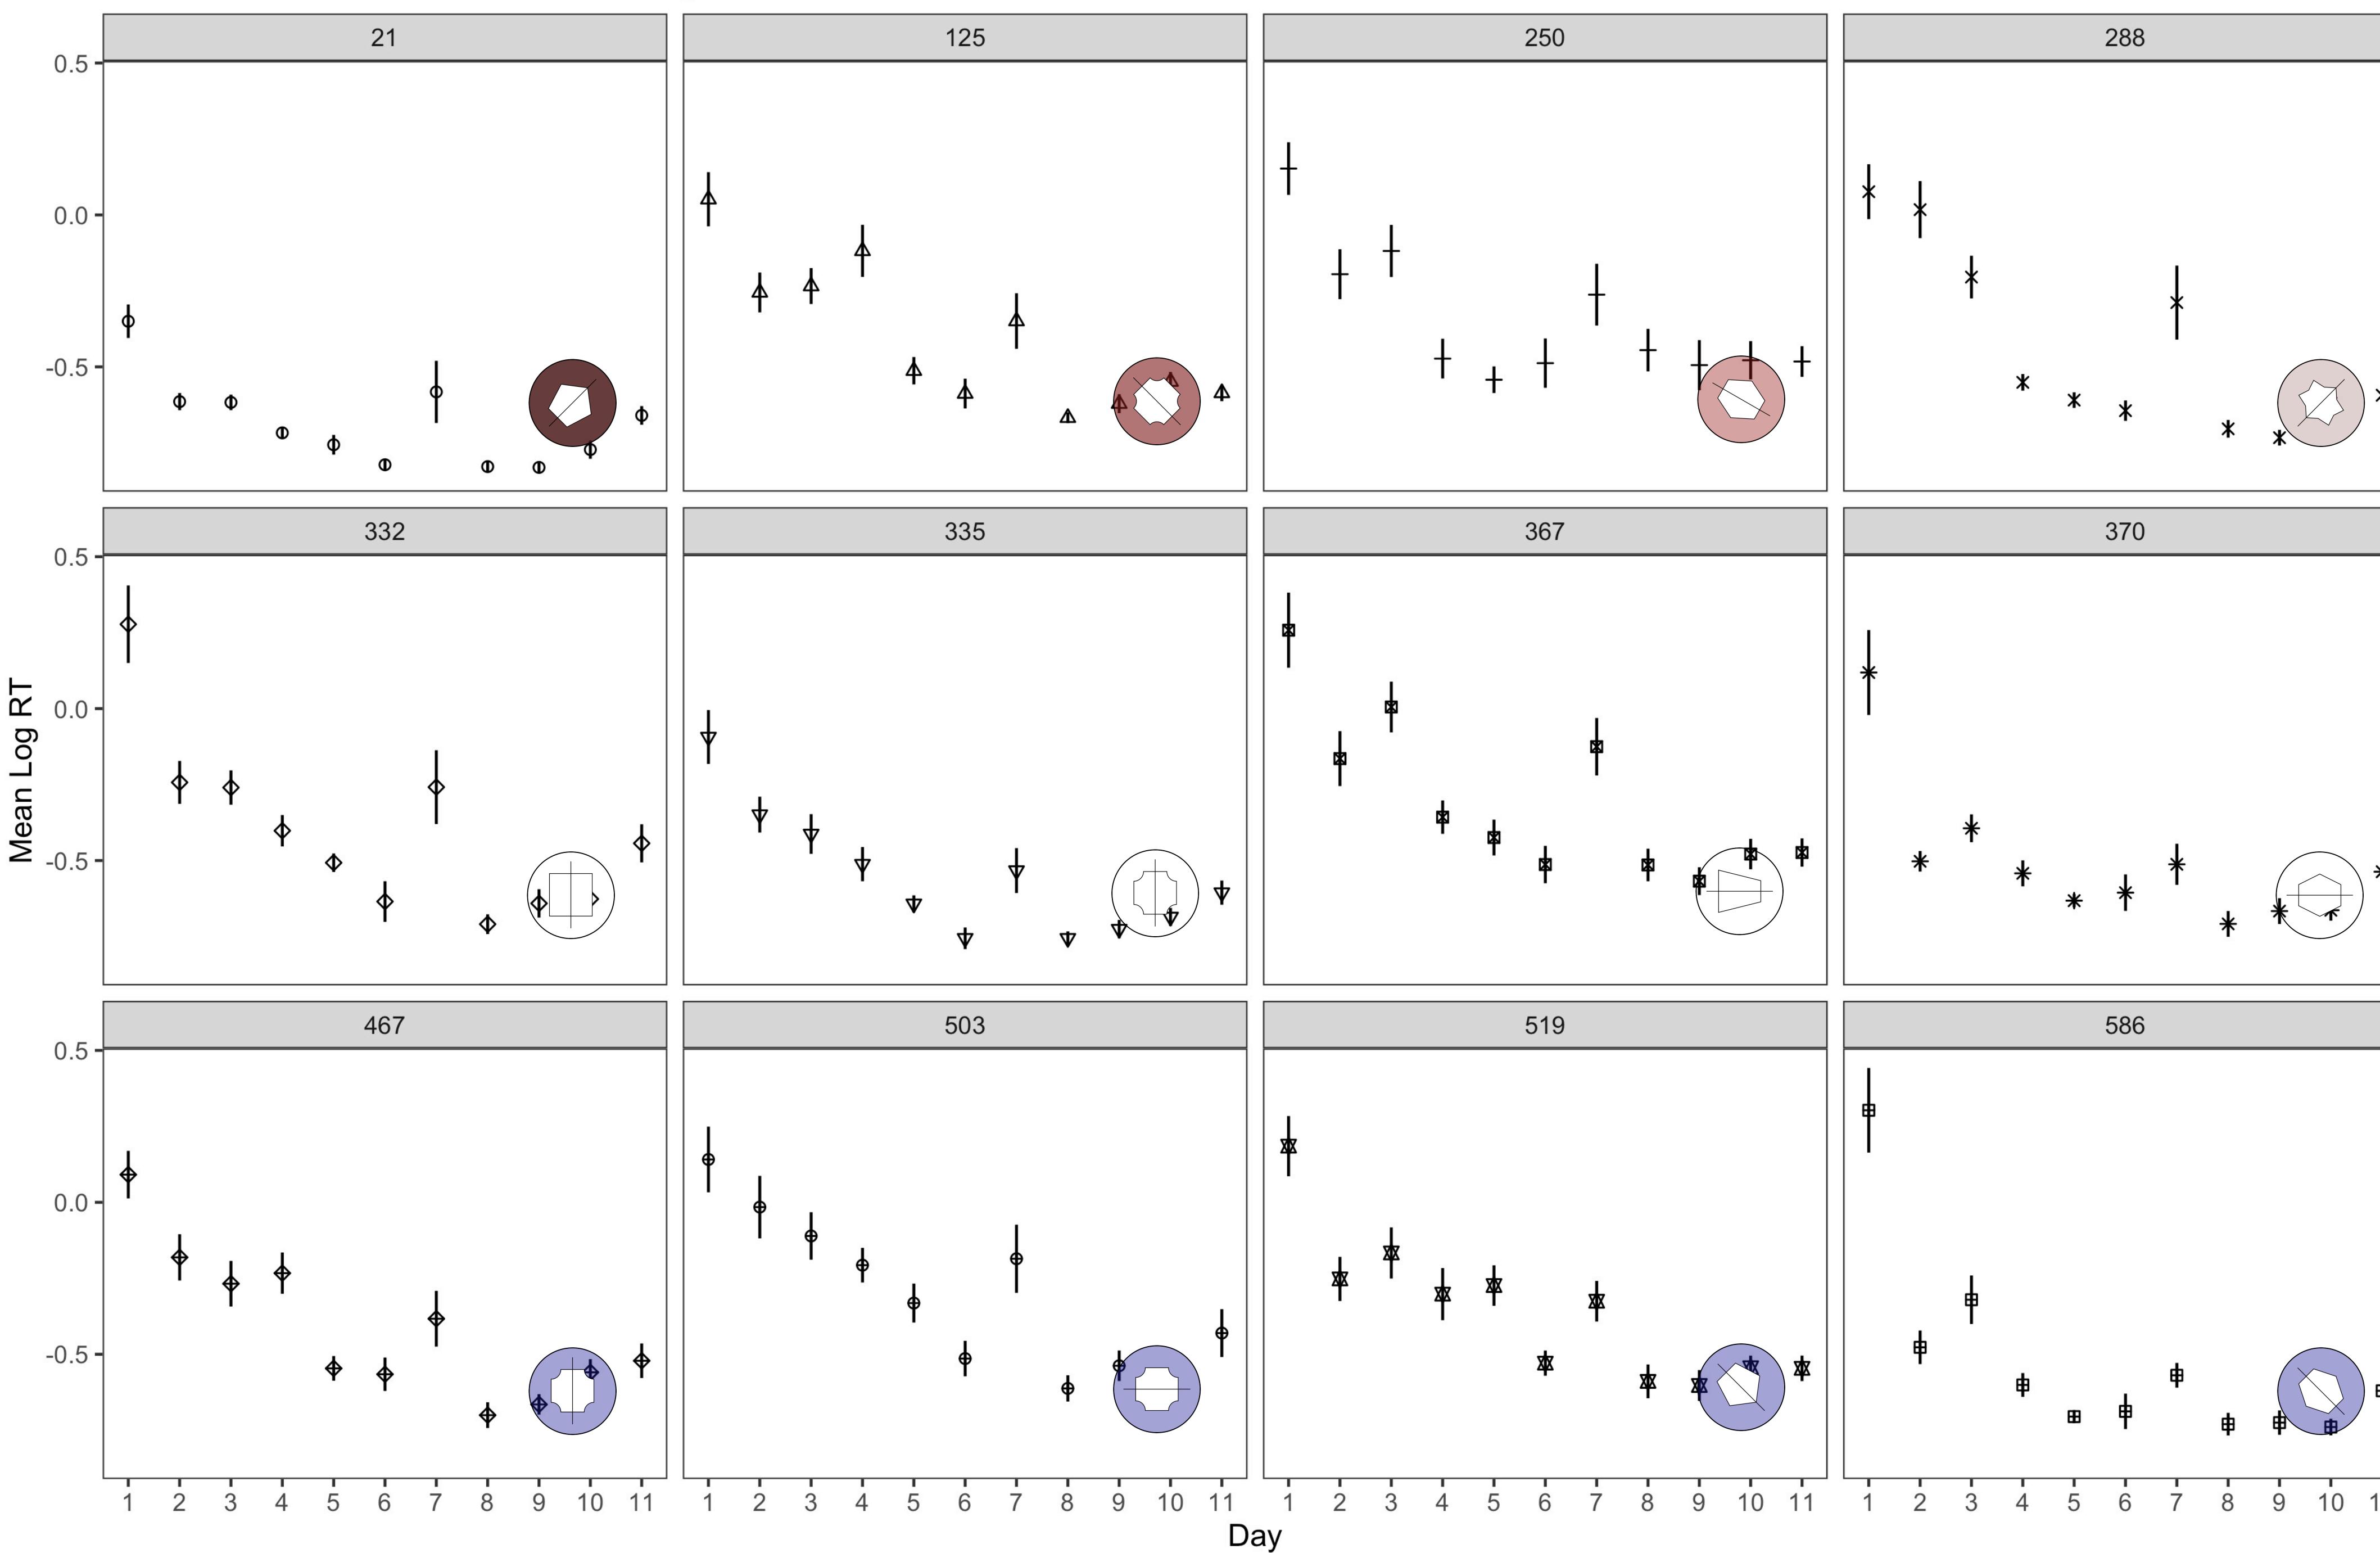


Y/N Task sub-619 HT stim accuracy

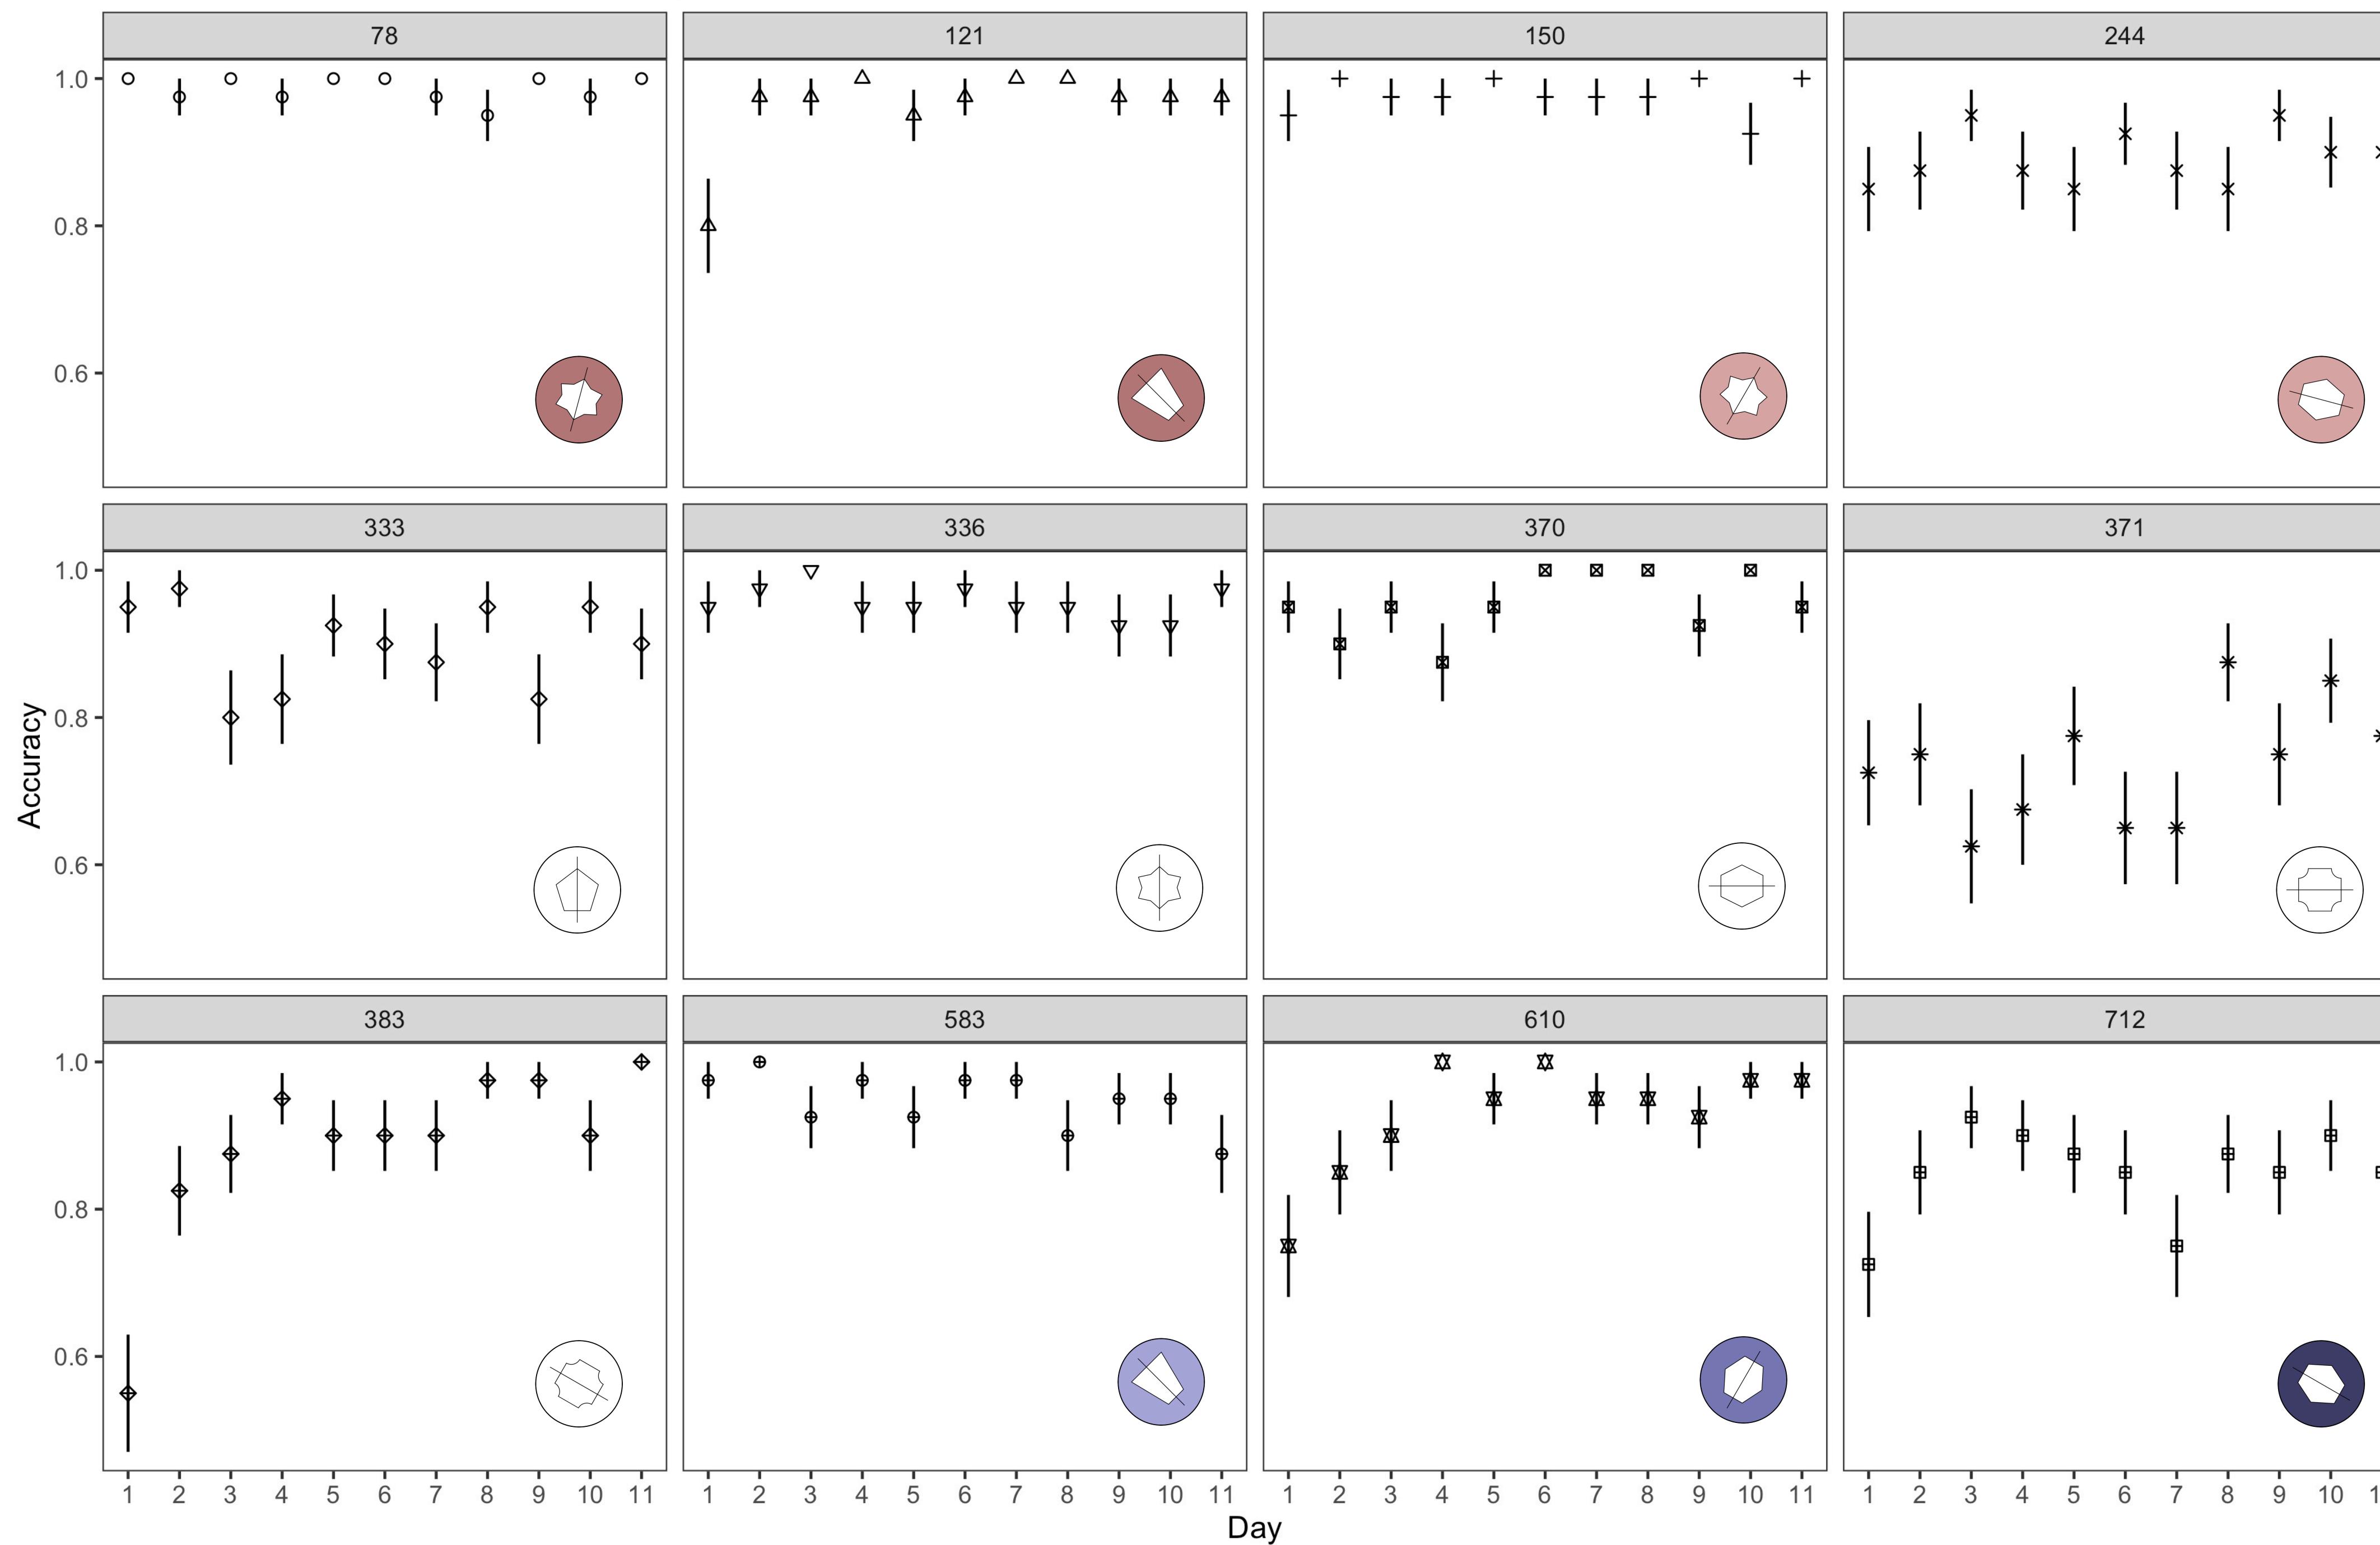


Y/N Task sub-619 HT stim mean log RT

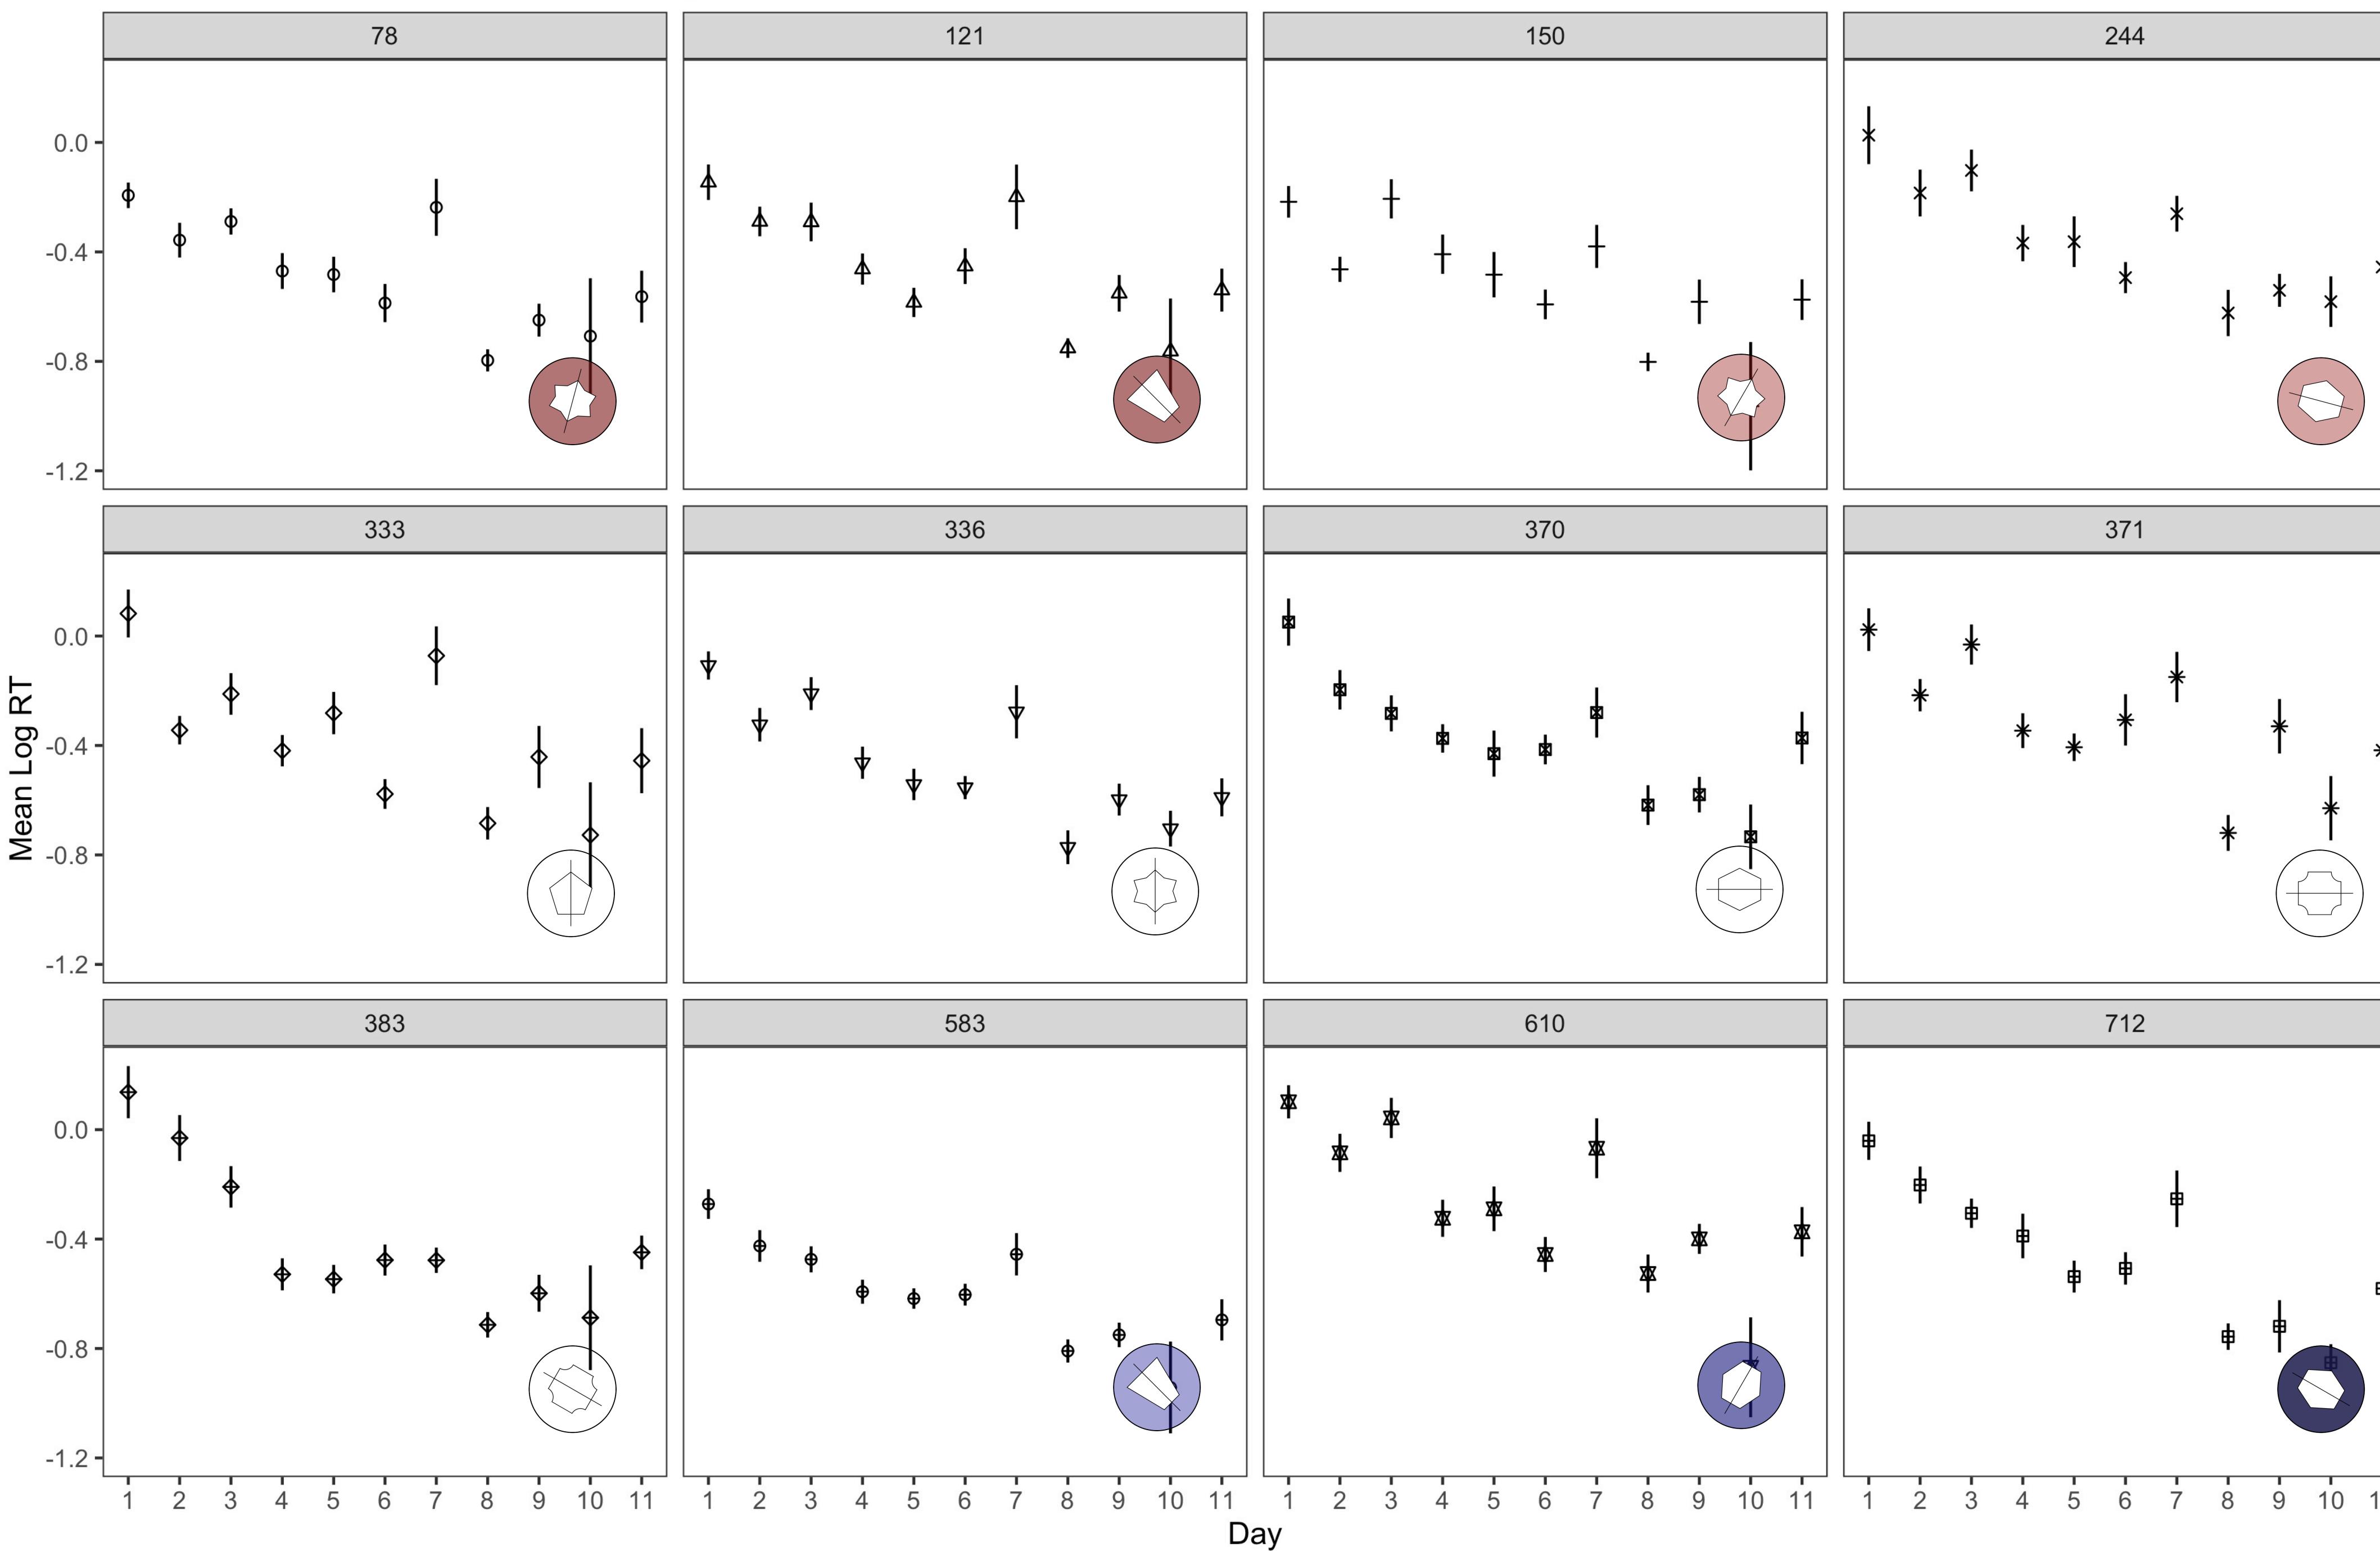


Y/N Task sub-621 HT stim accuracy

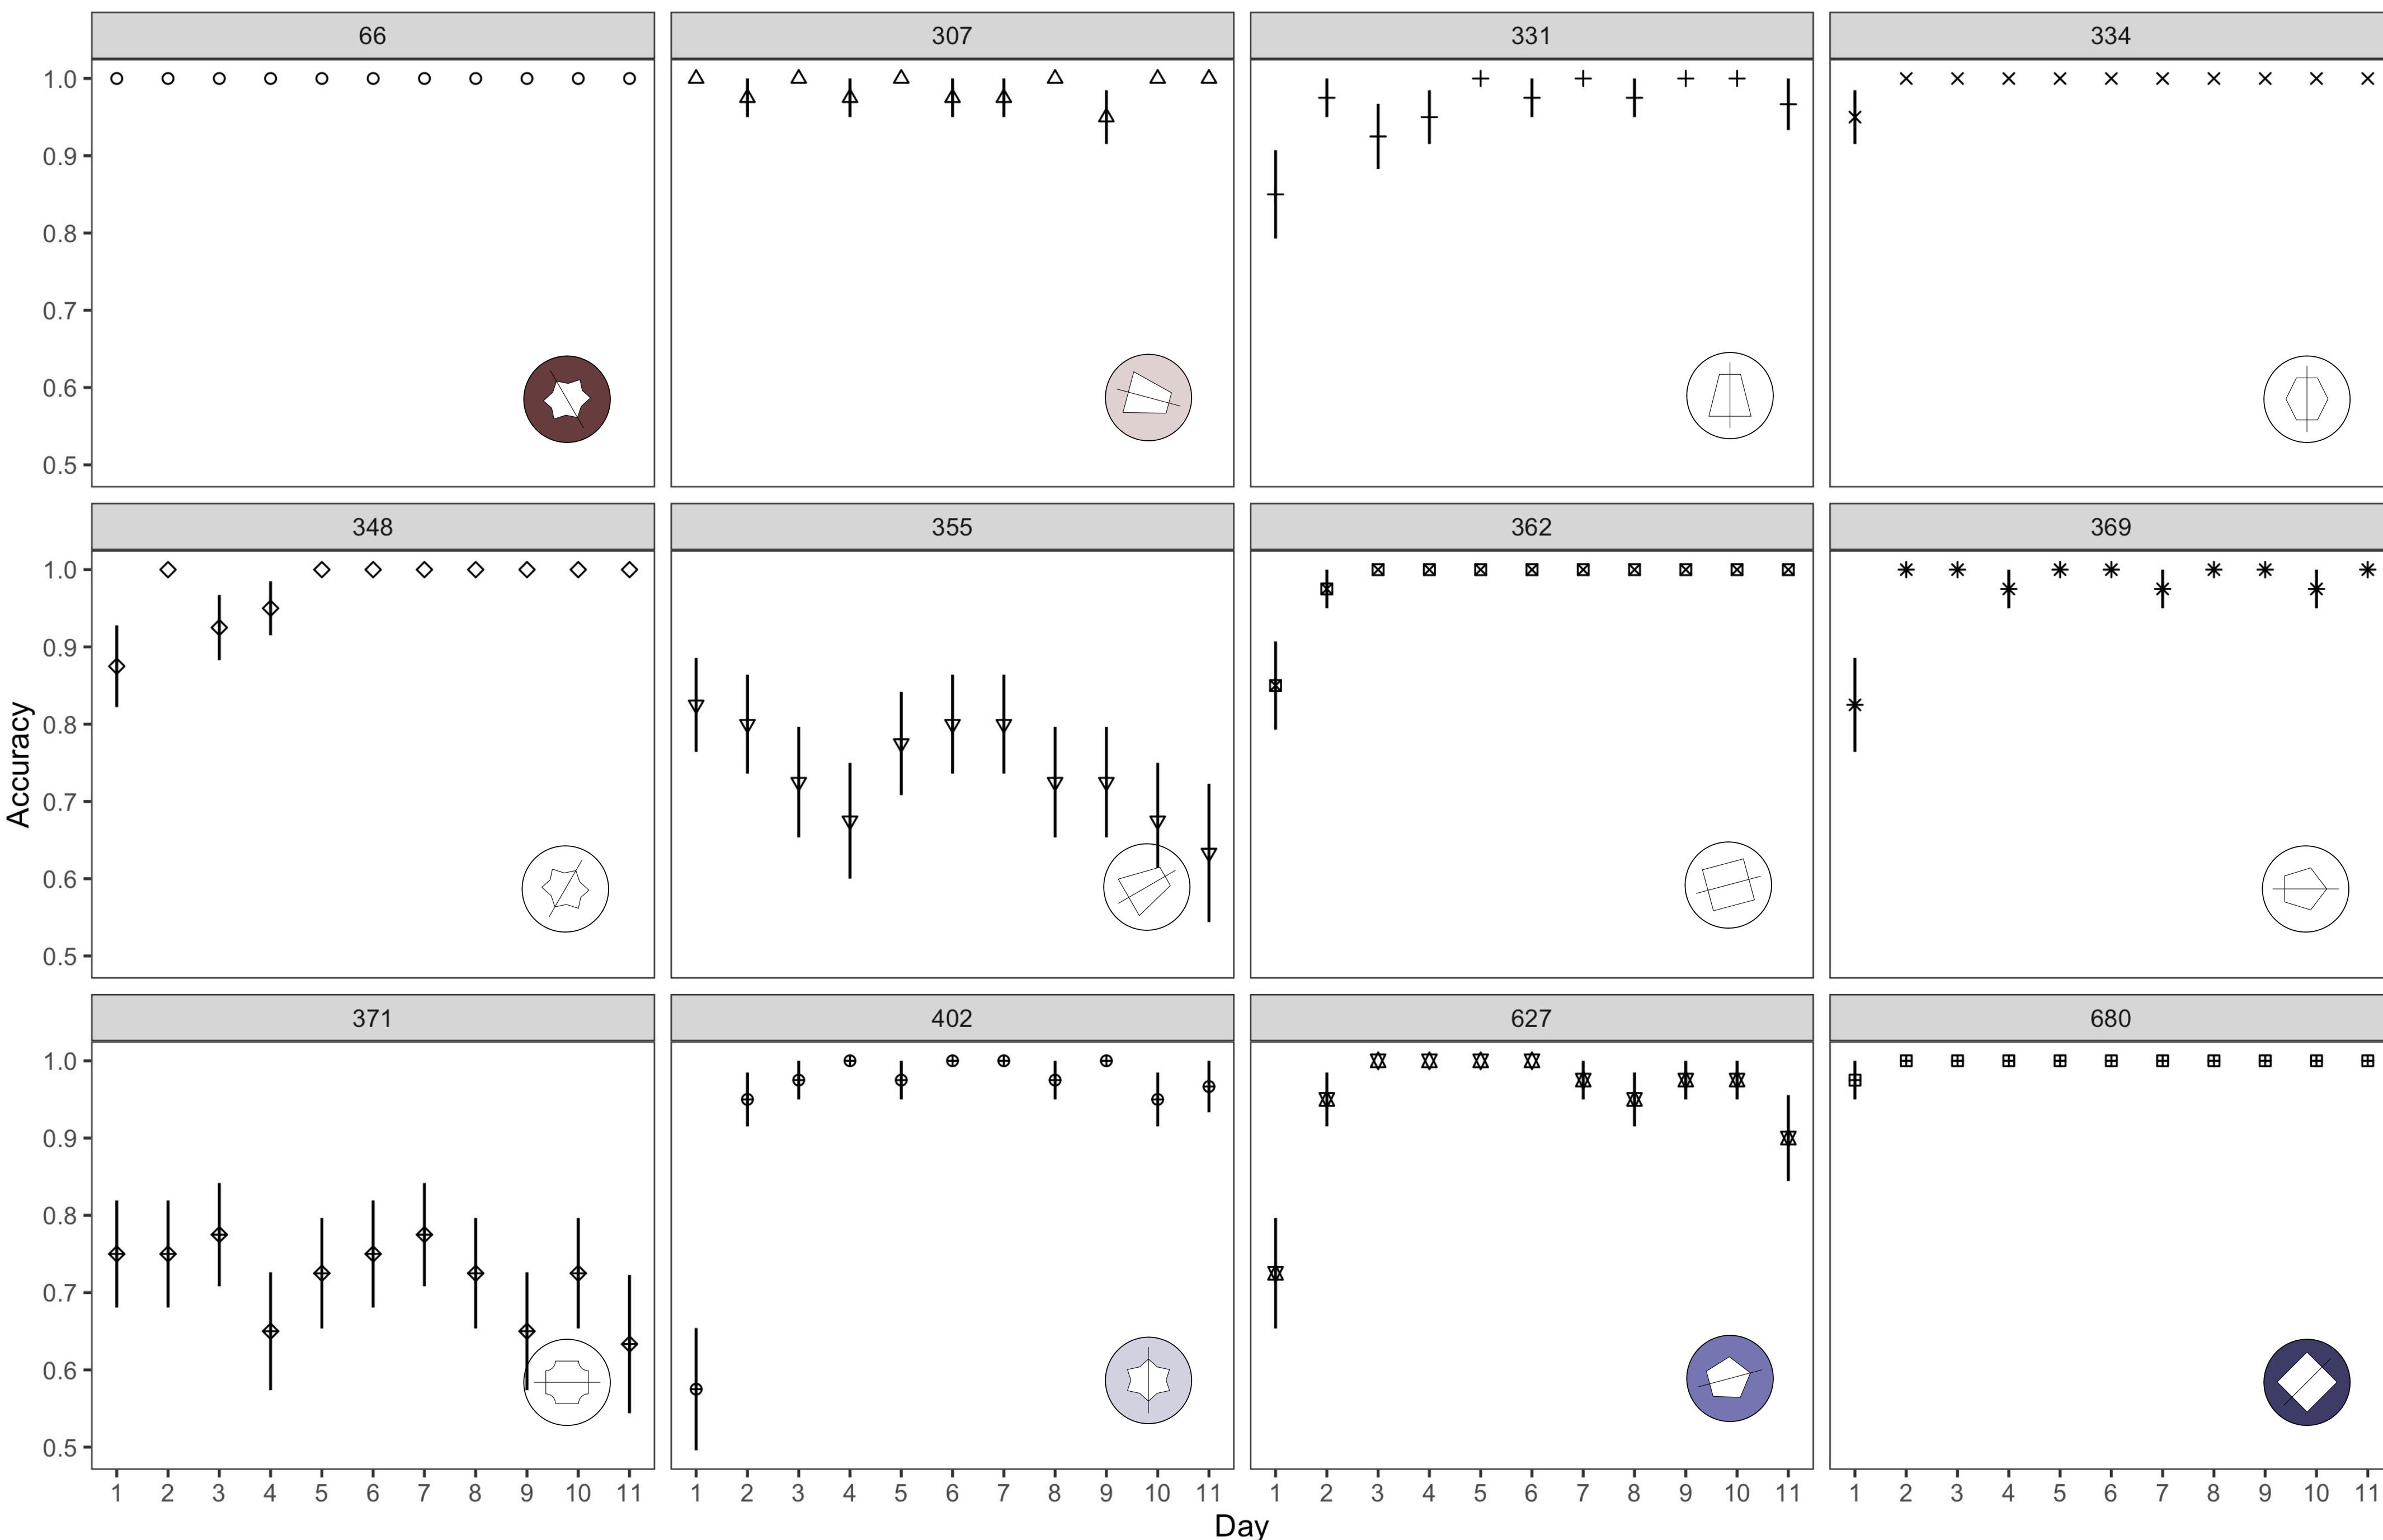

Y/N Task sub-621 HT stim mean log RT

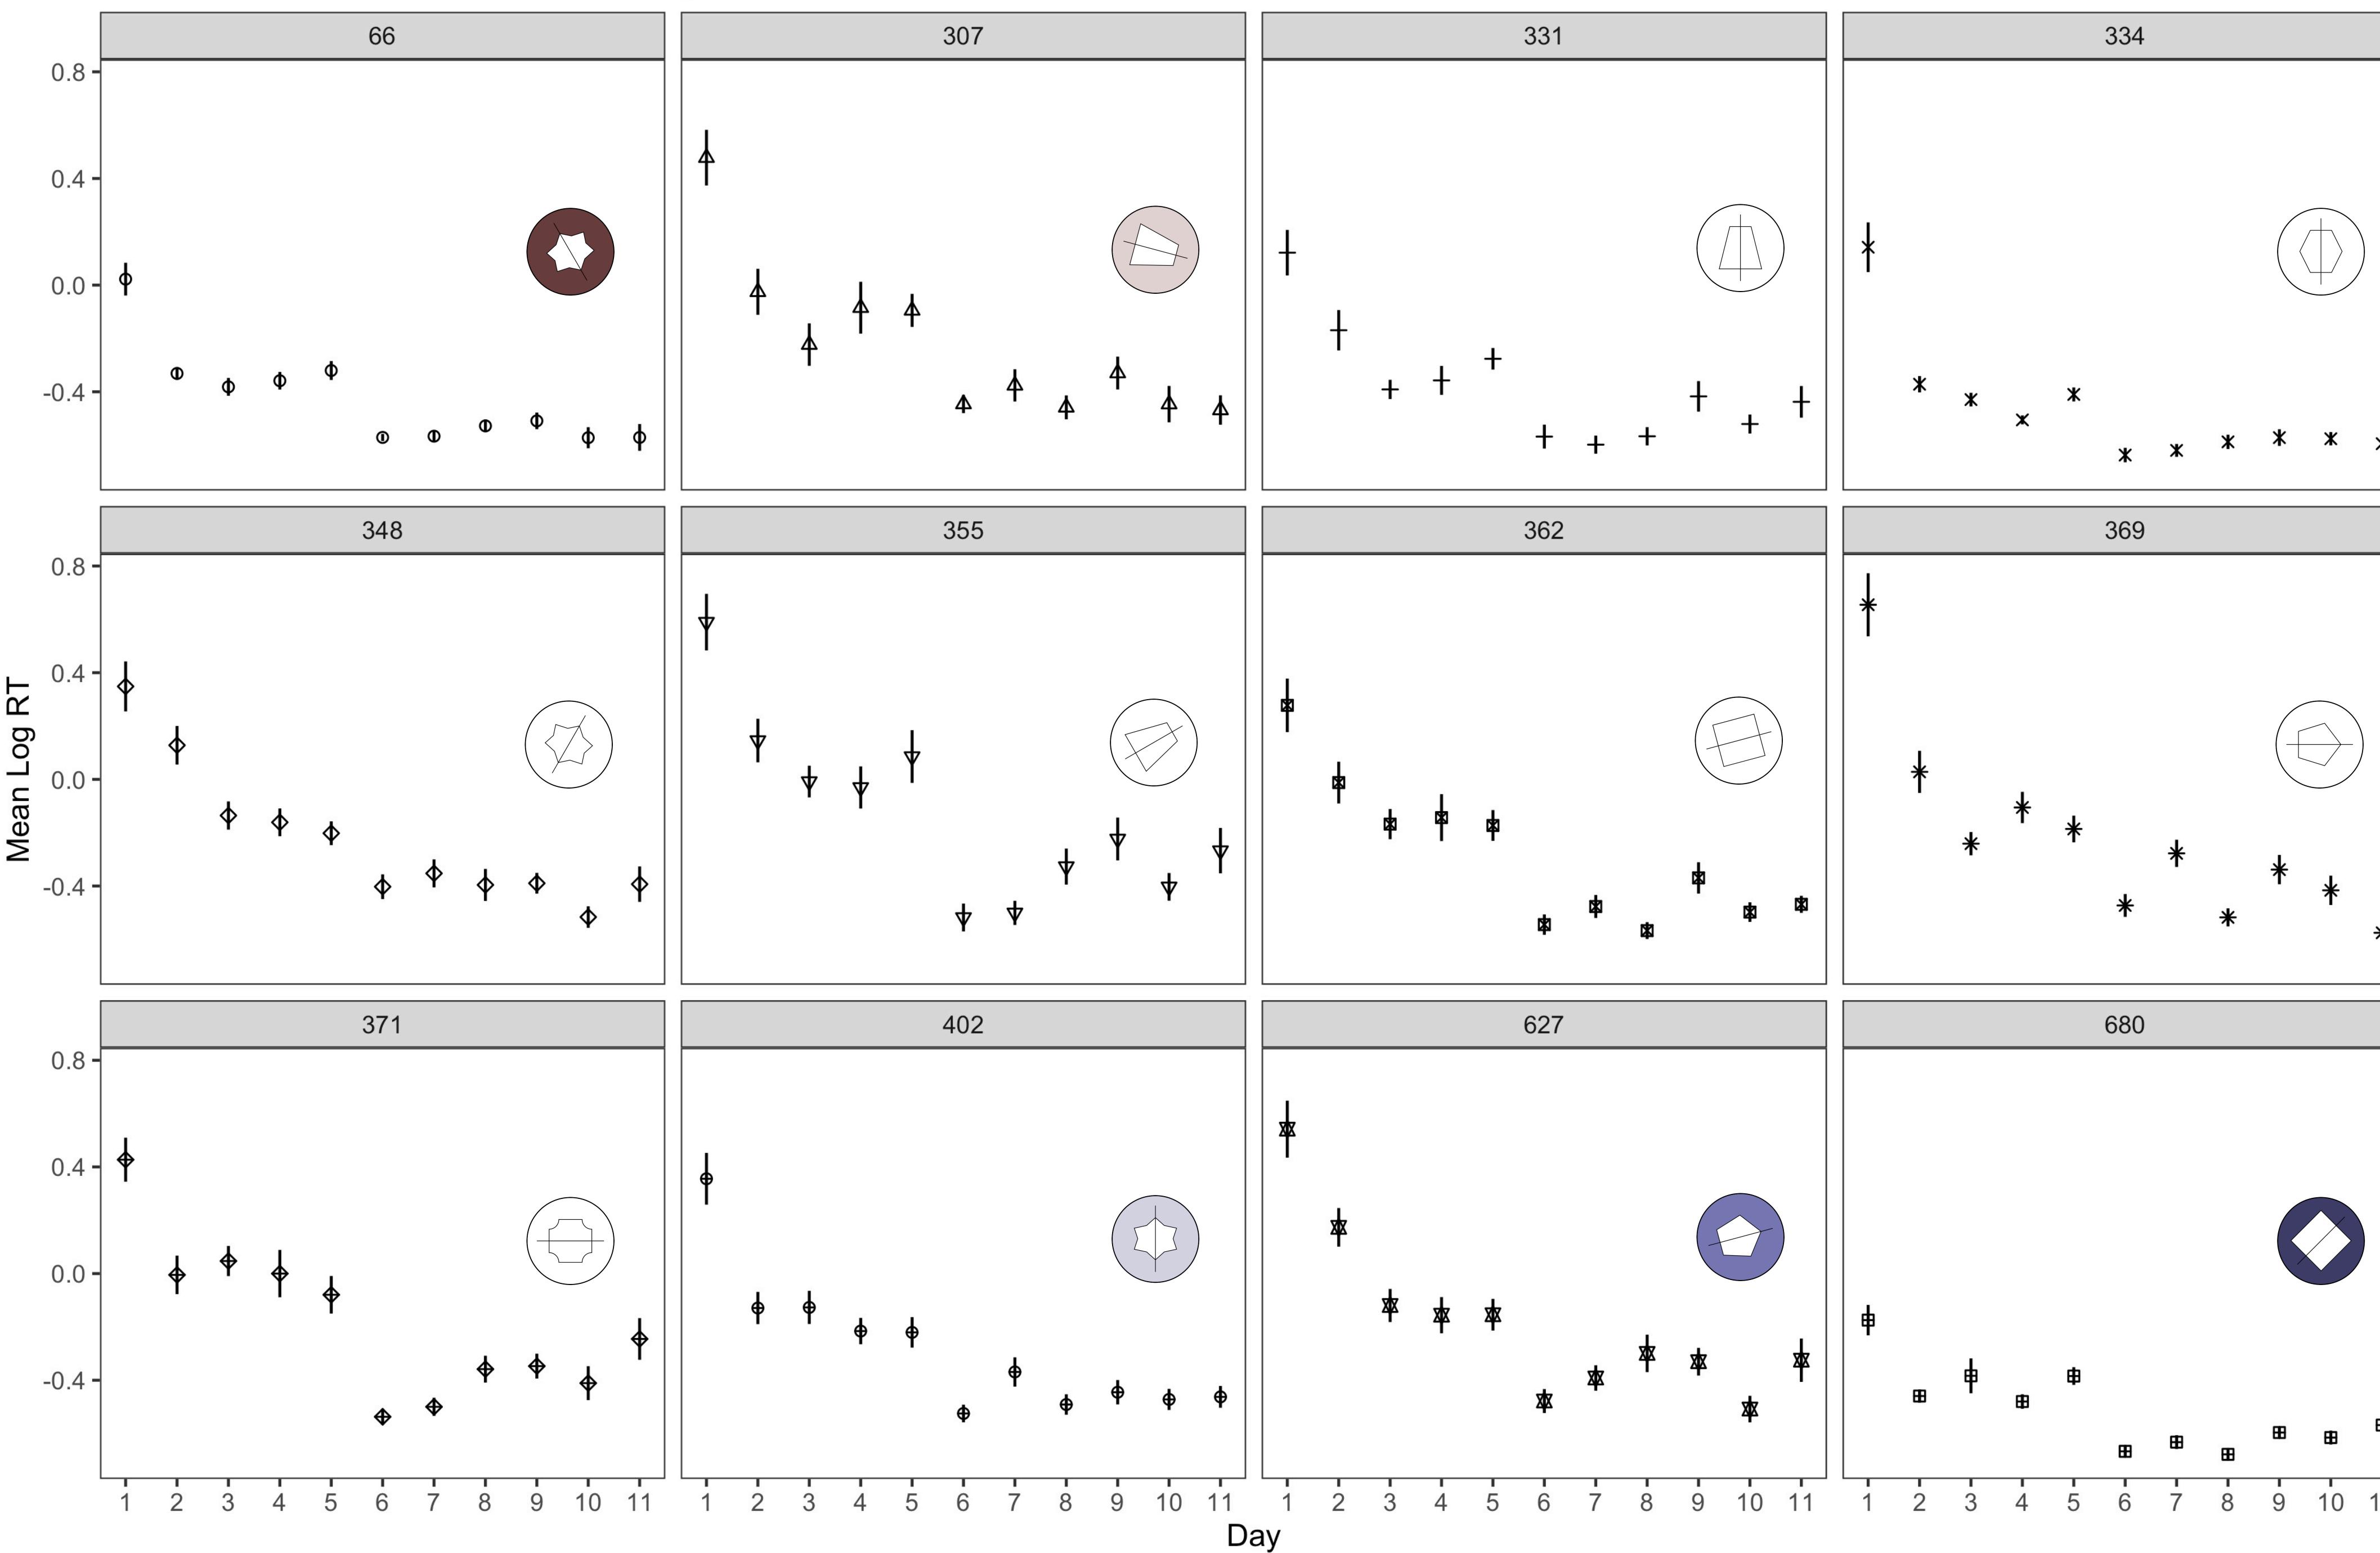

Y/N Task sub-629 HT stim accuracy

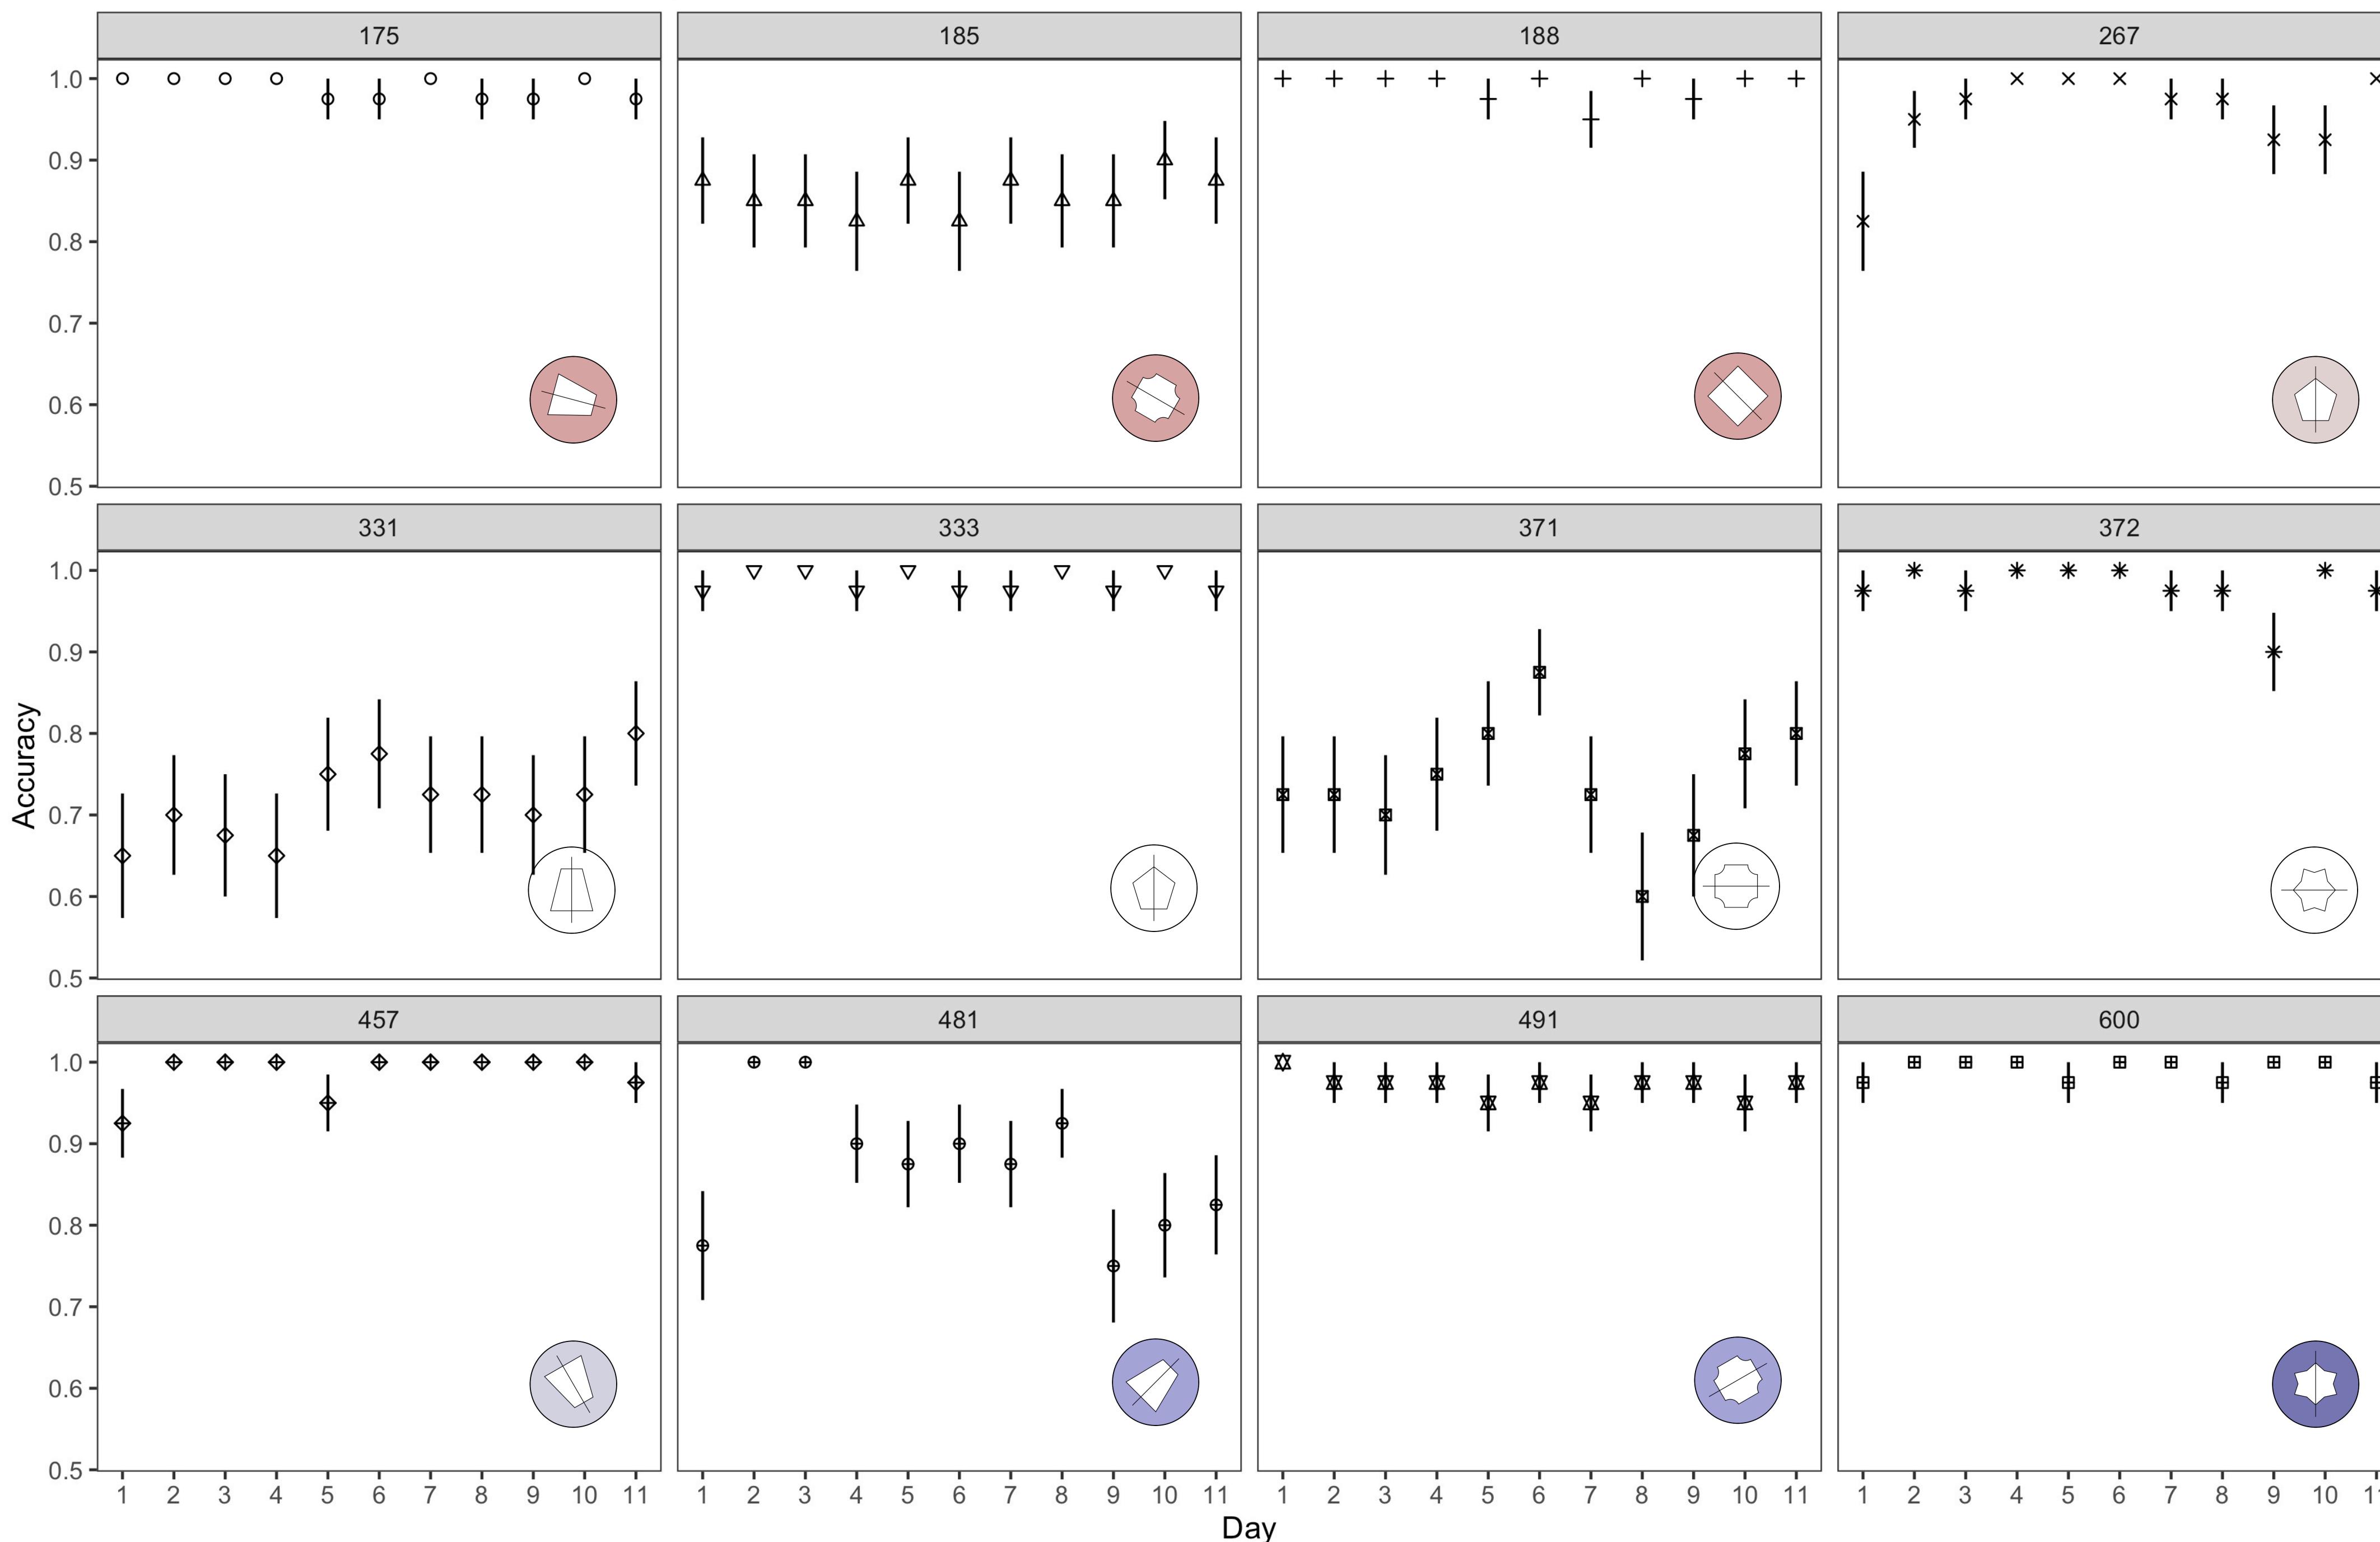

Y/N Task sub-629 HT stim mean log RT

