

FFT of Residuals **Entries** Mean 2.192e+06 Std Dev 7.121e+05 Frequency (Hz)

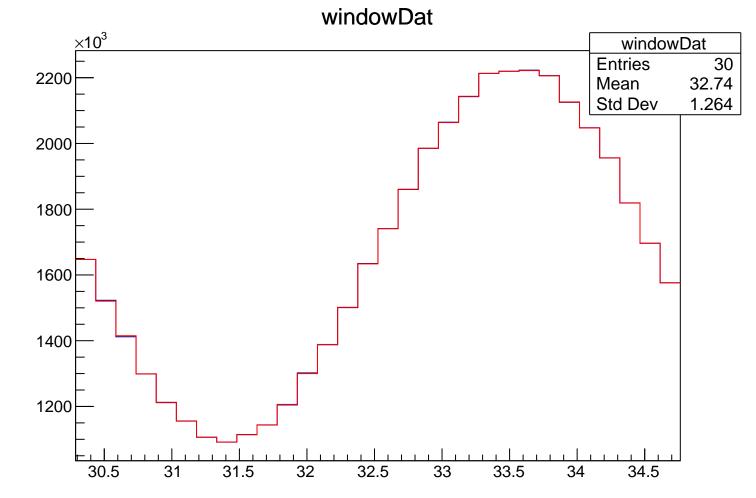


FFT of Residuals FFT of Residuals Power (arb. units) **Entries** 2.037e+06 Mean Std Dev 8.231e+05 Frequency (Hz)

windowDat

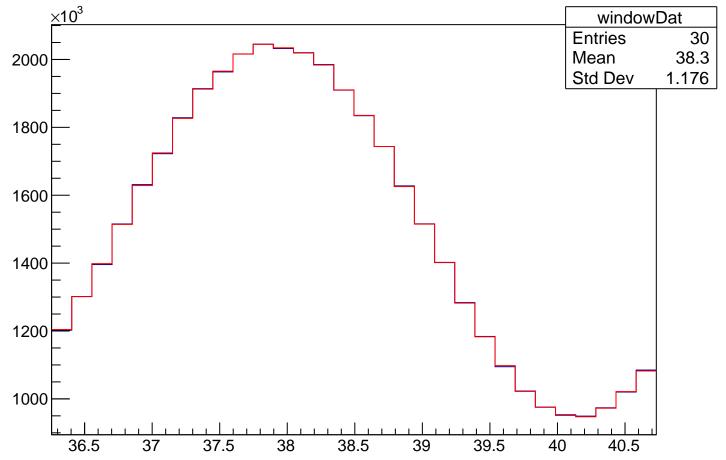


FFT of Residuals Power (arb. units) **Entries** 2.121e+06 Mean Std Dev 8.008e+05 Frequency (Hz)

window Dat

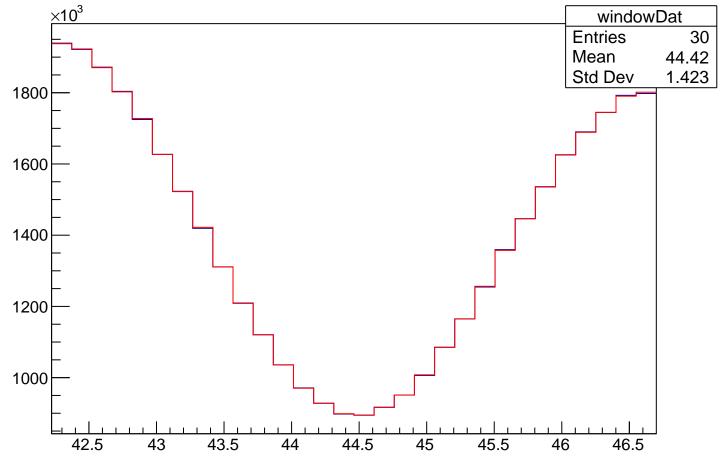


FFT of Residuals **Entries** Mean 1.665e+06 Std Dev 9.355e+05 Frequency (Hz)

windowDat  $\times 10^3$ 

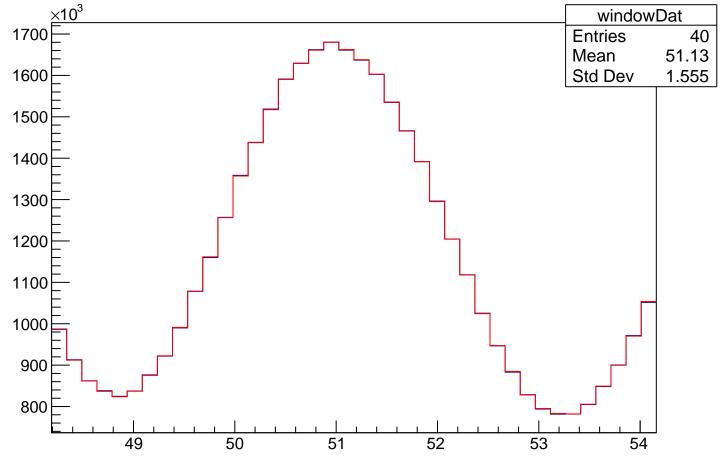

FFT of Residuals FFT of Residuals **Entries** 25000 Mean 1.976e+06 7.716e+05 Std Dev 20000 15000 10000 5000 500 1000 1500 2000 2500 3000 Frequency (Hz)

windowDat

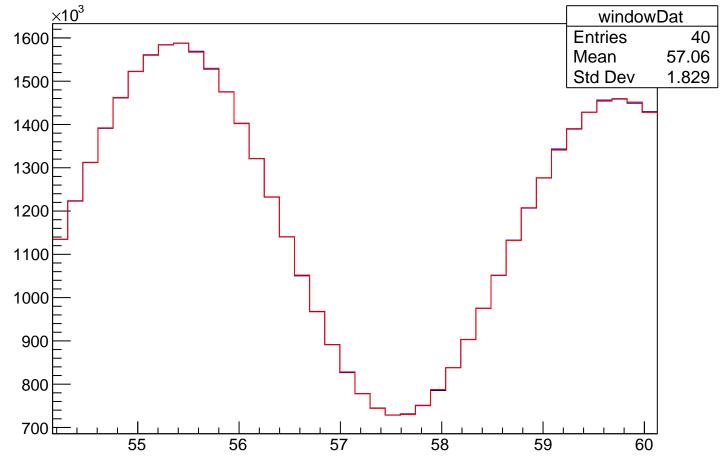

FFT of Residuals **Entries** Mean 1.504e+06 Std Dev 1.035e+06 

Frequency (Hz)


windowDat  $\times 10^3$ windowDat Entries 63.71 Mean Std Dev 2.1 

FFT of Residuals **Entries** 1.661e+06 Mean 9.625e+05 Std Dev CBO Frequency (Hz)


windowDat  $\times 10^3$ windowDat Entries 73.65 Mean Std-Dev 2.624 

FFT of Residuals FFT of Residuals **Entries** 1.581e+06 Mean 9.026e+05 Std Dev 

Frequency (Hz)

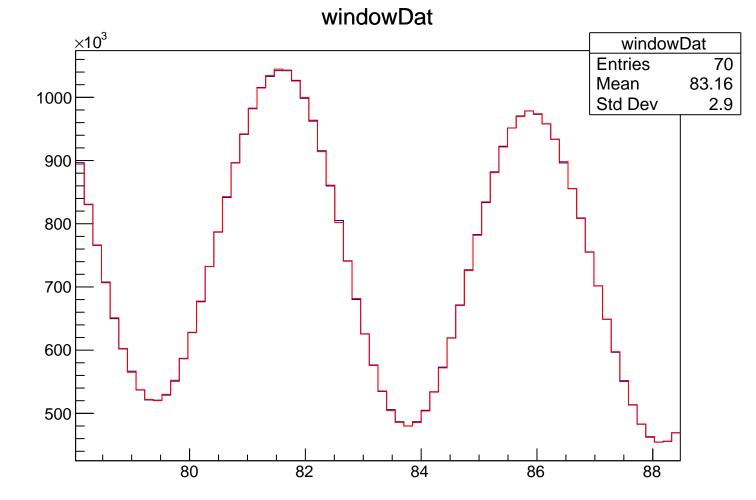


FFT of Residuals FFT of Residuals **Entries** Mean 1.576e+06 Std Dev 1.008e+06 Frequency (Hz)

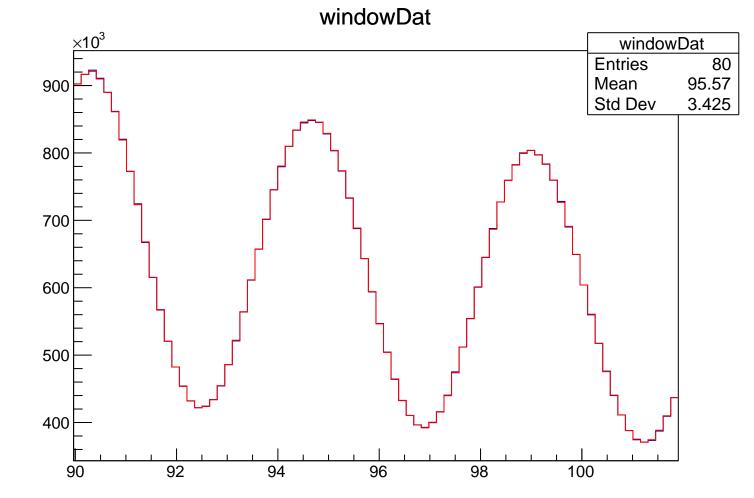


FFT of Residuals FFT of Residuals **Entries** Mean 1.613e+06 9.914e+05 Std Dev CBO Frequency (Hz)

windowDat

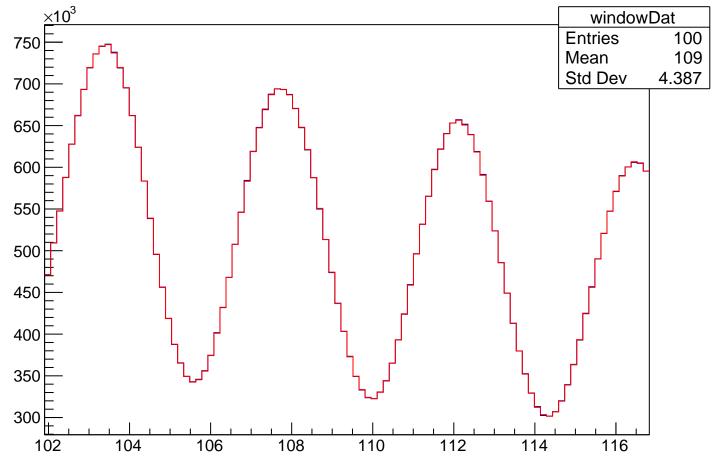



FFT of Residuals **Entries** 1.649e+06 Mean 9.732e+05 Std Dev 


Frequency (Hz)

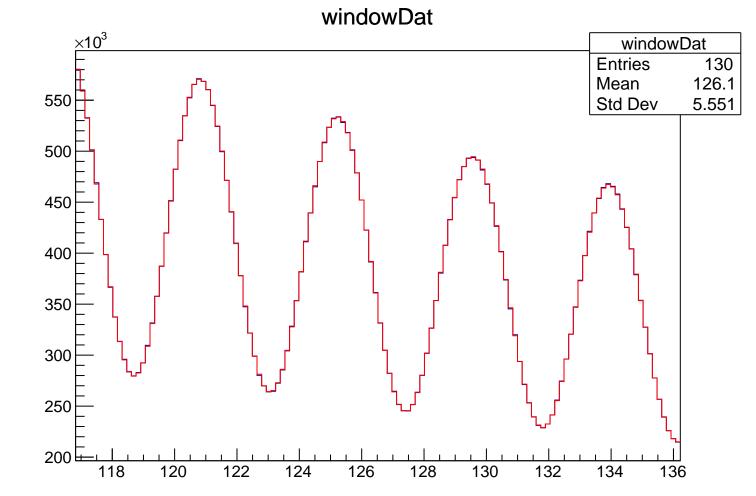



FFT of Residuals FFT of Residuals Power (arb. units) **Entries** 200 Mean 1.629e+06 16000 Std Dev 9.969e+05 14000 12000 10000 8000

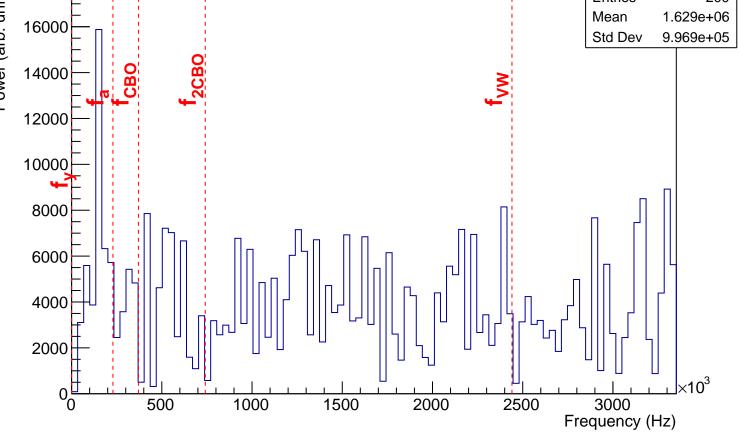


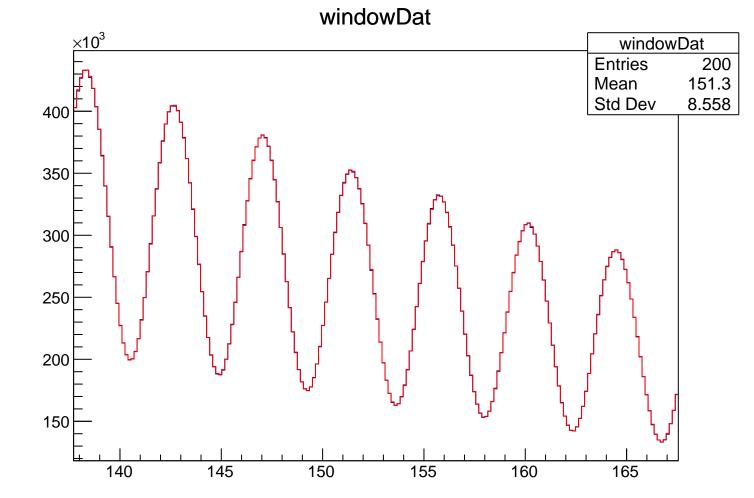

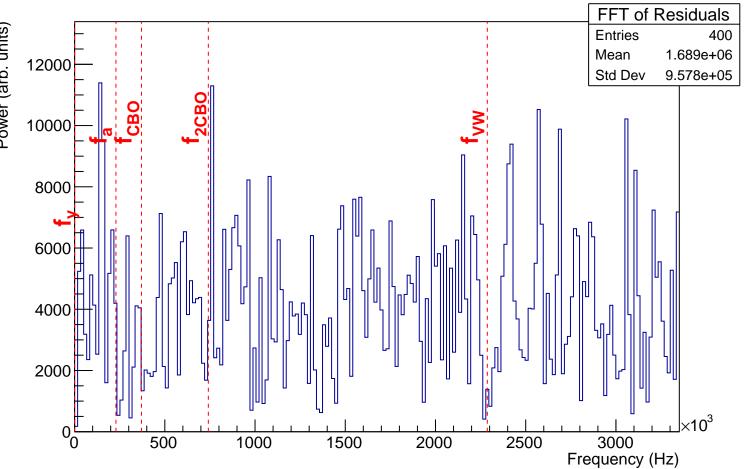


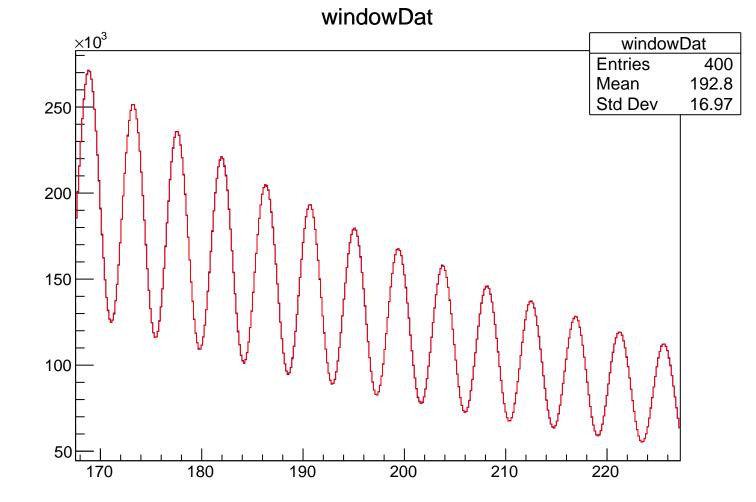

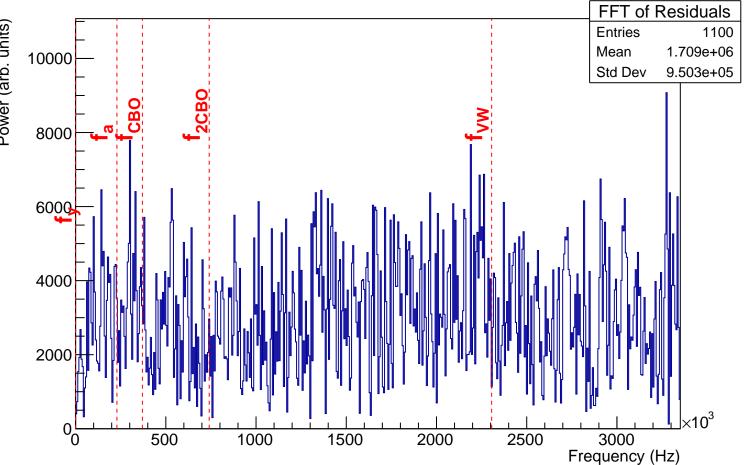

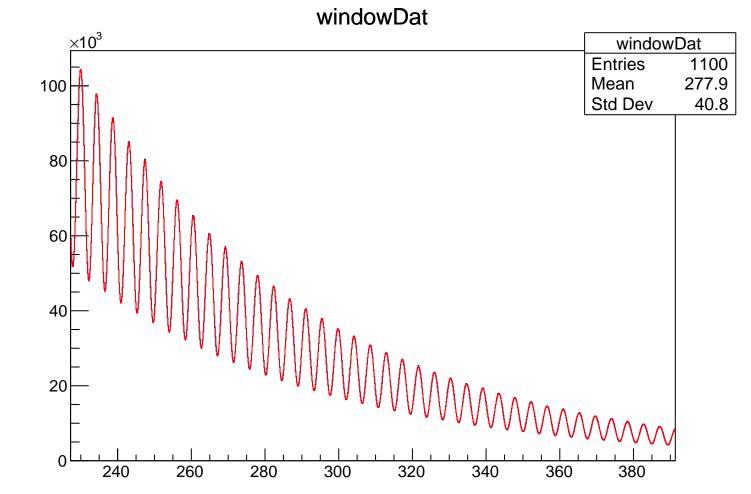

FFT of Residuals

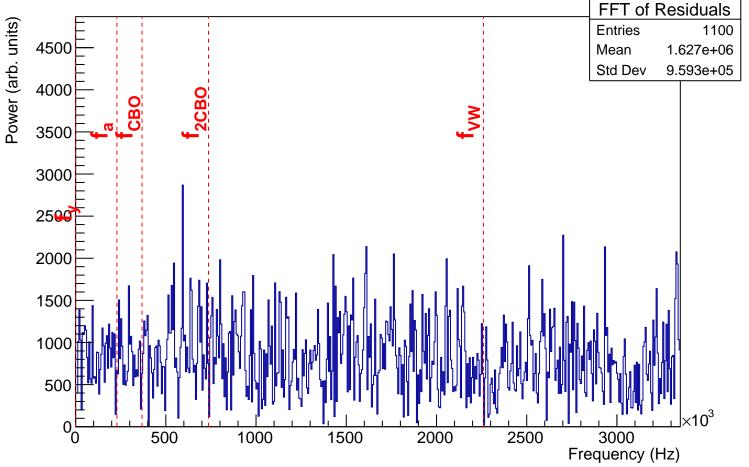

## windowDat

