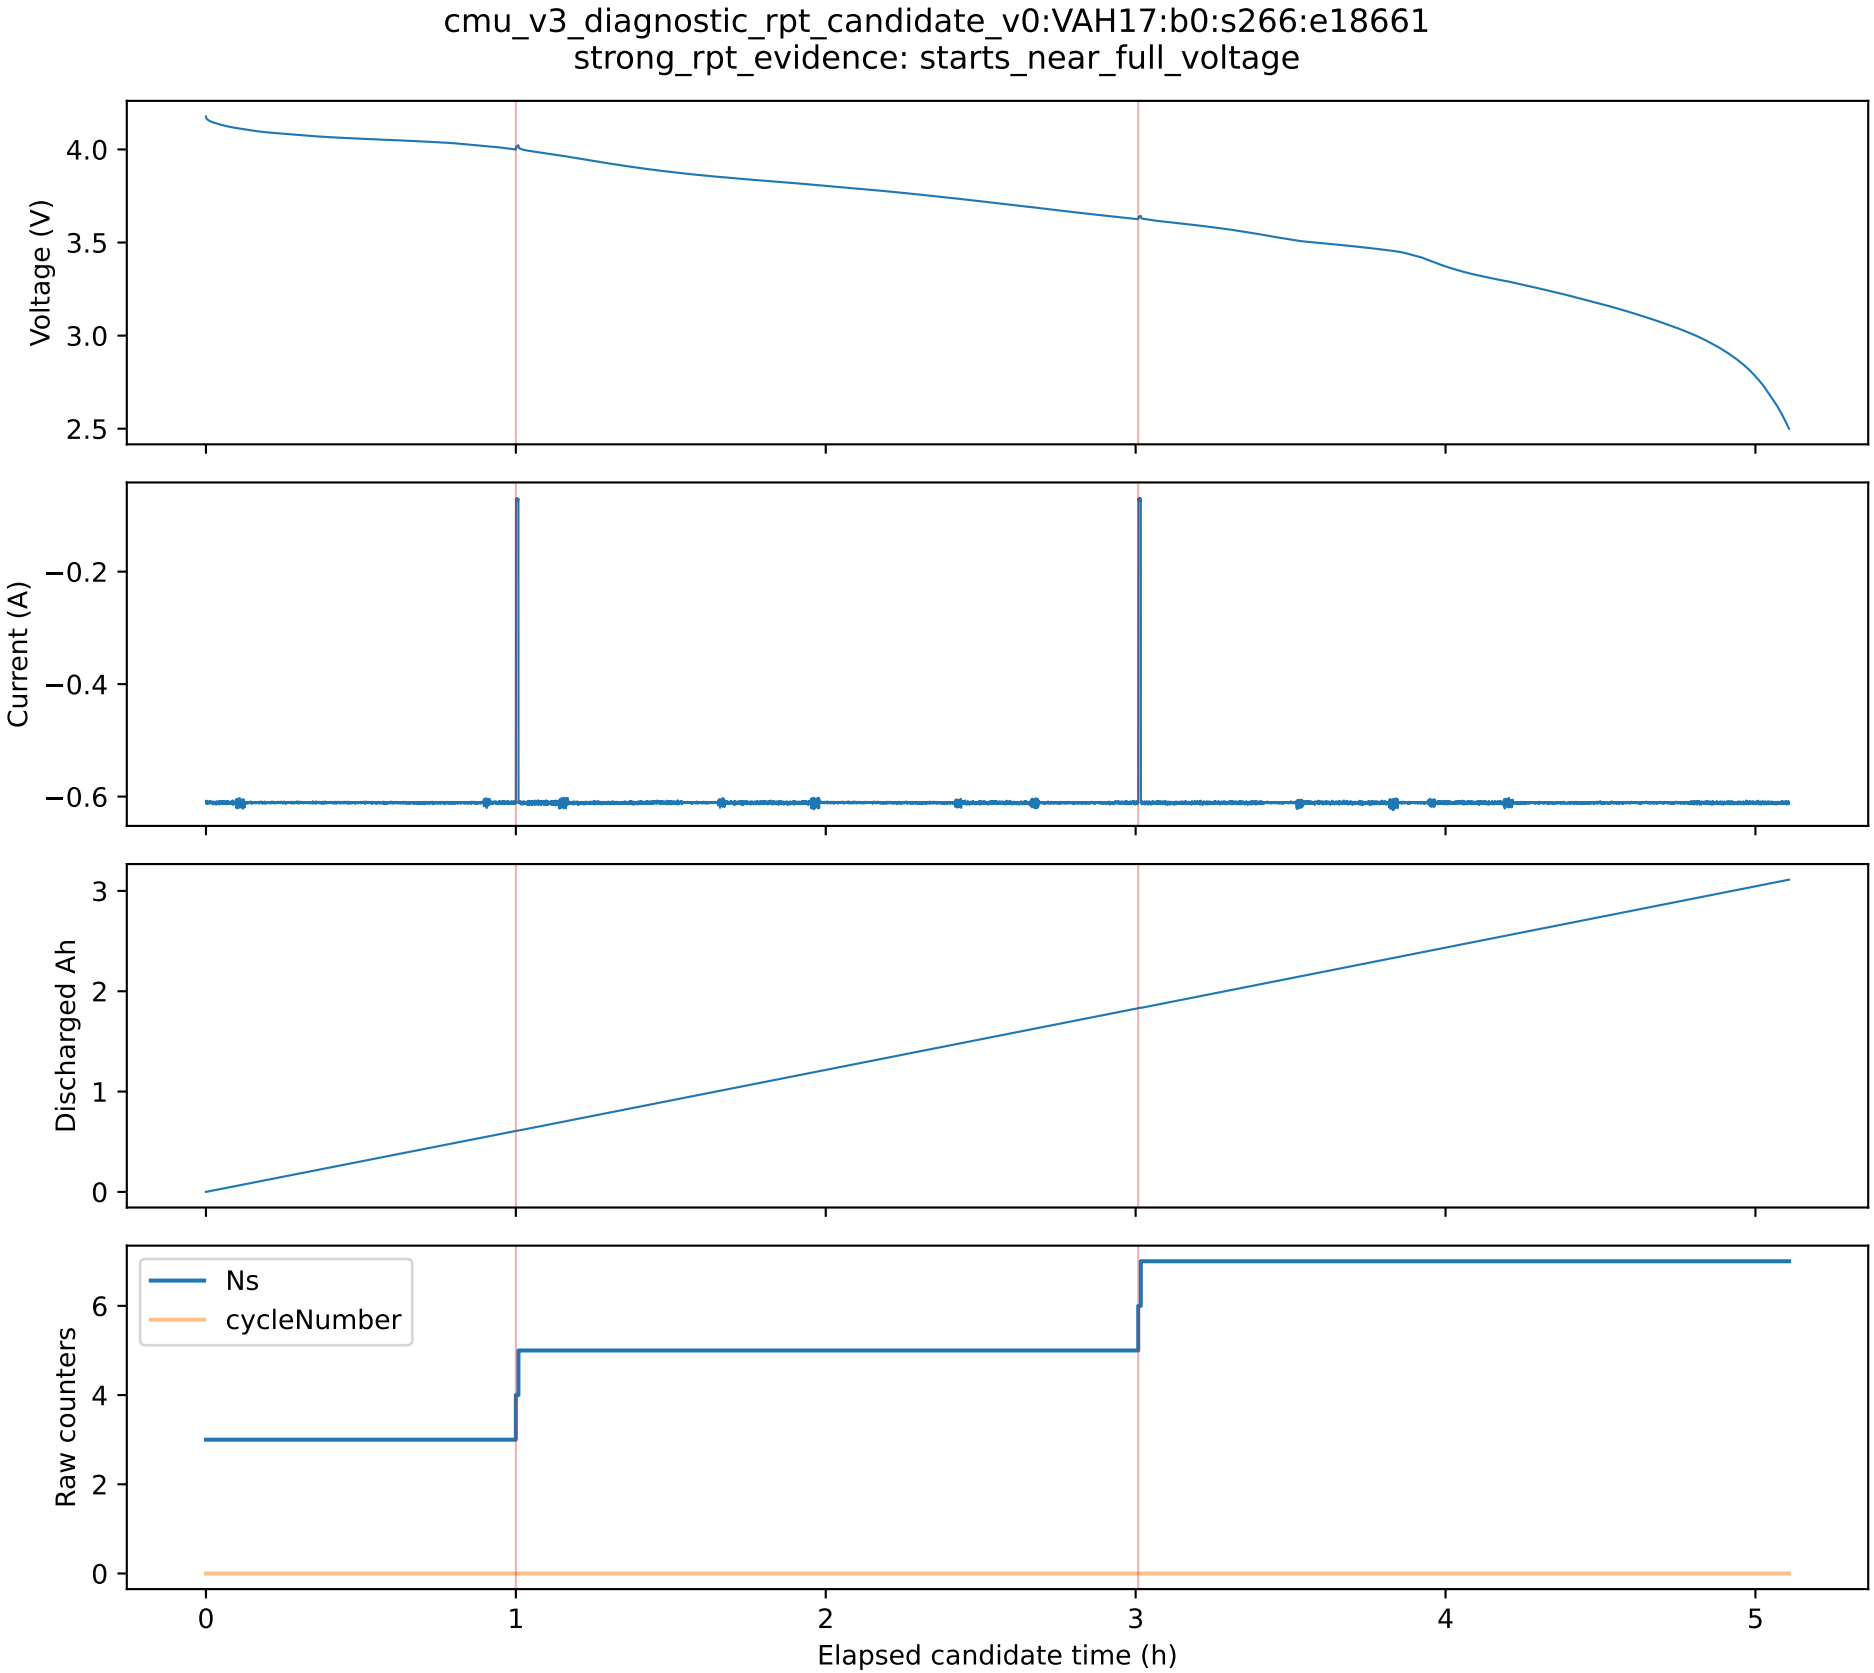
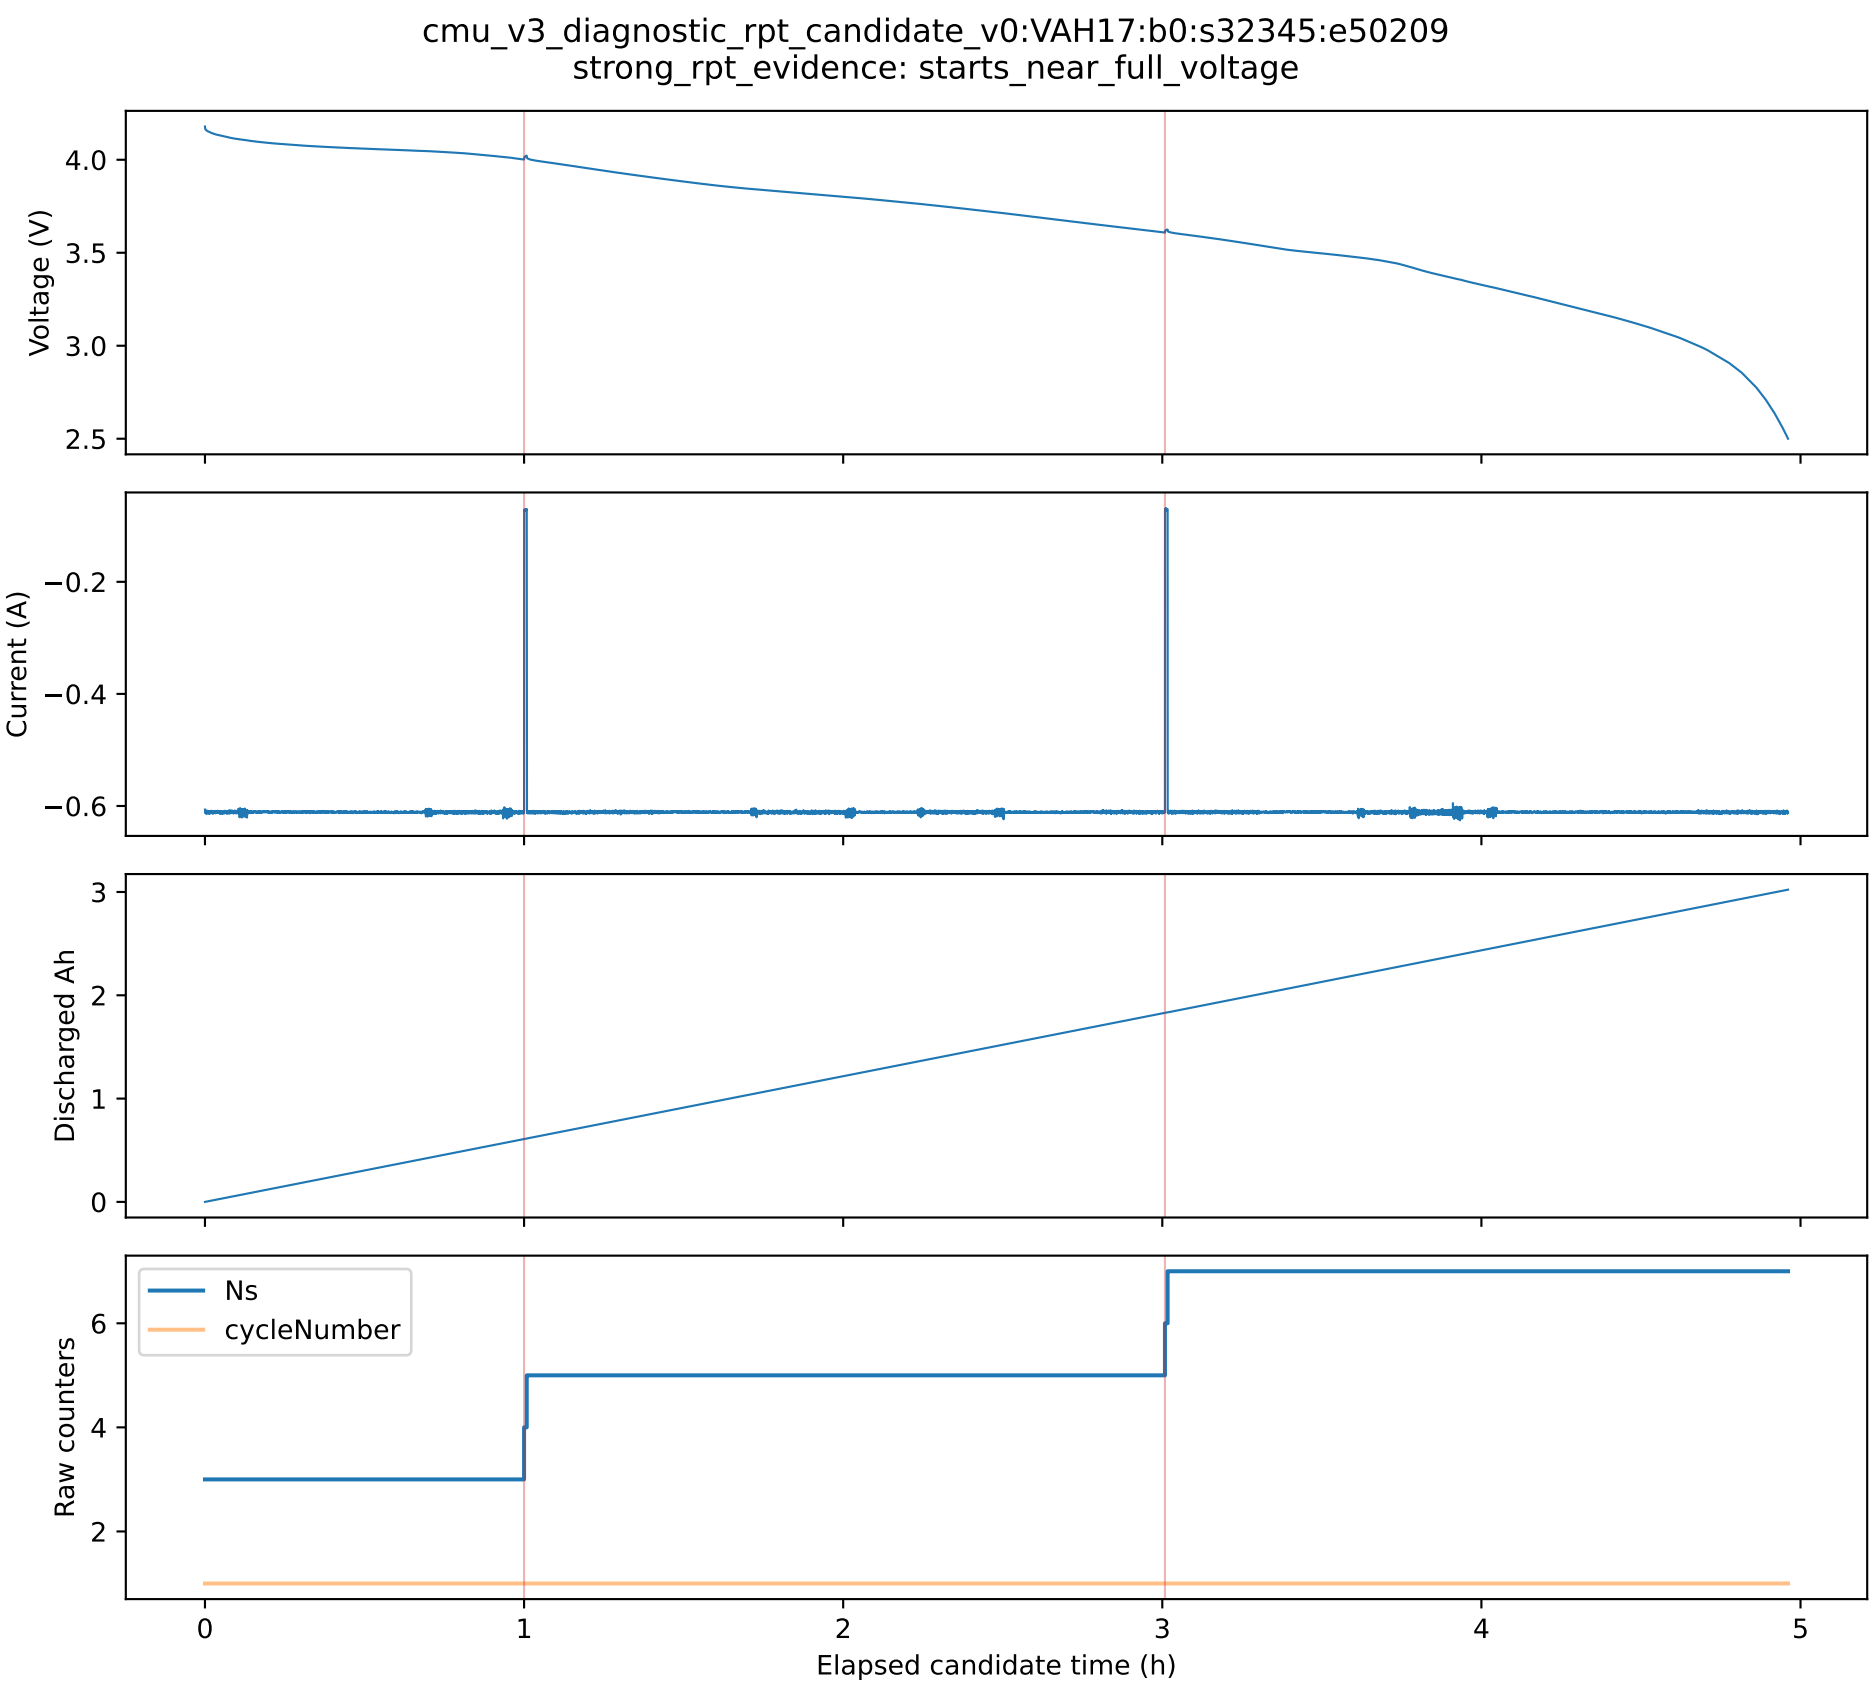
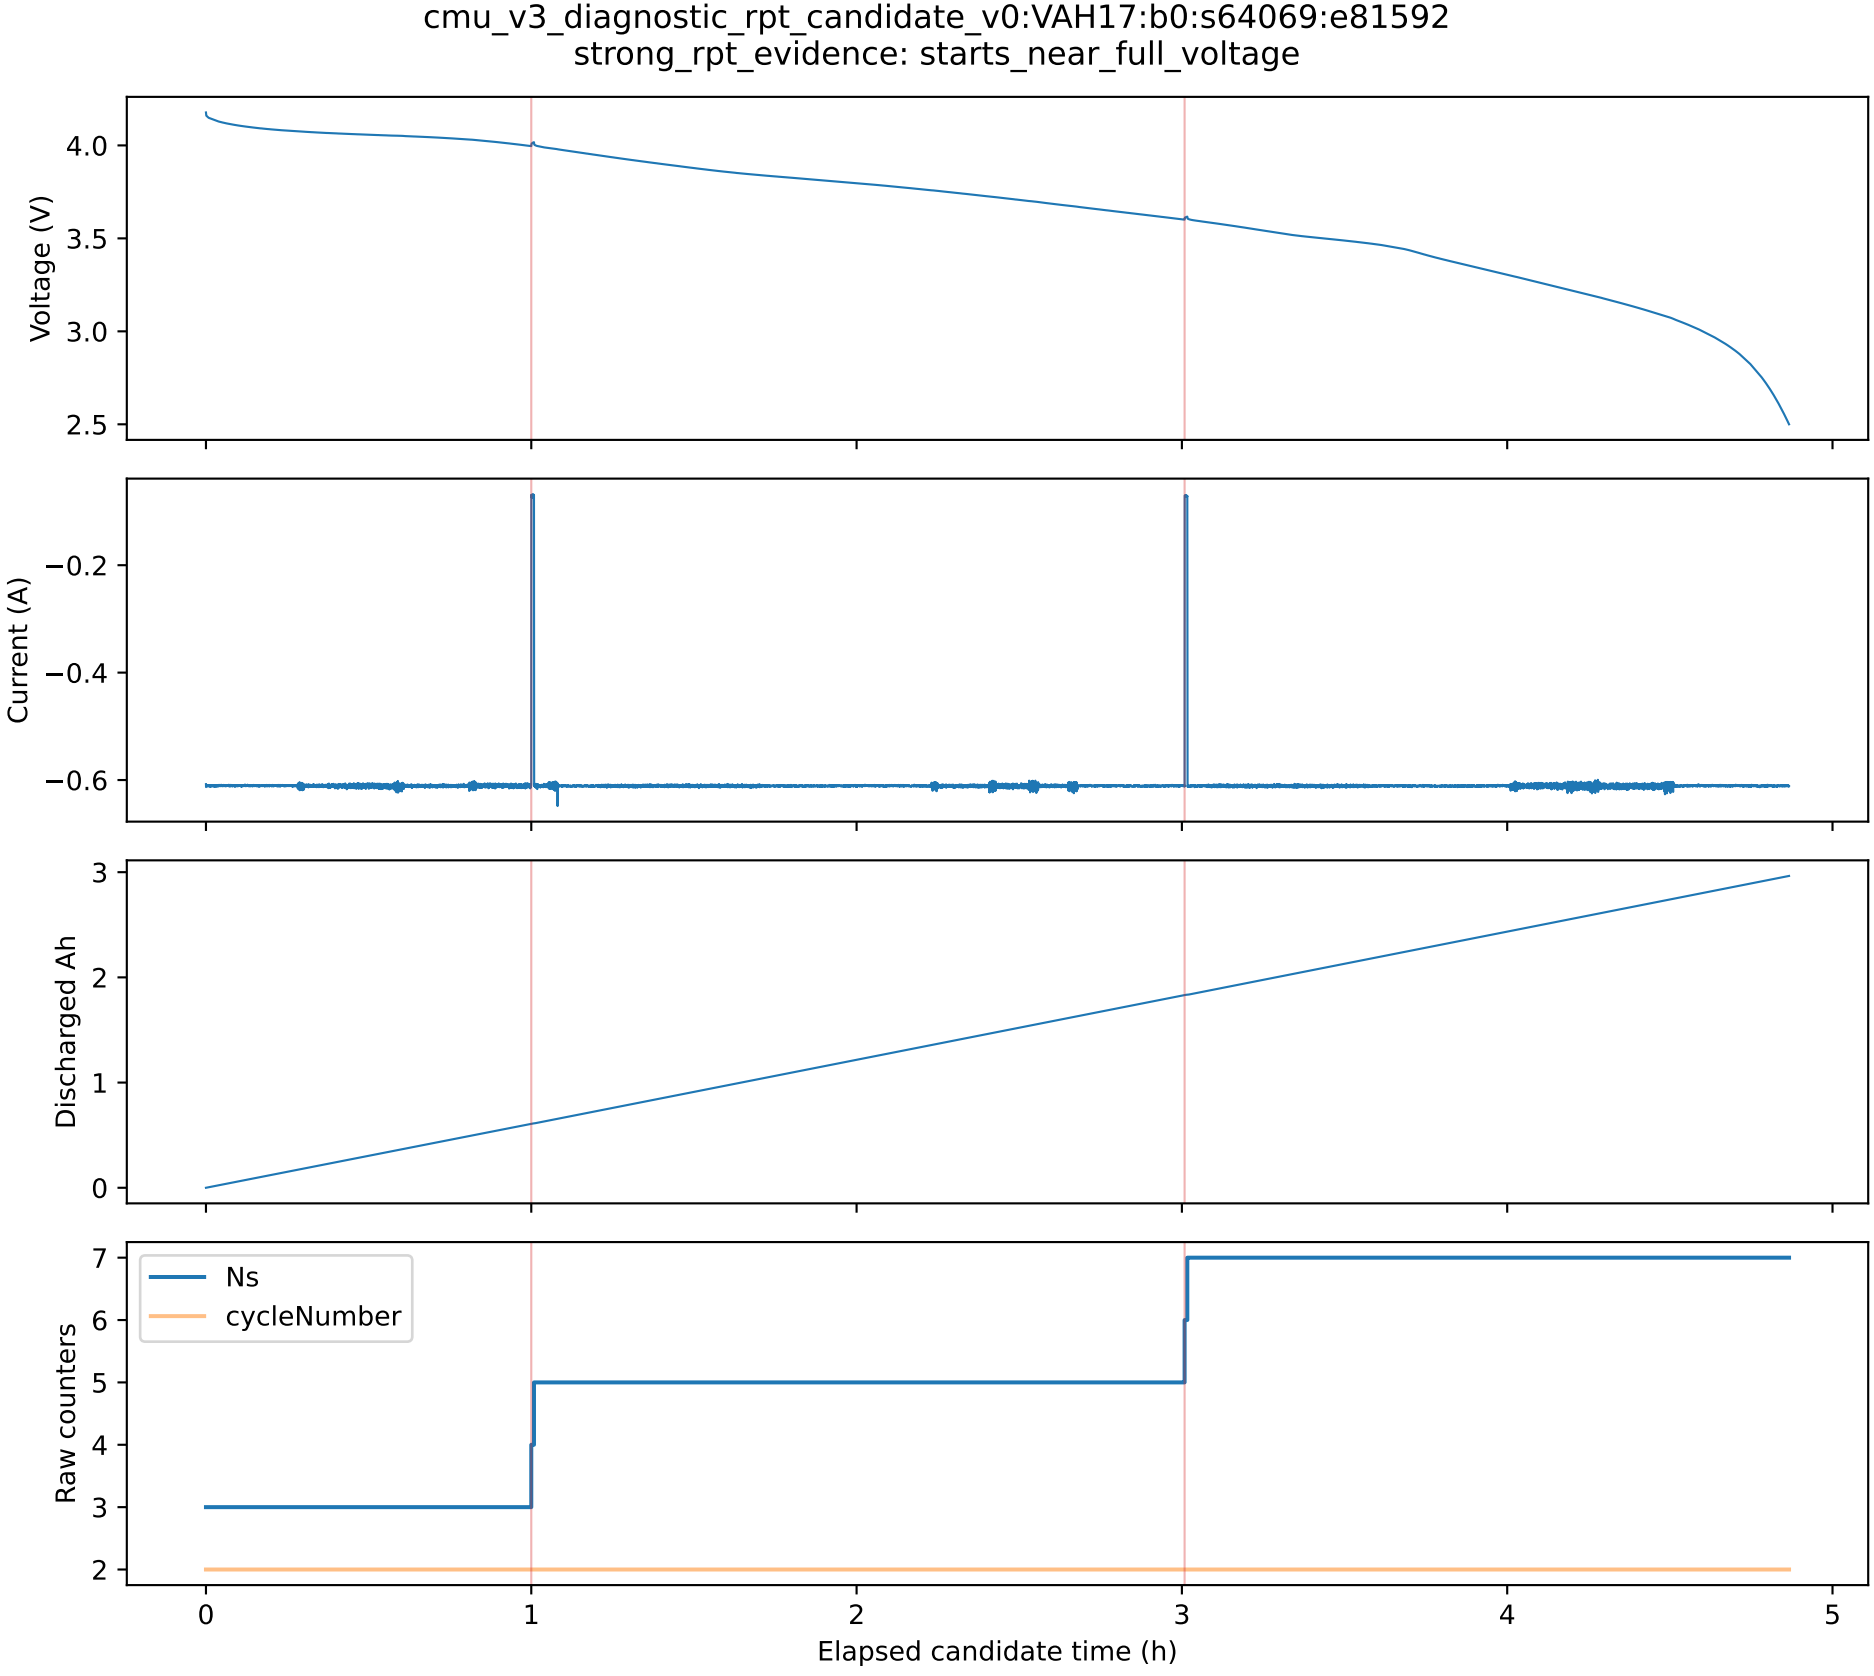
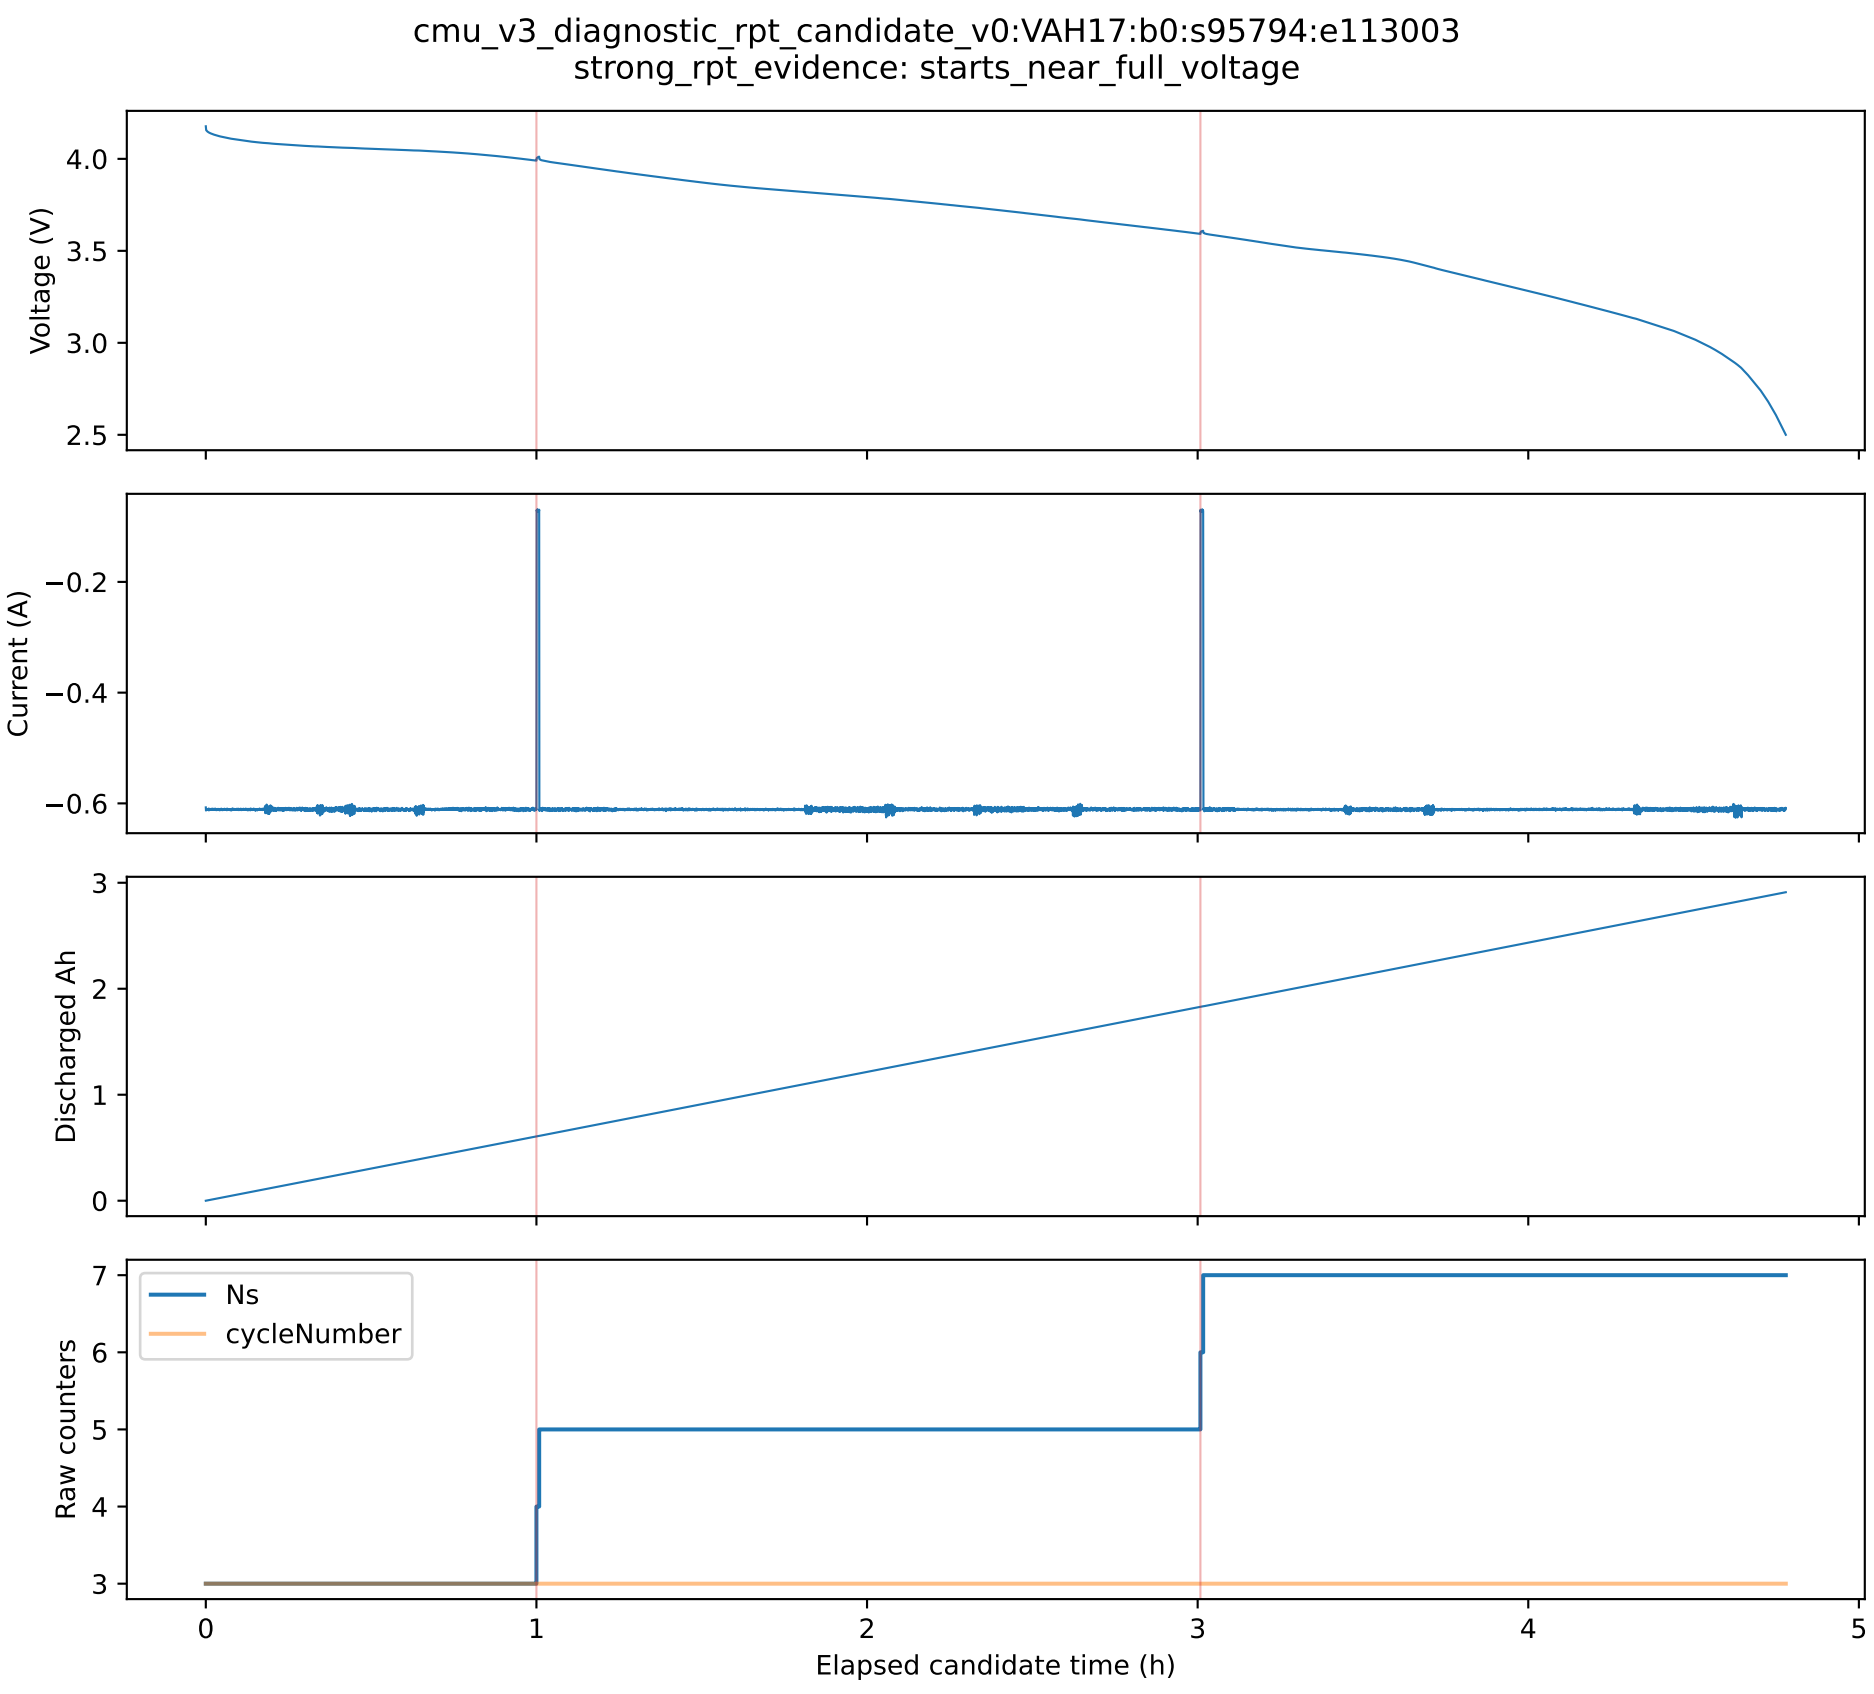
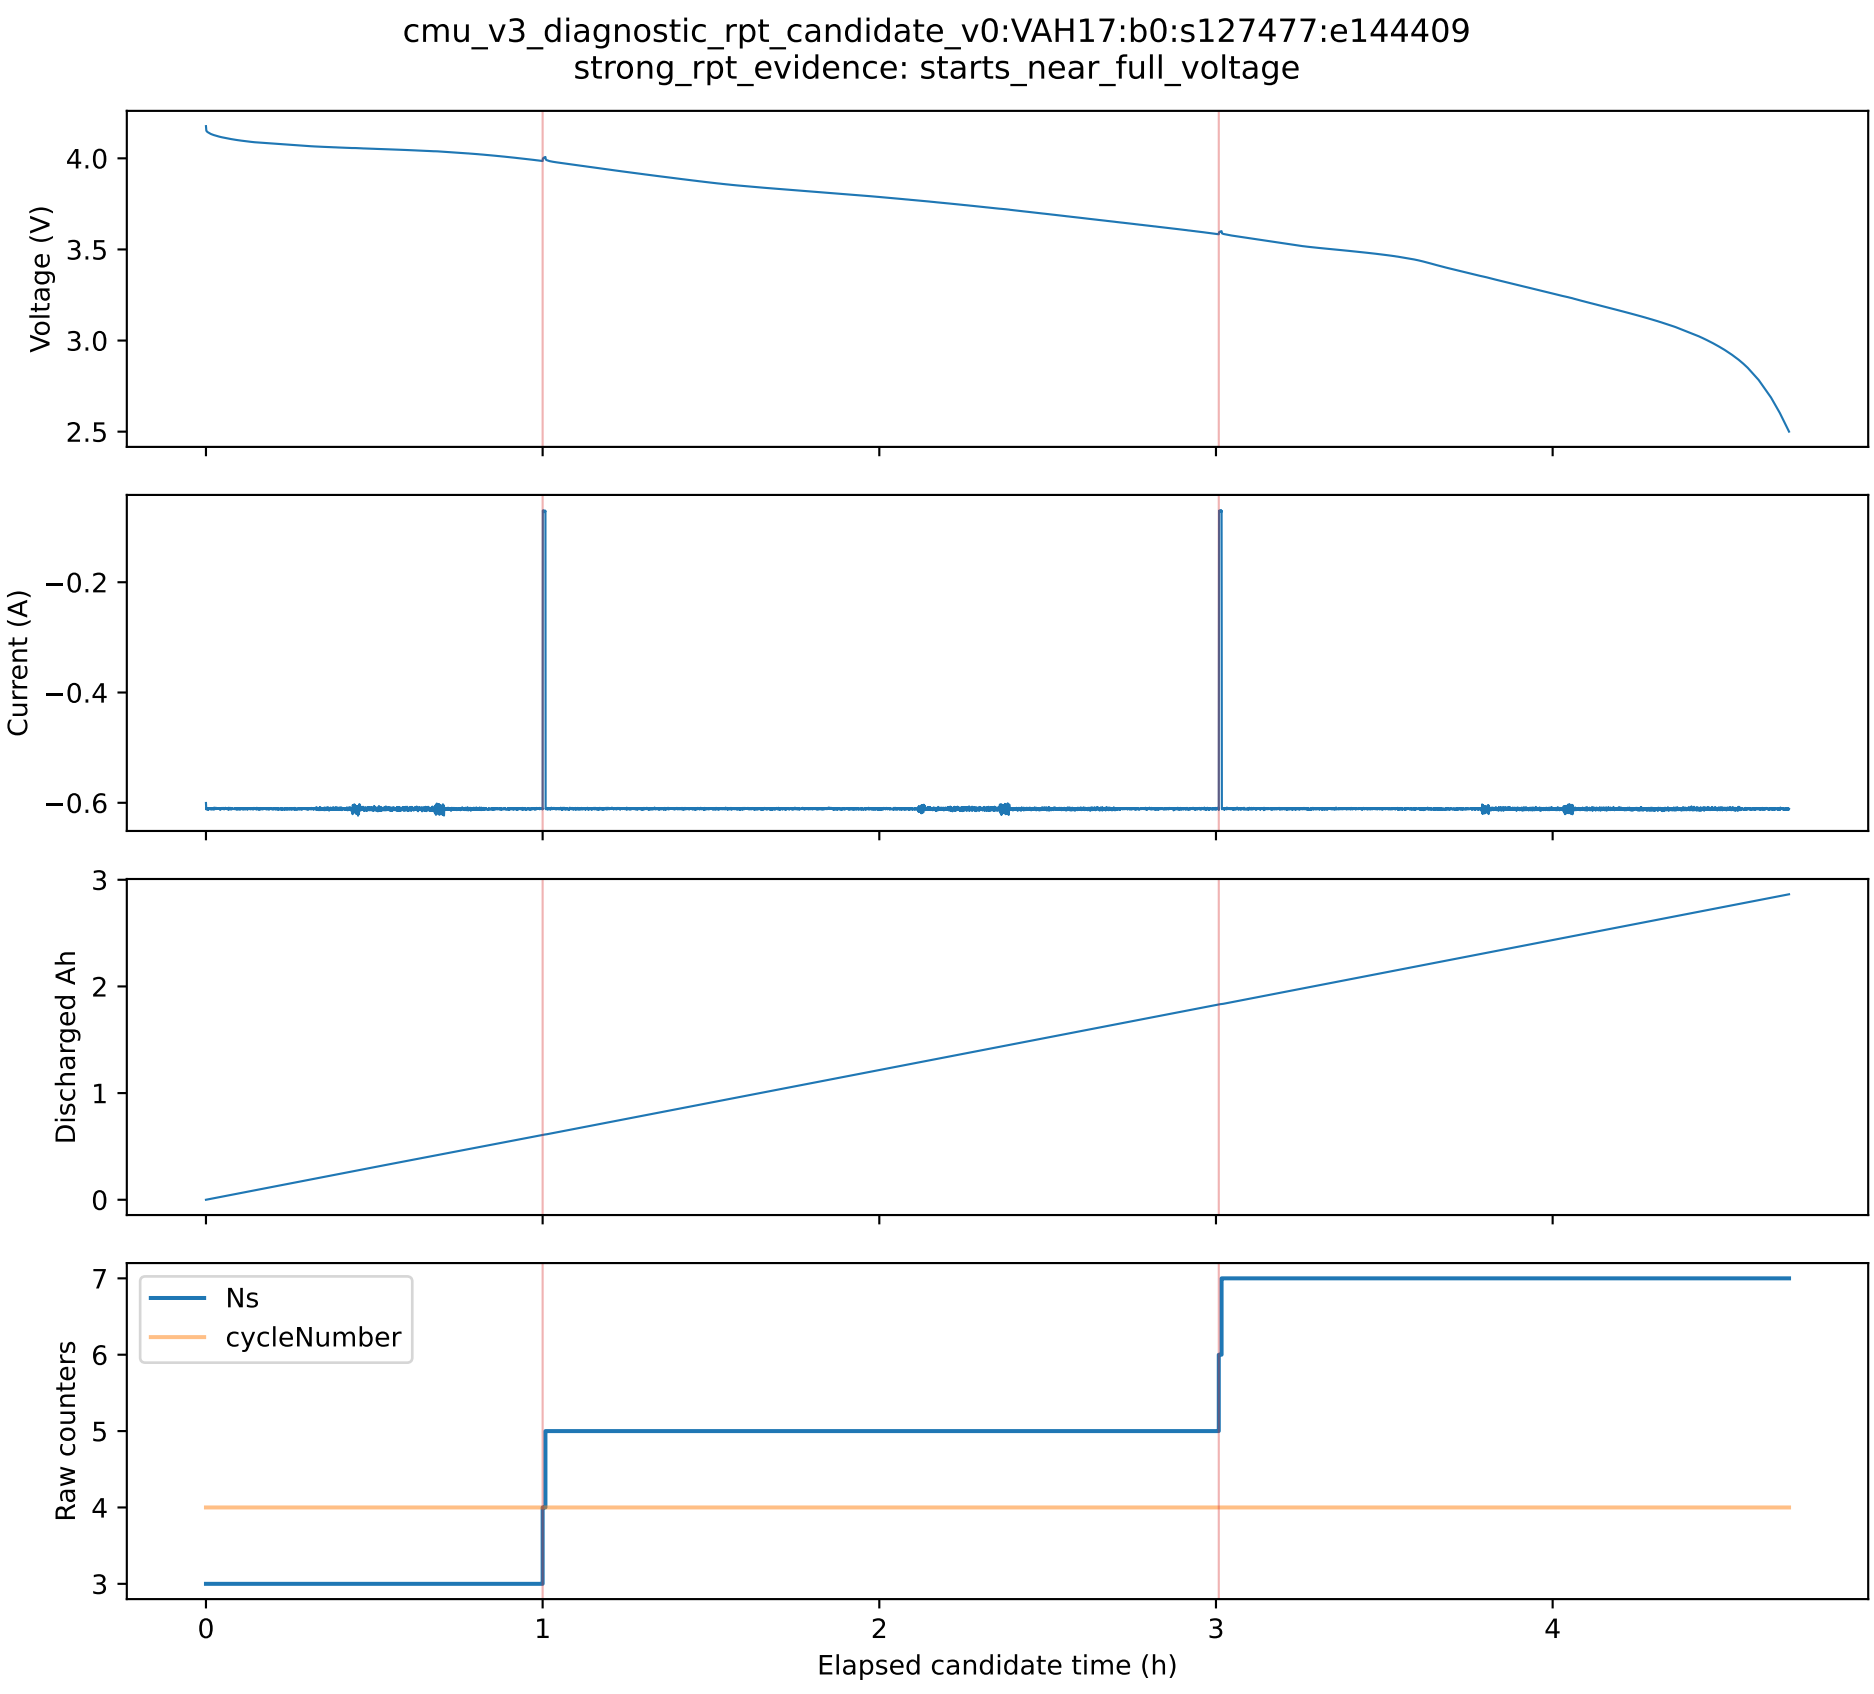
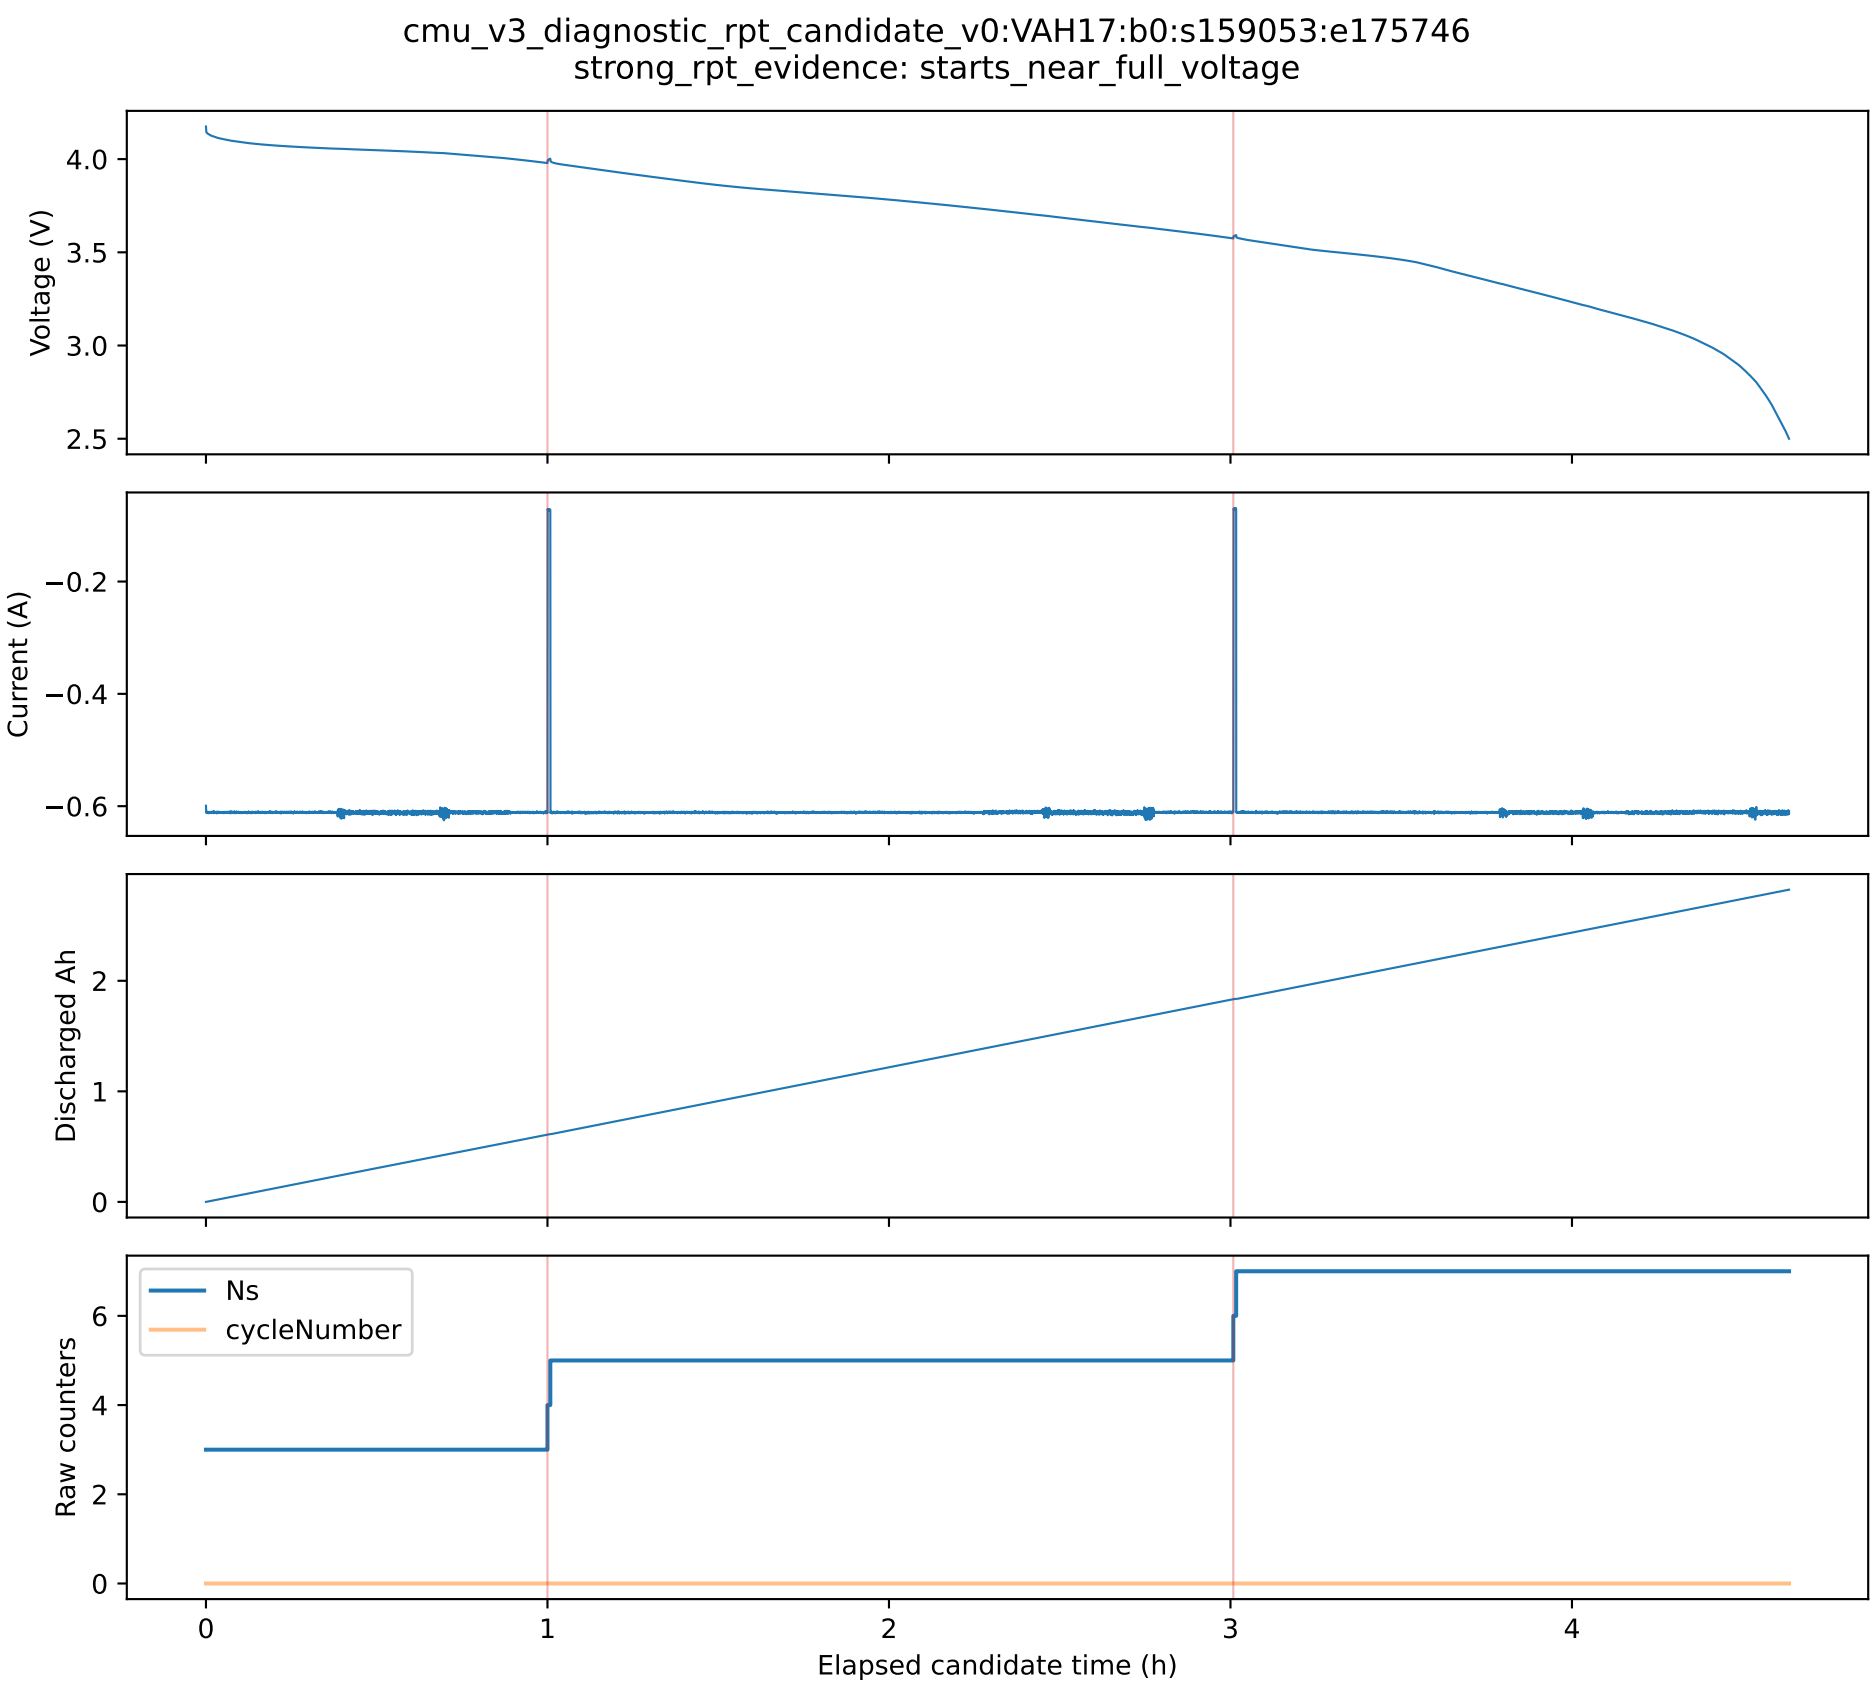

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s266:e18661
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
3
2
1
0
Raw counters
Ns
cycleNumber
6
4
2
0
0
1
2
3
4
5
Elapsed candidate time (h)

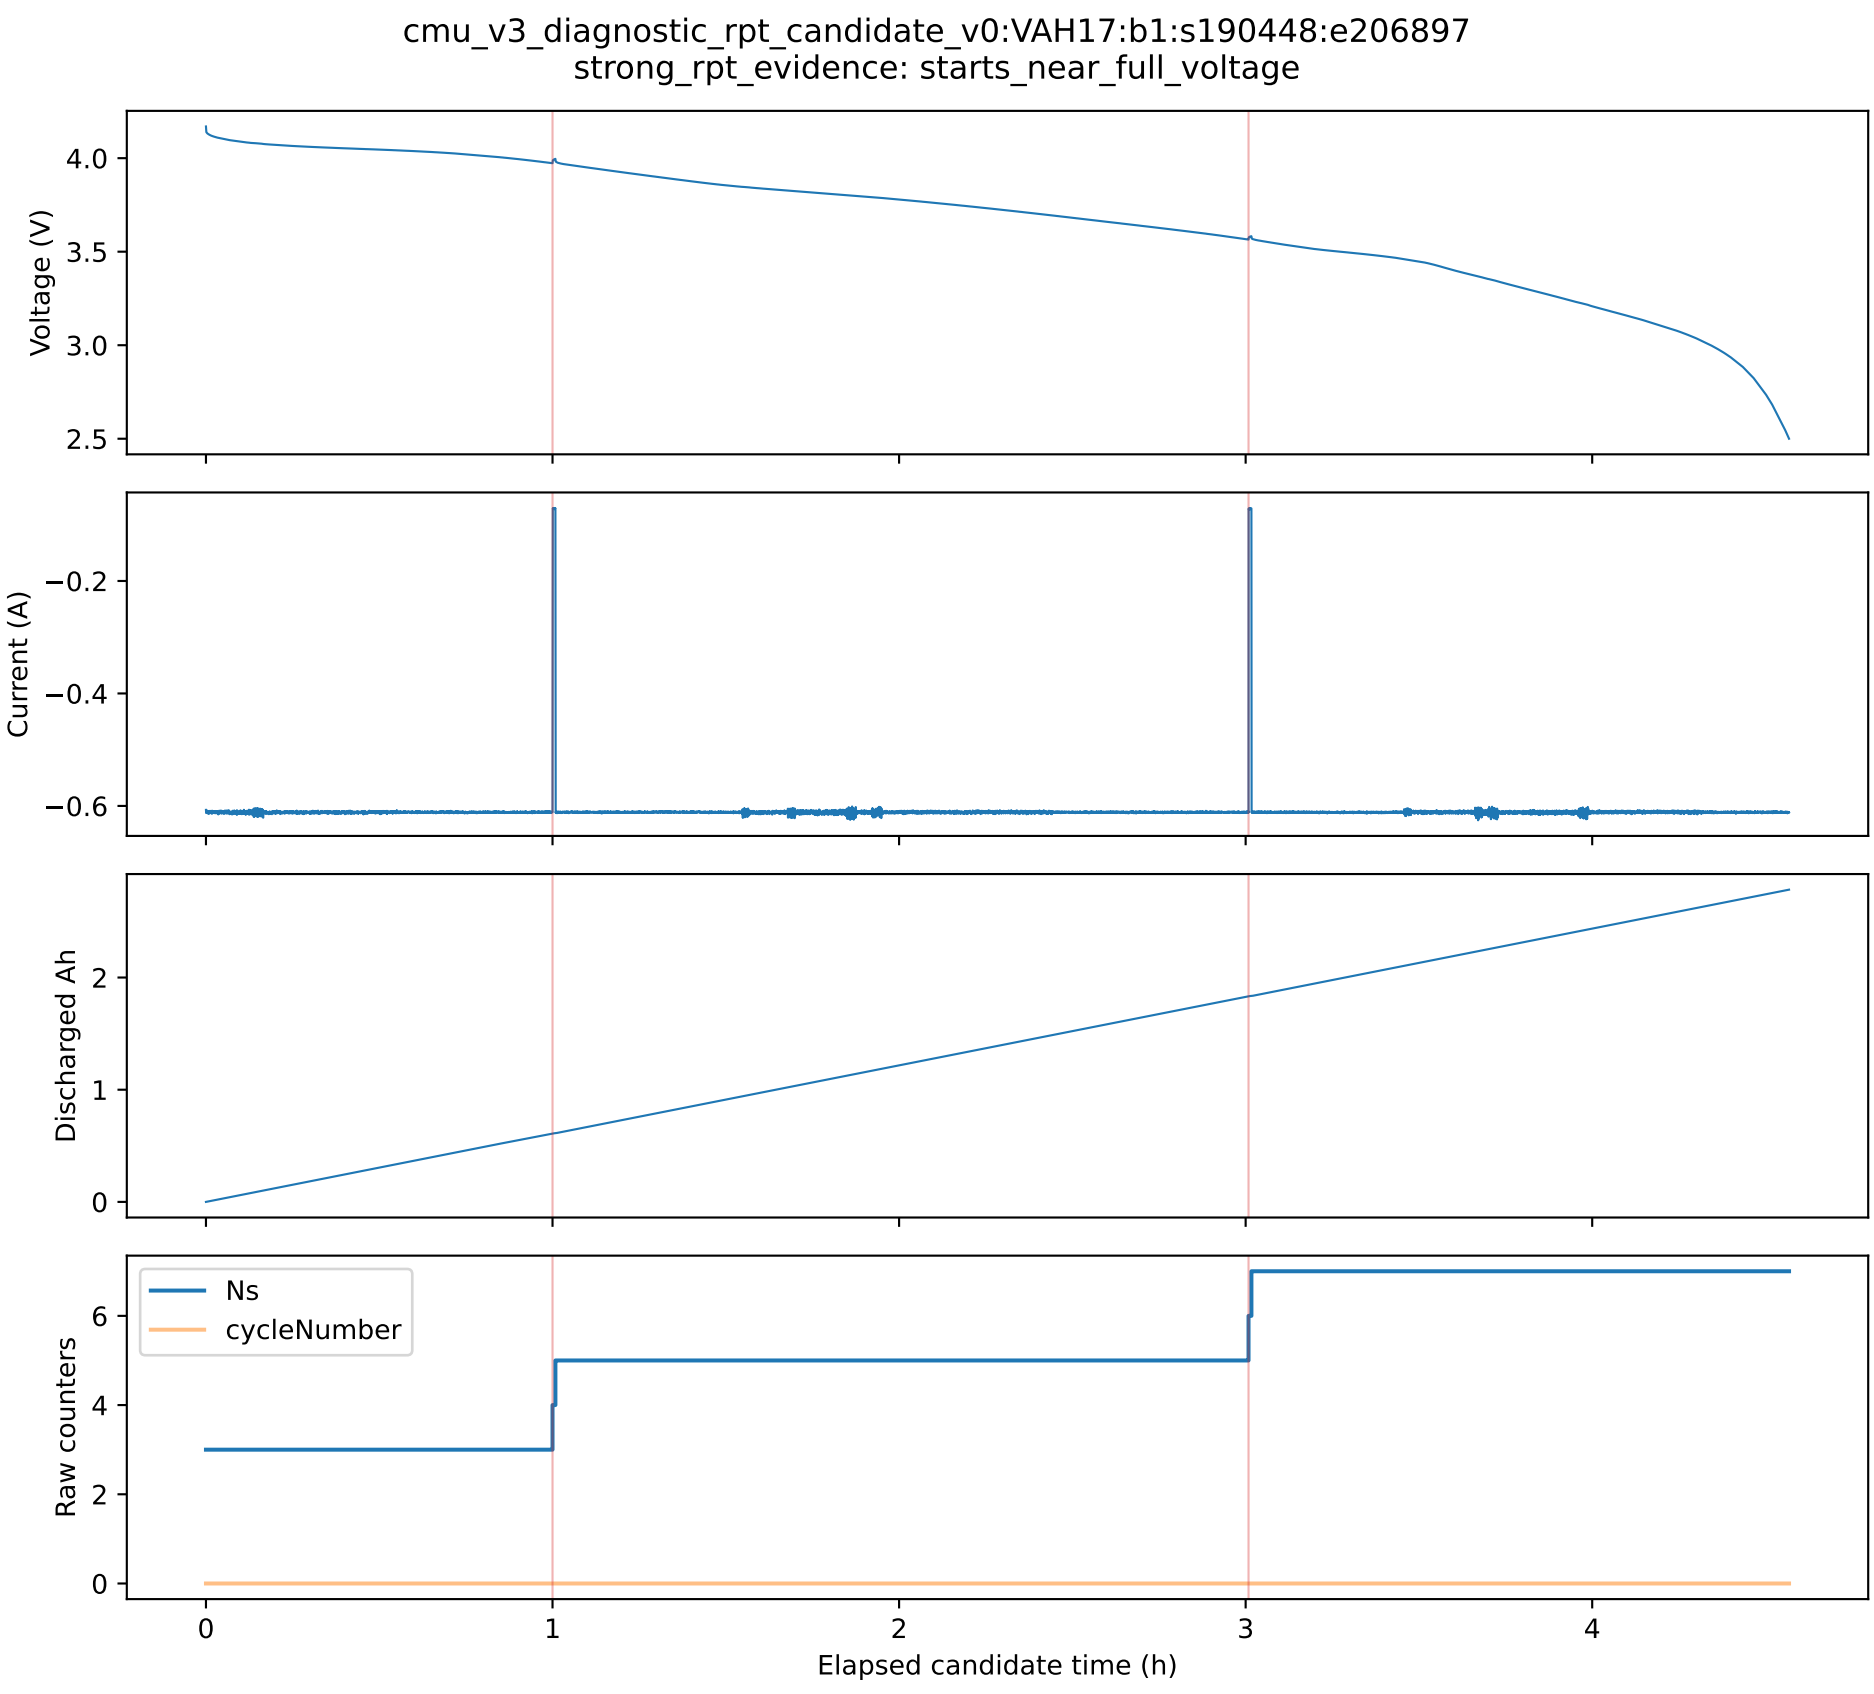

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s32345:e50209
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
3
2
1
0
Raw counters
Ns
cycleNumber
6
4
2
0
1
2
3
4
5
Elapsed candidate time (h)

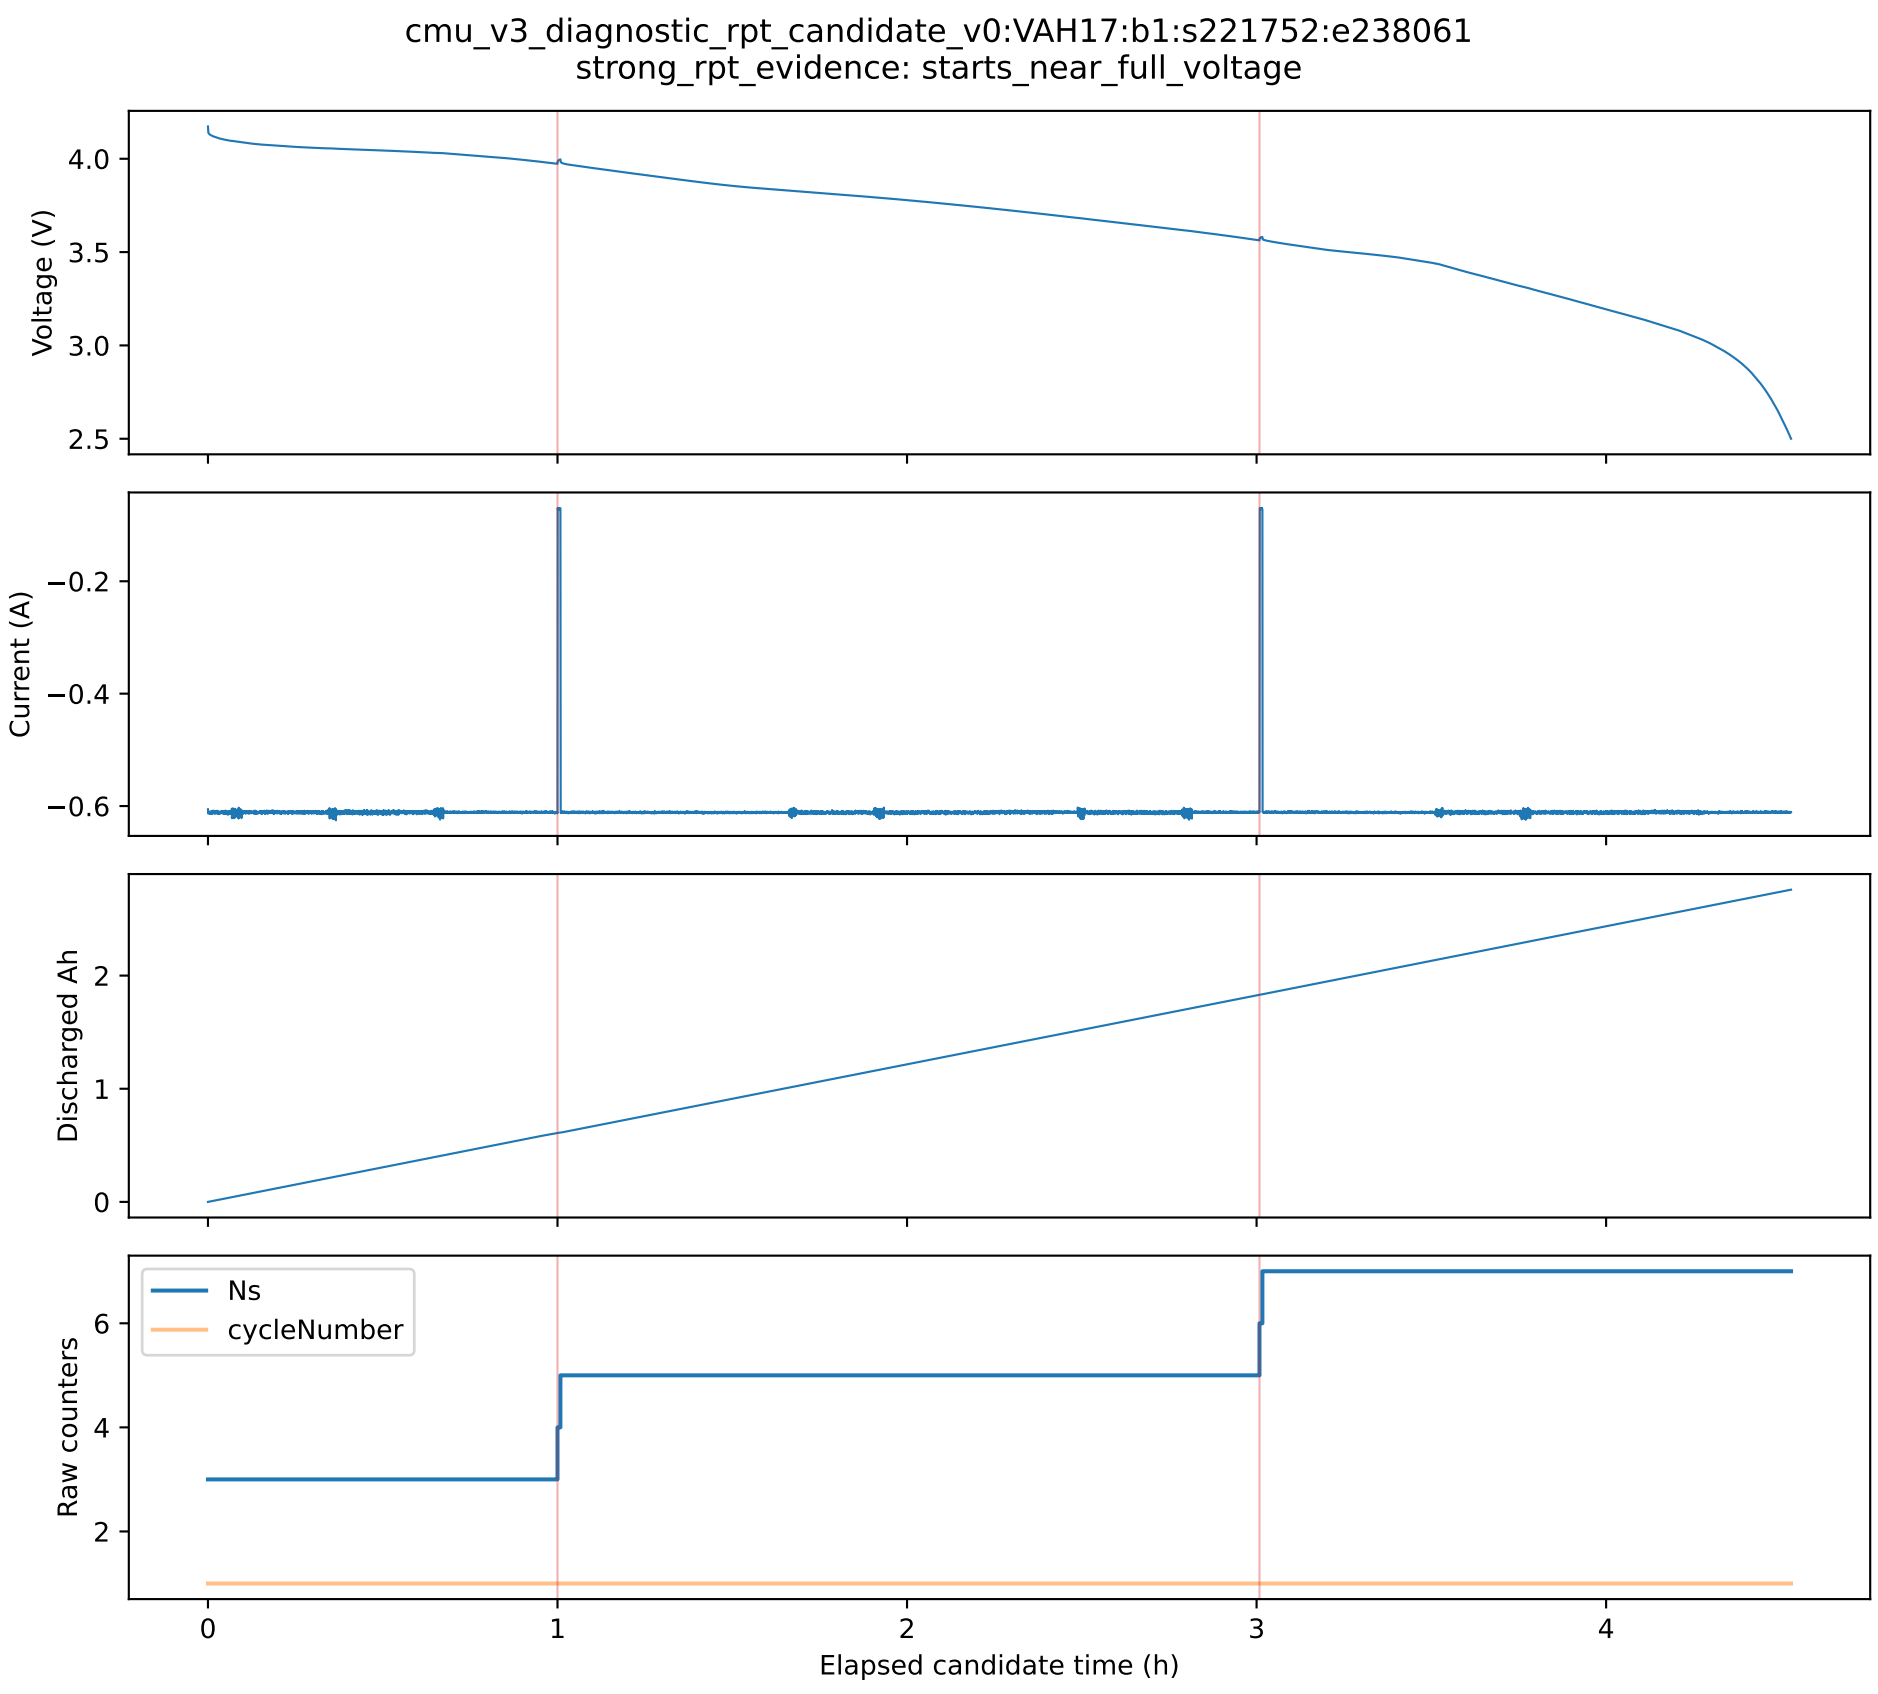

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s64069:e81592
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
3
2
1
0
Raw counters
Ns
cycleNumber
7
6
5
4
3
2
0
1
2
3
4
5
Elapsed candidate time (h)

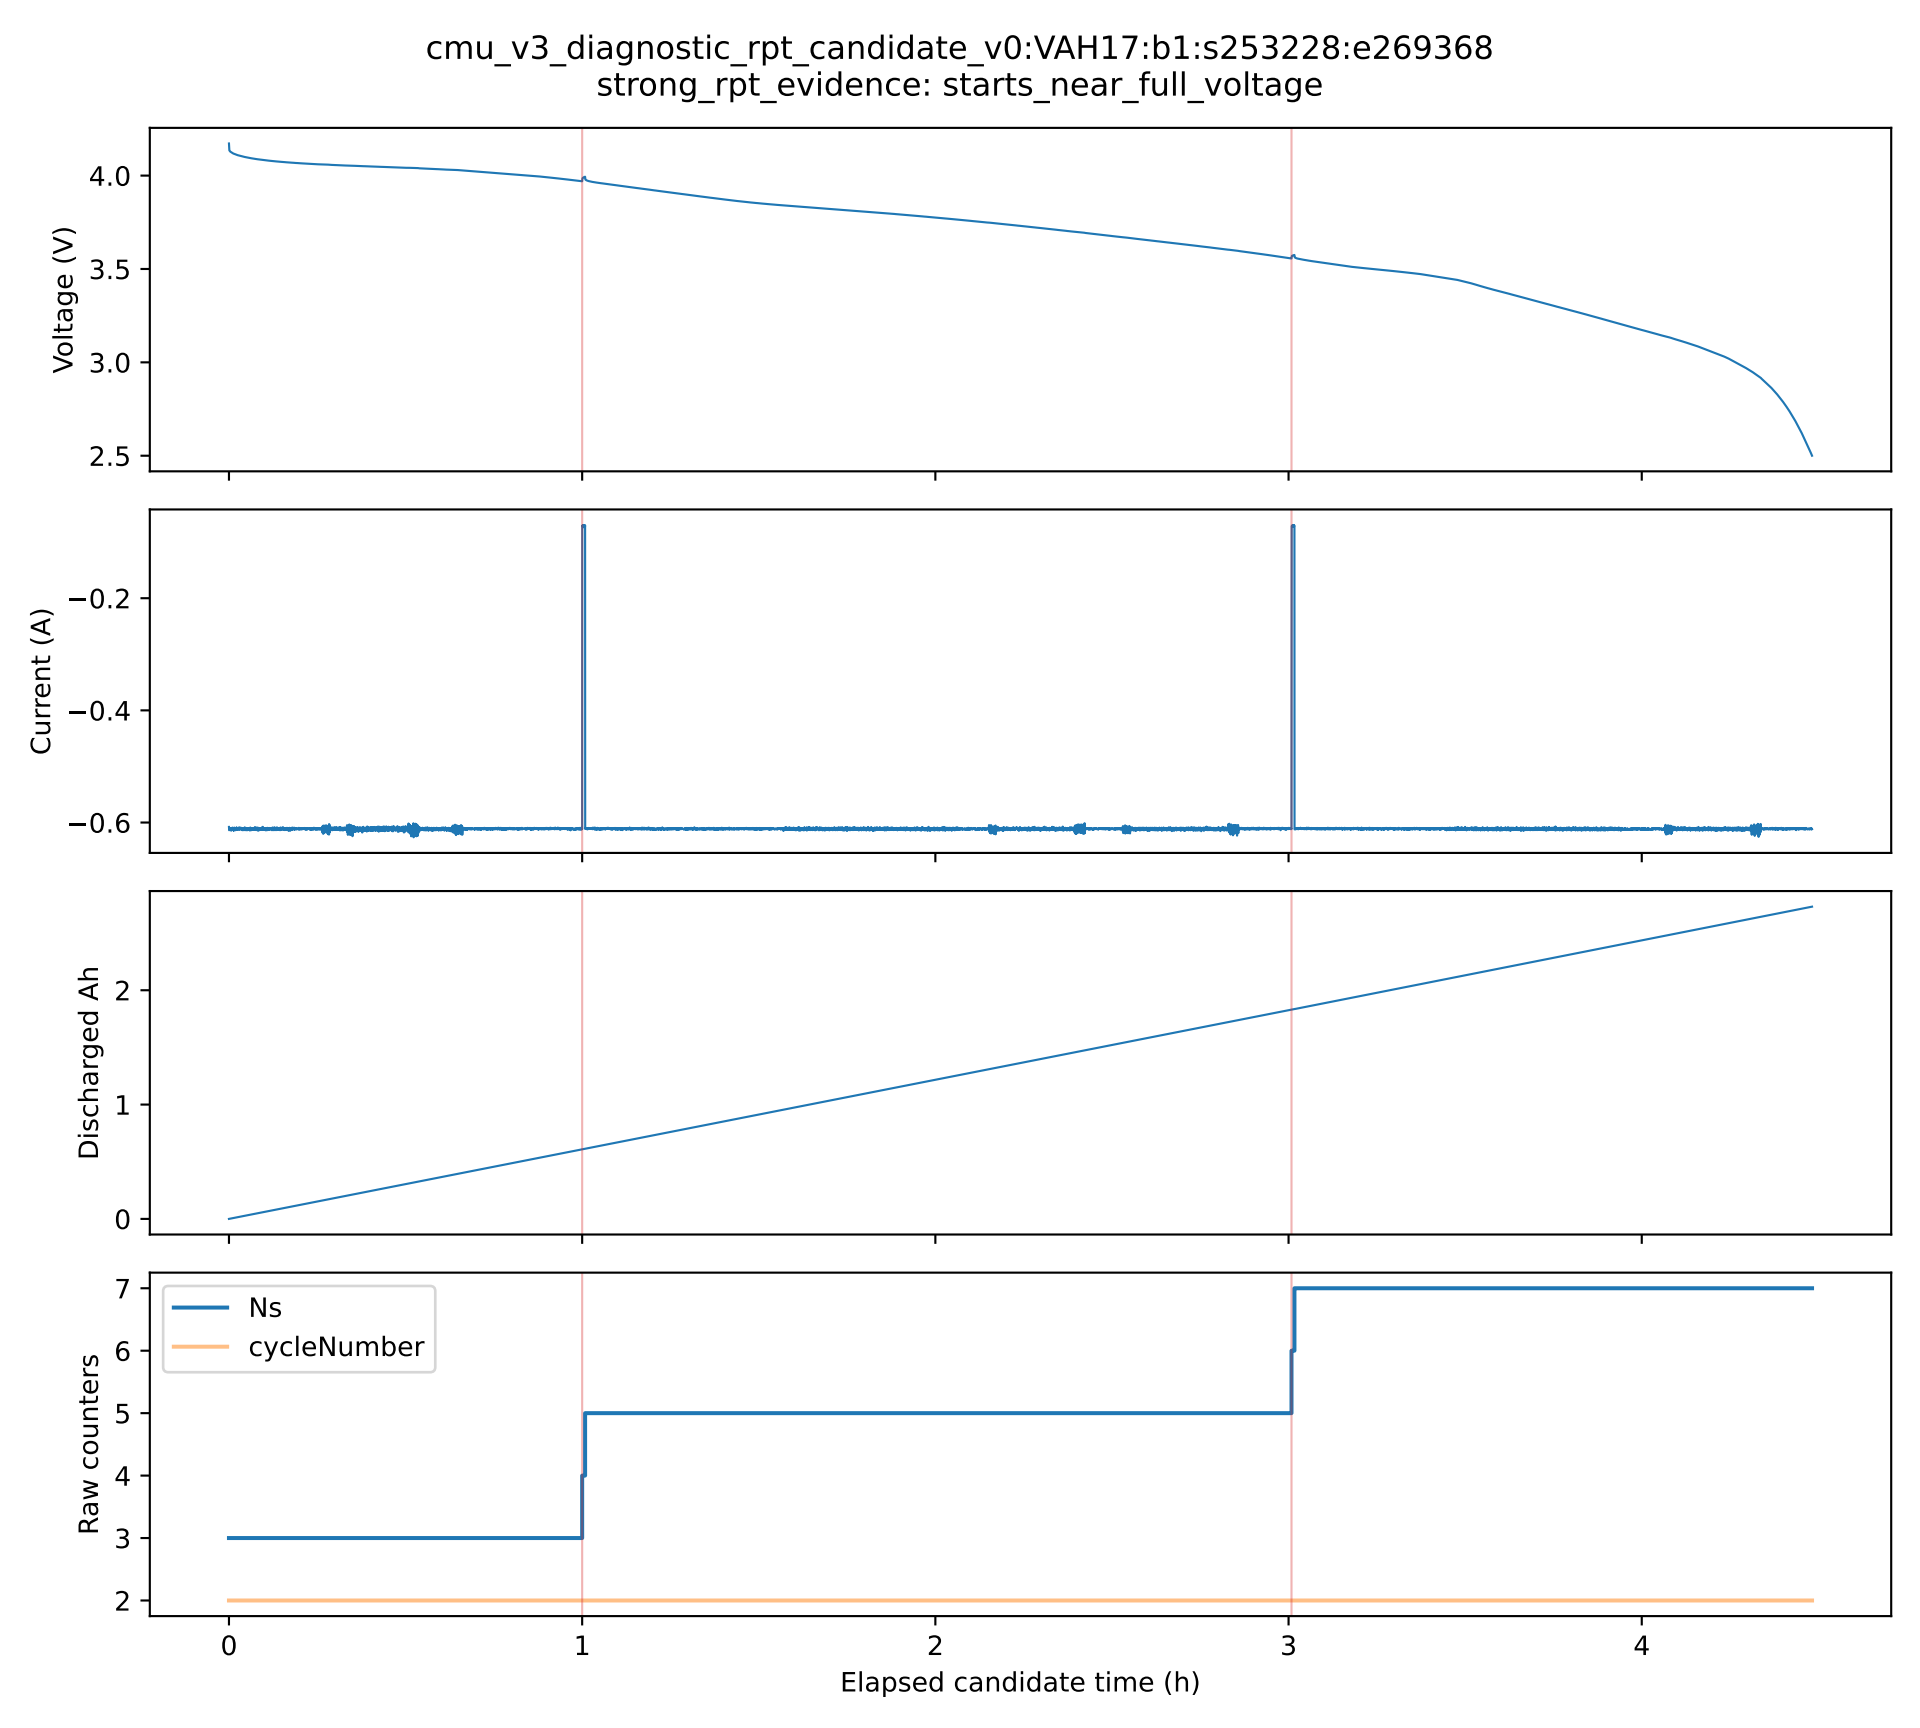

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s95794:e113003
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
3
2
1
0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
5
Elapsed candidate time (h)

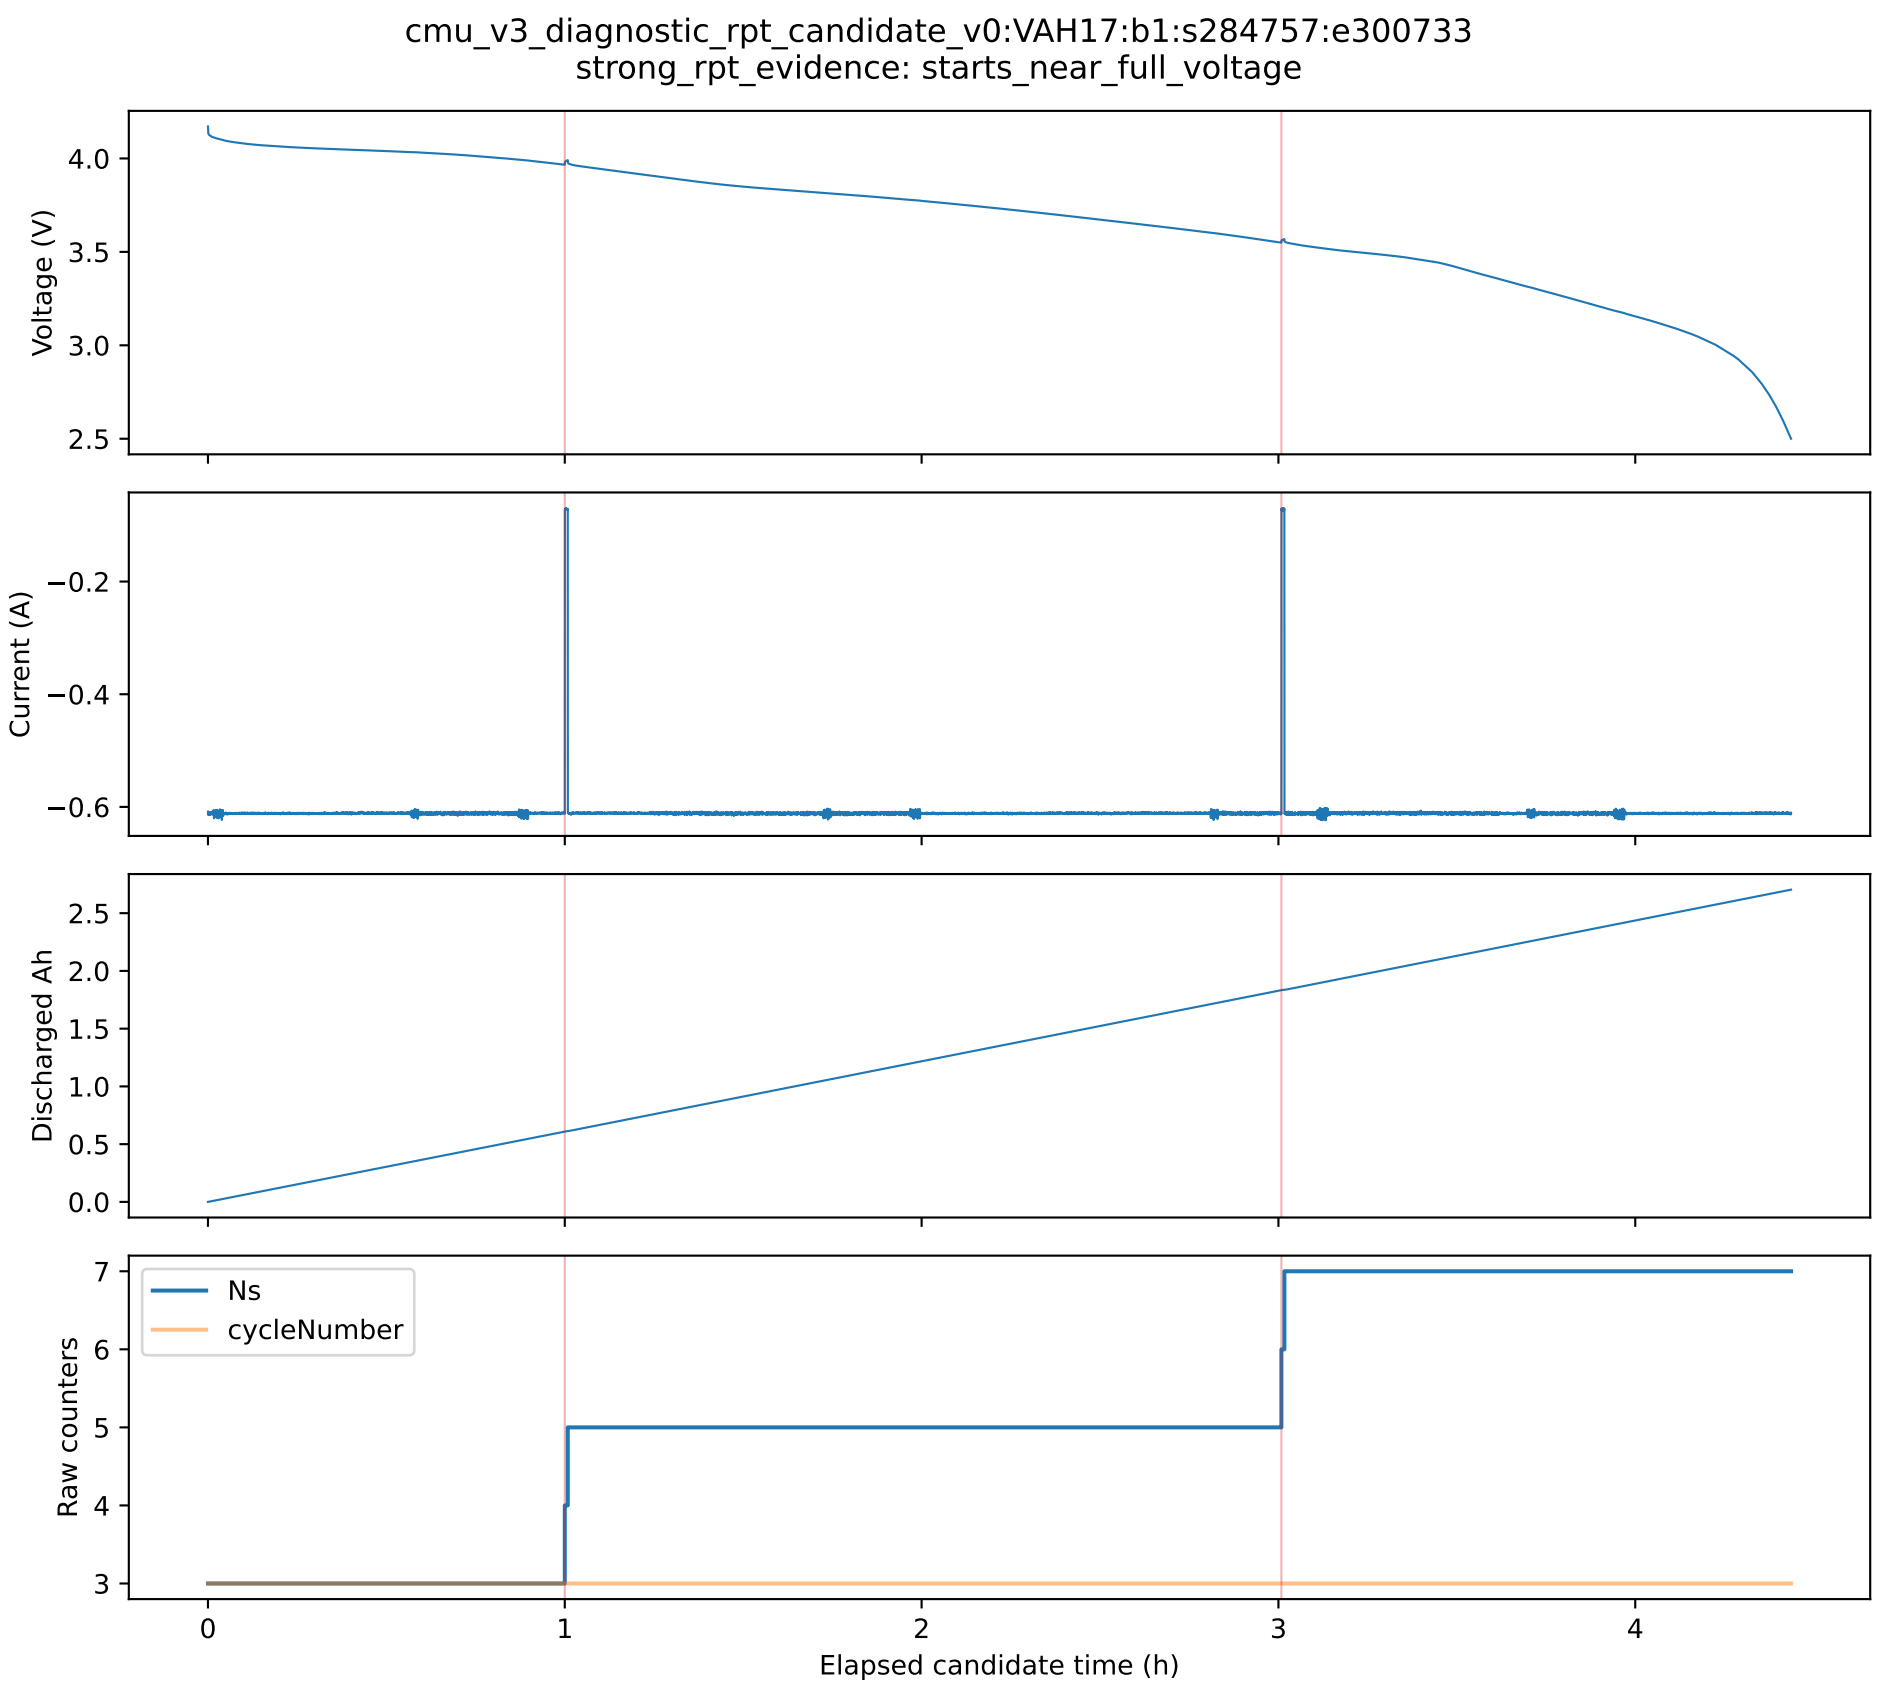

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s127477:e144409
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
3
2
1
0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)

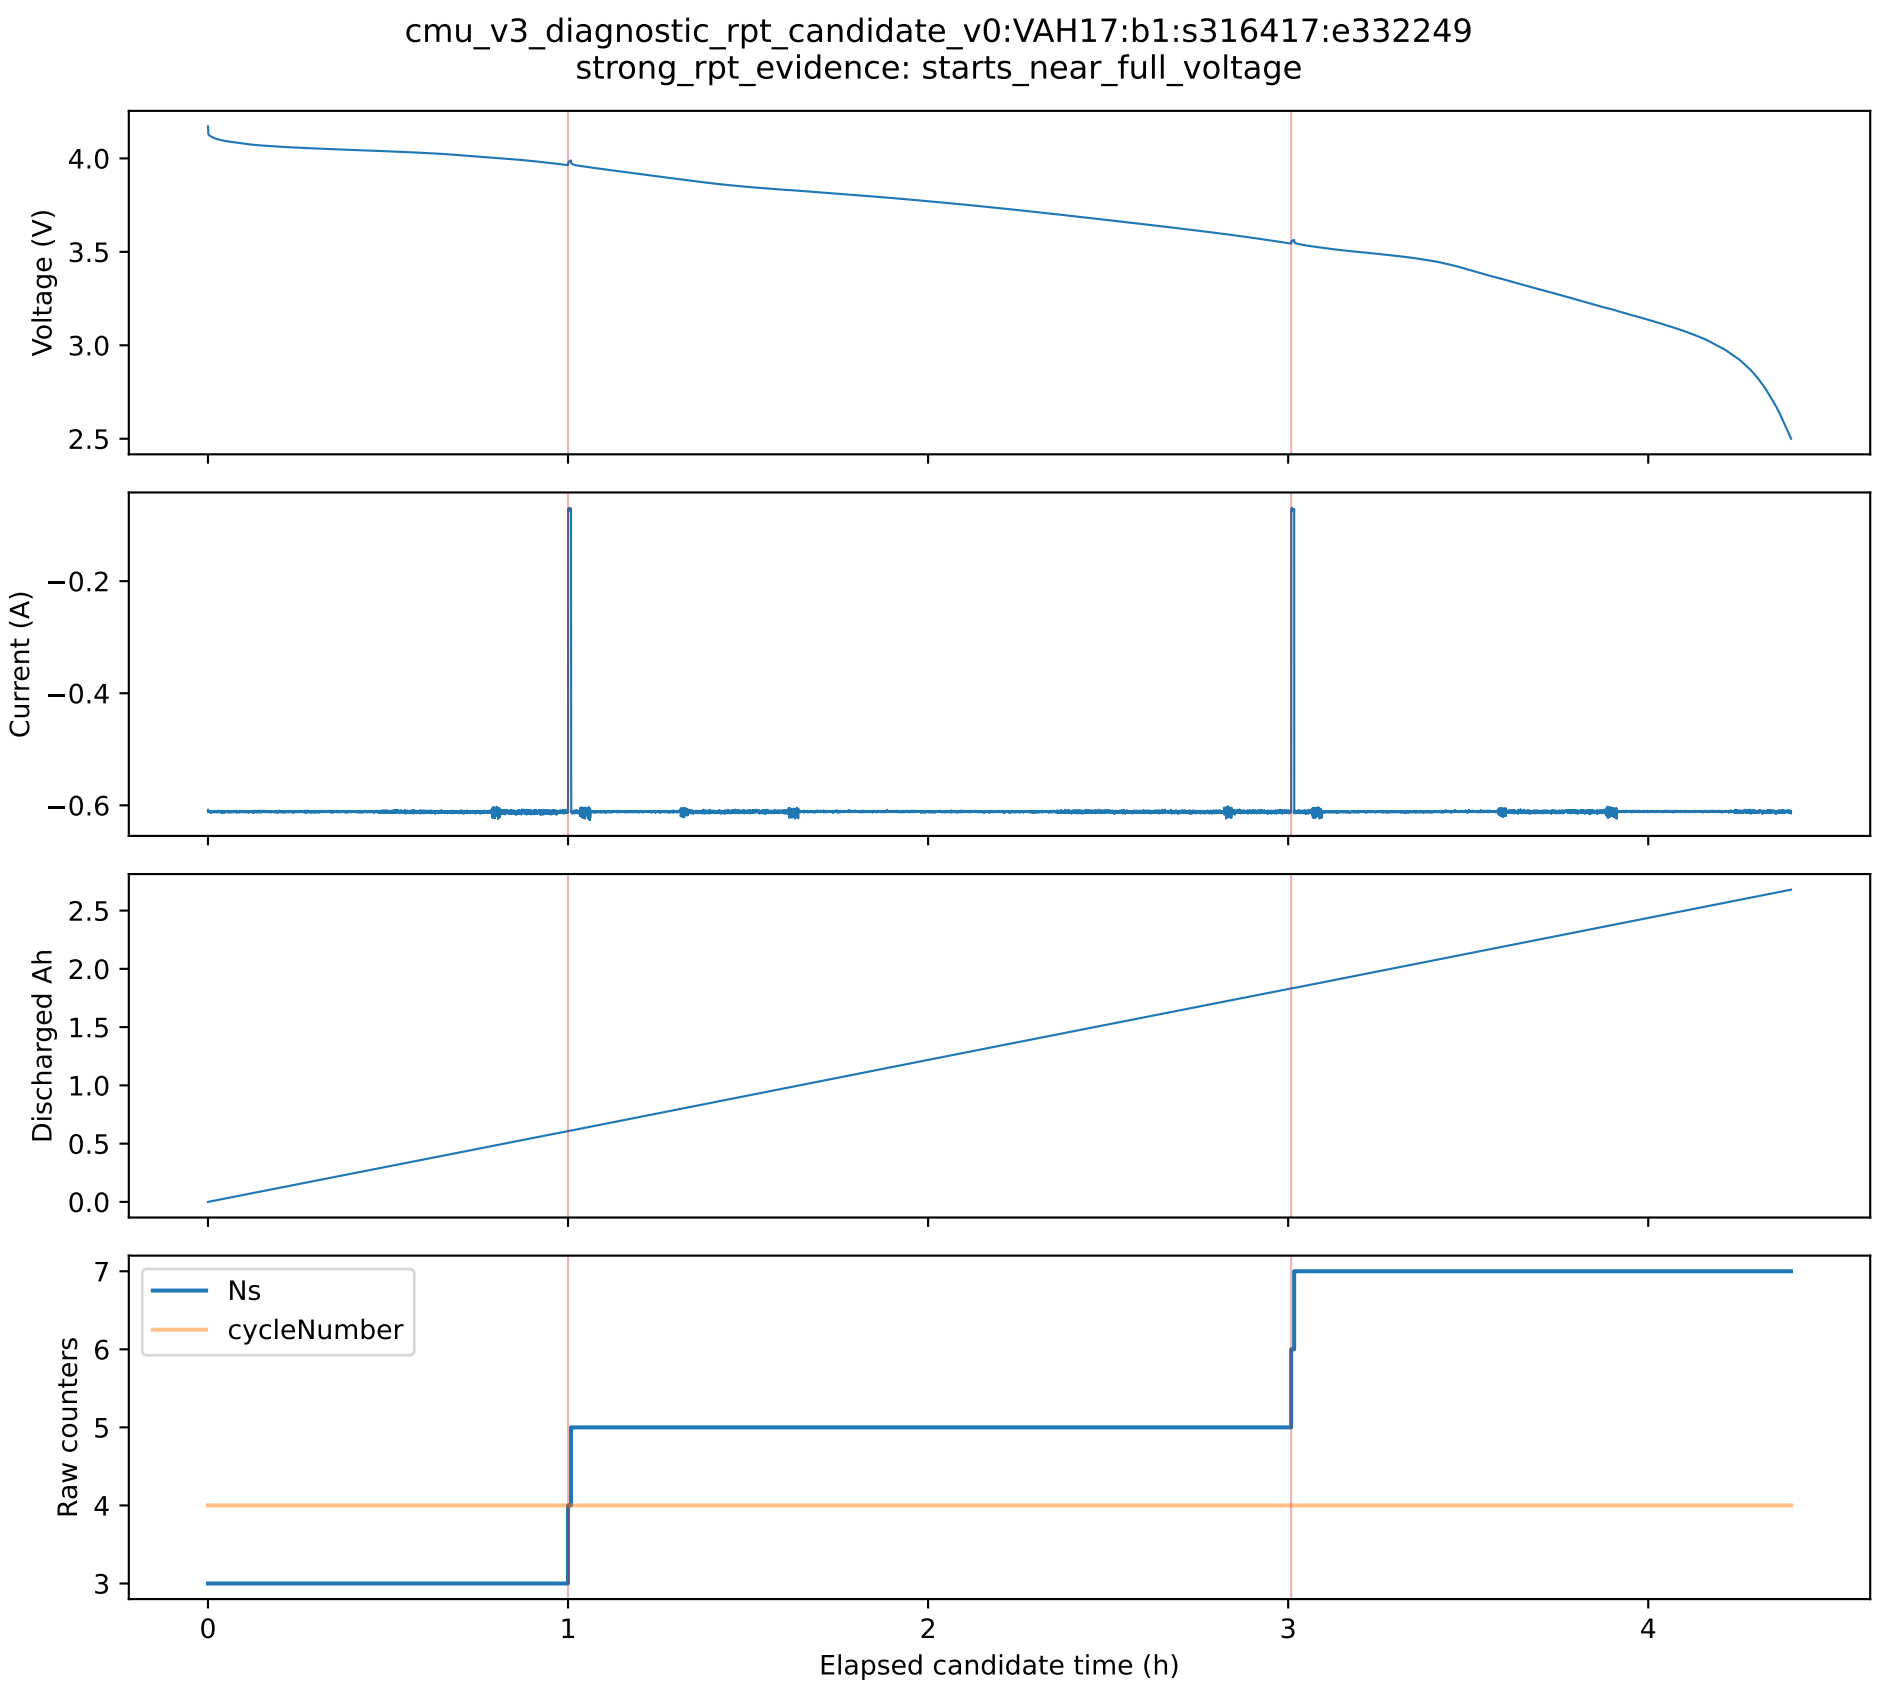

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b0:s159053:e175746
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2
1
0
Raw counters
Ns
cycleNumber
6
4
2
0
0
1
2
3
4
Elapsed candidate time (h)

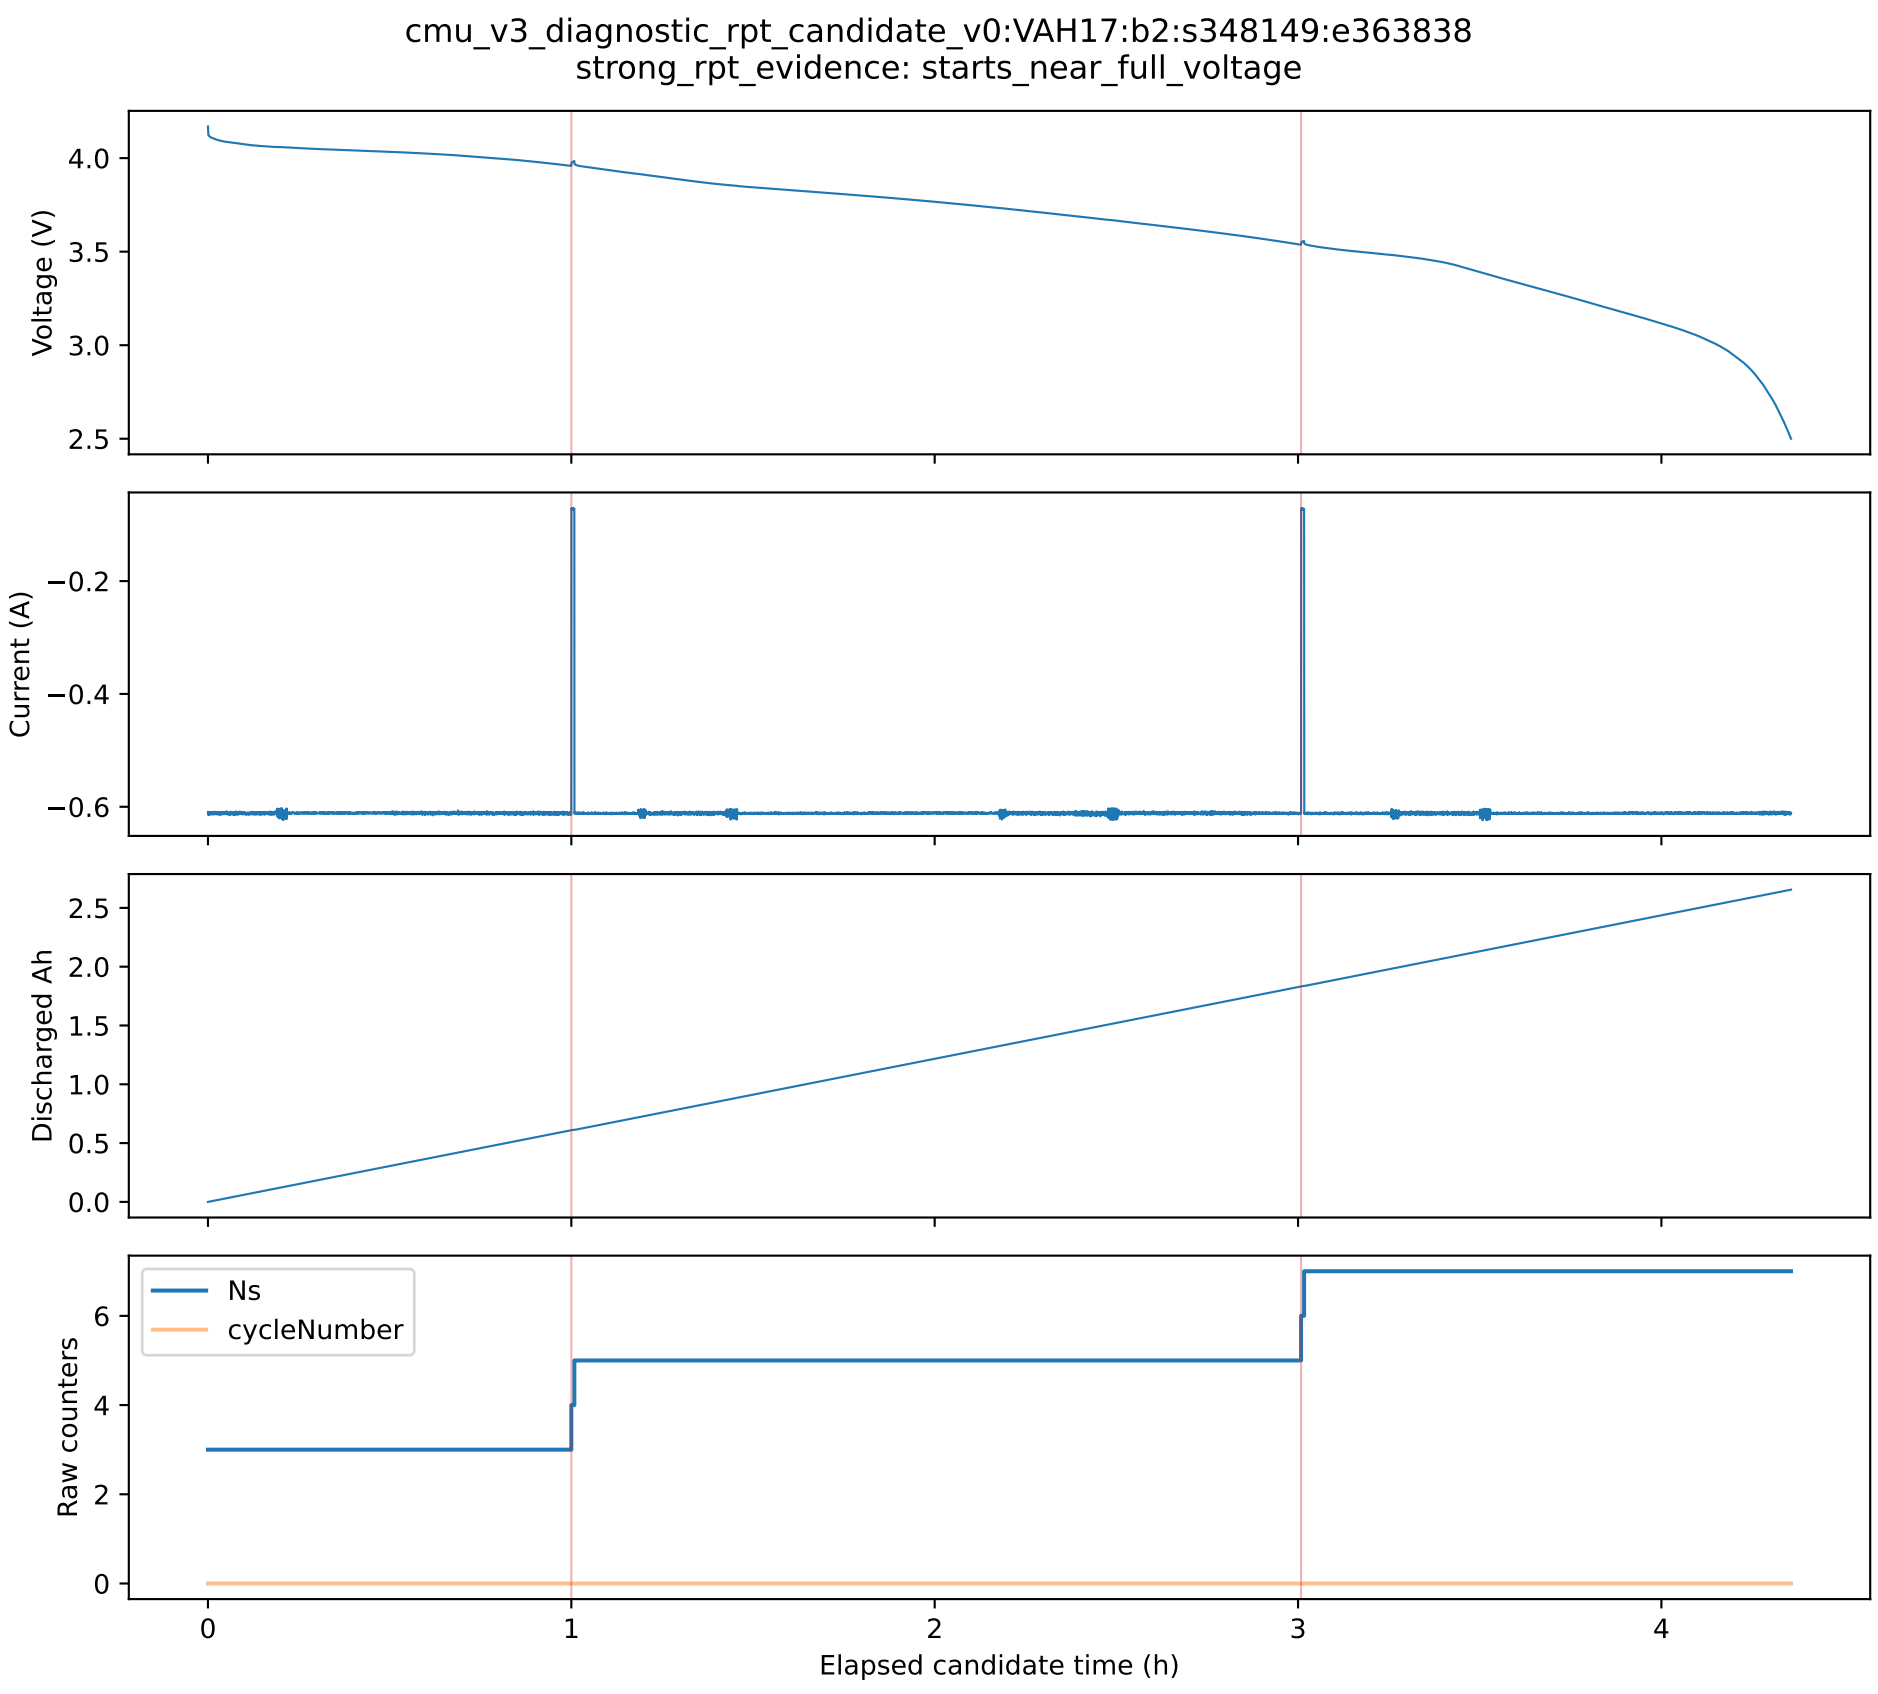

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b1:s190448:e206897
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2
1
0
Raw counters
Ns
cycleNumber
6
4
2
0
0
1
2
3
4
Elapsed candidate time (h)

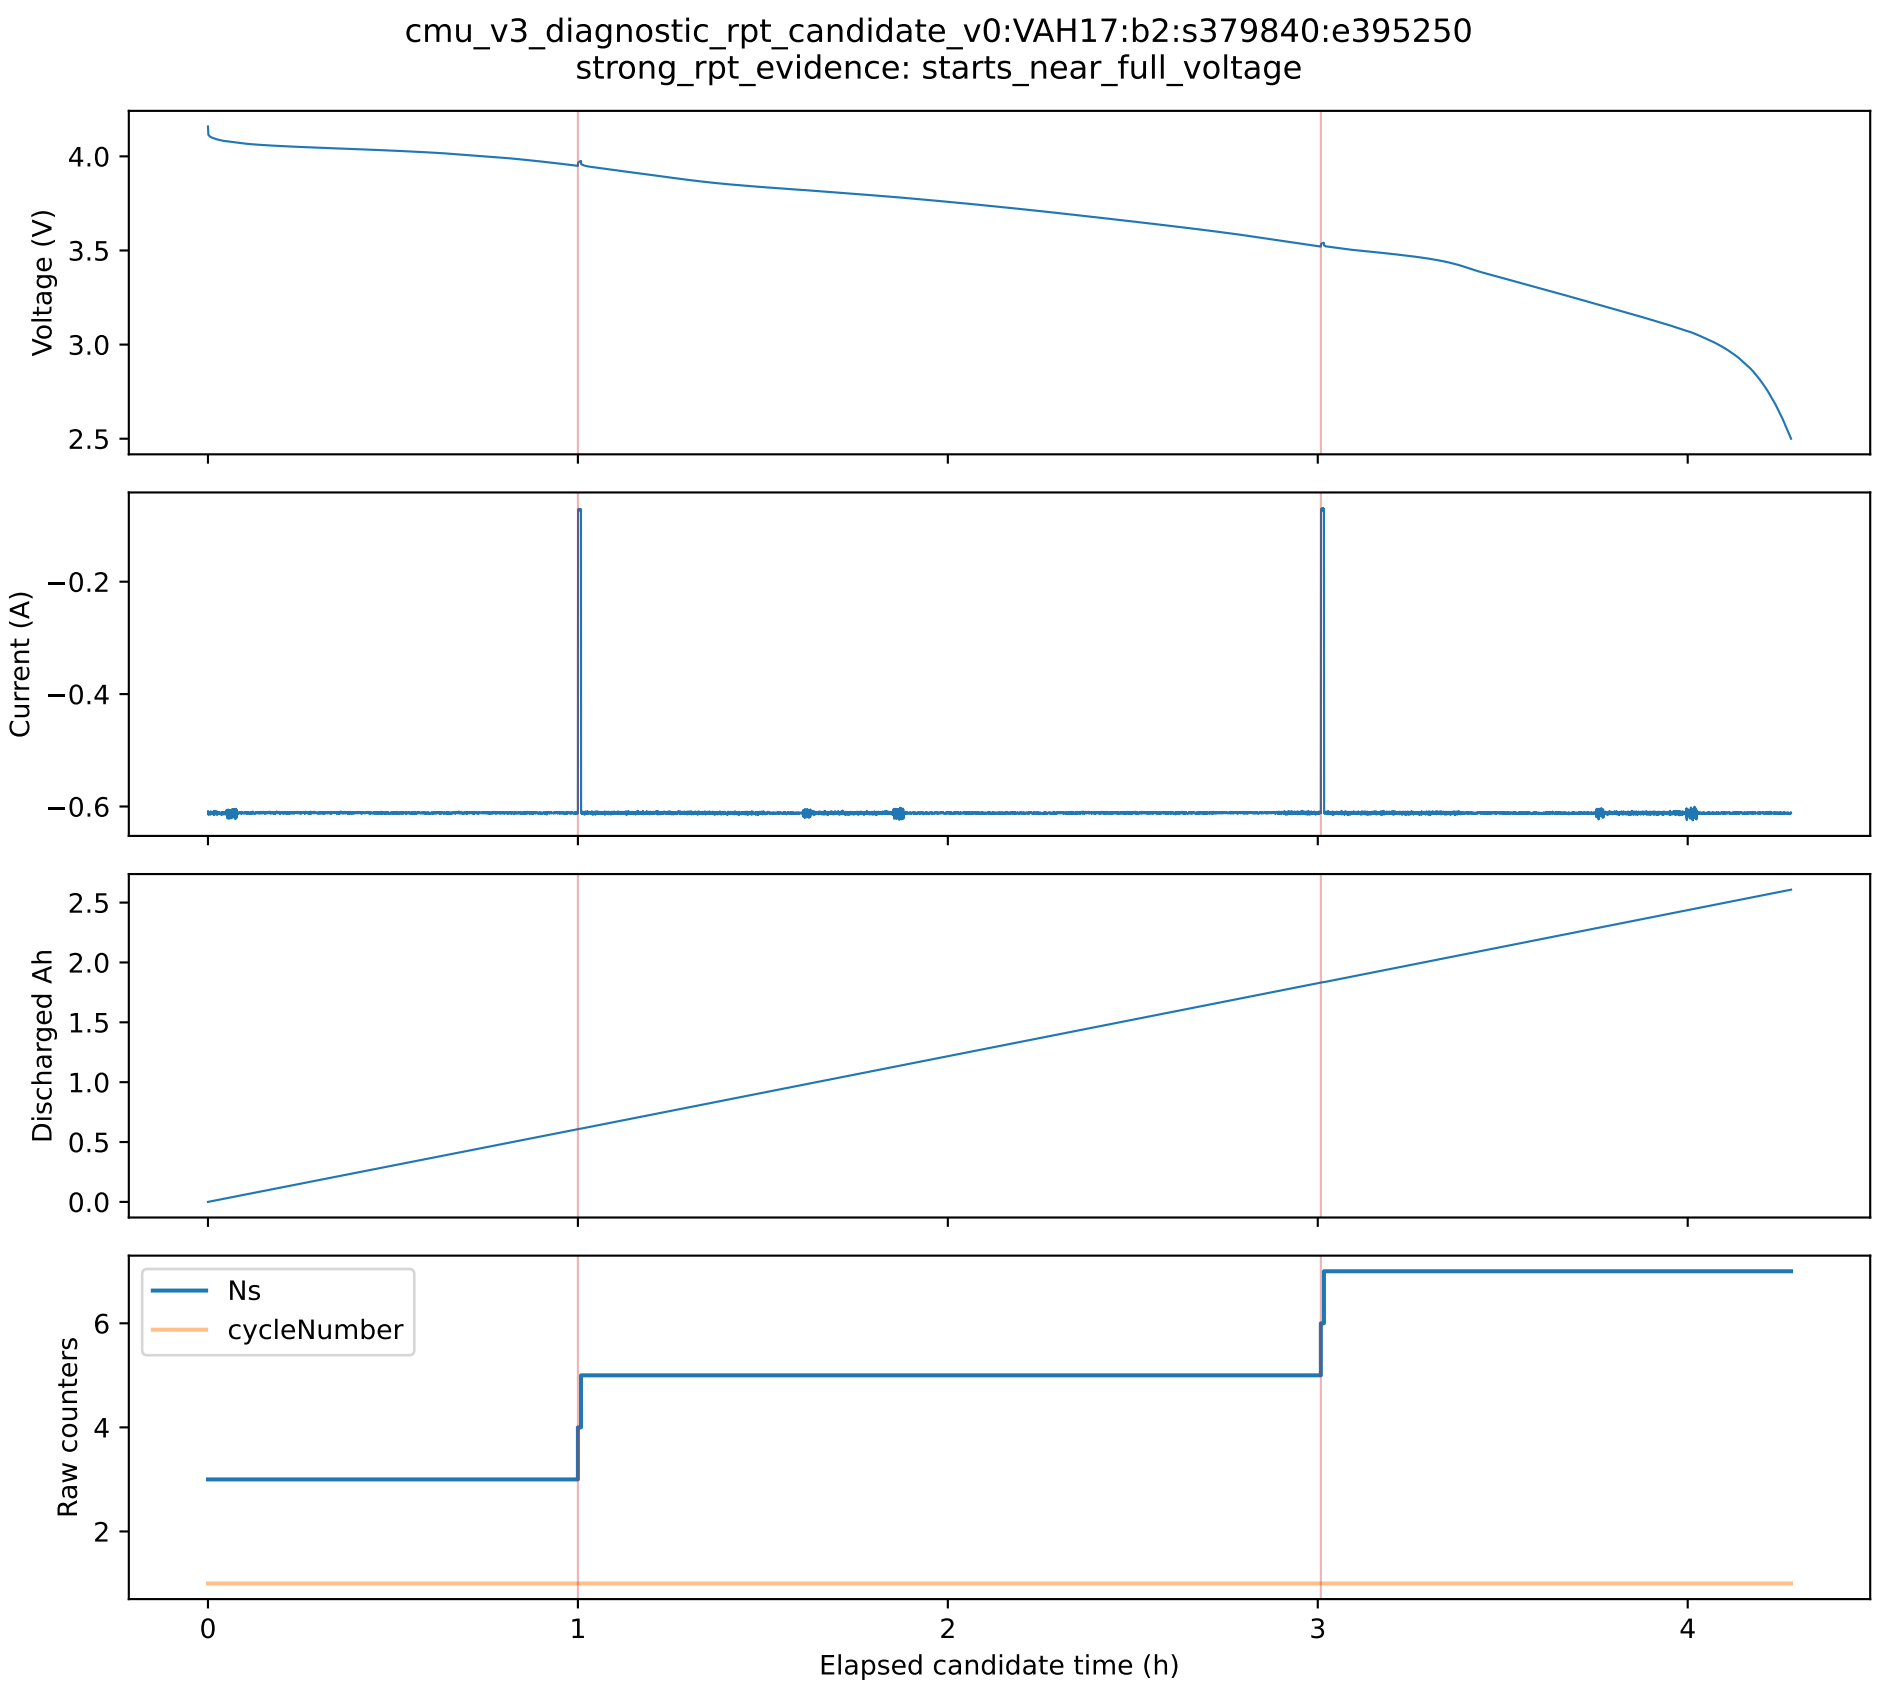

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b1:s221752:e238061
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2
1
0
Raw counters
Ns
cycleNumber
6
4
2
0
1
2
3
4
Elapsed candidate time (h)

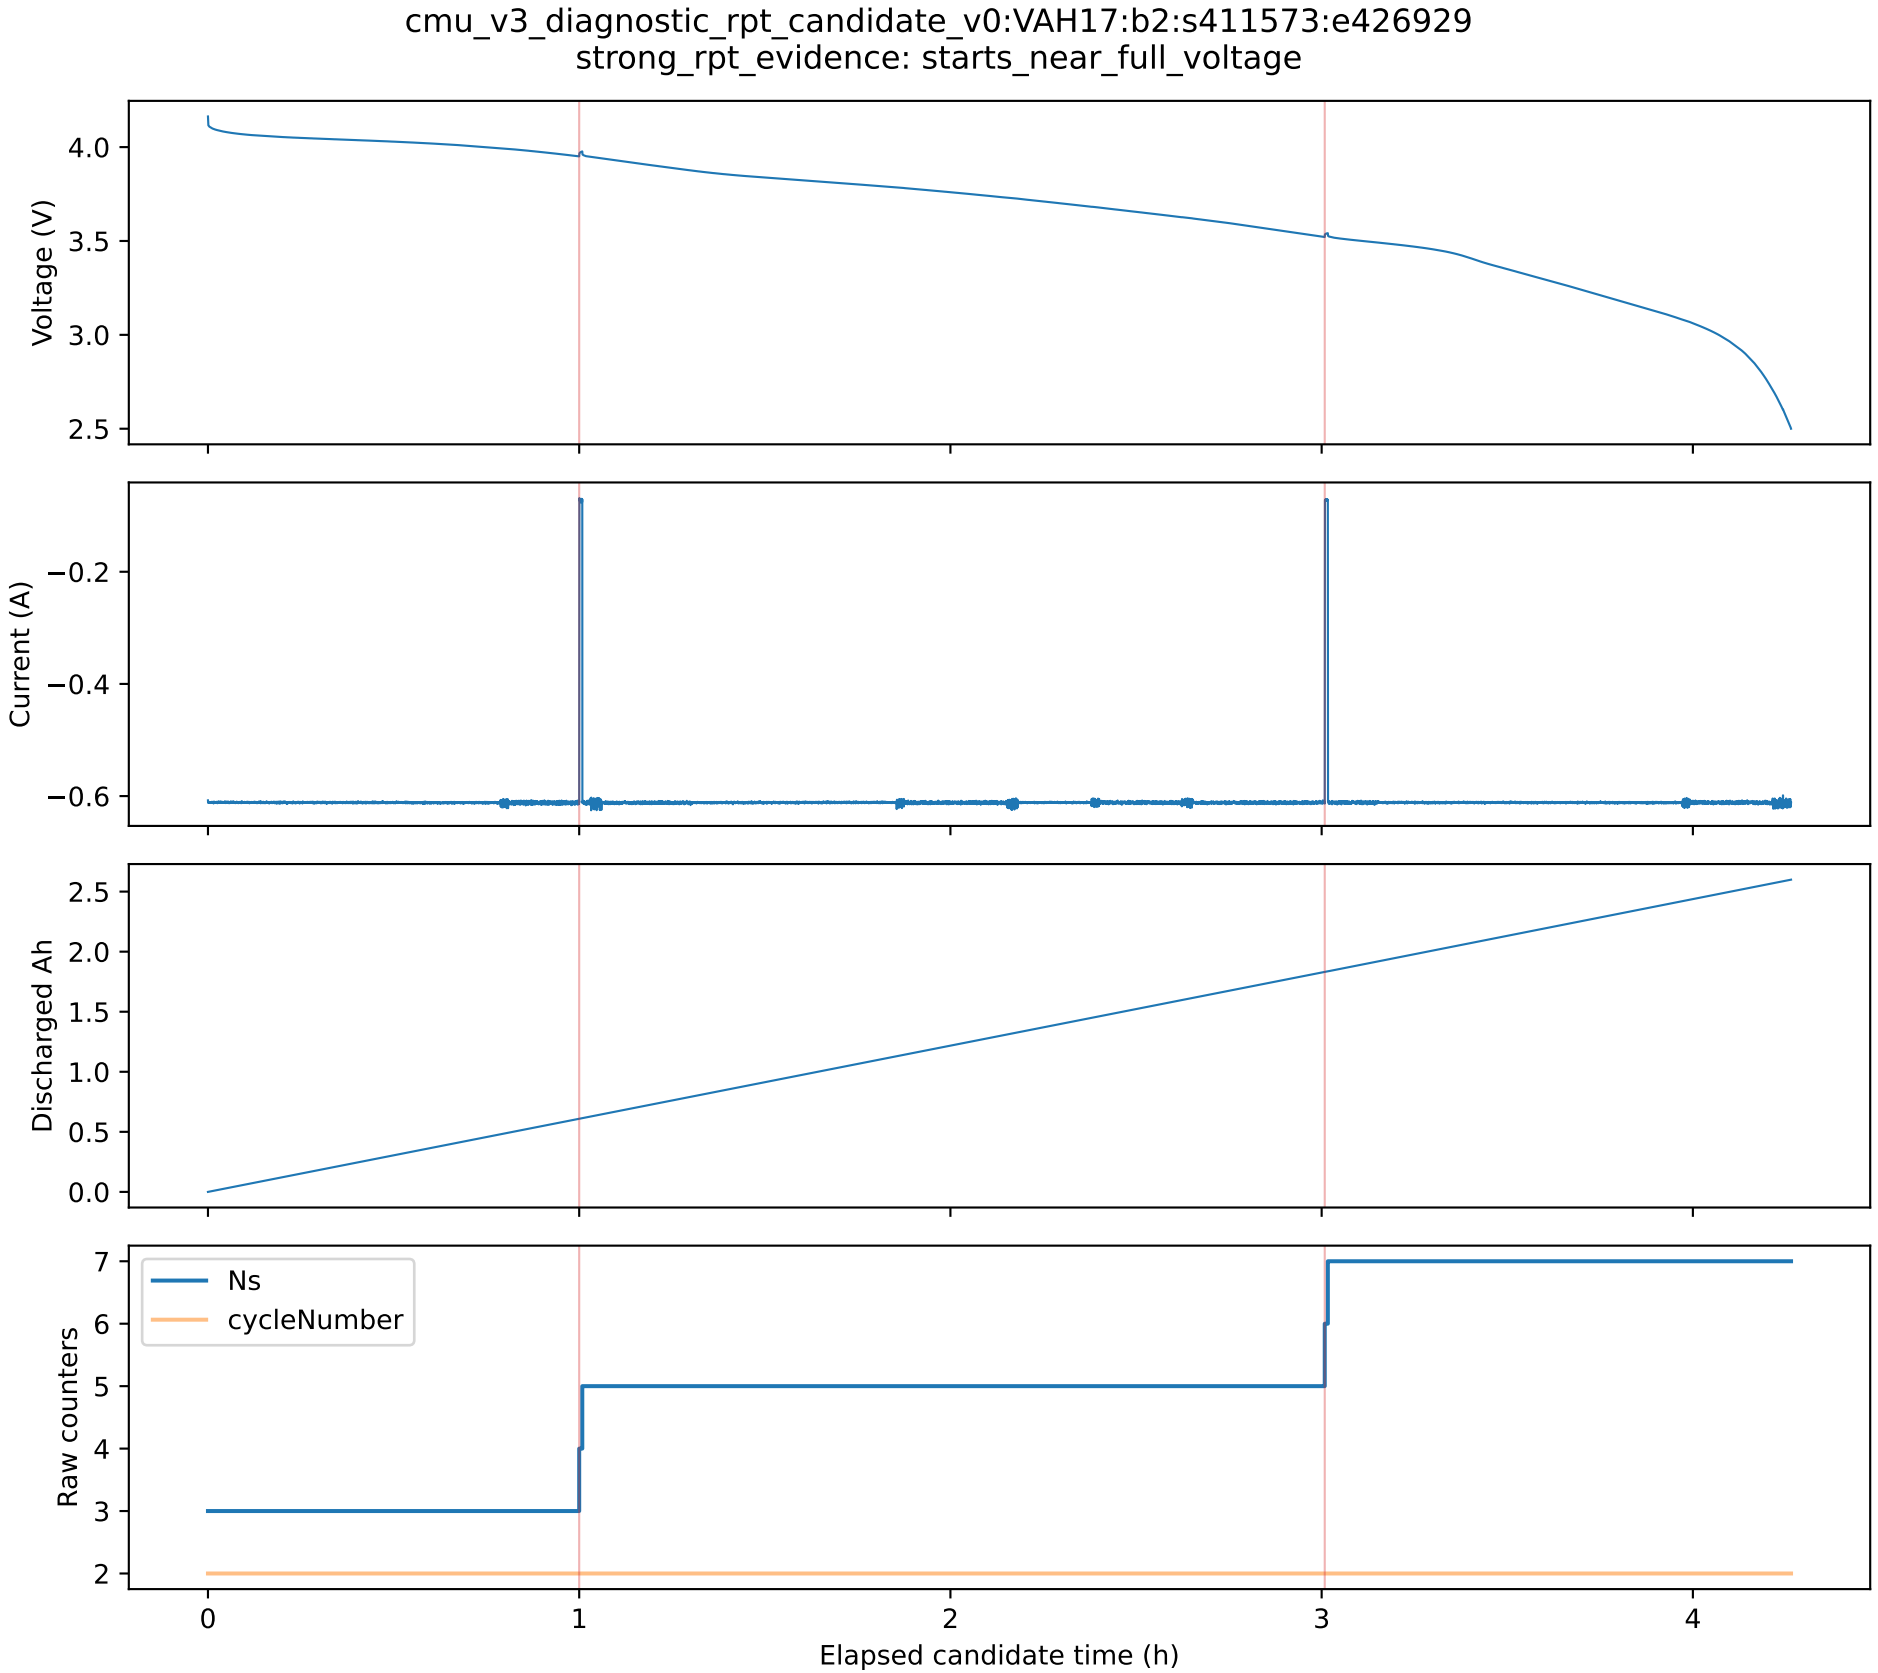

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b1:s253228:e269368
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2
1
0
Raw counters
Ns
cycleNumber
7
6
5
4
3
2
0
1
2
3
4
Elapsed candidate time (h)

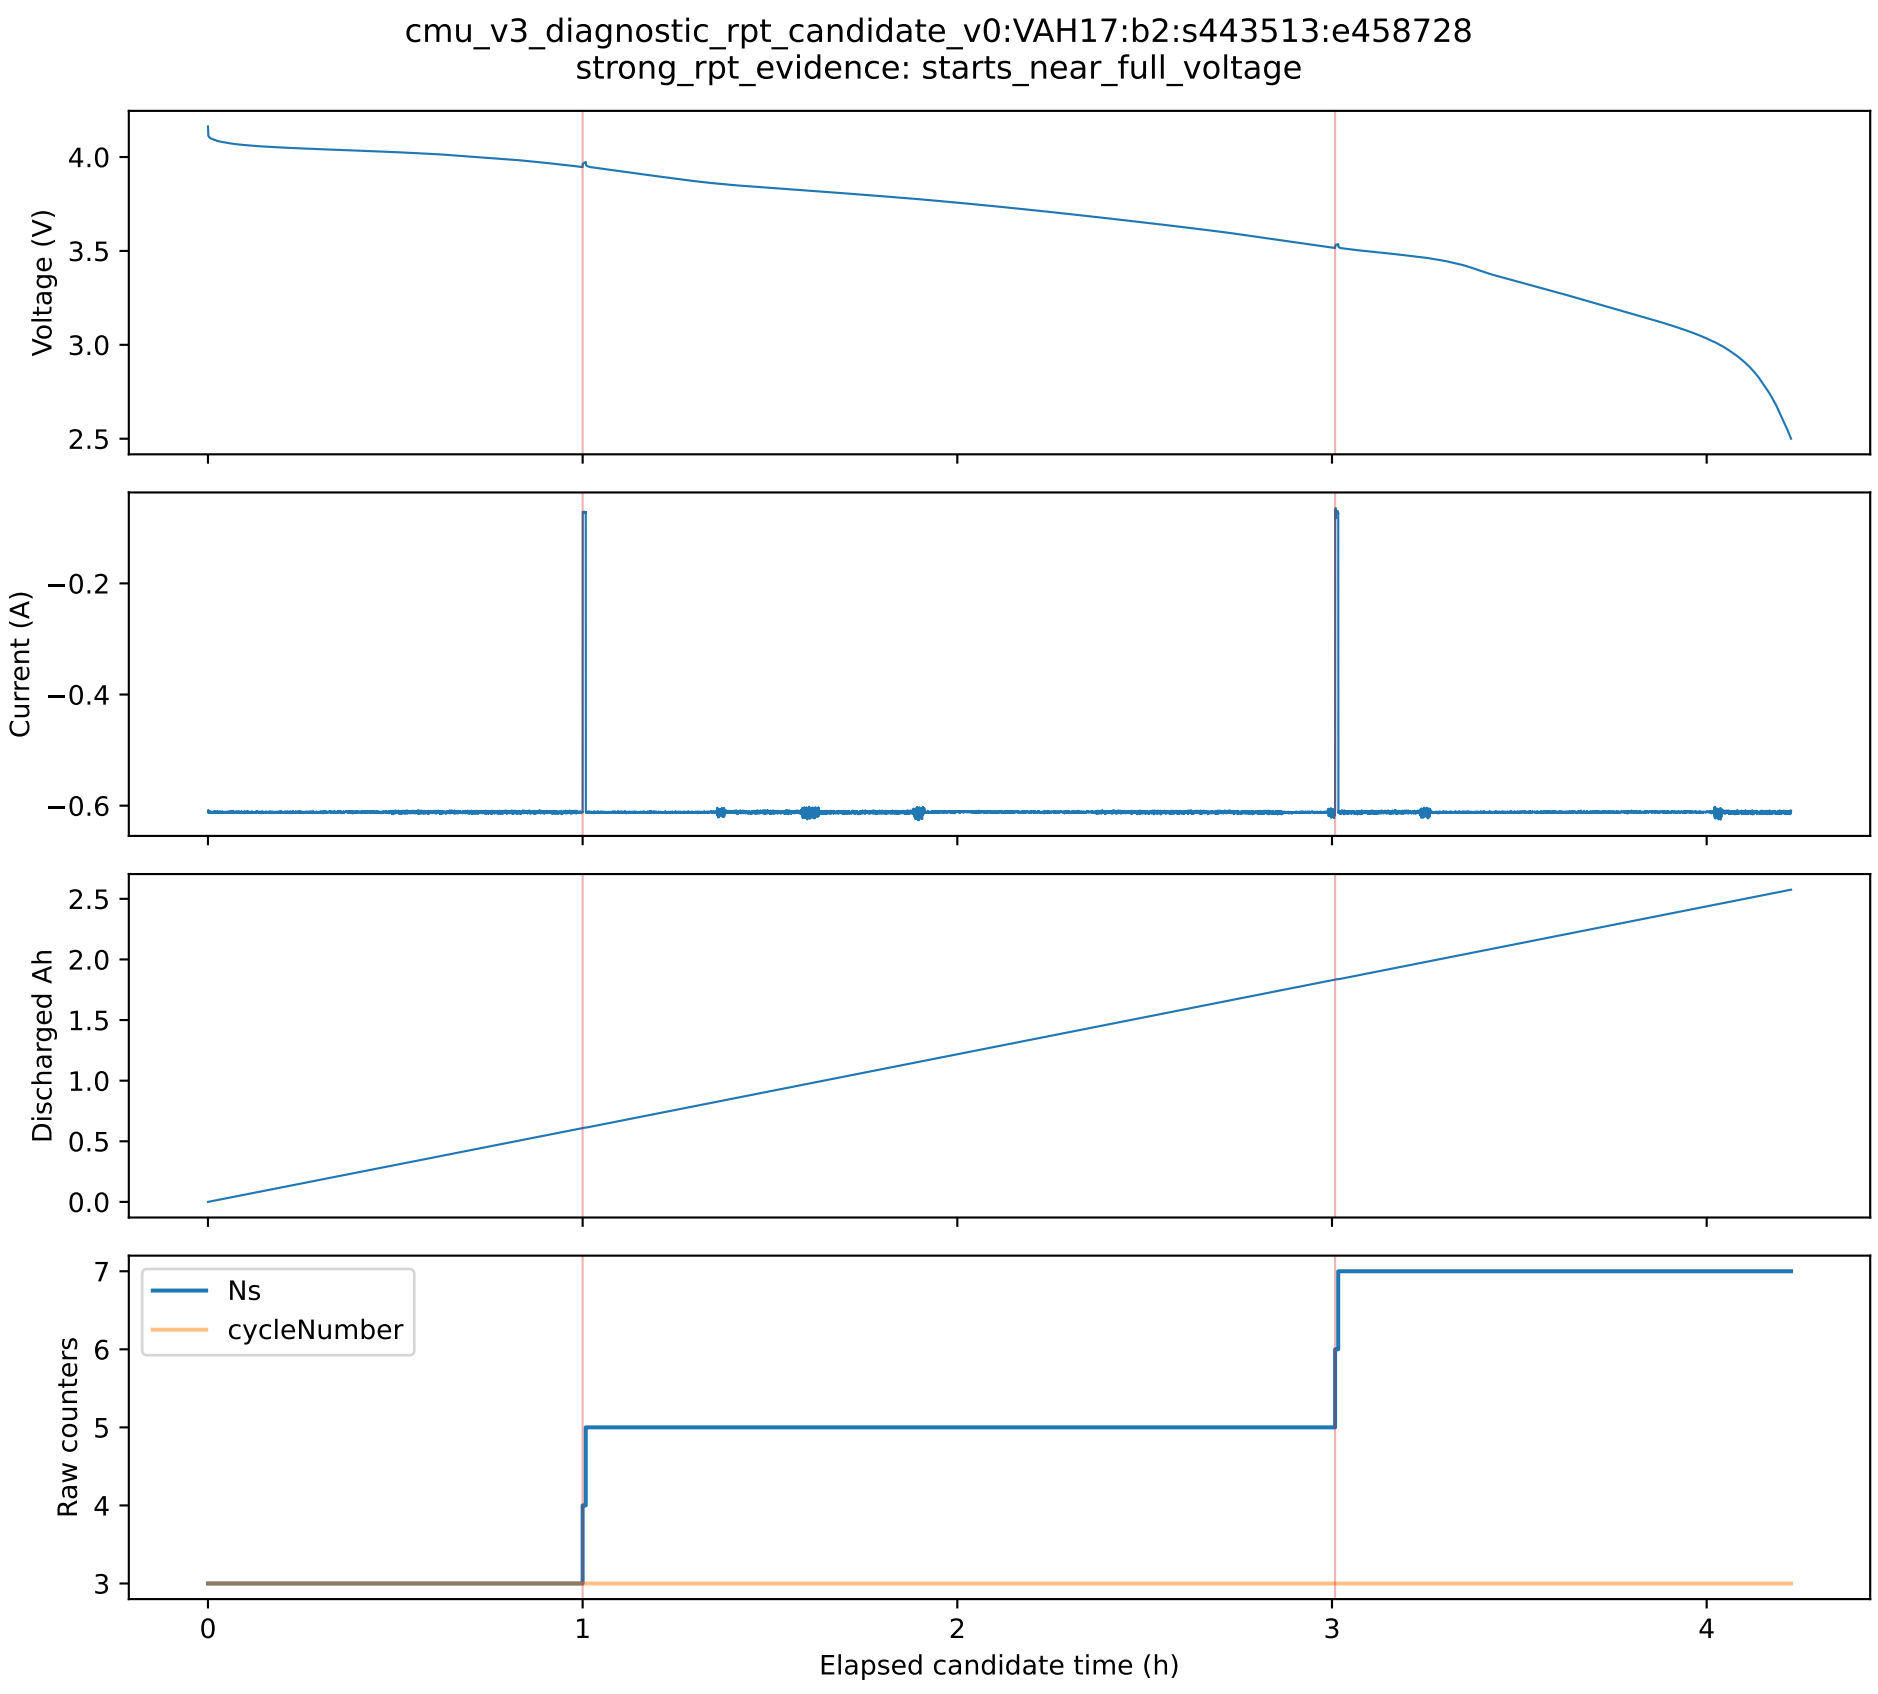

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b1:s284757:e300733
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)

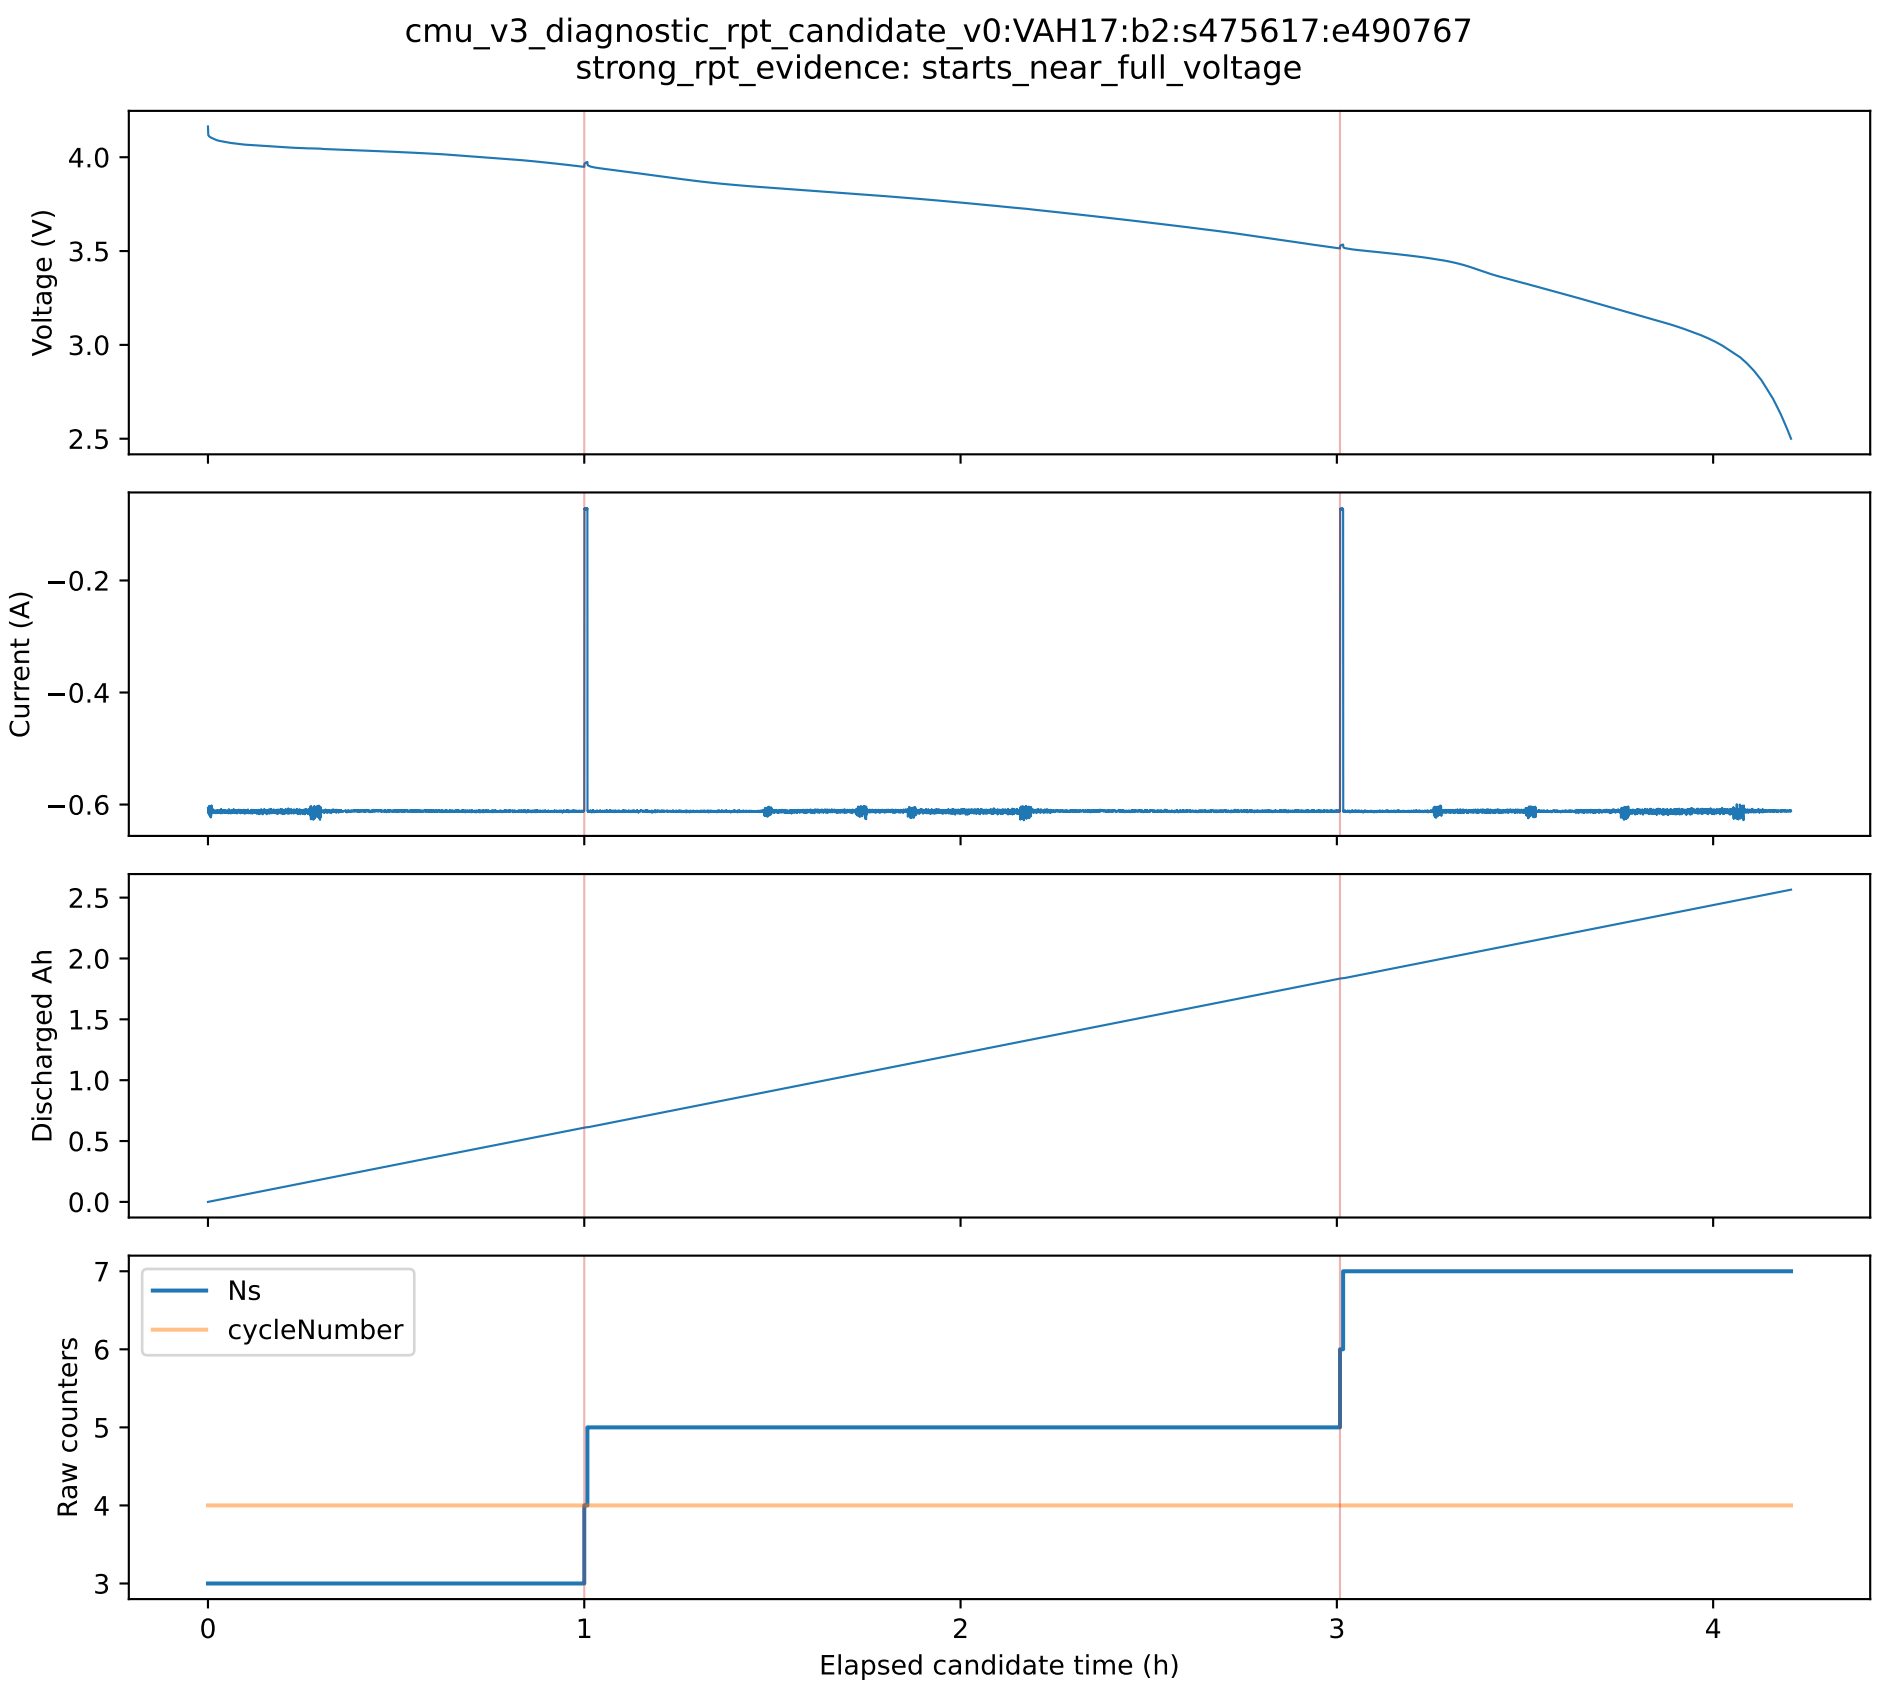

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b1:s316417:e332249
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)

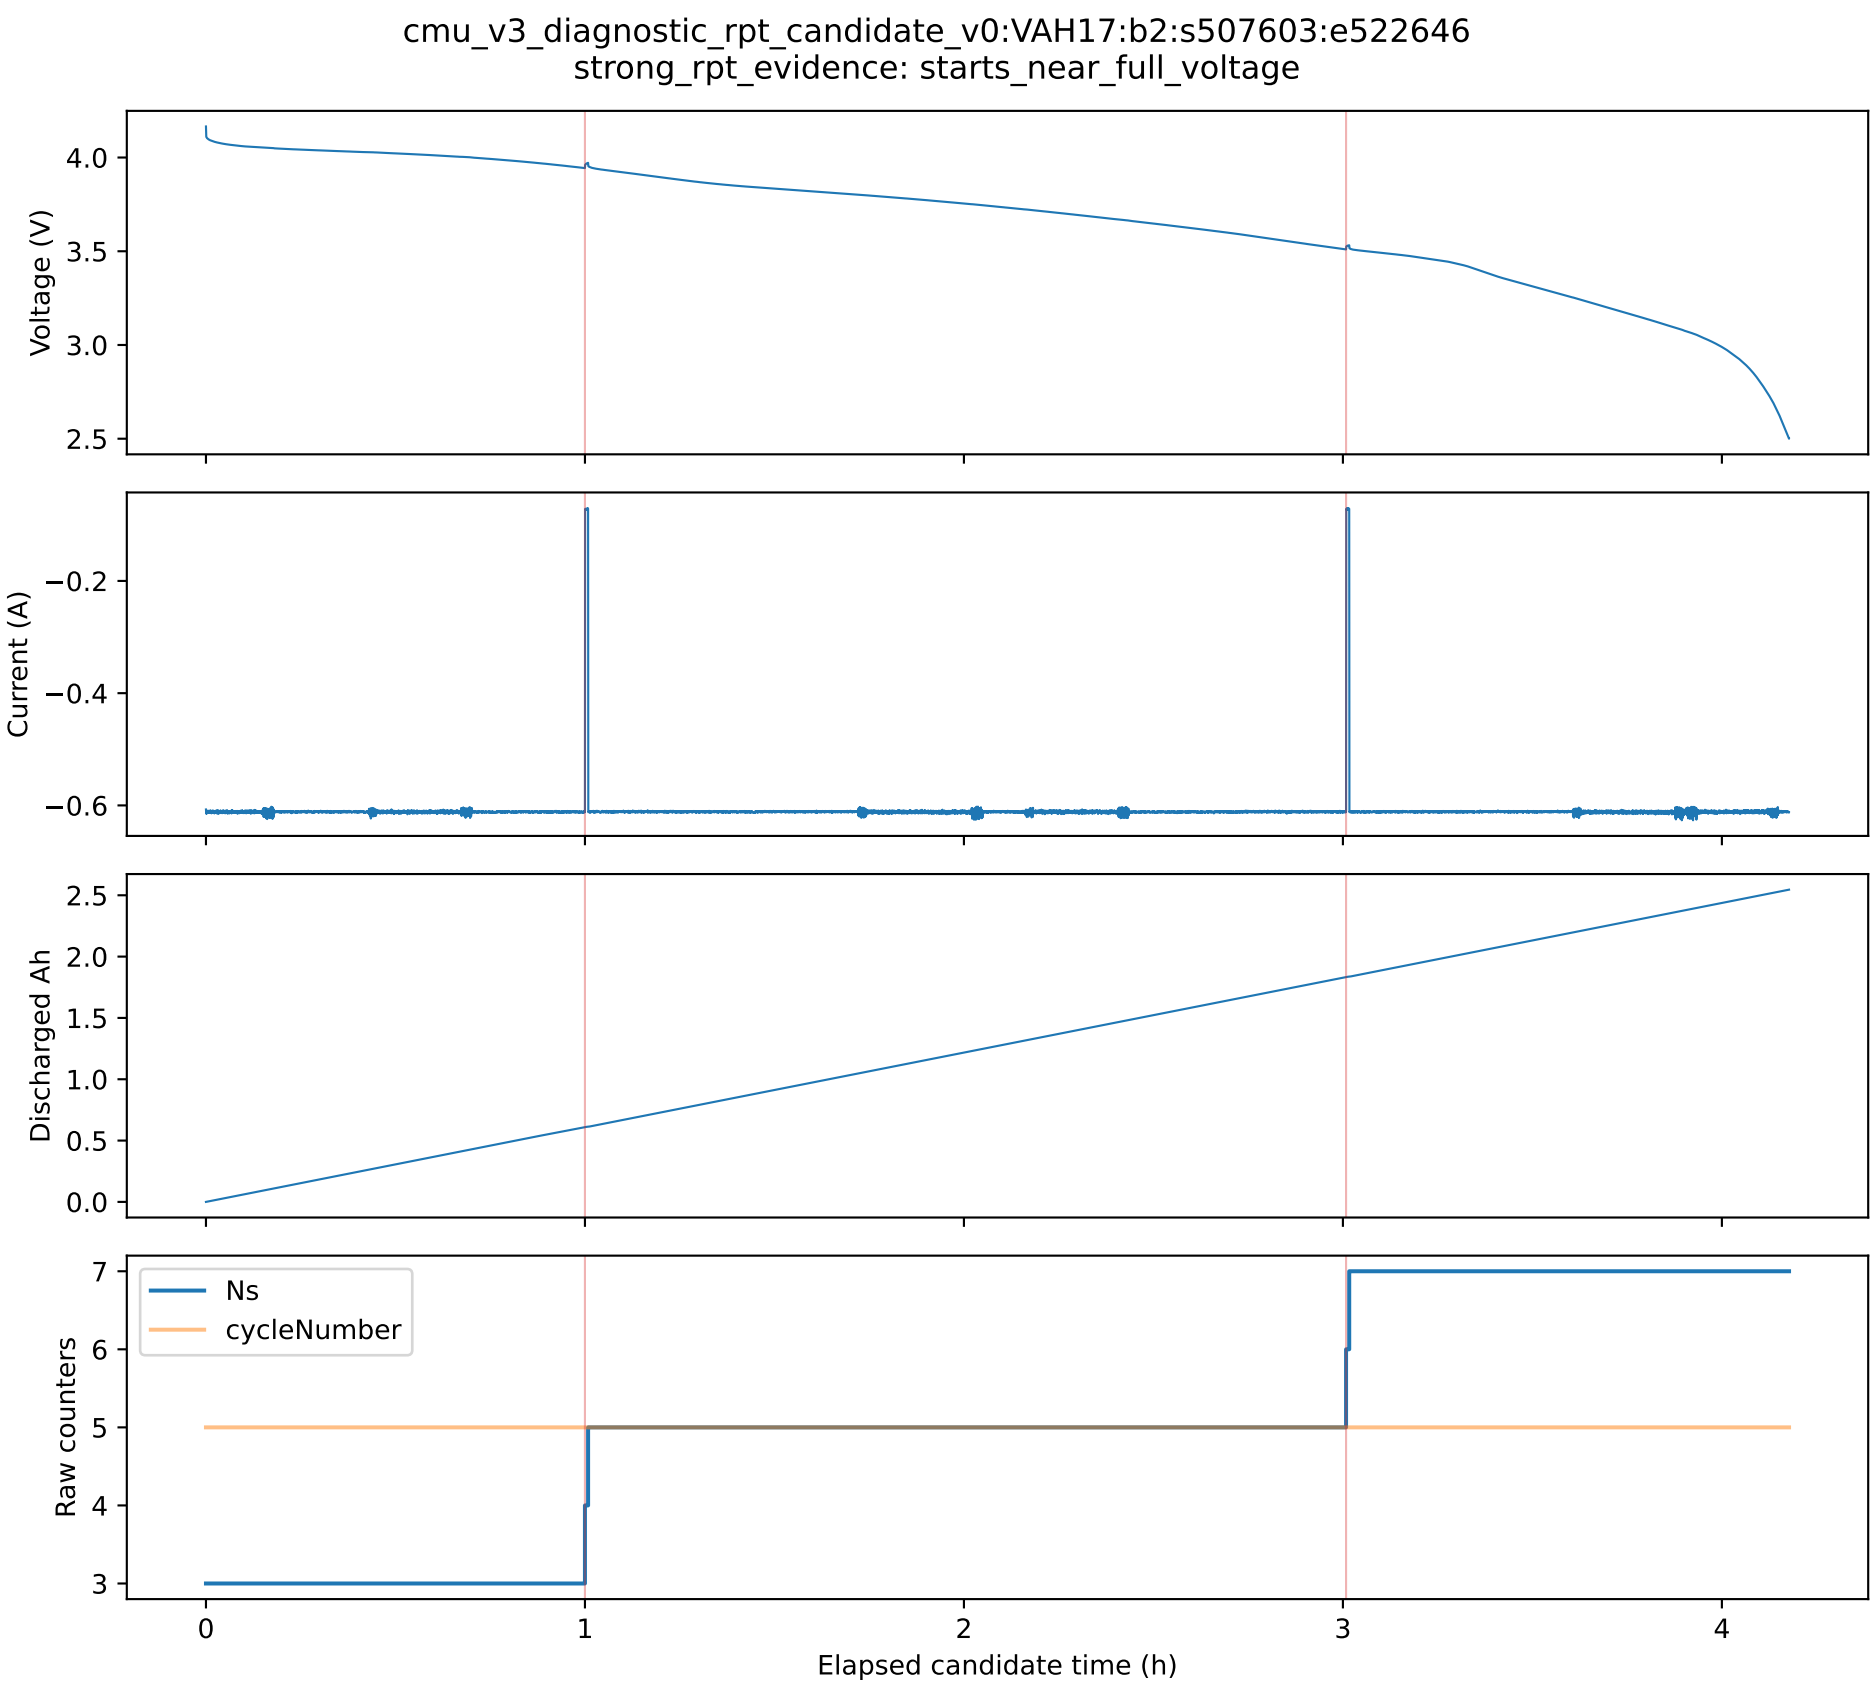

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s348149:e363838
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
6
4
2
0
0
1
2
3
4
Elapsed candidate time (h)

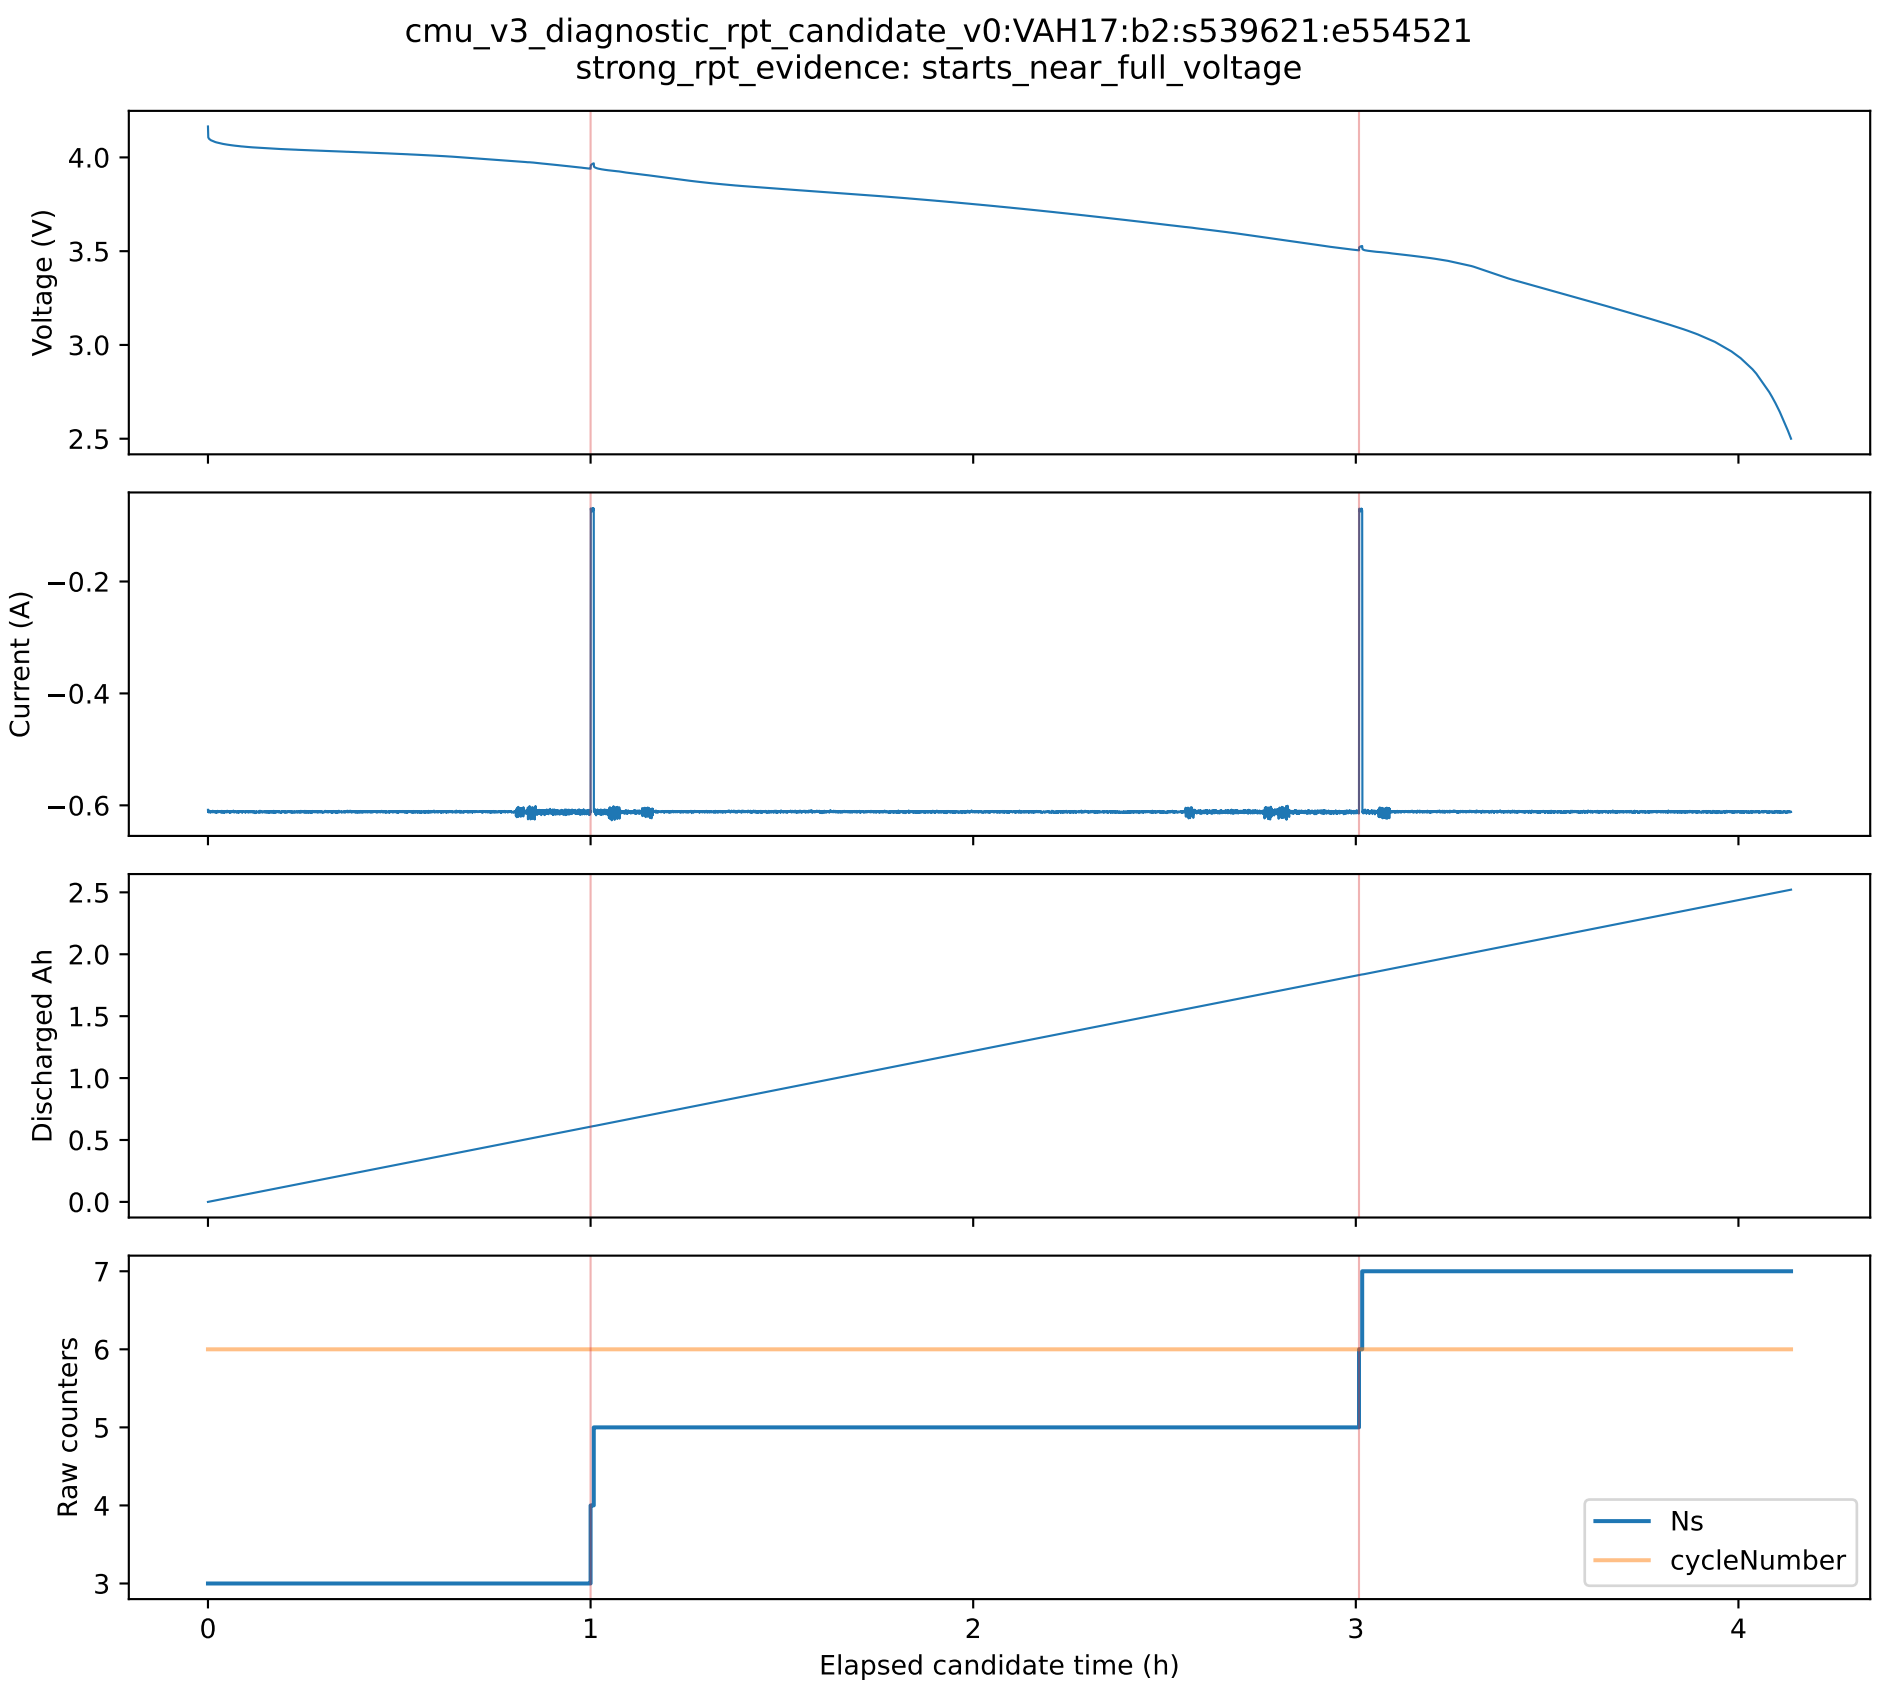

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s379840:e395250
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
6
4
2
0
1
2
3
4
Elapsed candidate time (h)

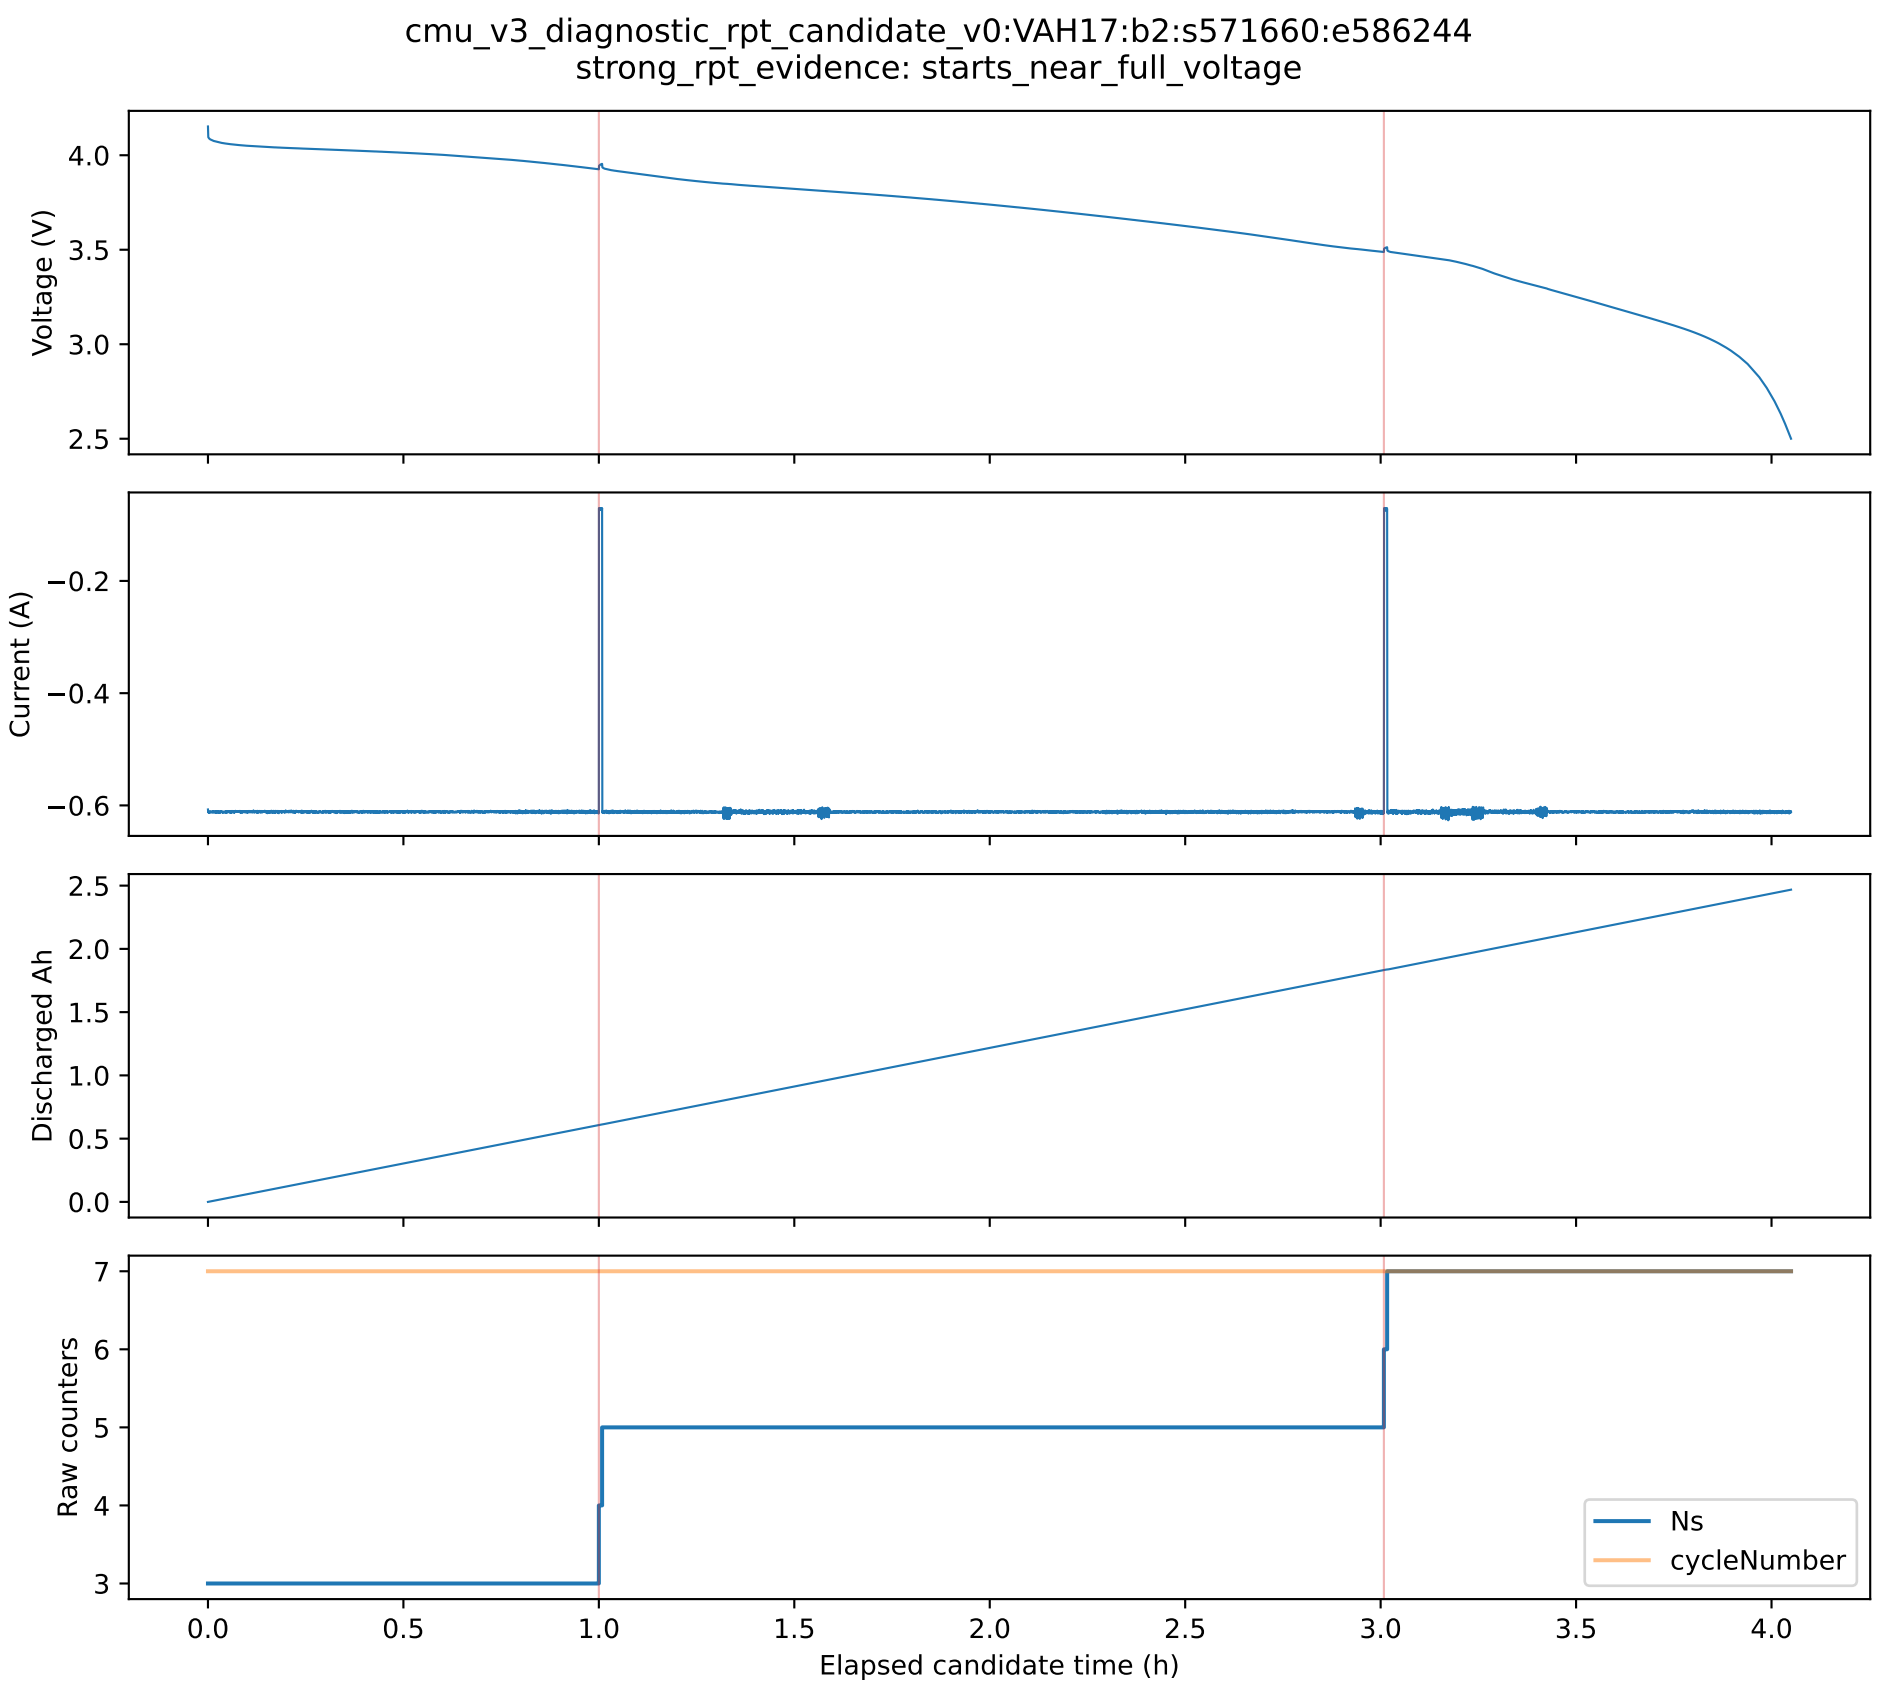

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s411573:e426929
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
2
0
1
2
3
4
Elapsed candidate time (h)

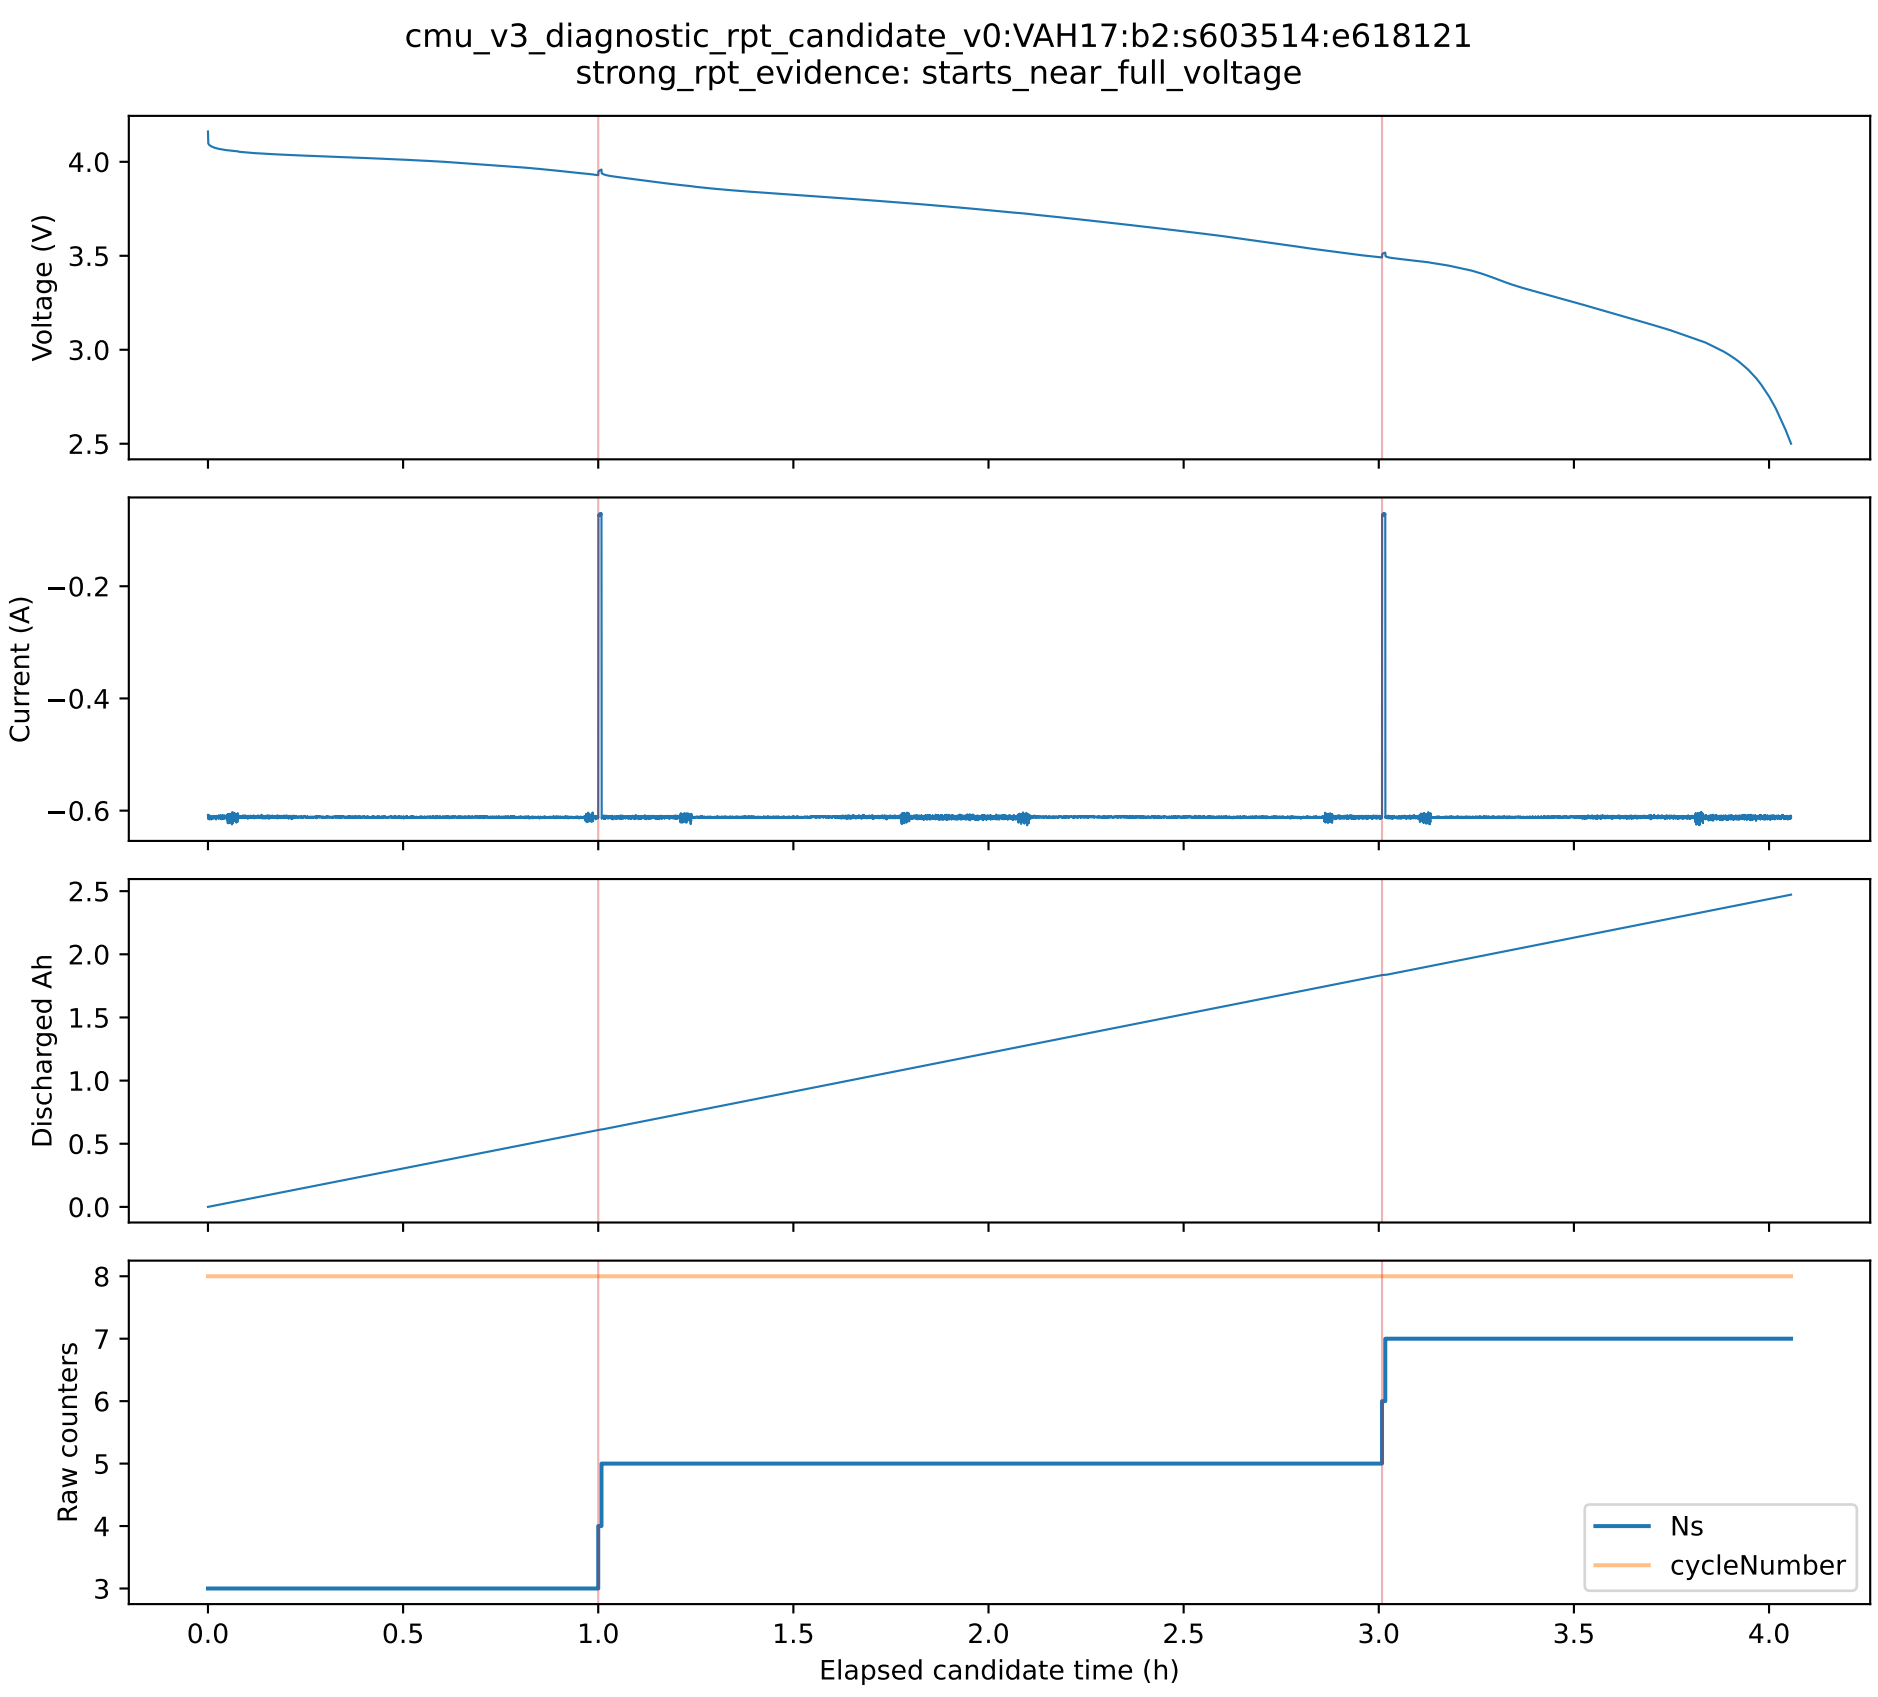

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s443513:e458728
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)

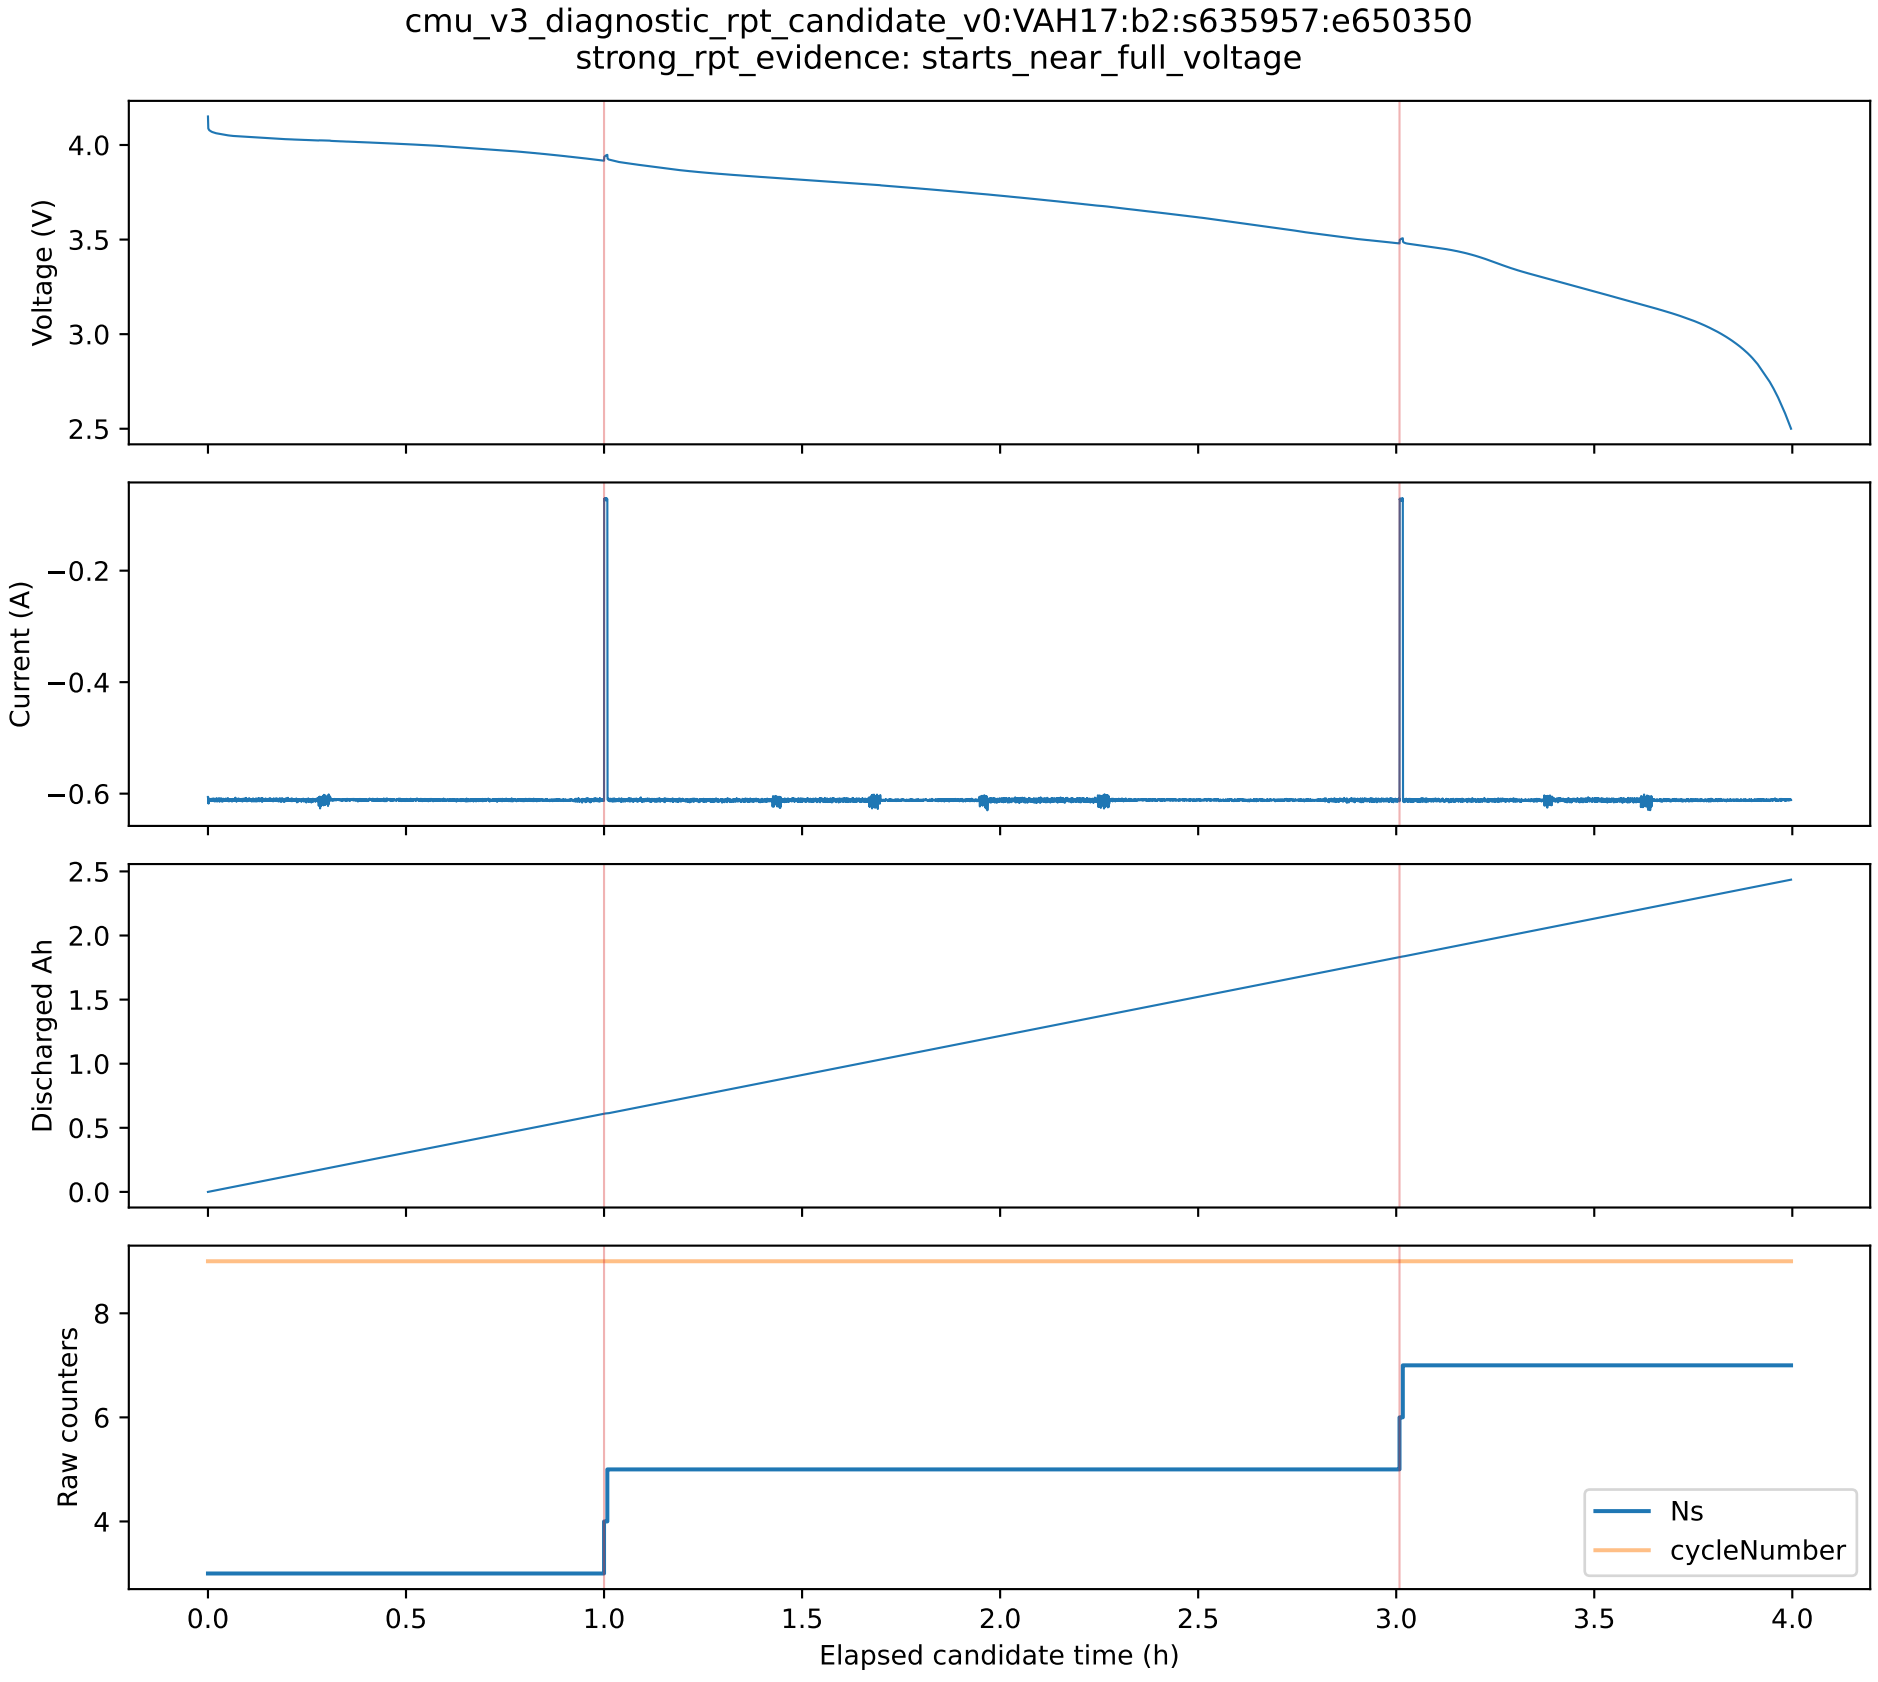

cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s475617:e490767
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)


cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s507603:e522646
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
Ns
cycleNumber
7
6
5
4
3
0
1
2
3
4
Elapsed candidate time (h)


cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s539621:e554521
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
7
6
5
4
3
Ns
cycleNumber
0
1
2
3
4
Elapsed candidate time (h)


cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s571660:e586244
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
7
6
5
4
3
Ns
cycleNumber
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
4.0
Elapsed candidate time (h)


cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s603514:e618121
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
8
7
6
5
4
3
Ns
cycleNumber
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
4.0
Elapsed candidate time (h)


cmu_v3_diagnostic_rpt_candidate_v0:VAH17:b2:s635957:e650350
strong_rpt_evidence: starts_near_full_voltage
Voltage (V)
4.0
3.5
3.0
2.5
Current (A)
−0.2
−0.4
−0.6
Discharged Ah
2.5
2.0
1.5
1.0
0.5
0.0
Raw counters
8
6
4
Ns
cycleNumber
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
4.0
Elapsed candidate time (h)