



Assumption-Gated BioDesign Runtime - Trust Policy Evaluation Results


Evaluation Accuracy by Claim Surface

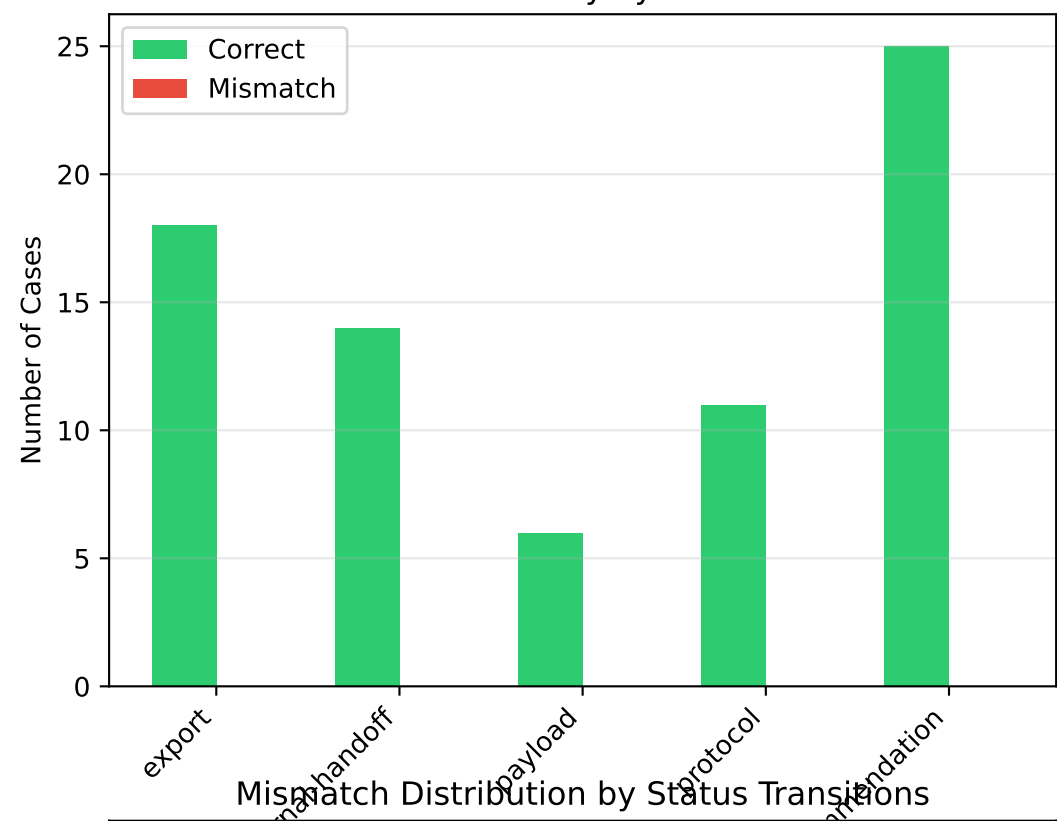

Mismatch Distribution by Status Transitions

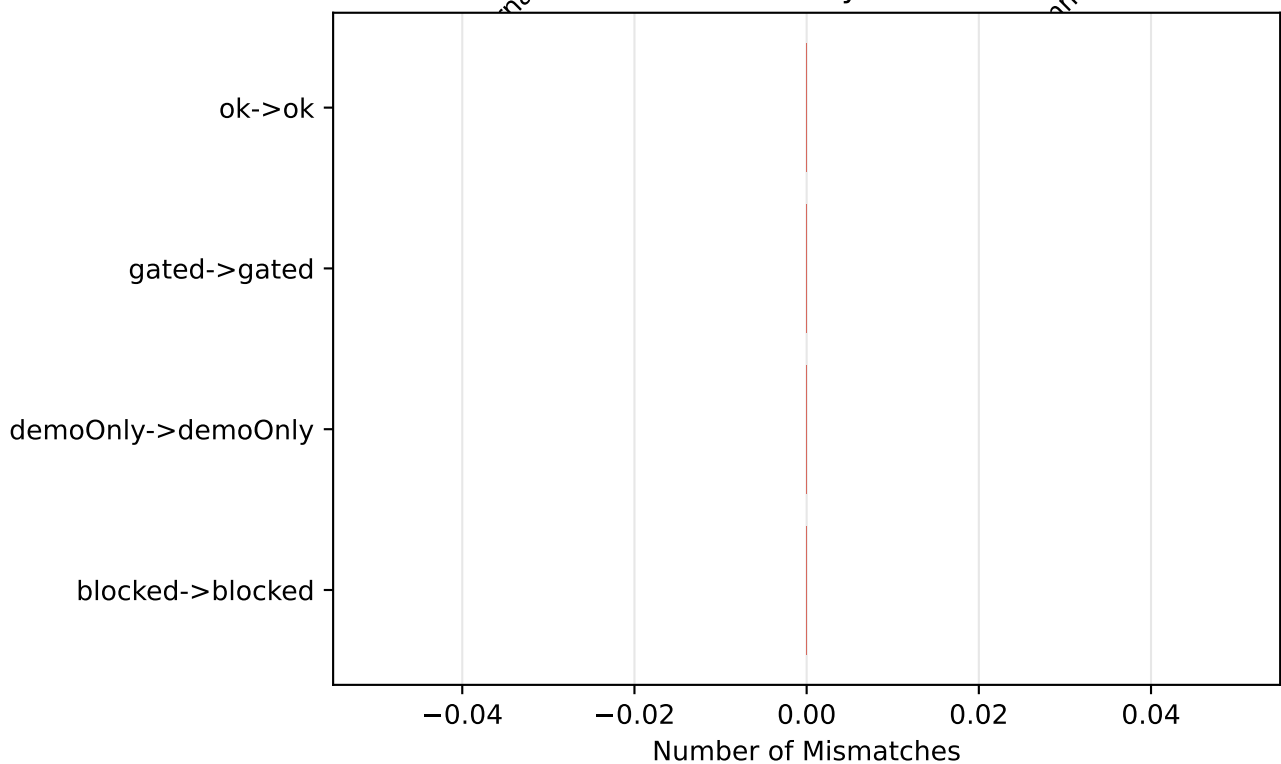

Overall Accuracy: 100.0%

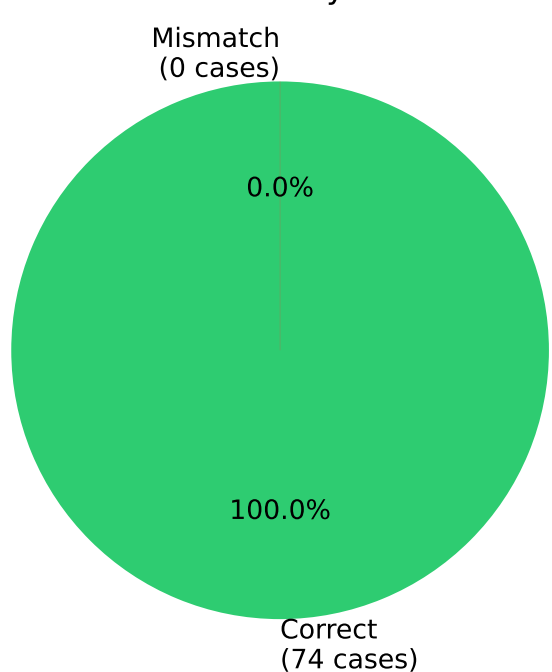

Benchmark Summary

Total Cases: 74
Correct: 74 (100.0%)
Mismatches: 0 (0.0%)

Mismatch Breakdown by Surface:

export: 0
external-handoff: 0
payload: 0
protocol: 0
recommendation: 0

Note: This is a representative artifact benchmark.
It does not constitute third-party validation or regulatory certification.