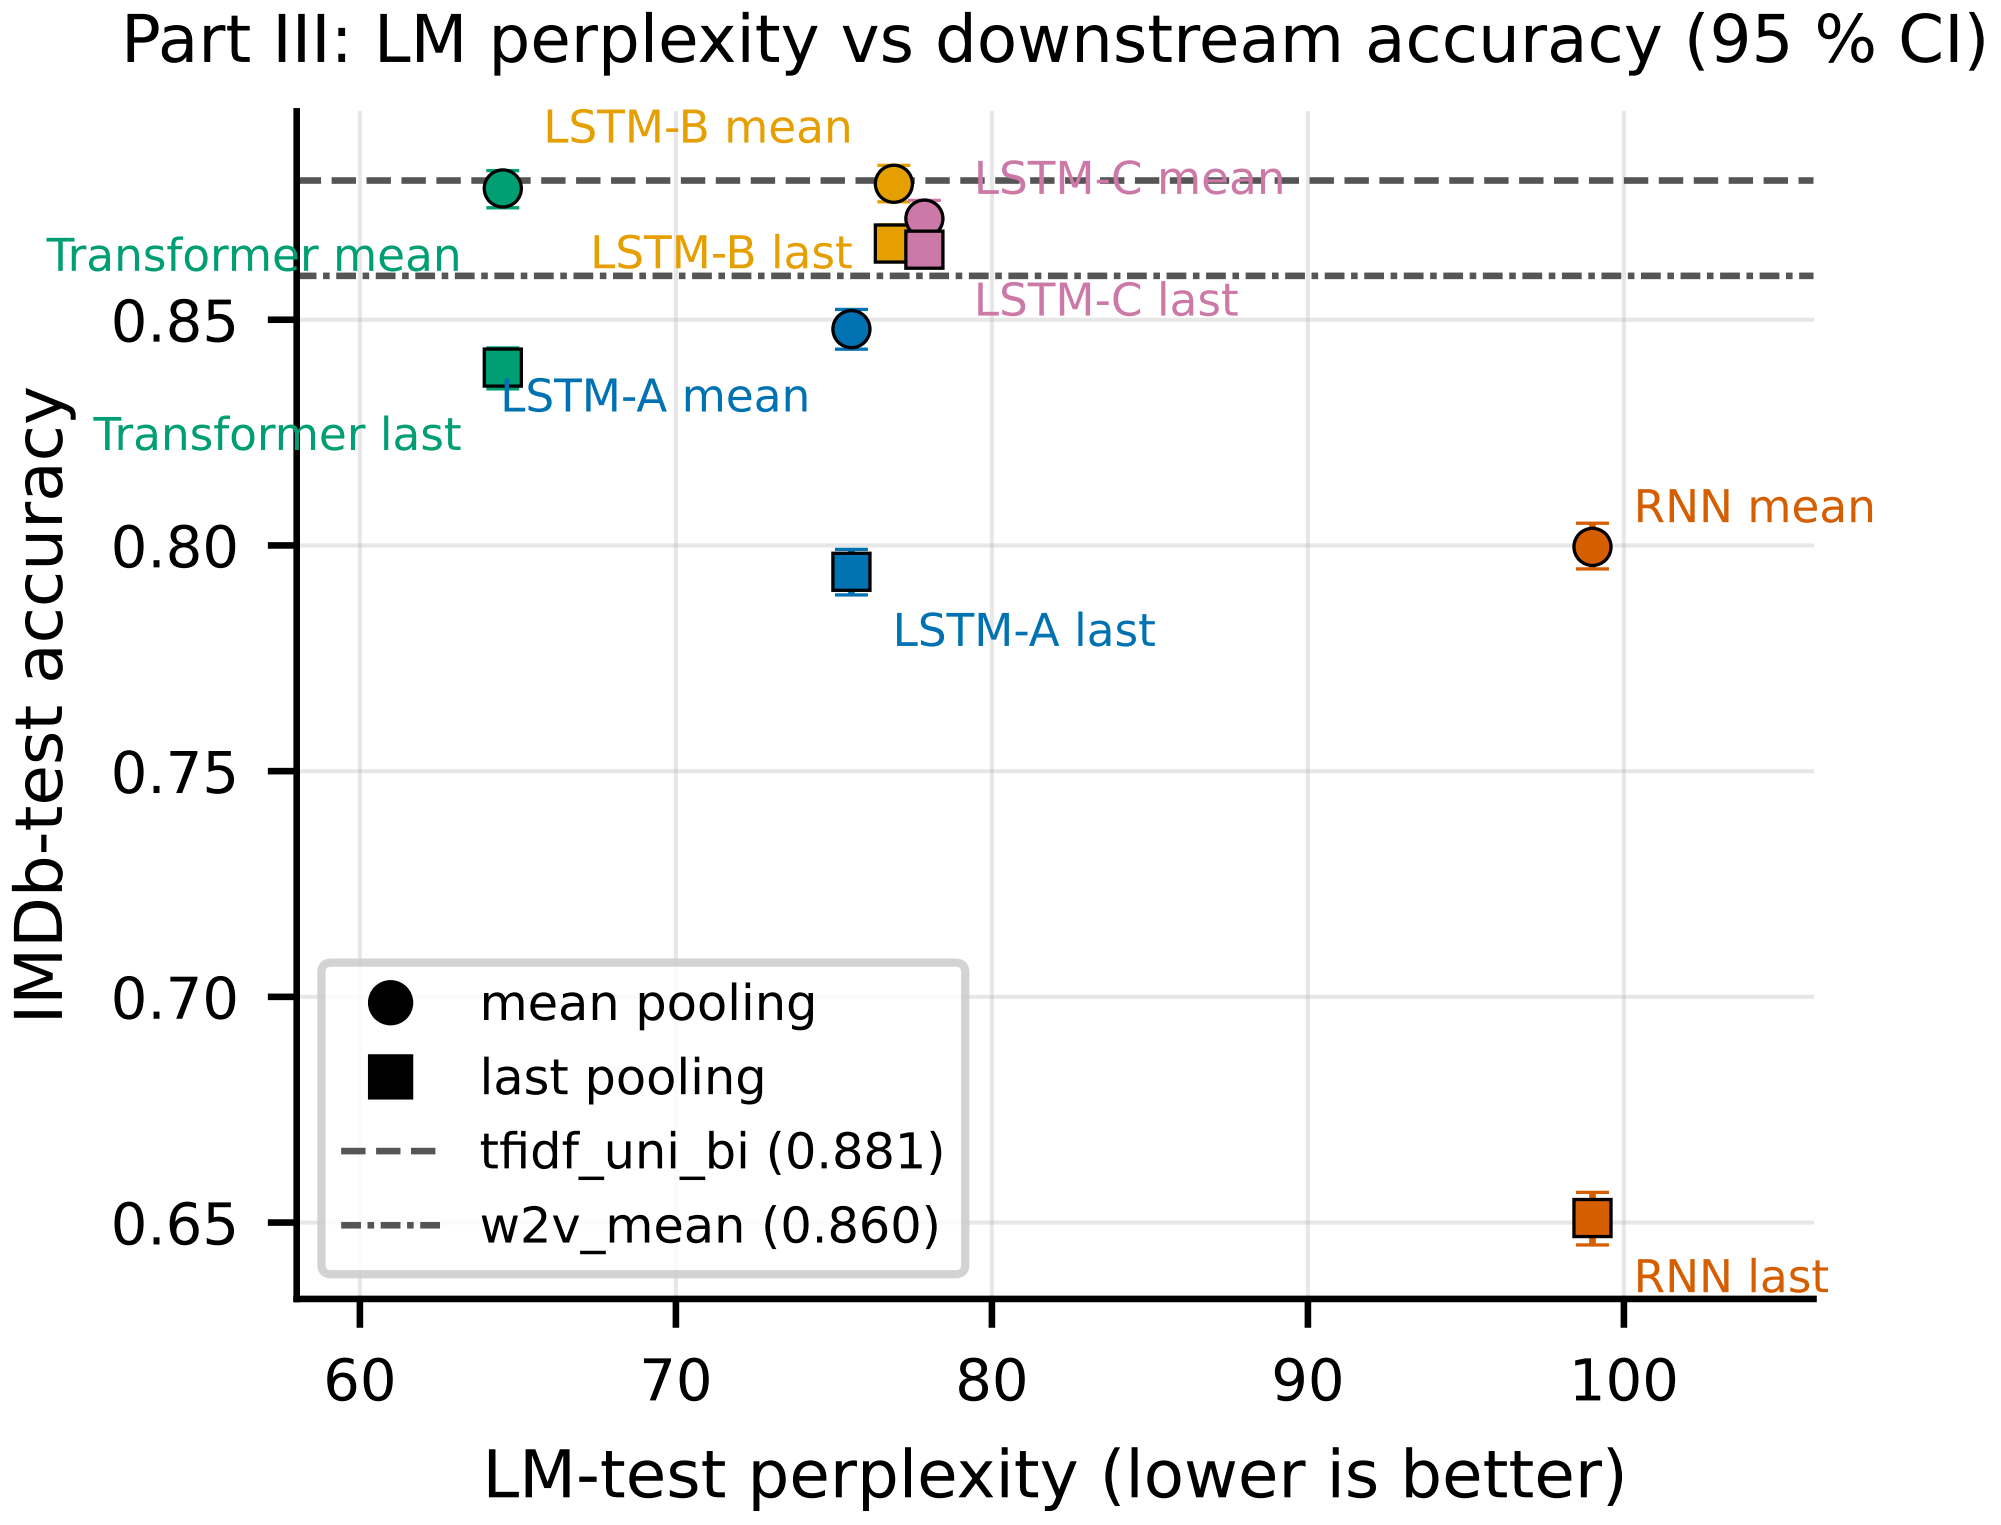
Part III: LM perplexity vs downstream accuracy (95 % CI)
LSTM-B mean
LSTM-C mean
Transformer mean
LSTM-B last
LSTM-C last
LSTM-A mean
Transformer last
RNN mean
LSTM-A last
RNN last
mean pooling
last pooling
tfidf_uni_bi (0.881)
w2v_mean (0.860)
IMDb-test accuracy
0.85
0.80
0.75
0.70
0.65
60
70
80
90
100
LM-test perplexity (lower is better)