



Ablation: Macro-F1 vs. class_overlap and env_burst_rate (label_noise=0.05)


Enhanced

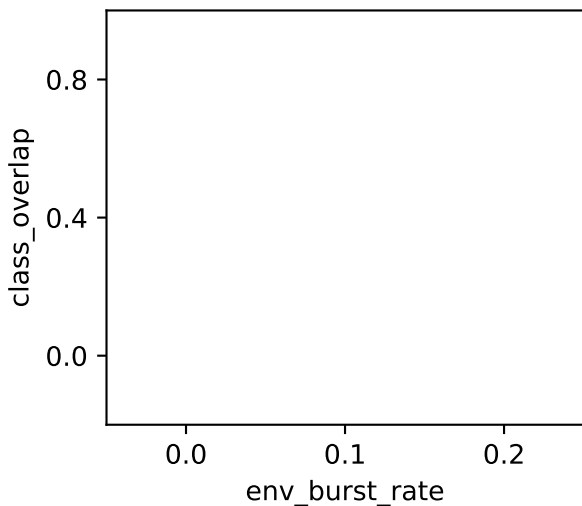

Cnn

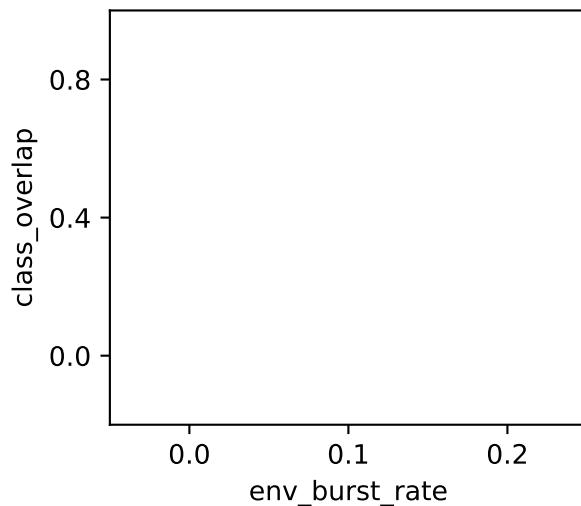

Bilstm

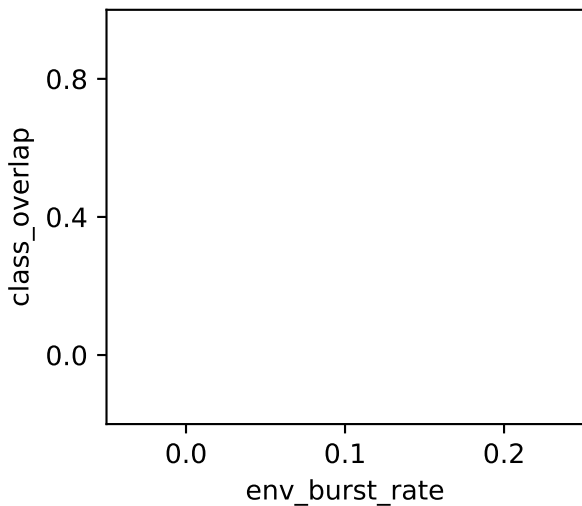

Conformer-lite

