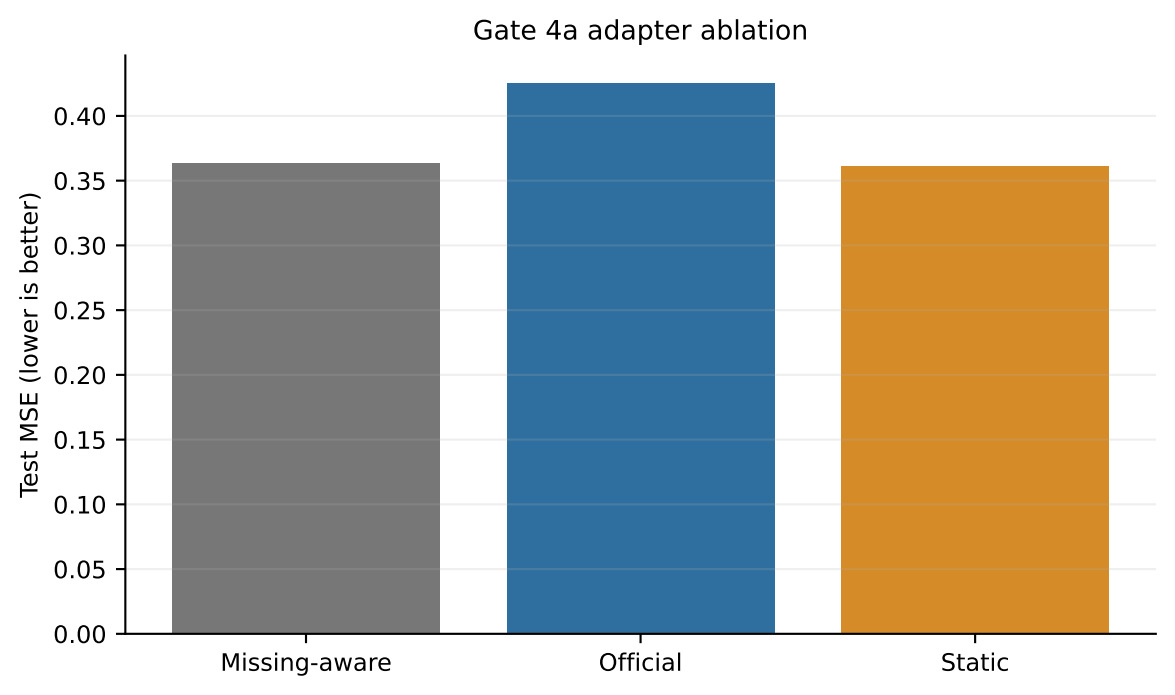
Gate 4a adapter ablation
Test MSE (lower is better)
0.00
0.05
0.10
0.15
0.20
0.25
0.30
0.35
0.40
Missing-aware
Official
Static