


Note.
1- PLEASE REFER TO BELOW TABLE FOR THE COLUMN NUMBERS MENTIONED IN THIS DRAWING

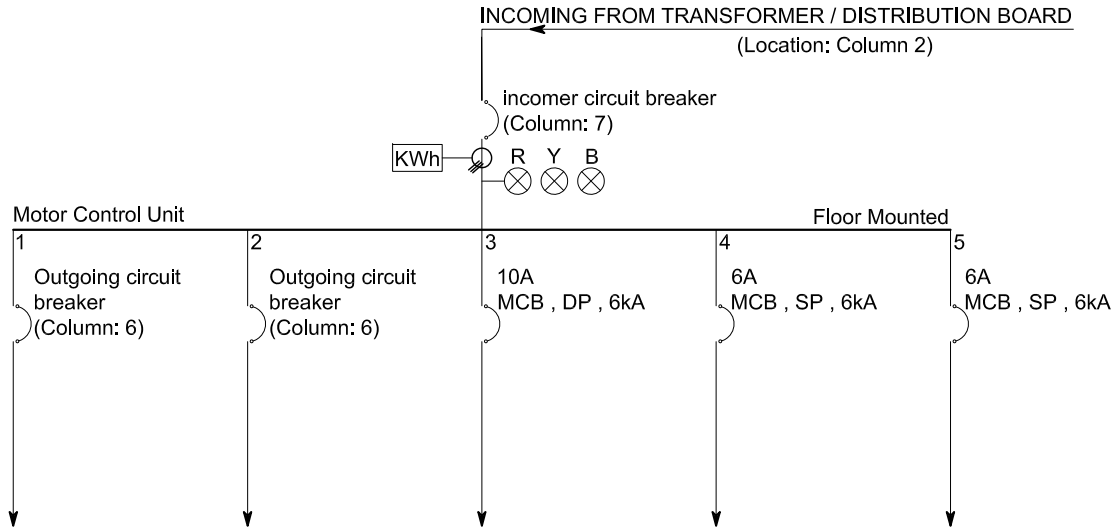

Equipment Description	VENTILLATION FAN 1	VENTILATION FAN 2 (if Applicable)	I&C System	Lights	Spare/misc.
Equipment Rating (kW))	COLUMN: 3	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Drop Structure Odor Control System						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	Main Mir (D1)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
2	Infantry (D2)	4	1	DOL	MCB -TP, 10A-16kA	MCCB-TP, 20A - 25kA
3	Bird Market (D3)	7.5	1	DOL	MCB -TP, 20A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
4	Gov House (D4)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
5	Lakshami Chowk (D5)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
6	Line-A Qurtaba (D6)	15	2	DOL	MCB -TP, 40A-16kA	MCCB-TP, 50A - 25kA
7	Grumangat(D7)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
8	Q Block (D8)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
9	G Block (D10)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		2.2	1	DOL	MCB -TP, 6A-16kA	
10	Zafar Ali Rd (D11)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
11	Ichra (D12)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
12	Shama (D14)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
13	Line-B Qurtaba (D16)	11	1	ASD	MCB -TP, 32A-16kA	MCCB-TP, 50A - 25kA
		7.5	1	DOL	MCB -TP, 20A-16kA	
14	Lyton (D17)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
15	PIA (D18)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
16	Poonch (D19)	4	1	DOL	MCB -TP, 16-16kA	MCCB-TP, 20A - 25kA

SYMBOL	LEGENDS
	DESCRIPTION
	CIRCUIT BREAKER
MCCB	MOLDED CASE CIRCUIT BREAKER
MCB	MINIATURE CIRCUIT BREAKER
FP	FOUR POLE
TP	THREE POLE
DP	DOUBLE POLE
SP	SINGLE POLE
	EARTH SWITCH
	AMMETER SELECTOR SWITCH
	VOLTMETER SELECTOR SWITCH
	DIGITAL POWER METER
	CURRENT TRANSFORMER
	INDICATION LIGHT

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04		
03		
02		
01		
REV.	DATE	DESCRIPTION


DRAWN	MUHAMMAD ARSLAN
CHECKED BY	SHAHZAIB SHABBIR
RECOMMENDED	
CHD./VER.	
APPROVED	

ODOR CONTROL SYSTEM (SINGLE LINE DIAGRAM) TYPICAL

DATE:-
SEPTEMBER, 2024

DRAWING NO.:-
LW-TD-151

Note.
1- PLEASE REFER TO BELOW TABLE FOR
THE COLUMN NUMBERS MENTIONED IN
THIS DRAWING

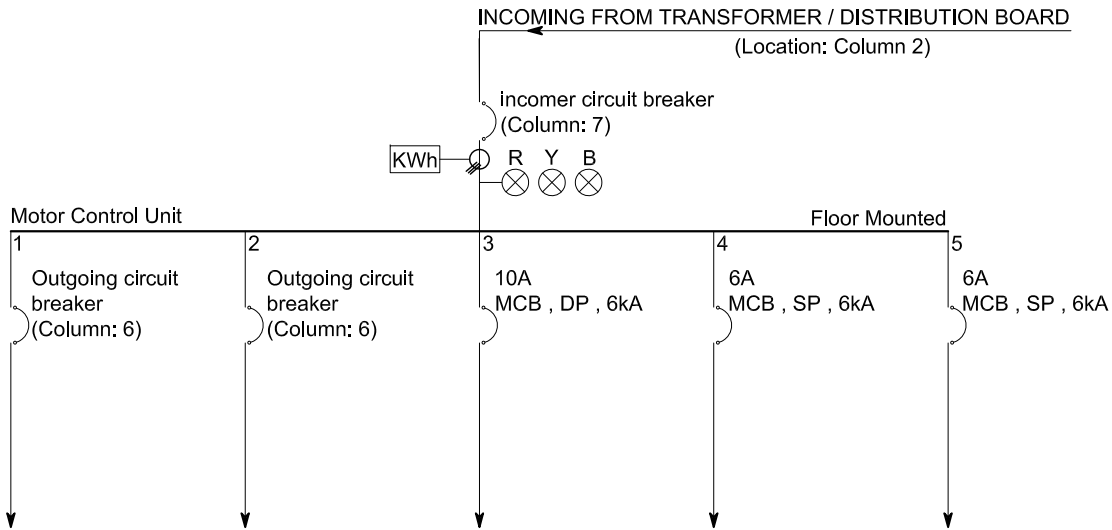

Equipment Description	SCREEN	CONVEYOR (if Applicable)	I&C System	Lights	Spare/misc.
Equipment Rating (kW))	COLUMN: 3	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Screens Area						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	Main Mir	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
2	infantry	3	2	DOL	MCB -TP, 10A-16kA	MCB -TP, 16A-16kA
3	Bird Market	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
4	Larech Colony	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
5	Ghazi Mohallah	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
6	Mohammad Nagar	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
7	Lakshmi Chowk	1.5	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Lakshmi Chowk Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	
8	Gov House	0.75	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
9	Janki Devi	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
10	Grumangat	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
11	Q Block	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
12	Center Point	1.5	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
13	G Block	1.5	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
14	Shareef Colony	0.55	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
15	Zafar Ali Rd	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
16	Shadman	2.2	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
17	Shama	0.75	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
18	Ichra	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
19	Rasool Park	2.2	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Rasool Park Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	
20	Lyton /Lake Rd	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
21	PIA	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
22	Poonch	1.5	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Poonch Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04		
03		
02		
01		
REV.	DATE	DESCRIPTION


DRAWN	MUHAMMAD ARSLAN
CHECKED BY	SHAHZAIB SHABBIR
RECOMMENDED	
CHD./VER.	
APPROVED	

SCREENS (SINGLE LINE DIAGRAM) TYPICAL

DATE:-
SEPTEMBER, 2024

DRAWING NO.:-
LW-TD-152

Note.
1- PLEASE REFER TO BELOW TABLE FOR THE COLUMN NUMBERS MENTIONED IN THIS DRAWING

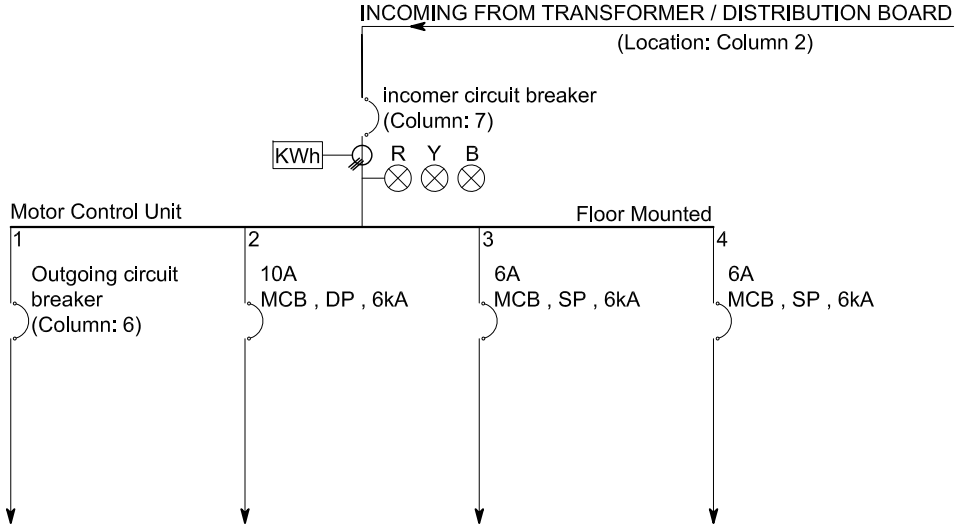

Equipment Description	SCREEN	I&C System	Lights	Spare/misc.
Equipment Rating (kW)	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Ventillation System						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	E1	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
2	E2	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
3	E3	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
4	E4	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
5	E5	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
6	E6	2.2	2	DOL	MCB -TP, 10A-16kA	MCB -TP, 32A-16kA
7	E7	3	1	DOL	MCB -TP, 10A-16kA	MCB -TP, 32A-16kA
8	E8	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
9	E9	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
10	E10	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
11	E11	22	1	ASD	MCB -TP, 50A-16kA	MCB -TP, 63A-16kA
12	E12	22	1	ASD	MCB -TP, 50A-16kA	MCB -TP, 63A-16kA
13	E13	15	1	ASD	MCB -TP, 40A-16kA	MCB -TP, 63A-16kA

	LEGENDS
SYMBOL	DESCRIPTION
	CIRCUIT BREAKER
MCCB	MOLDED CASE CIRCUIT BREAKER
MCB	MINIATURE CIRCUIT BREAKER
FP	FOUR POLE
TP	THREE POLE
DP	DOUBLE POLE
SP	SINGLE POLE
	EARTH SWITCH
	AMMETER SELECTOR SWITCH
	VOLTMETER SELECTOR SWITCH
	DIGITAL POWER METER
	CURRENT TRANSFORMER
	INDICATION LIGHT

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04		
03		
02		
01		
REV.	DATE	DESCRIPTION


DRAWN	MUHAMMAD ARSLAN
CHECKED BY	SHAHZAIB SHABBIR
RECOMMENDED	
CHD./VER.	
APPROVED	

VENTILATION SYSTEM (SINGLE LINE DIAGRAM) TYPICAL

DATE:-
SEPTEMBER, 2024

DRAWING NO.:-
LW-TD-153

附件-B

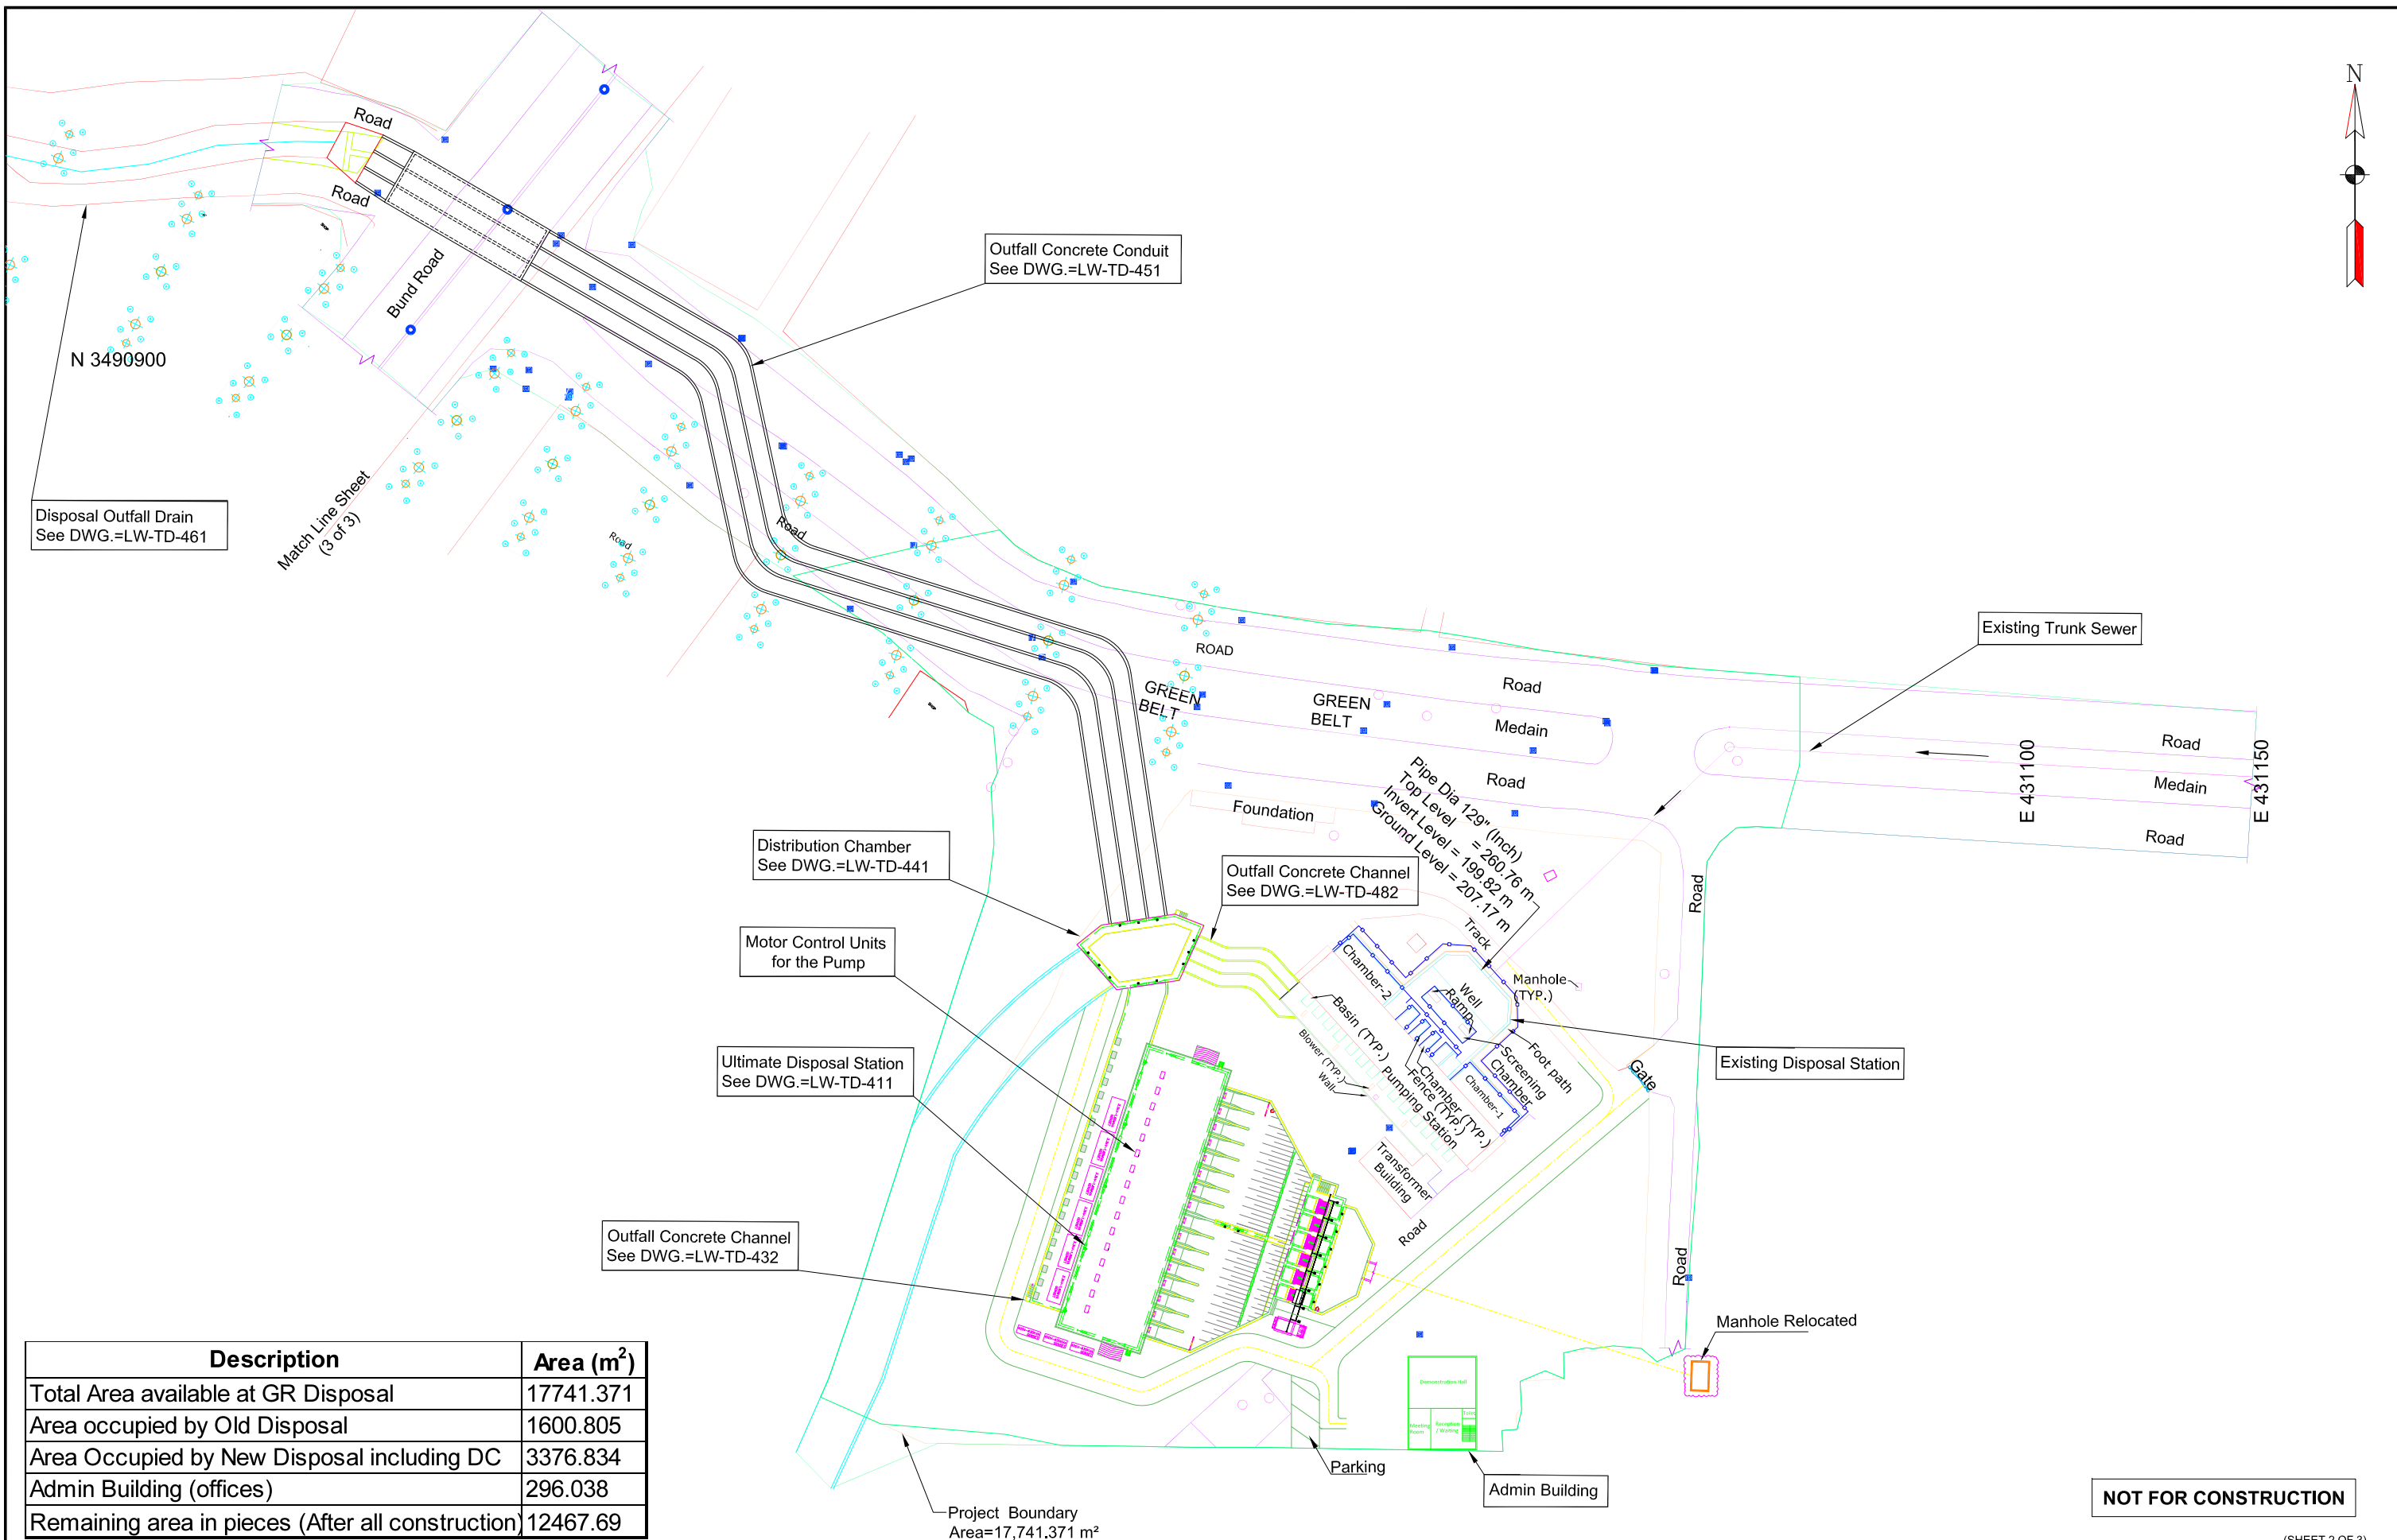

Description	Area (m ²)
Total Area available at GR Disposal	17741.371
Area occupied by Old Disposal	1600.805
Area Occupied by New Disposal including DC	3376.834
Admin Building (offices)	296.038
Remaining area in pieces (After all construction)	12467.69

NOT FOR CONSTRUCTION

(SHEET 2 OF 3)

LAHORE WASTEWATER AND DRAINAGE MANAGEMENT PROJECT (LWDMP) - SEWERAGE SYSTEM FROM LARECHS COLONY TO GULSHAN-E-RABI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04

03

02

01

REV.

DATE

DESCRIPTION

DRAWN

MUHAMMAD HAMMAD NASEER

CHECKED BY

MUHAMMAD SAQIB RAZA

RECOMMENDED

CHD./VER.

APPROVED

ULTIMATE DISPOSAL STATION
MASTER LAYOUT PLAN PUMP HOUSE

DATE:-

NOVEMBER, 2025


DRAWING NO.:-

LW - TD - 402

附件-C

序号	提升泵站名称	水泵数量及容量（电机额定功率）	变压器（KVA）	发电机（KVA）	备注
1	Mian Mir	1台 x 4立方英尺/秒（60马力）	100	不可用	
2	Infantry Road	1台 x 4立方英尺/秒（50马力）	200	200	根据PMC设计需迁移发电机
		1台 x 4立方英尺/秒（50马力）			
		1台 x 6立方英尺/秒（50马力）			
		1台 x 10立方英尺/秒（75马力）			
3	Bird Market	1台 x 10立方英尺/秒（100马力）	400	300	根据PMC设计需迁移发电机
		1台 x 10立方英尺/秒（100马力）			
		1台 x 25立方英尺/秒（200马力）			
4	Larech Colony	1台 x 2立方英尺/秒（20马力）	100	200	根据PMC设计需迁移发电机
		1台 x 6立方英尺/秒（60马力）			
5	Ghazi Mohalla	1台 x 4立方英尺/秒（30马力）	100	200	根据PMC设计需迁移发电机
		1台 x 6立方英尺/秒（60马力）			
6	Muhammad Nagar	1台 x 6立方英尺/秒（80马力）	50	200	
7	Governor House	1台 x 6立方英尺/秒（60马力）	2 x 200 KVA	不可用	
		1台 x 6立方英尺/秒（60马力）			
		1台 x 6立方英尺/秒（60马力）			
8	Lakshmi Chowk	1 台 x 25 Cusec (215 HP)	400 & 1000KVA	500 KVA + 500 KVA + 1000 KVA	根据PMC设计需迁移发电机
		1 台 x 25 Cusec (215 HP)			
		1 台 x 25 Cusec (215 HP)			
		1 台 x 25 Cusec (215 HP)			
		1 台 x 25 Cusec (215 HP)			
		1 台 x 25 Cusec (215 HP)			
		1 台 x 25 Cusec (215 HP)			
9	Lytton Road	1台 x 6立方英尺/秒（60马力）	200 KVA	200 KVA	根据PMC设计需迁移发电机
		1台 x 10 立方英尺/秒（80 HP）			
		1台 x 6 立方英尺/秒（40 HP）			
10	PIA Planterium	1 台 x 25 立方英尺/秒（215 HP）	400 & 200 KVA	200 KVA & 1000 KVA	
		1 台 x 12 立方英尺/秒（100 HP）			
		1 台 x 12 立方英尺/秒（100 HP）			
		1 台 x 12 立方英尺/秒（100 HP）			
		1 台 x 25 立方英尺/秒（215 HP）			
11	Gurumangat Road	1 台 x 25 立方英尺/秒（150 HP）	200 KVA	500 KVA	
		1 台 x 15 立方英尺/秒（150 HP）			
		1 台 x 15 立方英尺/秒（150 HP）			
12	Q Block Gulberg	1 台 x 25 立方英尺/秒（150 HP）	200 KVA	200 KVA	
		1 台 x 6 立方英尺/秒（50 HP）			
13	G Block Gulberg	1 台 x 25 立方英尺/秒（150 HP）	1000 KVA	500 KVA	根据PMC设计需迁移发电机
		1 台 x 25 立方英尺/秒（150 HP）			
		1 台 x 25 立方英尺/秒（150 HP）			
		1 台 x 25 立方英尺/秒（150 HP）			
		1 台 x 25 立方英尺/秒（150 HP）			
14	Zafar Ali Road	1 台 x 6 立方英尺/秒（50 HP）	100 KVA	200 KVA	根据PMC设计需迁移发电机
		1 台 x 6 立方英尺/秒（40 HP）			
15	Shareef Colony	1 台 x 6 立方英尺/秒（40 HP）	50 KVA	200 KVA	根据PMC设计需迁移发电机
		1 台 x 6 立方英尺/秒（40 HP）			
16	Shadman Colony	1 台 x 6 立方英尺/秒（40 HP）	2 x 630 KVA	630 KVA	
		1 台 x 25 立方英尺/秒（150 HP）			
		1 台 x 25 立方英尺/秒（150 HP）			
17	Shama	1台 x 10立方英尺/秒（75马力）	100 KVA	200 KVA	根据PMC设计需迁移发电机
		1台 x 6立方英尺/秒（80马力）			
		1台 x 6立方英尺/秒（60马力）			
18	Ichra	1台 x 6立方英尺/秒（60马力）	800 KVA	300 KVA	
		1台 x 6立方英尺/秒（80马力）			
		1台 x 6立方英尺/秒（80马力）			
19	Rasool Park	1 台 x 25 立方英尺/秒（150 HP）	200 KVA & 630 KVA	500 KVA	根据PMC设计需迁移发电机
		1台 x 15立方英尺/秒（110马力）			
		1台 x 08立方英尺/秒（80马力）			
		1台 x 06立方英尺/秒（60马力）			
		1台 x 06立方英尺/秒（110马力）			
20	Poonch Road	1台 x 10立方英尺/秒（80马力）	400 KVA	400 KVA	根据PMC设计需迁移发电机
		1台 x 10立方英尺/秒（80马力）			
		1台 x 20立方英尺/秒（150马力）			
21	Jhan ki Devi	1台 x 01立方英尺/秒（20马力）	50 KVA	不可用	
22	中心点	1台 x 08立方英尺/秒（50马力）	400 KVA	300 KVA	根据PMC设计需迁移发电机
		1 台 x 06 立方英尺/秒（50 马力）			
		1台 x 06立方英尺/秒（60马力）			
23	Harbanspura /Karachi Phatak 处 置	5 台 x 25 立方英尺/秒（150 马力）	1000KVA	1000KVA	在建中（预计将于2026年第一季度完工）

附件-D

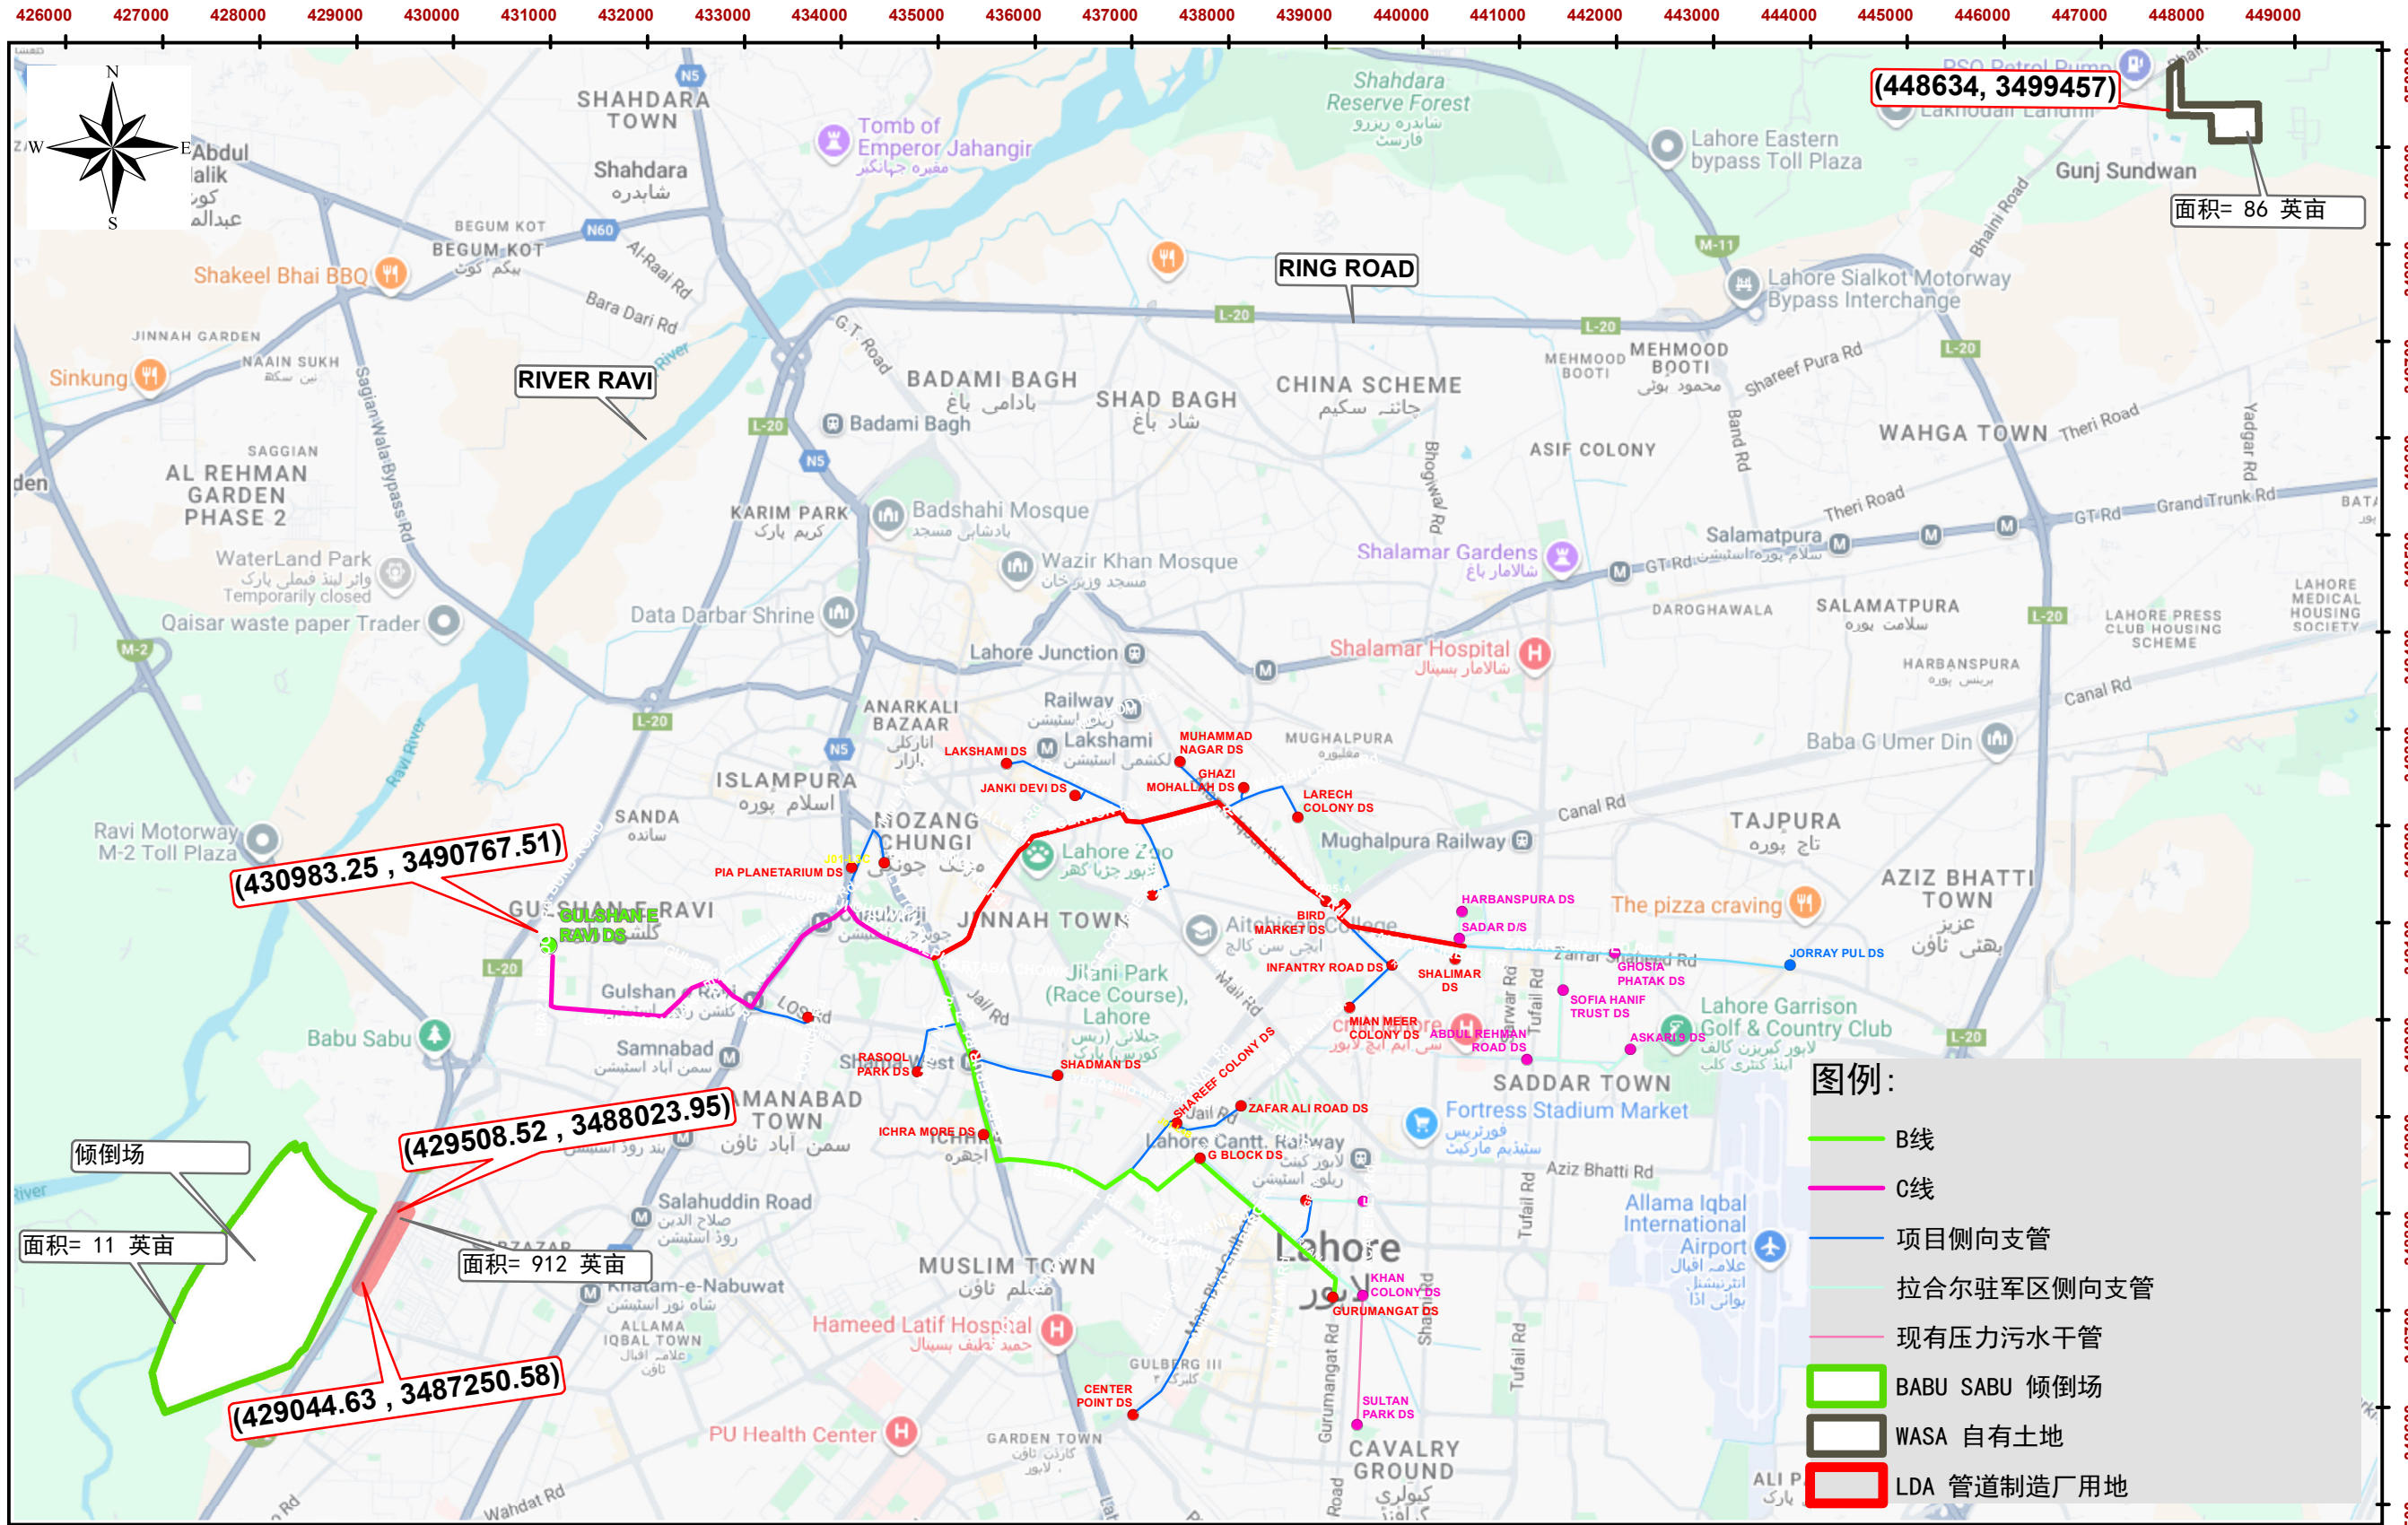

拉合尔废水与排水管理项目（LWDMP）- 从 LARECHS COLONY 到 GULSHAN-E-RAVI 的污水系统（采用非开挖技术）

 供水与卫生 机构, LAHORE	    A Joint Venture	修订				控制	绘图		WASA 自有土地		比例
			03				校核人				
			02				推荐				
			01				CHD./VER.		日期 :-	图纸编号	版本 :-
			说明	日期	批准		版本		2025年12月	LW-TD-005A	