


Note.
1- PLEASE REFER TO BELOW TABLE FOR
THE COLUMN NUMBERS MENTIONED IN
THIS DRAWING

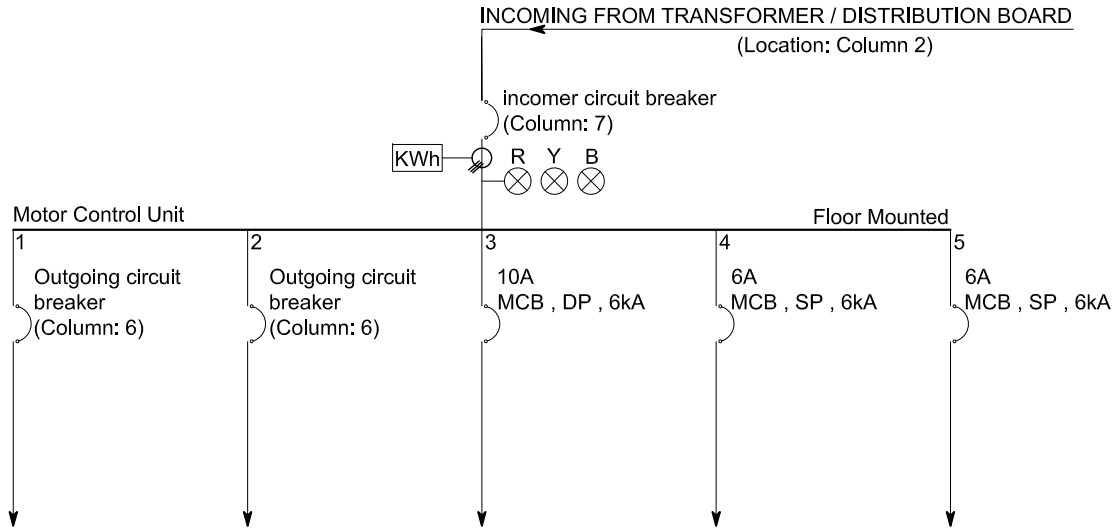

Equipment Description	VENTILLATION FAN 1	VENTILATION FAN 2 (if Applicable)	I&C System	Lights	Spare/misc.
Equipment Rating (kW))	COLUMN: 3	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Drop Structure Odor Control System						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	Main Mir (D1)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
2	Infantry (D2)	4	1	DOL	MCB -TP, 10A-16kA	MCCB-TP, 20A - 25kA
3	Bird Market (D3)	7.5	1	DOL	MCB -TP, 20A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
4	Gov House (D4)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
5	Lakshami Chowk (D5)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
6	Line-A Qurtaba (D6)	15	2	DOL	MCB -TP, 40A-16kA	MCCB-TP, 50A - 25kA
7	Grumangat(D7)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
8	Q Block (D8)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
9	G Block (D10)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		2.2	1	DOL	MCB -TP, 6A-16kA	
10	Zafar Ali Rd (D11)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
11	Ichra (D12)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
12	Shama (D14)	5.5	1	DOL	MCB -TP, 16A-16kA	MCCB-TP, 32A - 25kA
		1.5	1	DOL	MCB -TP, 6A-16kA	
13	Line-B Qurtaba (D16)	11	1	ASD	MCB -TP, 32A-16kA	MCCB-TP, 50A - 25kA
		7.5	1	DOL	MCB -TP, 20A-16kA	
14	Lyton (D17)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
15	PIA (D18)	1.5	1	DOL	MCB -TP, 6A-16kA	MCCB-TP, 20A - 25kA
16	Poonch (D19)	4	1	DOL	MCB -TP, 16-16kA	MCCB-TP, 20A - 25kA

LEGENDS	
SYMBOL	DESCRIPTION
	CIRCUIT BREAKER
MCCB	MOLDED CASE CIRCUIT BREAKER
MCB	MINIATURE CIRCUIT BREAKER
FP	FOUR POLE
TP	THREE POLE
DP	DOUBLE POLE
SP	SINGLE POLE
	EARTH SWITCH
	AMMETER SELECTOR SWITCH
	VOLTMETER SELECTOR SWITCH
	DIGITAL POWER METER
	CURRENT TRANSFORMER
	INDICATION LIGHT

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04		
03		
02		
01		
REV.	DATE	DESCRIPTION

DRAWN
CHECKED BY
RECOMMENDED
CHD./VER.
APPROVED

MUHAMMAD ARSLAN


SHAHZAIB SHABBIR

ODOR CONTROL SYSTEM (SINGLE LINE DIAGRAM) TYPICAL

DATE:-
SEPTEMBER, 2024

DRAWING NO.:-
LW-TD-151

Note.
1- PLEASE REFER TO BELOW TABLE FOR
THE COLUMN NUMBERS MENTIONED IN
THIS DRAWING

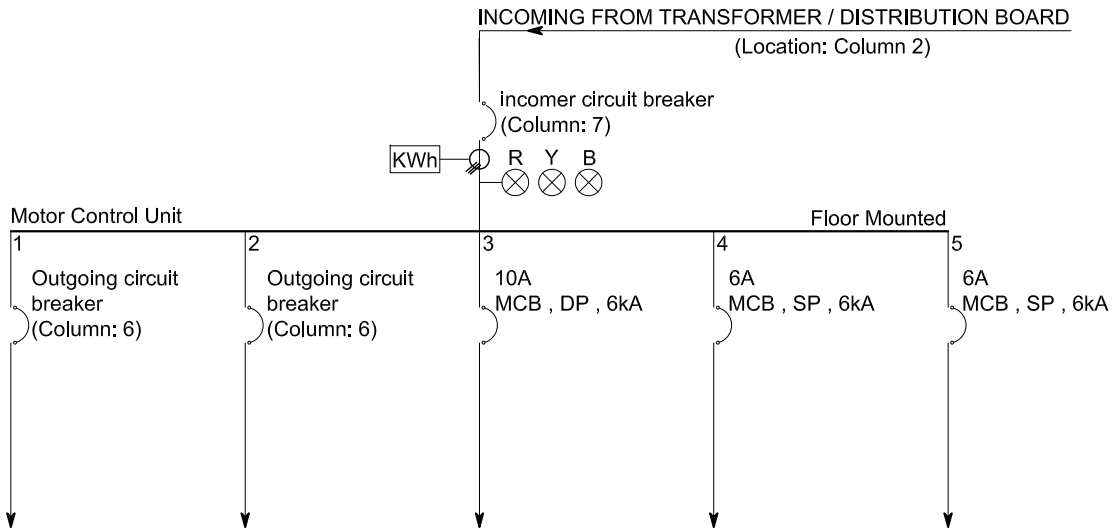

Equipment Description	SCREEN	CONVEYOR (if Applicable)	I&C System	Lights	Spare/misc.
Equipment Rating (kW))	COLUMN: 3	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Screens Area						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	Main Mir	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
2	infantry	3	2	DOL	MCB -TP, 10A-16kA	MCB -TP, 16A-16kA
3	Bird Market	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
4	Larech Colony	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
5	Ghazi Mohallah	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
6	Mohammad Nagar	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
7	Lakshmi Chowk	1.5	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Lakshmi Chowk Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	
8	Gov House	0.75	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
9	Janki Devi	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
10	Grumangat	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
11	Q Block	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
12	Center Point	1.5	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
13	G Block	1.5	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
14	Shareef Colony	0.55	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
15	Zafar Ali Rd	0.37	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
16	Shadman	2.2	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
17	Shama	0.75	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
18	Ichra	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
19	Rasool Park	2.2	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Rasool Park Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	
20	Lyton /Lake Rd	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
21	PIA	1.1	1	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
22	Poonch	1.5	2	DOL	MCB -TP, 6A-16kA	MCB -TP, 16A-16kA
	Poonch Belt Conveyor	0.75	1	DOL	MCB -TP, 6A-16kA	

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04		
03		
02		
01		
REV.	DATE	DESCRIPTION


DRAWN	MUHAMMAD ARSLAN
CHECKED BY	SHAHZAIB SHABBIR
RECOMMENDED	
CHD./VER.	
APPROVED	

SCREENS (SINGLE LINE DIAGRAM) TYPICAL

DATE:-
SEPTEMBER, 2024

DRAWING NO.:-
LW-TD-152

Note.
1- PLEASE REFER TO BELOW TABLE FOR
THE COLUMN NUMBERS MENTIONED IN
THIS DRAWING

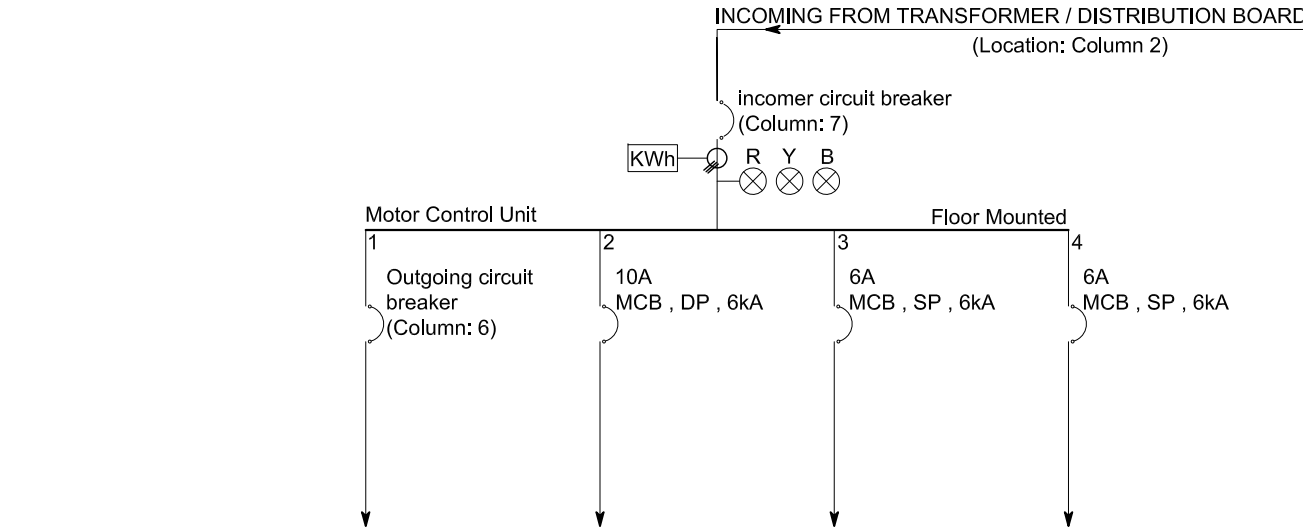

Equipment Description	SCREEN	I&C System	Lights	Spare/misc.
Equipment Rating (kW)	COLUMN: 3	--	--	--
Quantity (Nos.)	COLUMN: 4	02	04	04
Starter Type	COLUMN: 5	--	--	--

Column:1	Column:2	Column:3	Column:4	Column:5	Column:6	Column:7
Ventillation System						
Sr.No.	Location	installed Equipment Details				Incoming Circuit Breaker
		Equipment Rating	Installed Qty.	Starter Type	Feeder Circuit Breaker	
		(kW)	(Nos.)			
1	E1	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
2	E2	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
3	E3	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
4	E4	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
5	E5	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
6	E6	2.2	2	DOL	MCB -TP, 10A-16kA	MCB -TP, 32A-16kA
7	E7	3	1	DOL	MCB -TP, 10A-16kA	MCB -TP, 32A-16kA
8	E8	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
9	E9	5.5	1	DOL	MCB -TP, 16A-16kA	MCB -TP, 32A-16kA
10	E10	7.5	1	DOL	MCB -TP, 20A-16kA	MCB -TP, 40A-16kA
11	E11	22	1	ASD	MCB -TP, 50A-16kA	MCB -TP, 63A-16kA
12	E12	22	1	ASD	MCB -TP, 50A-16kA	MCB -TP, 63A-16kA
13	E13	15	1	ASD	MCB -TP, 40A-16kA	MCB -TP, 63A-16kA


	LEGENDS
SYMBOL	DESCRIPTION
	CIRCUIT BREAKER
MCCB	MOLDED CASE CIRCUIT BREAKER
MCB	MINIATURE CIRCUIT BREAKER
FP	FOUR POLE
TP	THREE POLE
DP	DOUBLE POLE
SP	SINGLE POLE
	EARTH SWITCH
	AMMETER SELECTOR SWITCH
	VOLTMETER SELECTOR SWITCH
	DIGITAL POWER METER
	CURRENT TRANSFORMER
	INDICATION LIGHT

(SHEET 1 OF 1)

LAHORE WATER & WASTEWATER MANAGEMENT PROJECT - SEWERAGE SYSTEM FROM LARECH COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)

 WATER AND SANITATION AGENCY, LAHORE	 <i>A Joint Venture</i>	04			DRAWN	MUHAMMAD ARSLAN	VENTILATION SYSTEM (SINGLE LINE DIAGRAM) TYPICAL	
		03			CHECKED BY	SHAHZAIB SHABBIR		
		02			RECOMMENDED			
		01			CHD./VER.			
		REV.	DATE	DESCRIPTION	APPROVED		DATE:- SEPTEMBER, 2024	DRAWING NO.:- LW-TD-153

附件-B

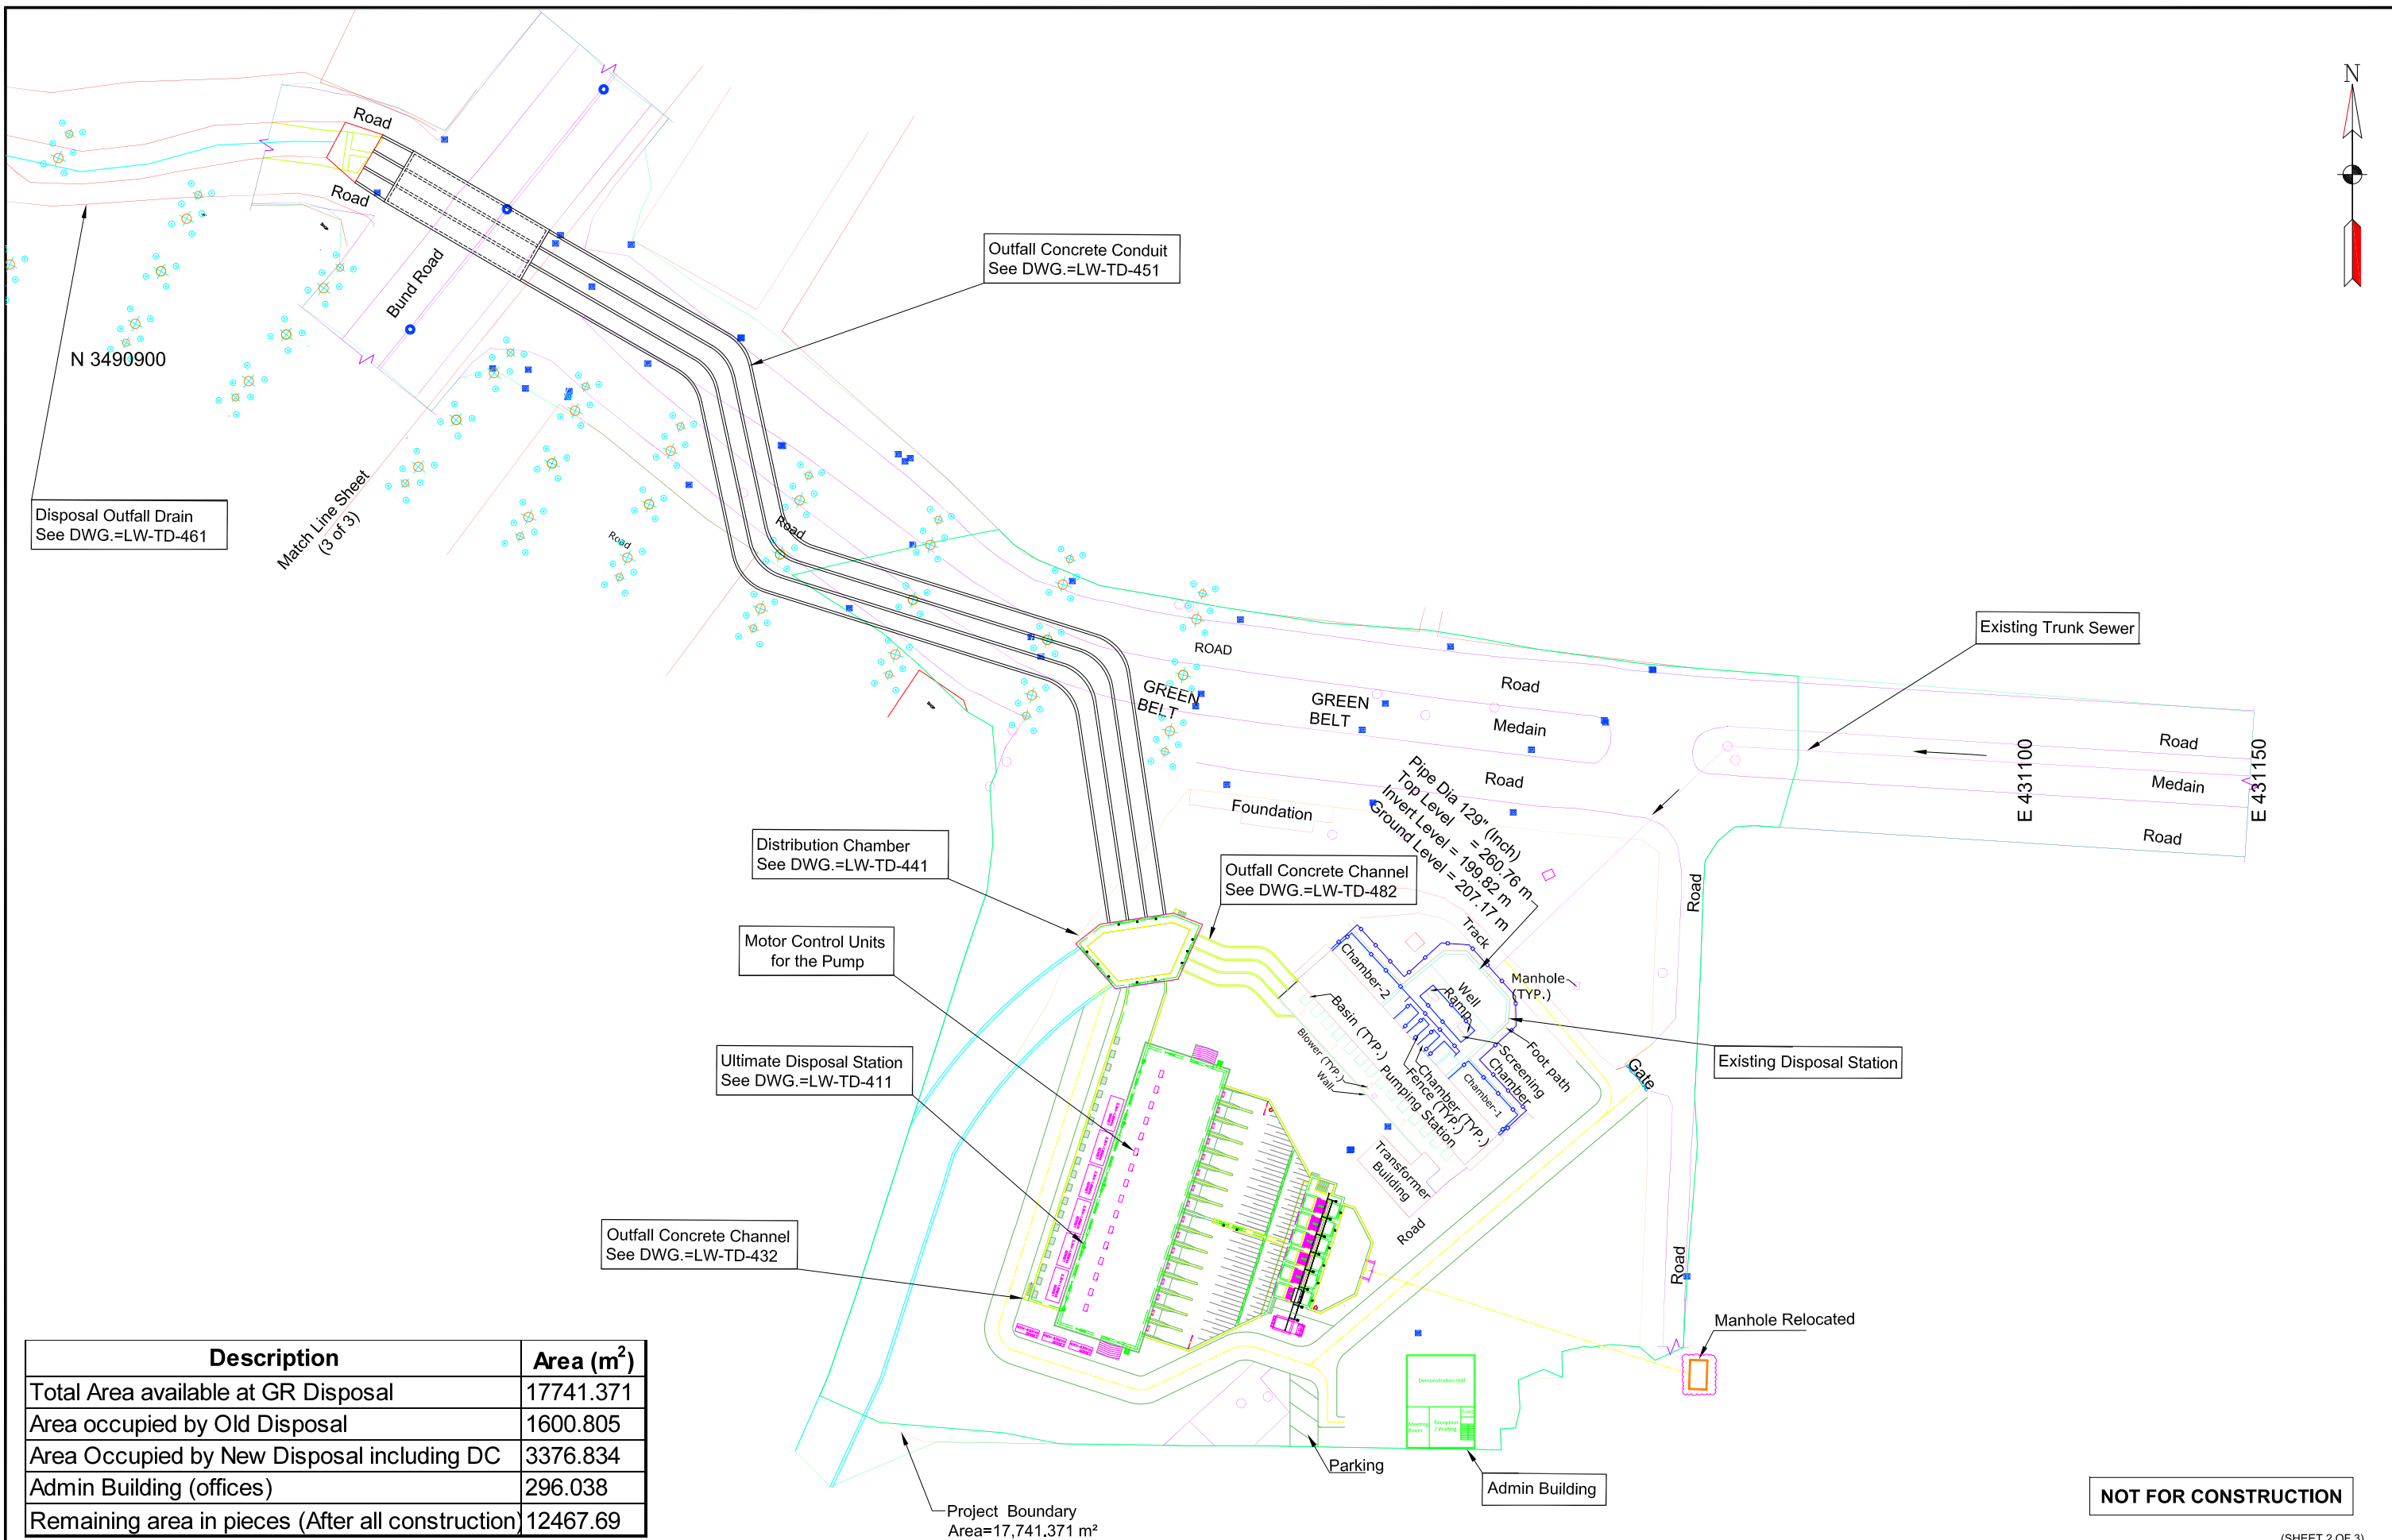

Description	Area (m ²)
Total Area available at GR Disposal	17741.371
Area occupied by Old Disposal	1600.805
Area Occupied by New Disposal including DC	3376.834
Admin Building (offices)	296.038
Remaining area in pieces (After all construction)	12467.69

LAHORE WASTEWATER AND DRAINAGE MANAGEMENT PROJECT (LWDMP) - SEWERAGE SYSTEM FROM LARECHS COLONY TO GULSHAN-E-RAVI, LAHORE (THROUGH TRENCHLESS TECHNOLOGY)



WATER AND SANITATION
AGENCY, LAHORE



A Joint Venture

04			DRAWN	MUHAMMAD HAMMAD NASEER
03			CHECKED BY	MUHAMMAD SAQIB RAZA
02			RECOMMENDED	
01			CHD./VER.	
REV.	DATE	DESCRIPTION	APPROVED	

DRAWN	MUHAMMAD HAMMAD NASEER
CHECKED BY	MUHAMMAD SAQIB RAZA
RECOMMENDED	
CHD./VER.	
APPROVED	

DATE:-
NOVEMBER, 2025

ULTIMATE DISPOSAL STATION
MASTER LAYOUT PLAN PUMP HOUSE

DRAWING NO.:-
LW - TD - 402

(SHEET 2 OF 3)

附件-C

Sr	No	Name of Lift Station	Number & Capacity of Pumps	Transformer	Generator	Remarks
(Motor Rating)	(KVA)	(KVA)				
1	Mian Mir	1	No x 4 Cusec (60 HP)	100	Not Available	
1	No x 4 Cusec (50 HP)					
2	Infantry Road	1	No x 4 Cusec (50 HP)	200	200	Shifting of Generator
1	No x 6 Cusec (50 HP)					Requires as per PMC Design
1	No x 10 Cusec (75 HP)					
1	No x 10 Cusec (100 HP)					Shifting of Generator
3	Bird Market	1	No x 10 Cusec (100 HP)	400	300	Requires as per PMC Design
1	No x 25 Cusec (200 HP)					
	Larech Colony	1	No x 2 Cusec (20 HP)	100	200	Shifting of Generator
4	1	No x 6 Cusec (60 HP)				Requires as per PMC Design
5	Ghazi Mohalla	1	No x 4 Cusec (30 HP)	100	200	Shifting of Generator
1	No x 6 Cusec (60 HP)					Requires as per PMC Design
6	Muhammad Nagar	1	No x 6 Cusec (80 HP)	50	200	
1	No x 6 Cusec (60 HP)					
7	Governor House	1	No x 6 Cusec (60 HP)	2 x 200	KVA	Not Available
1	No x 6 Cusec (60 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 25 Cusec (215 HP)					500 KVA + 500 KVA + Shifting of Generator
8	Lakshmi Chowk	1	No x 25 Cusec (215 HP)	400	& 1000KVA	1000 KVA Requires as per PMC Design
1	No x 25 Cusec (215 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 6 Cusec (60 HP)					Shifting of Generator
9	Lytton Road	1	No x 10 Cusec (80 HP)	200	KVA	200 KVA Requires as per PMC Design
1	No x 6 Cusec (40 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 12 Cusec (100 HP)					
10	PIA Planterium	1	No x 12 Cusec (100 HP)	400	& 200 KVA	200 KVA & 1000 KVA
1	No x 12 Cusec (100 HP)					
1	No x 25 Cusec (215 HP)					
1	No x 25 Cusec (150 HP)					
11	Gurumangat Road	1	No x 15 Cusec (150 HP)	200	KVA	500 KVA
1	No x 15 Cusec (150 HP)					
12	Q Block Gulberg	1	No x 25 Cusec (150 HP)	200	KVA	200 KVA
1	No x 6 Cusec (50 HP)					
1	No x 25 Cusec (150 HP)					
1	No x 25 Cusec (150 HP)					Shifting of Generator
13	G Block Gulberg	1	No x 25 Cusec (150 HP)	1000	KVA	500 KVA Requires as per PMC Design
1	No x 25 Cusec (150 HP)					
1	No x 25 Cusec (150 HP)					
14	Zafar Ali Road	1	No x 6 Cusec (50 HP)	100	KVA	200 KVA Shifting of Generator
1	No x 6 Cusec (40 HP)					Requires as per PMC Design
15	Shareef Colony	1	No x 6 Cusec (40 HP)	50	KVA	200 KVA Shifting of Generator
1	No x 6 Cusec (40 HP)					Requires as per PMC Design
1	No x 6 Cusec (40 HP)					
16	Shadman Colony	1	No x 25 Cusec (150 HP)	2 x 630	KVA	630 KVA
1	No x 25 Cusec (150 HP)					
1	No x 10 Cusec (75 HP)					Shifting of Generator
17	Shama	1	No x 6 Cusec (80 HP)	100	KVA	200 KVA Requires as per PMC Design
1	No x 6 Cusec (60 HP)					
1	No x 6 Cusec (60 HP)					
18	Ichra	1	No x 6 Cusec (80 HP)	800	KVA	300 KVA
1	No x 6 Cusec (80 HP)					
1	No x 25 Cusec (150 HP)					
1	No x 15 Cusec (110 HP)					200 KVA & 630 Shifting of Generator
19	Rasool Park	1	No x 08 Cusec (80 HP)	KVA	500 KVA	Requires as per PMC Design
1	No x 06 Cusec (60 HP)					
1	No x 06 Cusec (110 HP)					
1	No x 10 Cusec (80 HP)					Shifting of Generator
20	Poonch Road	1	No x 10 Cusec (80 HP)	400	KVA	400 KVA Requires as per PMC Design
1	No x 20 Cusec (150 HP)					
21	Jhan ki Devi	1	No x 01 Cusec (20 HP)	50	KVA	Not Available
1	No x 08 Cusec (50 HP)					Shifting of Generator
22	Centre Point	1	No x 06 Cusec (50 HP)	400	KVA	300 KVA Requires as per PMC Design
1	No x 06 Cusec (60 HP)					
	Under Construction					
	Harbanspura /Karachi	5	No x 25 Cusec (150 HP)	1000KVA	1000KVA	(Expected to be completed

附件-D

