


Methodology	TS 02795.06	MG Sample No.	S116202
Client	AECOM	MG Project No.	S26240-1
Address	Level 21/420 George St, Sydney NSW 2000	Date Sampled	24/03/2026
Project	Chowder Bay DFI (60740478)	Date Received	8/03/2026
Sample ID	ABH5_0.13-1.5	Date Tested	29/05/2026
Report No.	S116202-T_SMDD		
Sampling Method	Sampled by Client - results apply to the sample as received		
Preparation Method	Prepared in accordance with the test method		
Sample Description	Sandy Silty CLAY, trace of gravel		



Standard Maximum Dry Density (t/m³)	1.95
Standard Optimum Moisture Content (%)	10.3
Oversize Retained on 19 mm Sieve (%)	1
Oversize Retained on 37.5 mm Sieve (%)	0
Nominal Mould Size & Fraction Tested	1L Mould, -19 mm Test Fraction
Method of Determining MDD/OMC	Non-Linear Regression Plot

Notes

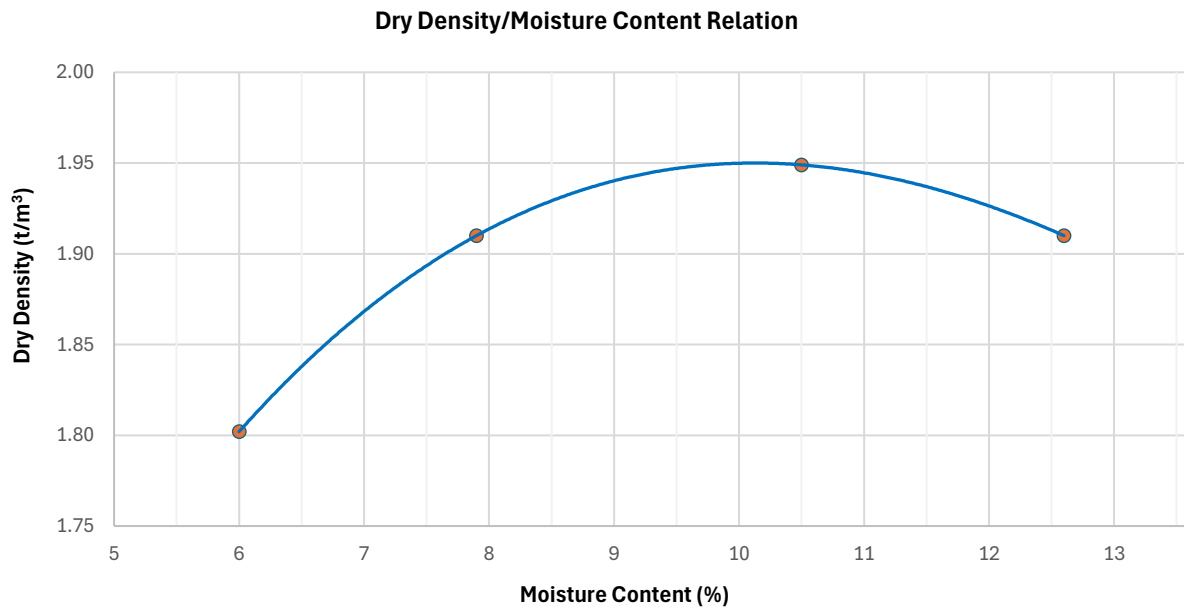

Accredited for compliance with ISO/IEC 17025 - Testing.
 NATA Accredited Laboratory Number: 14874
 Macquarie Geotechnical Pty Ltd
 14 Carter Street, Lidcombe NSW 2141 (Sydney Laboratory)

Authorised Signatory

Raj Mani

Raj Mani

Date of Issue

17/06/2026

Results relate only to the samples tested.
 This document shall not be reproduced, except in full.