


Methodology	TS 02795.11		
Client	AECOM	MG Sample No.	S116201
Address	Level 21/420 George St, Sydney NSW 2000	MG Project No.	S26240-1
Project	Chowder Bay DFI (60740478)	Date Sampled	24/03/2026
Sample ID	ABH2_1.0-2.0	Date Received	8/03/2026
Report No.	S116201-T_CBR	Date Tested	12/06/2026
Sampling Method	Sampled by Client - results apply to the sample as received		
Preparation Method	Prepared in accordance with the test method		
Sample Description	Silty Clayey SAND, trace of gravel		

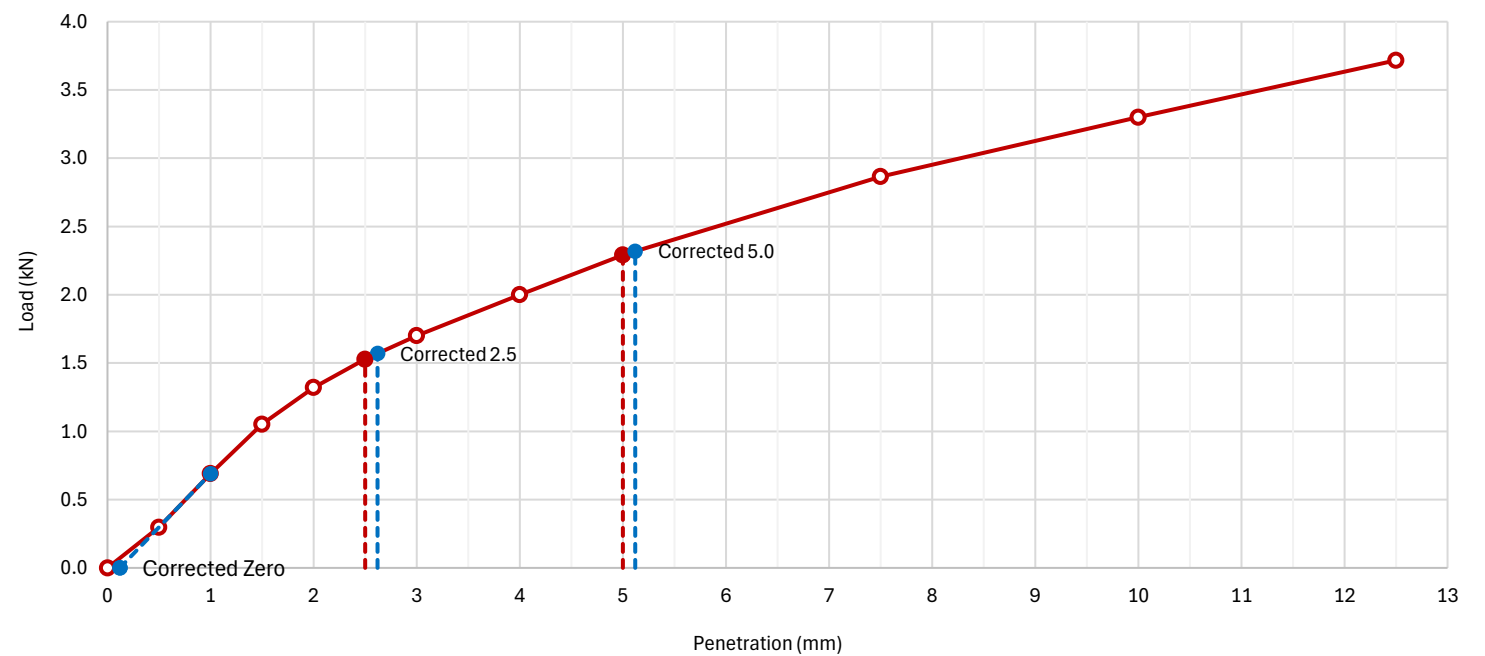

Preparation & Specification		Density & Moisture		Achieved	Target
Material Retained on 19.0 mm Sieve (%)	1	Lab Moisture Ratio - LMR (%)		98	100
Method of Establishing Plasticity Level	Technician Assessment	Lab Density Ratio - LDR (%)		100	100
Sample Curing Time (hrs)	24 hrs	Dry Density - At Compaction (t/m ³)		1.91	1.91
Compaction Hammer Used	Standard	Dry Density - After Soaking (t/m ³)		1.90	
Surcharge Mass Applied (kg)	4.5	Specimen Swell (%)		0.7	
Period of Soaking (days)	10	Moisture Content - At Compaction (%)		12.6	
Maximum Dry Density (t/m ³)	1.91	Moisture Content - Top 30 mm (%)		16.9	
Optimum Moisture Content (%)	12.9	Moisture Content - Full Depth (%)		14.0	
CBR Value (%) at 2.5 mm Penetration	12				

Notes