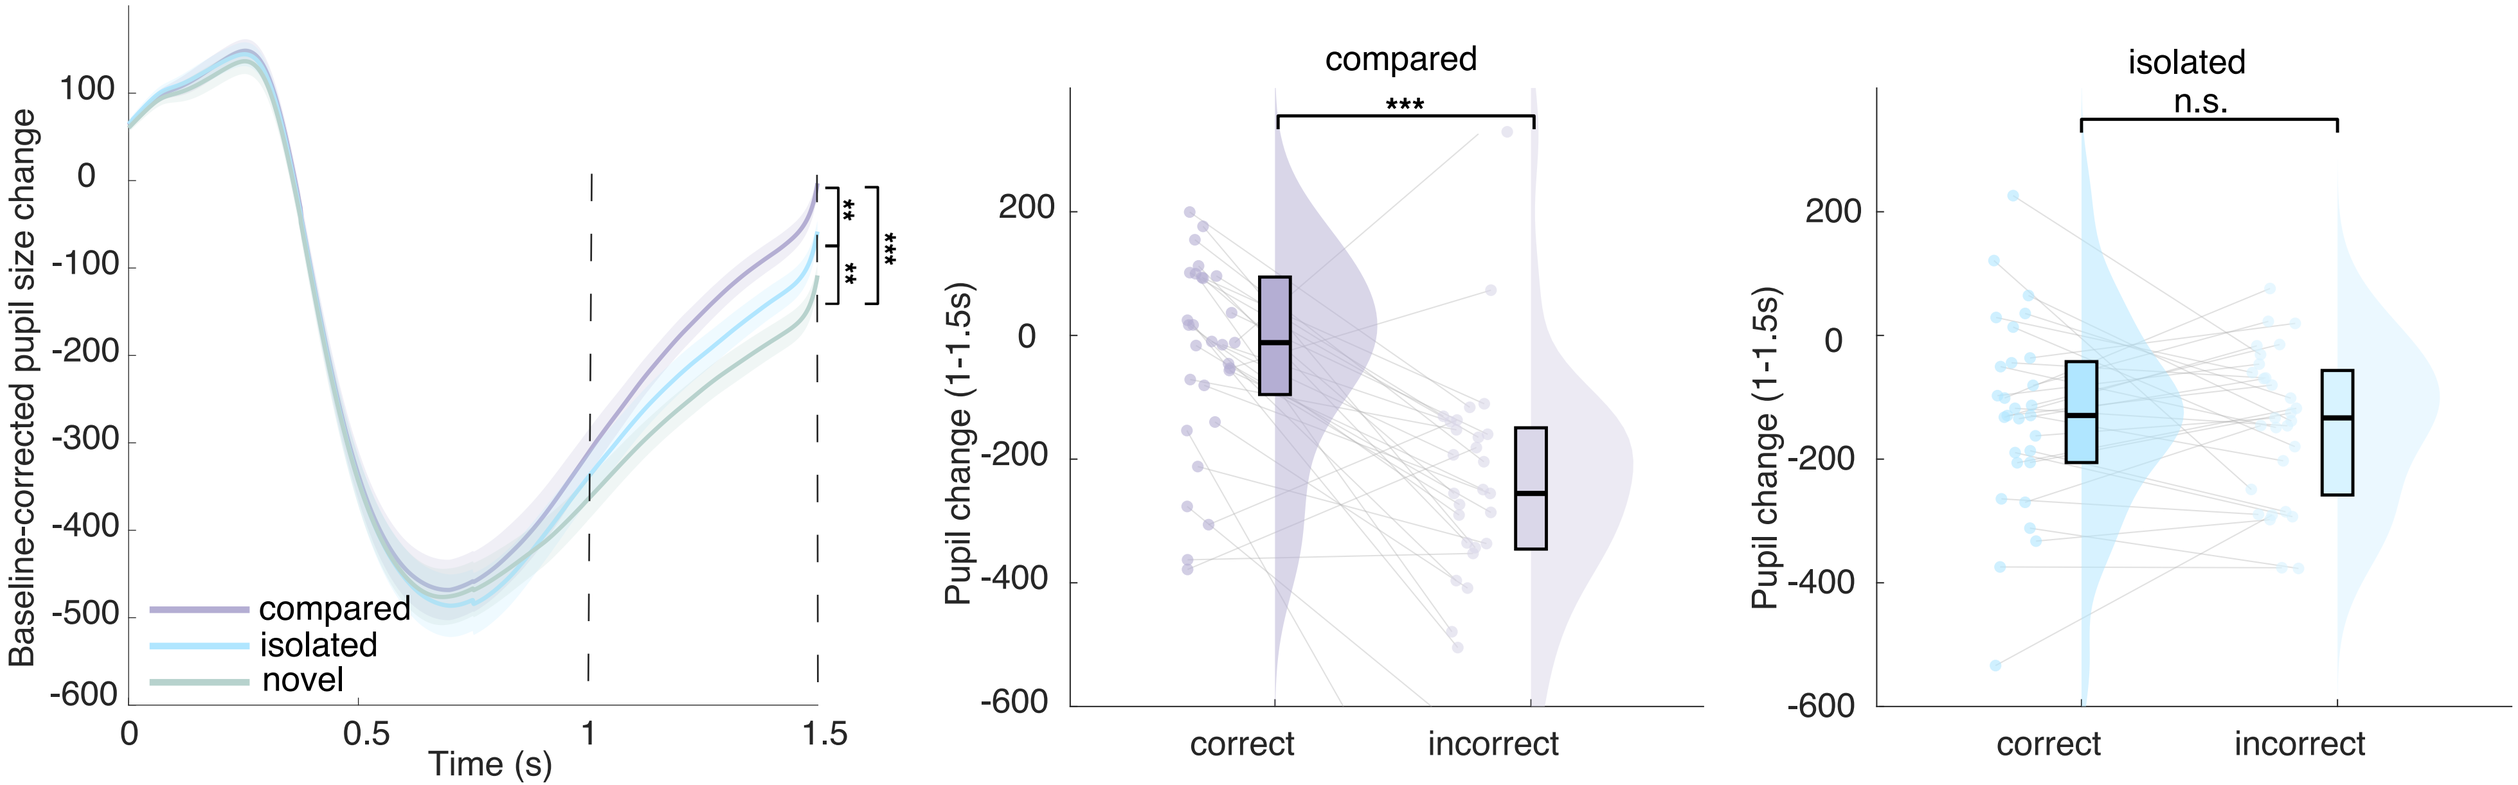
Baseline-corrected pupil size change
100
0
-100
-200
-300
-400
-500
-600
0
0.5
1
1.5
Time (s)
compared
isolated
novel
**
**
***
compared
***
Pupil change (1-1.5s)
200
0
-200
-400
-600
correct
incorrect
isolated
n.s.
Pupil change (1-1.5s)
200
0
-200
-400
-600
correct
incorrect