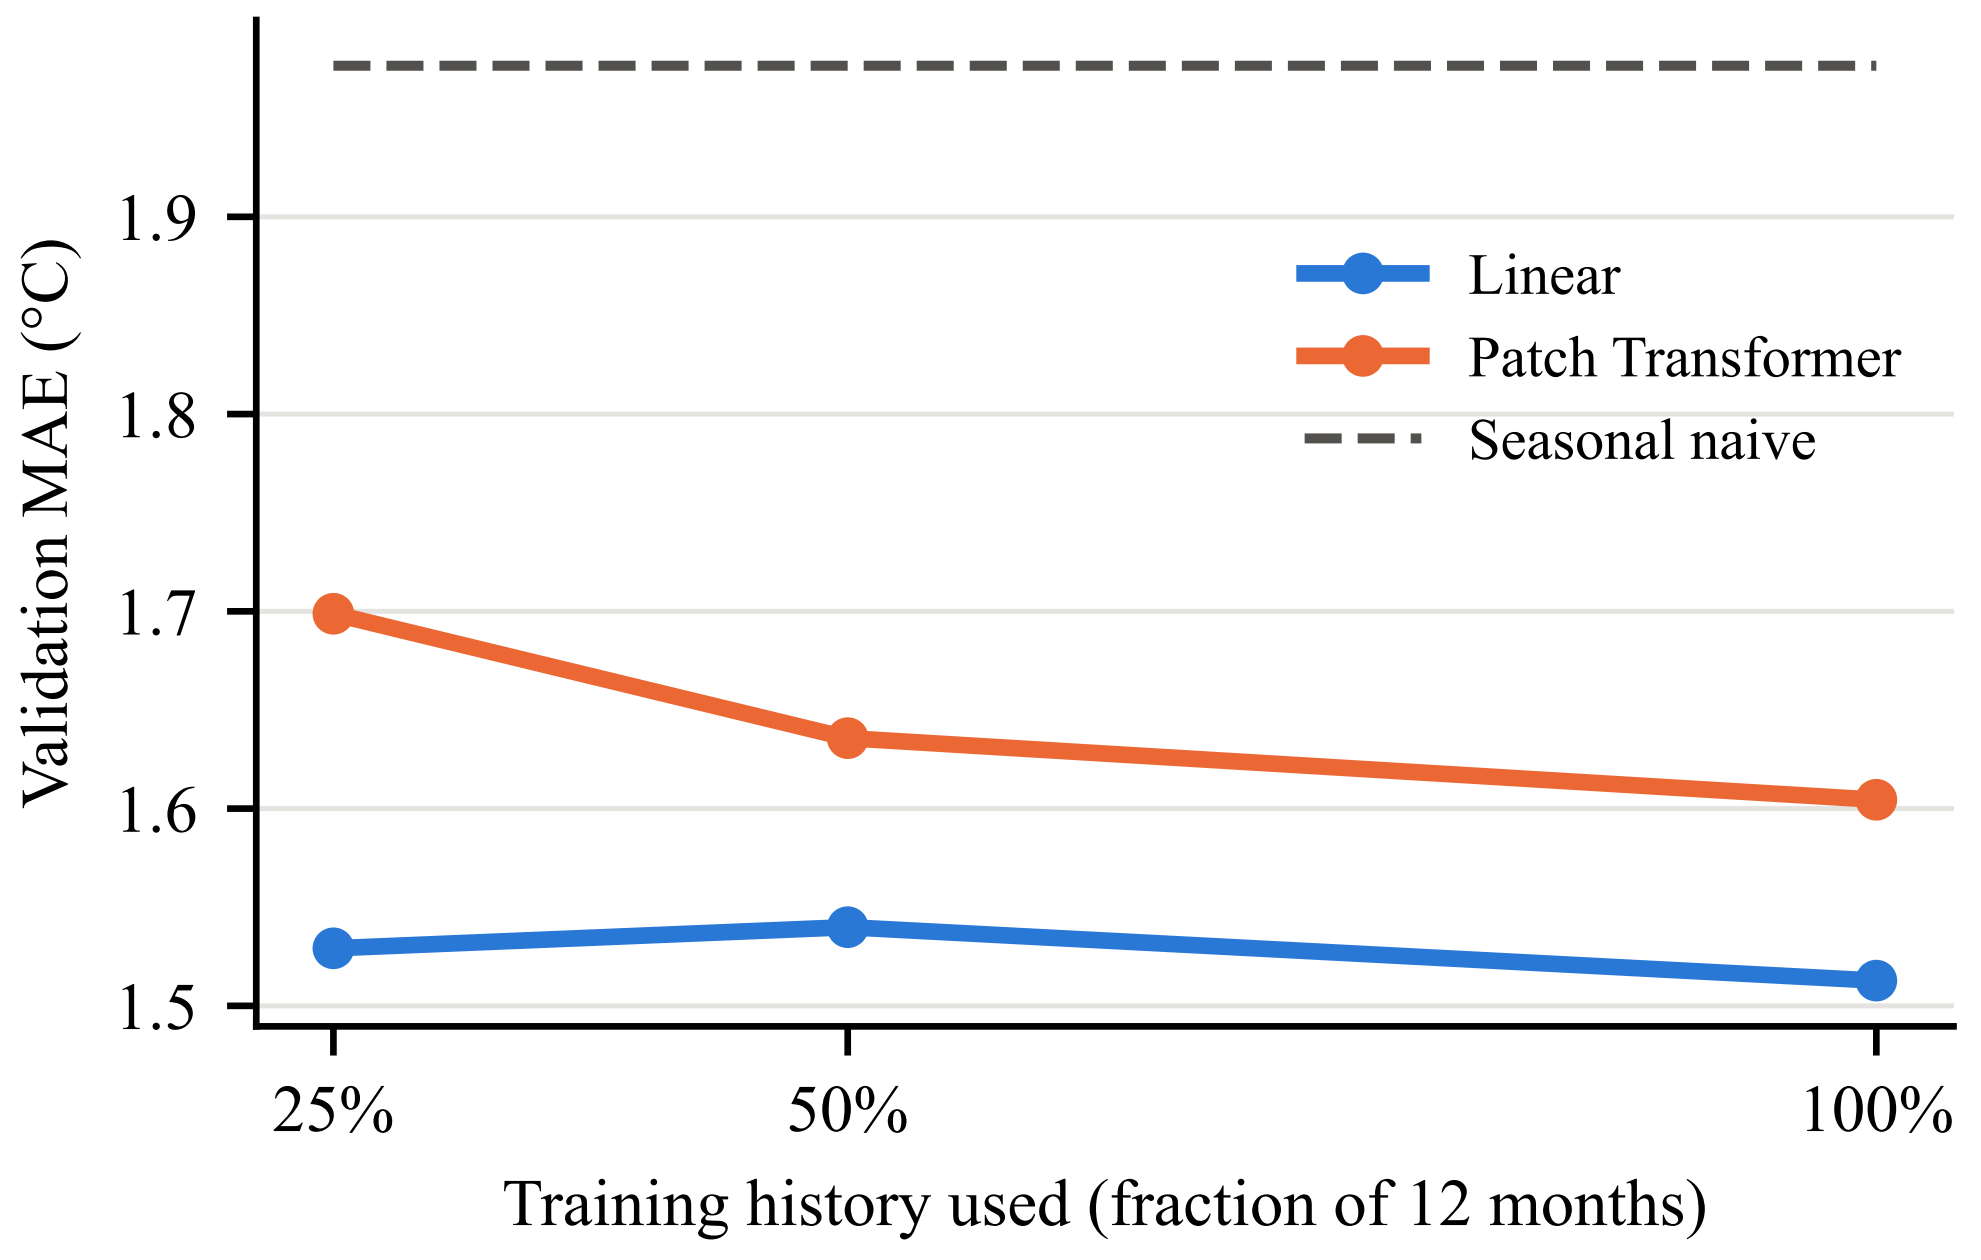
Validation MAE (°C)
1.9
1.8
1.7
1.6
1.5
Linear
Patch Transformer
Seasonal naive
25%
50%
100%
Training history used (fraction of 12 months)