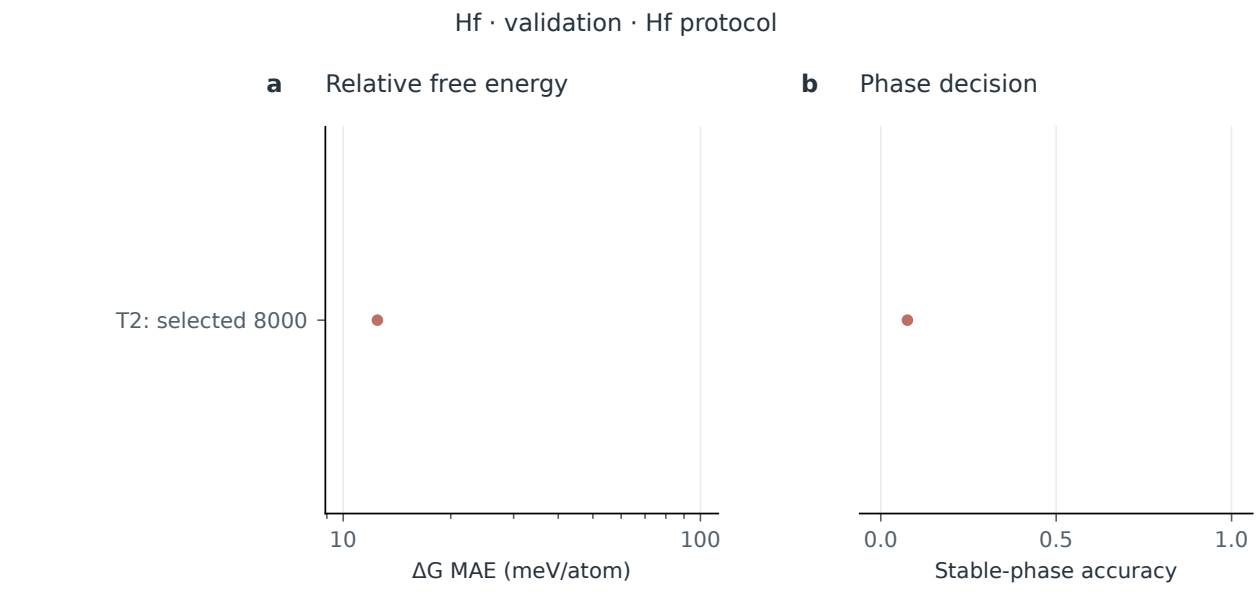
Hf · validation · Hf protocol
a
Relative free energy
T2: selected 8000
10
100
ΔG MAE (meV/atom)
b
Phase decision
0.0
0.5
1.0
Stable-phase accuracy