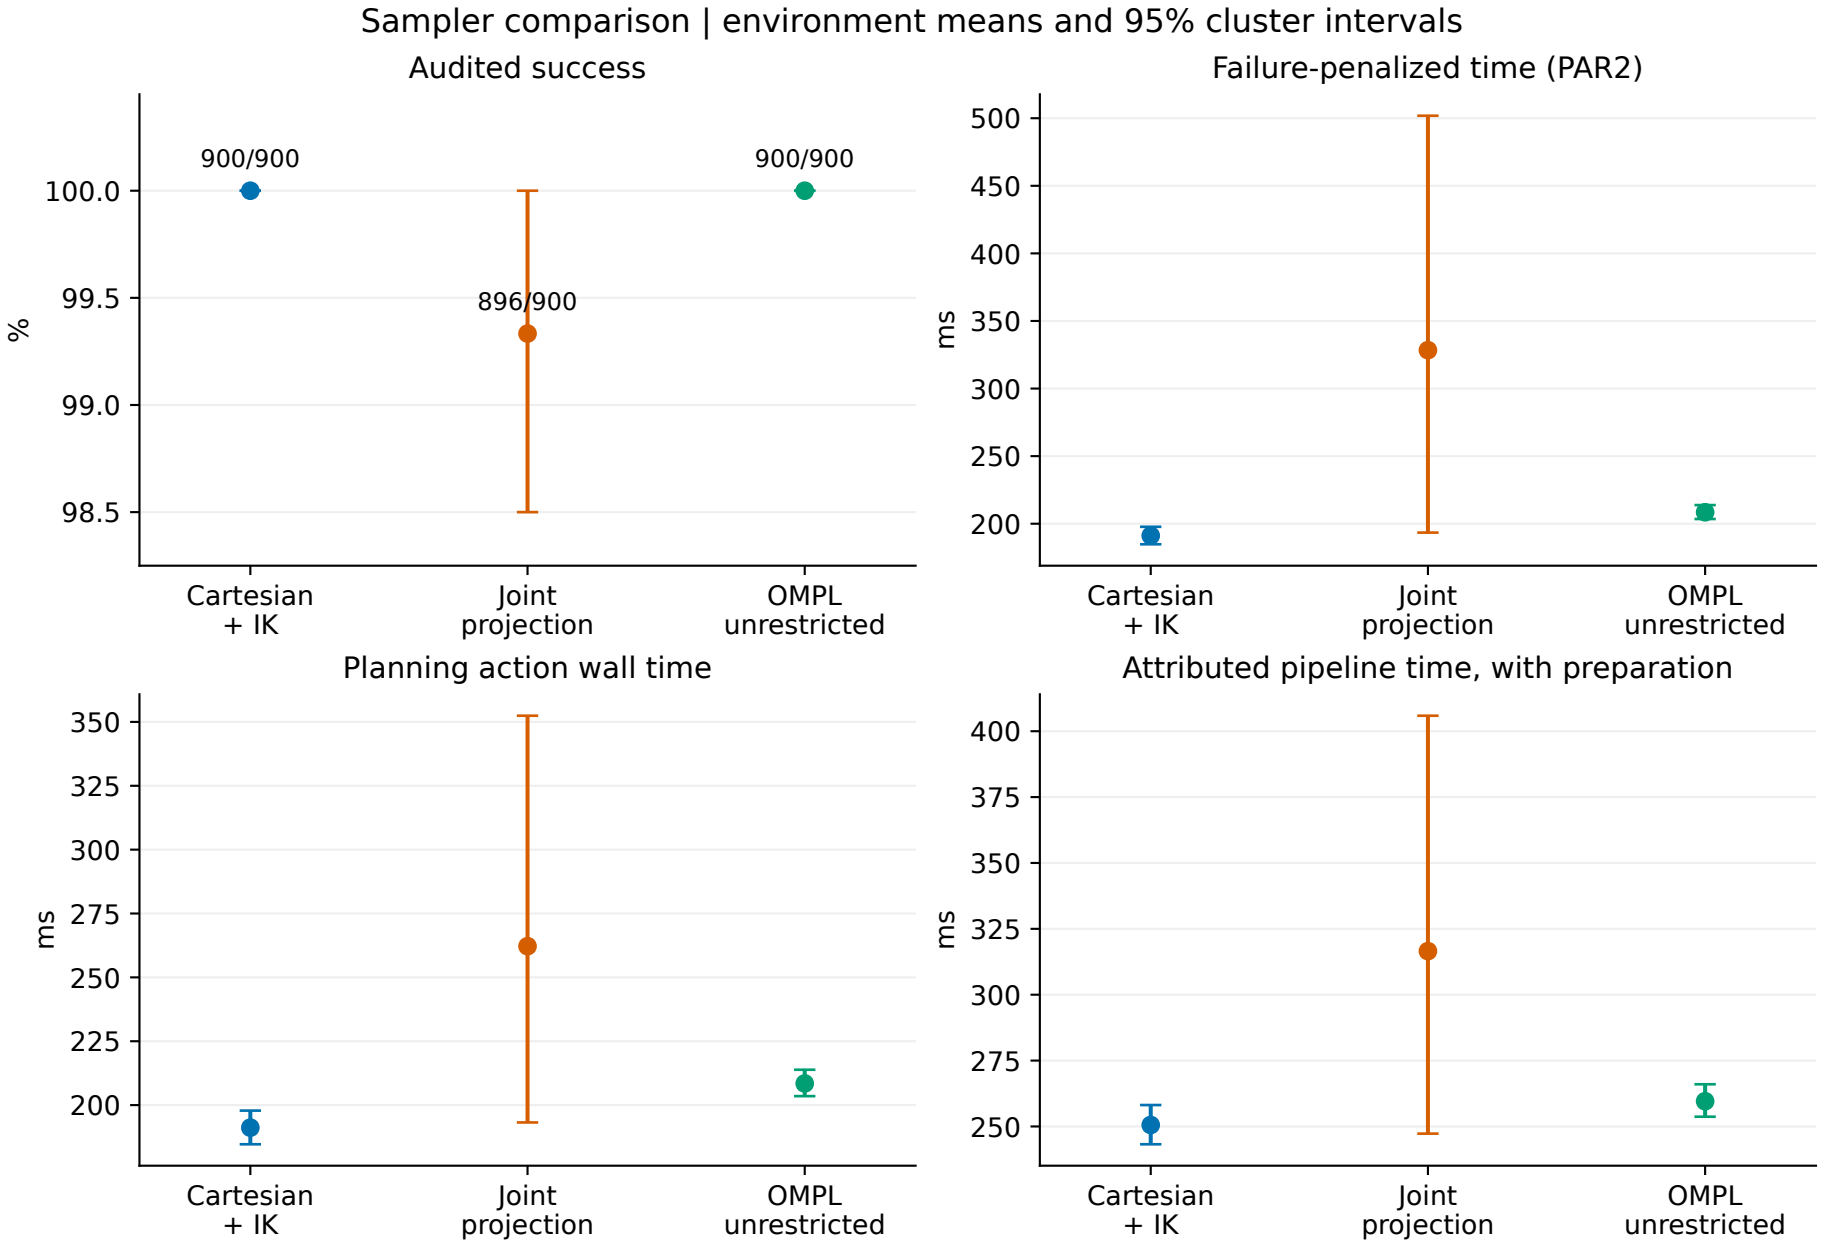
Sampler comparison | environment means and 95% cluster intervals
Audited success
%
100.0
99.5
99.0
98.5
900/900
896/900
900/900
Cartesian + IK
Joint projection
OMPL unrestricted
Failure-penalized time (PAR2)
ms
500
450
400
350
300
250
200
Cartesian + IK
Joint projection
OMPL unrestricted
Planning action wall time
ms
350
325
300
275
250
225
200
Cartesian + IK
Joint projection
OMPL unrestricted
Attributed pipeline time, with preparation
ms
400
375
350
325
300
275
250
Cartesian + IK
Joint projection
OMPL unrestricted