


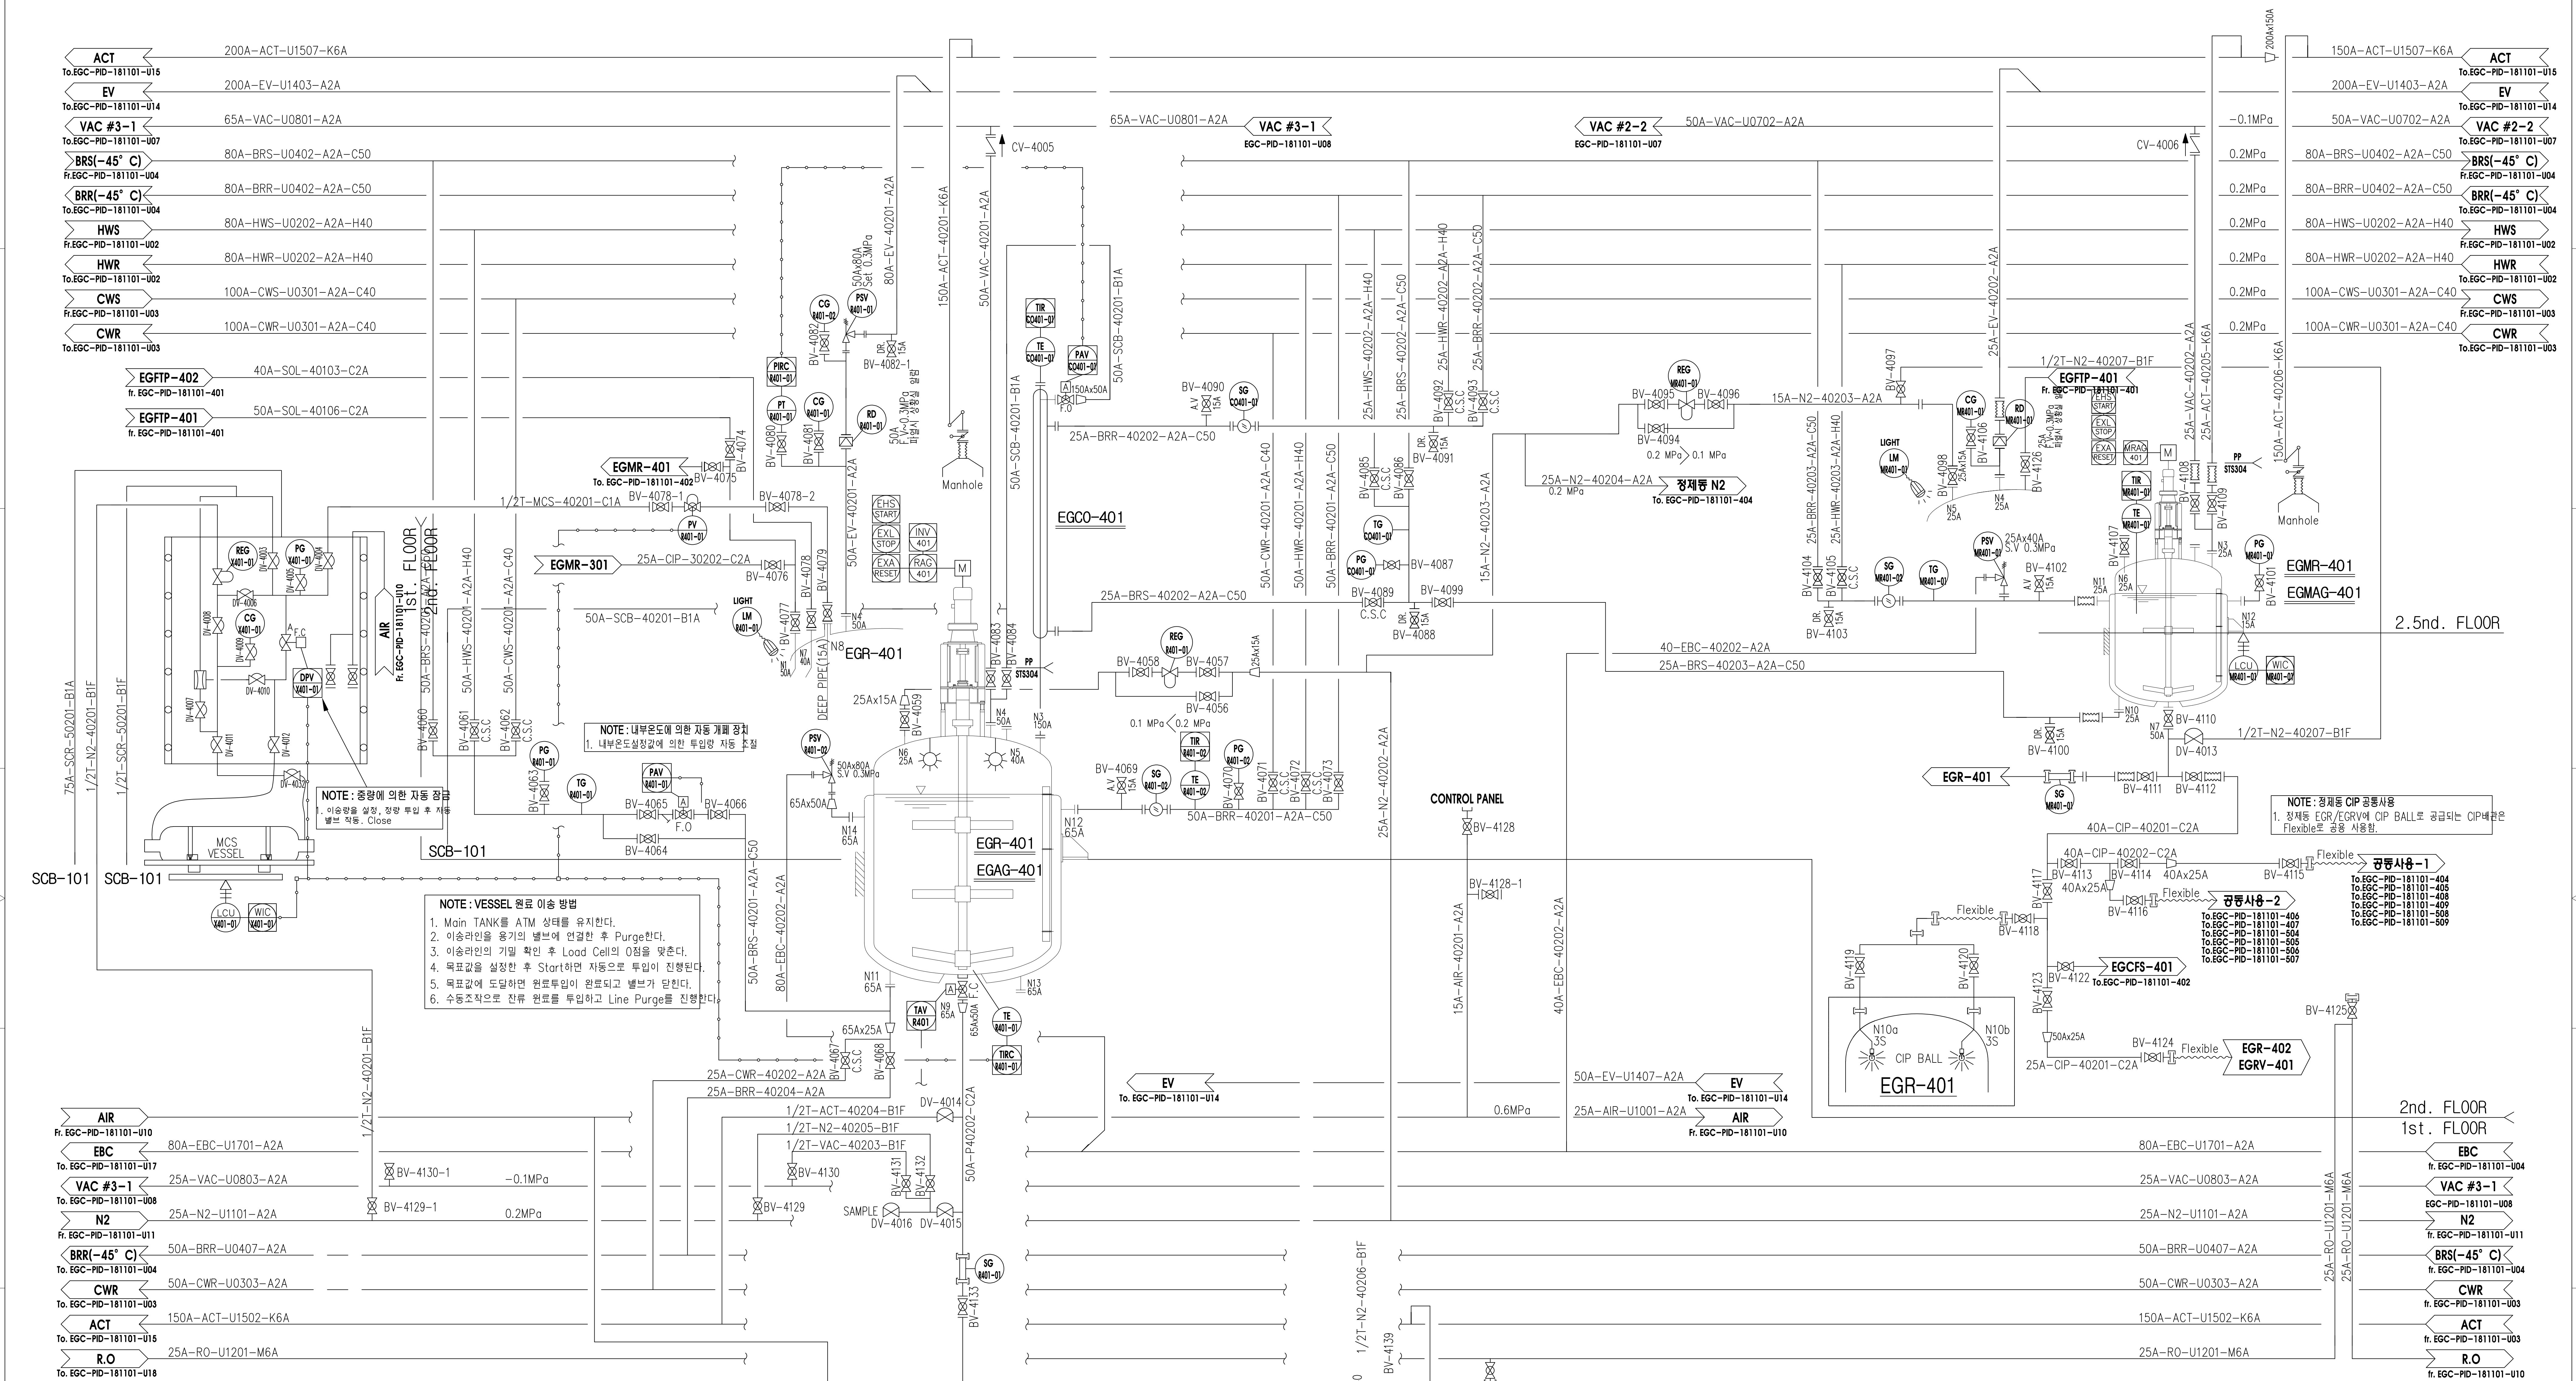

<u>EFCFTP-401</u>	<u>EGCO-401</u>	<u>SCB-101</u>	<u>RT-101</u>	<u>NF-401, 402</u>
MAGNETIC TRASFER PUMP	COLUMN	SCRUBBER	Recirculation Tank	Nutsche Filter
CAPA. : 0.12 ^m /min x 20mH	SIZE : 150A x 200A	CAPA : STS316L / MP + EP	CAPA : 450L	CAPA : 1200 Liter
MAT'L : STS316L	MAT'L(S) : STS316L / MP + EP	TYPE : HEAT&WET	SIZE : 985(W)x800(D)x1342(H)	MAT'L : STS316L
POWER : 1.5kw x 2P x 380V	MAT'L(J) : STS304	SIZE : 1,100 x 1,350 x 2,000	System material : PVC	POWER : N/A
EXP. GRADE : Exd IIB T4	D.P(S/U) : F.V-0.3Mpa / 0.3Mpa	Heating temperature : 700~750℃	INLET / OUTLET: 16A PVC	D.P(S/J) : FV-0.18 MPA.
	D.T(S/U) : -40~150℃ / -40~150℃			D.T(S/J) : -30~150 ° C
<u>EGR-401</u>	<u>EGAG-401</u>	<u>EGMR-401</u>	<u>EGMAG-401</u>	
REACTOR	AGITATOR	REACTOR	AGITATOR	
CAPA. : 3.0 ^m	MAT'L : STS316L / EP	CAPA. : 0.3 ^m	MAT'L : STS316L / EP	
SIZE : Ø1500 x 1800H	RPM : 12 ~ 90 (1/20)	SIZE : Ø700 x 800H	RPM : 20 ~ 117 (1/15)	
MAT'L : STS316L / EP	POWER : 7.5kw x 380V x 4pole	MAT'L : STS316L / EP	POWER : 2.2kw x 380V x 4pole	
D.P(S/U) : F.V-0.3Mpa / 0.3Mpa	EXP. GRADE : Exd IIB T4	D.P(S/U) : F.V-0.2Mpa / 0.25Mpa	EXP. GRADE : Exd IIB T4	
D.T(S/U) : -70~150℃ / -70~150℃		D.T(S/U) : -20~80℃ / -20~80℃		

추후 리비전 기록	리비전기	비대칭 참조	2019.09.04	J.H LEE	J.H LEE	J.H LEE
배관 변경	2019.06.03	S.G LEE	J.J JIEONG	Y.J KIM		
배관 변경	2019.05.13	S.G LEE	J.J JIEONG	Y.J KIM		
REVISION	2019.04.22	S.G LEE	J.J JIEONG	Y.J KIM		
REVISION	2019.04.15	S.G LEE	J.J JIEONG	Y.J KIM		
for APPROVAL	2019.01.24	S.G LEE	J.J JIEONG	Y.J KIM		
REV.	REVISIONS	DATE	DRAWN	CHK'D	APP'D	
PROJECT NAME 공주공장 합성, 정제 증축공사						
CLIENT Chem (주)이지캠						
PREPARED BY CT CT ENG Co.,Ltd.						
PROJECTION N.S		TITLE P & ID (2/9-EGR401) DIPAS REACTION SYSTEM				
SCALE	DATE 2018.11.14	DWG. NO EGC-PID-181101-402			REV.	