
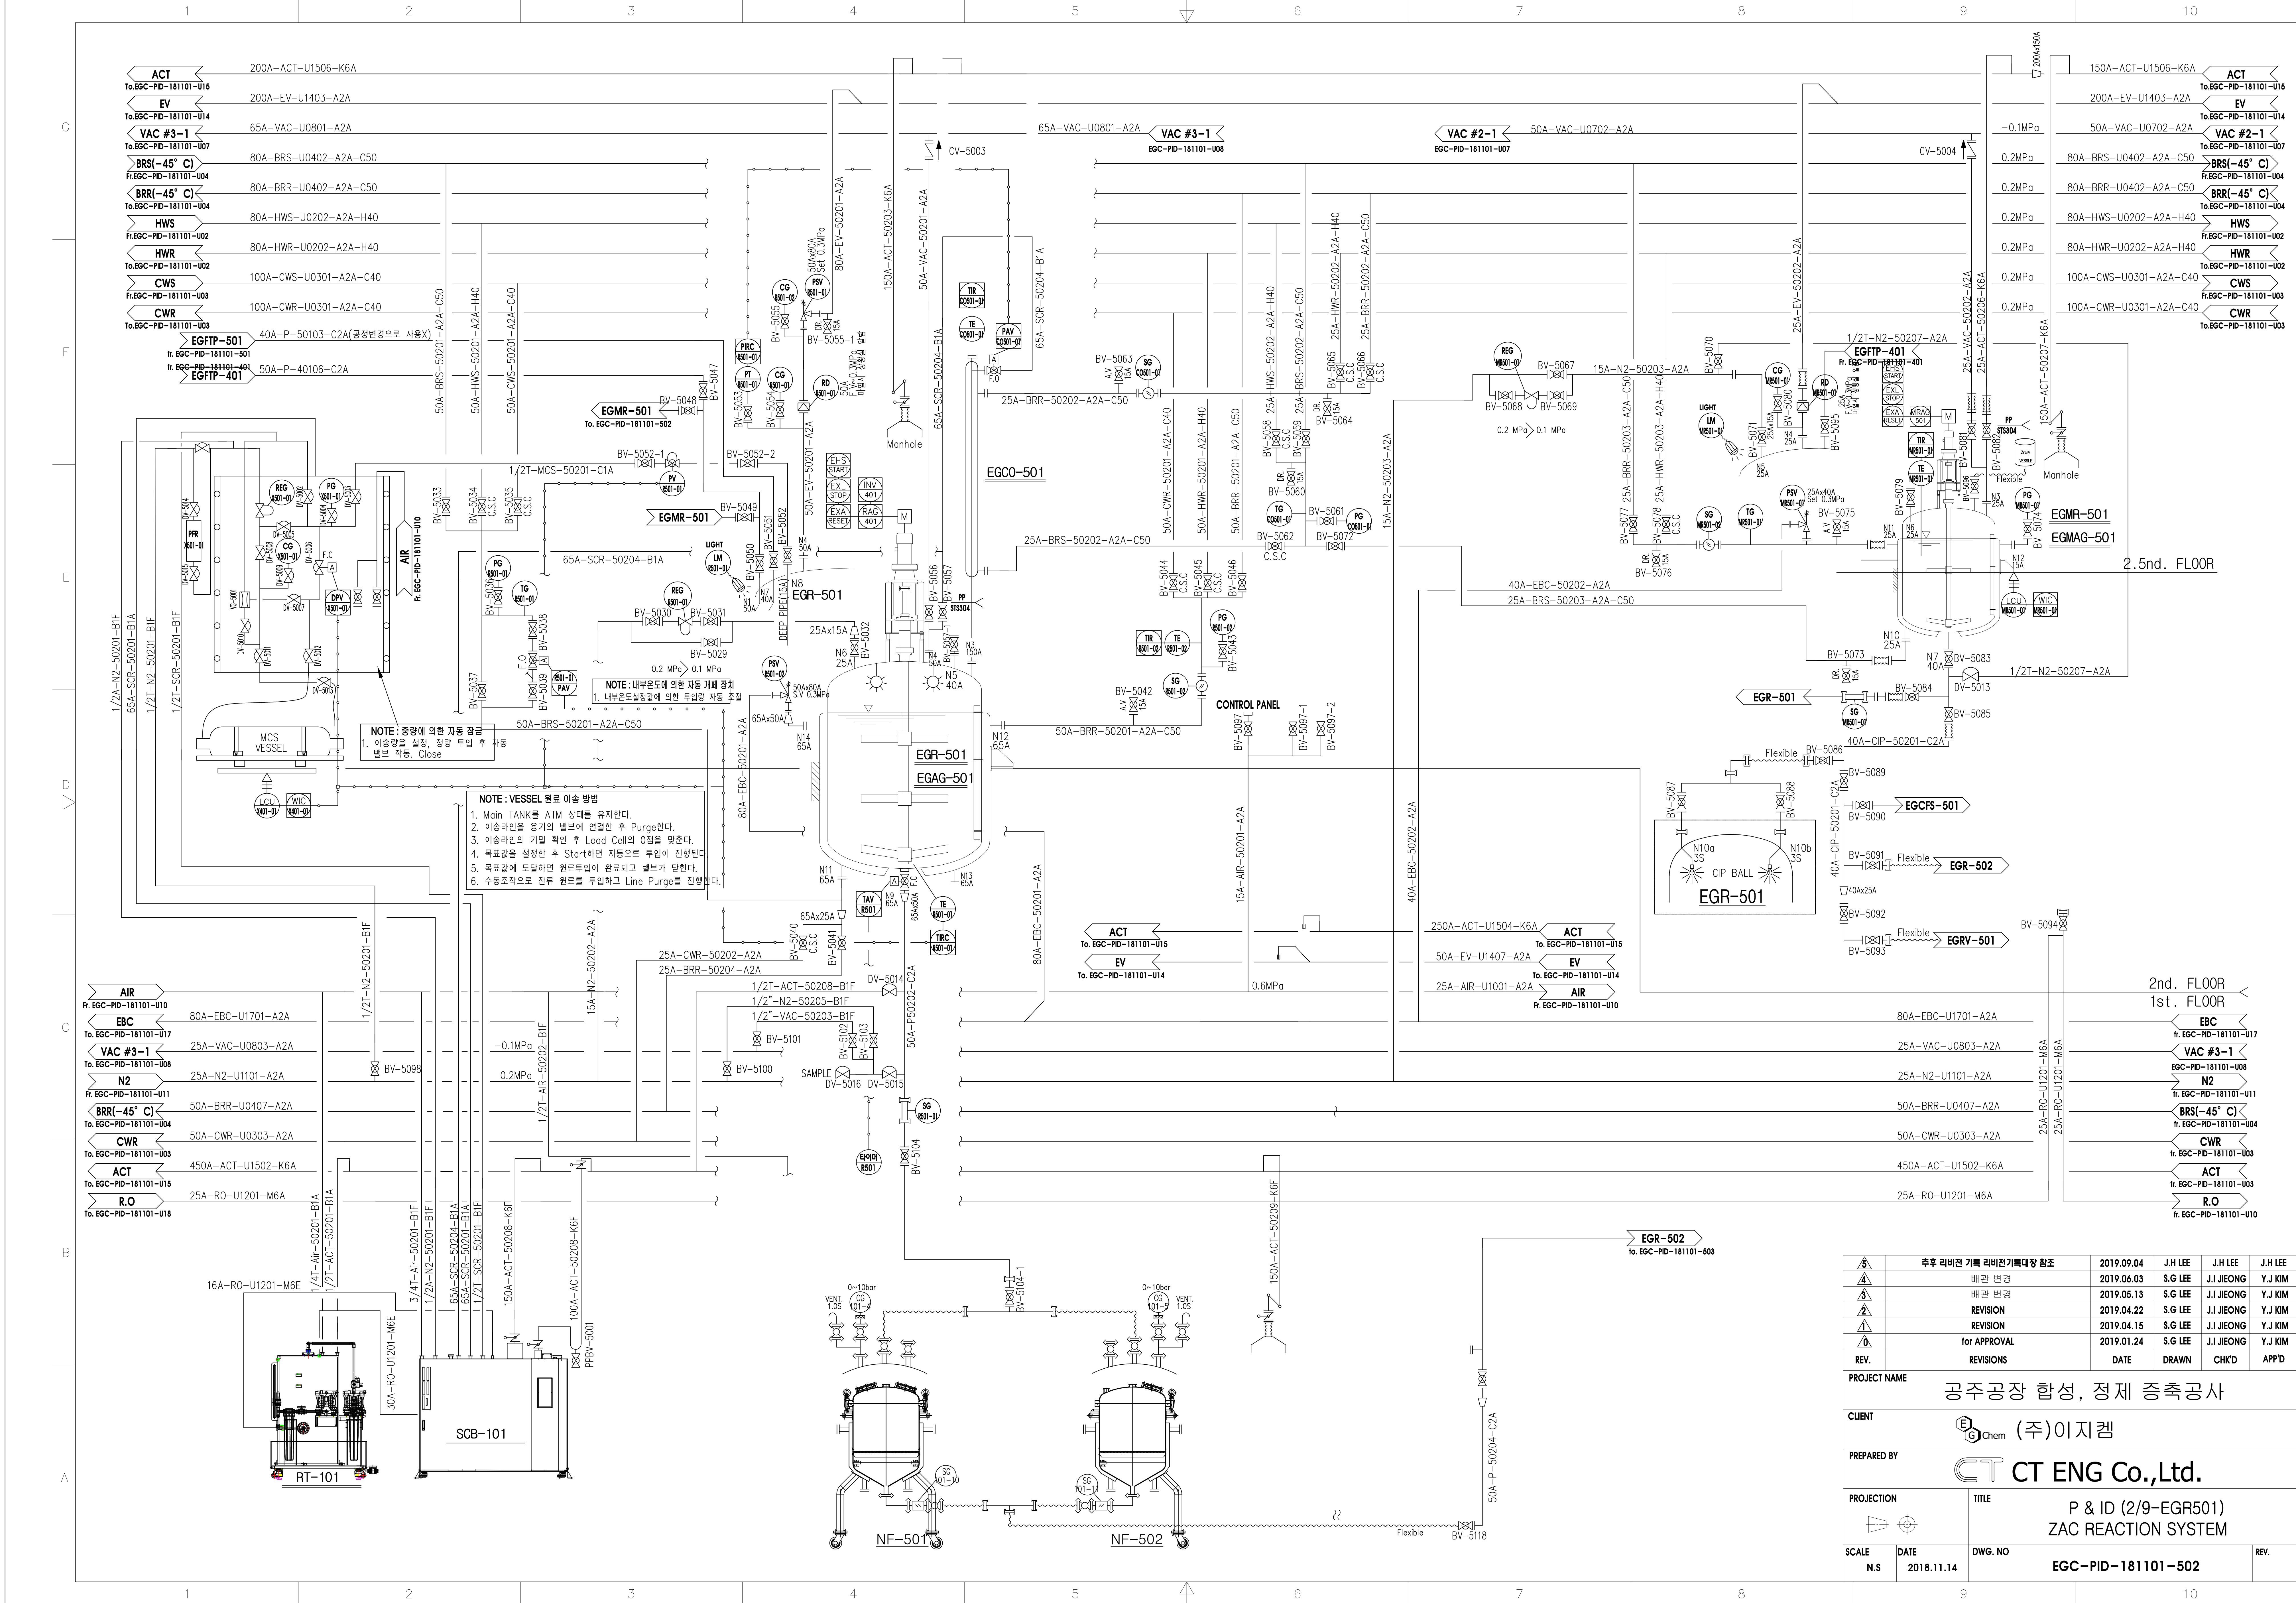




5	후후 리버전 기체 리버전기체대장 참조	2019.09.04	J.H LEE	J.H LEE	J.H LEE
4	배관 변경	2019.06.03	S.G LEE	J.I JEONG	Y.J KIM
3	배관 변경	2019.05.13	S.G LEE	J.I JEONG	Y.J KIM
2	REVISION	2019.04.22	S.G LEE	J.I JEONG	Y.J KIM
1	REVISION	2019.04.15	S.G LEE	J.I JEONG	Y.J KIM
0	for APPROVAL	2019.01.24	S.G LEE	J.I JEONG	Y.J KIM
REV.	REVISIONS	DATE	DRAWN	CHK'D	APP'D

PROJECT NAME	공주공장 합성, 정제 증축공사		
CLIENT	 (주)이치켄		
PREPARED BY	CT CT ENG Co.,Ltd.		
PROJECTION	TITLE		
	P & ID (2/9-EGR501) ZAC REACTION SYSTEM		
SCALE N.S	DATE 2018.11.14	DWG. NO EGC-PID-181101-502	REV.

EFCFTP-501	EGCO-501	SCB-101	RT-101	NF-501, 502	EGR-501	EGAG-501	EGMR-501	EGMAG-501
MAGNETIC TRASFER PUMP	COLUMN	SCRUBBER	Recirculation Tank	Nutsche Filter	REACTOR	AGITATOR	REACTOR	AGITATOR
CAPA : 0.12 ^m /min x 20mH	SIZE : 150A x 200A	CAPA : STS316L / MP + EP	CAPA : 450L	CAPA : 1200 Liter	CAPA : 3.0 ^m	MATL : STS316L / EP	CAPA : 0.3 ^m	MATL : STS316L / EP
MATL : STS316L	MATL(S) : STS316L / MP + EP	TYPE : HEAT&WET	SIZE : 985(W)x800(D)x1342(H)	MATL : STS316L	SIZE : Ø1500 x 1800H	RPM : 12 ~ 90 (1/20)	SIZE : Ø700 x 800H	RPM : 20 ~ 117 (1/15)
POWER : 1.5kw x 2P x 380V	MATL(U) : STS304	SIZE : 1,100 x1,350 x2,000	System material : PVC	POWER : N/A	MATL : STS316L / EP	POWER : 7.5kw x 380V x 4pole	MATL : STS316L / EP	POWER : 2.2kw x 380V x 4pole
EXP. GRADE : Exd IIB T4	D.P(S/U) : F.V-0.3Mpa / 0.3Mpa	Heating temperature : 700~750℃	INLET / OUTLET : 16A PVC	D.P(S/U) : FV-0.18 MPA.	D.P(S/U) : F.V-0.3Mpa / 0.3Mpa	EXP. GRADE : Exd IIB T4	D.P(S/U) : F.V-0.2Mpa / 0.25Mpa	EXP. GRADE : Exd IIB T4
	D.T(S/U) : 40~150℃ / 40~150℃			D.T(S/U) : -30~150 ° C	D.T(S/U) : -70~150℃ / -70~150℃		D.T(S/U) : -20~80℃ / -20~80℃	