

1 Introduction

For the determination of the plant and storage operation in the case studies, an economic parameter from the fundamental energy system model is used. The model is based on the Open Energy Modelling Framework (oemof). The parameter is derived from the shadow price as the change in the primal objective when relaxing the primal balancing constraint or as value of the dual variable associated to the primal balancing constraint:

With n producers producing a total amount of b^* , each producing amount x_i with specific cost c_i :

Primal:

$$\begin{aligned} \min \quad & c_1 x_1 + \dots + c_n x_n \\ \text{s.t.} \quad & \dots \\ & x_1 + \dots + x_n \geq b^* \quad (\text{primal balancing constraint}) \\ & x_1, \dots, x_n \geq 0 \end{aligned}$$

Dual:

$$\begin{aligned} \max \quad & b_1 y_1 + \dots + b^* \overbrace{y^*}^{(\text{shadow price})} + \dots + b_m y_m \\ \text{s.t.} \quad & \dots \\ & y_1, \dots, y_m \geq 0 \end{aligned}$$

See also Poster “Price theory and storage operation in electricity systems”, Angus 2 Project Meeting, 12 June 2019 in Leipzig.

2 Case Study CAES



2.1 First Iteration

For the development of the interface from the fundamental energy system model to the detailed CAES model of WG Tuschy, an iterative process for the model formulation was used. In the first step, a linear formulation for a generic storage was used for the simulation of the operation of the CAES.

2.1.1 Parameter

Efficiency charge	$c^{eta,in}$
Efficiency discharge	$c^{eta,out}$
Efficiency due to self-discharge	$c^{eta,self}$
Lower bounds of variables	$c^{out,min}, c^{in,min}, c^{level,min}$
Upper bounds of variables	$c^{out,max}, c^{in,max}, c^{level,max}$

2.1.2 Variables

Storage Discharge	$c^{out,min} \leq x^{out}(t) \leq c^{out,max}$	$\forall t \in T$
Storage Charge	$c^{in,min} \leq x^{in}(t) \leq c^{in,max}$	$\forall t \in T$
Storage Level	$c^{level,min} \leq x^{level}(t) \leq c^{level,max}$	$\forall t \in T$

2.1.3 Constraints

Storage balance

$$x^{level}(t) = c^{eta,self} \cdot x^{level}(t-1) - \frac{1}{c^{eta,out}} \cdot x^{out}(t) + c^{eta,in} \cdot x^{in}(t) \quad \forall t \in T_{>0}$$

$$x^{level}(0) = 0.5 \cdot c^{level,max}$$

2.1.4 Objective function


The objective function is maximising the profit of operation:

$$\max \sum_t c^{price}(t) \cdot x^{out}(t) - c^{price}(t) \cdot x^{in}(t)$$

2.1.5 Results

The simulated operation of the CAES based on the model described above was then analysed and compared with a more detailed component model of WG Tuschy. Based on the significant deviations a more suitable model is being formulated by WG Tuschy.

3 Case Study HEAT

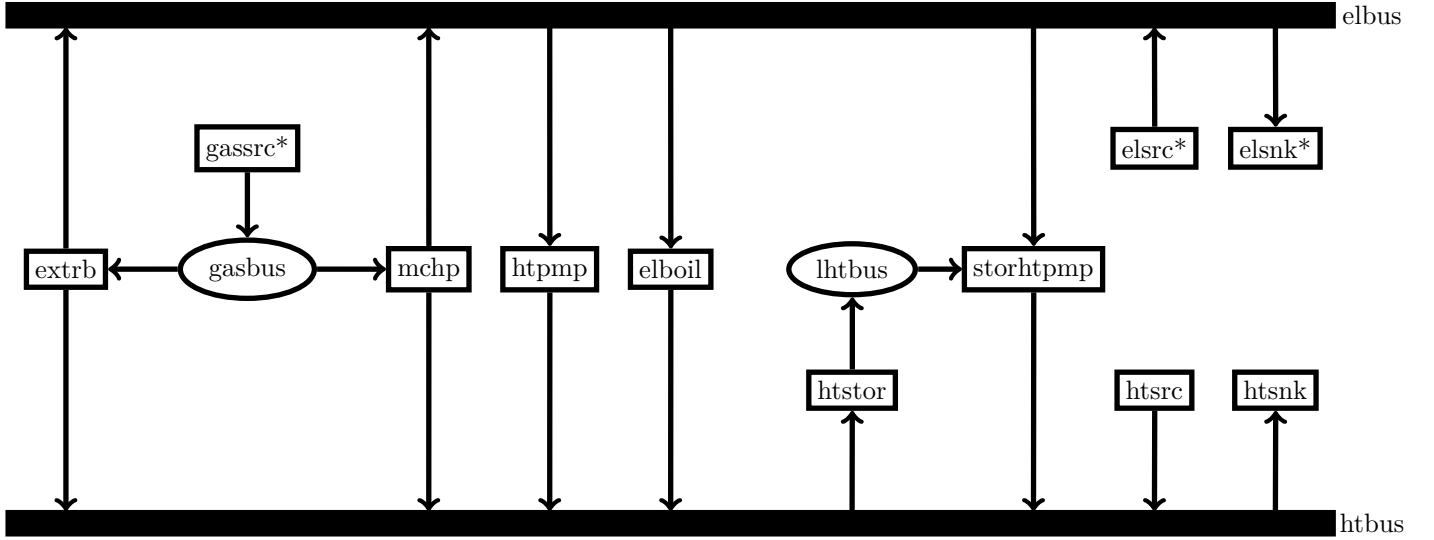

* marks slack variables with positive costs for gassrc and elsrc and negative costs for elsnk, no other costs

3.1 First iteration

$$\min \sum_t (c_{gas}^{cost} \cdot x_{gassrc,gasbus}(t) + c_{el}^{cost} \cdot (x_{elsrc,elbus}(t) - x_{elbus,elsnk}(t)))$$

subject to: $\forall t \in T$

$$\begin{aligned}
x_{\text{extrb},\text{elbus}}(t) &= c_{\text{extrb}}^{\text{eta,el,noex}} \cdot x_{\text{gasbus},\text{extrb}}(t) - \frac{c_{\text{extrb}}^{\text{eta,el,noex}} - c_{\text{extrb}}^{\text{eta,el,maxex}}}{c_{\text{extrb}}^{\text{eta,ht,maxex}}} \cdot x_{\text{extrb},\text{htbus}}(t) \\
x_{\text{extrb},\text{elbus}}(t) &\geq \frac{c_{\text{extrb}}^{\text{eta,el,maxex}}}{c_{\text{extrb}}^{\text{eta,ht,maxex}}} \cdot x_{\text{extrb},\text{htbus}}(t) \\
x_{\text{mchp},\text{elbus}}(t) &= (c_{\text{mchp}}^{\text{eta,el}} + c_{\text{mchp}}^{\text{eta,ht}}) \cdot x_{\text{gasbus},\text{mchp}}(t) - x_{\text{mchp},\text{htbus}}(t) \\
x_{\text{mchp},\text{elbus}}(t) &= \frac{c_{\text{mchp}}^{\text{eta,el}}}{c_{\text{mchp}}^{\text{eta,ht}}} \cdot x_{\text{mchp},\text{htbus}}(t) \\
x_{\text{htpmp},\text{htbus}}(t) &= c_{\text{htpmp}}^{\text{cop}} \cdot x_{\text{elbus},\text{htpmp}}(t) \\
x_{\text{elboil},\text{htbus}}(t) &= c_{\text{elboil}}^{\text{eta}} \cdot x_{\text{elbus},\text{elboil}}(t) \\
x_{\text{htstor}}^{\text{level}}(t) &= x_{\text{htstor}}^{\text{level}}(t-1) + x_{\text{htbus},\text{htstor}}(t) - x_{\text{htstor},\text{lhtbus}}(t) \\
x_{\text{storhtpmp},\text{htbus}}(t) &= c_{\text{storhtpmp}}^{\text{cop}} \cdot x_{\text{elbus},\text{storhtpmp}}(t) \\
x_{\text{storhtpmp},\text{htbus}}(t) &= x_{\text{lhtbus},\text{storhtpmp}}(t) + x_{\text{elbus},\text{storhtpmp}}(t) \\
x_{\text{htsrc},\text{htbus}}(t) &\leq c_{\text{htsrc}}^{\text{capacity}} \\
x_{\text{htbus},\text{htsnk}}(t) &= c_{\text{htsnk}}^{\text{capacity}}(t) \\
\sum_{\text{input}} x_{\text{input}(b),b}(t) &= \sum_{\text{output}} x_{b,\text{output}(b)}(t) \quad \forall b \in B
\end{aligned}$$

3.1.1 Parameters

$c^{\text{marginal_cost}}$ for all flows

3.1.2 Variables

x^{flow}

3.1.3 Constraints

Buses

For the case study four buses are modeled:

1. *Electricity Bus* which represents the electricity grid
2. *Heat Bus* which represents the district heating system (grid)
3. *Heat Bus Low* which is used to model the low temperature heat that comes from the storage
4. *Gas Bus* for the commodity used by fossil fuel based components

With the set of all Buses B all inputs $x_{i(b),b}^{\text{flow}}$ to a bus b must equal all its outputs $x_{b,o(b)}^{\text{flow}}$

$$\sum_i x_{i(b),b}^{\text{flow}}(t) - \sum_o x_{b,o(b)}^{\text{flow}}(t) = 0 \quad \forall t \in T, \forall b \in B$$

Heat Load at Heat Bus

The heat load x_l at timestep t equals the exogenously defined profile value c_l^{profile} multiplied by the annual amount of this load c_l^{amount}

$$x_l^{\text{flow}}(t) = c_l^{\text{profile}}(t) \cdot c_l^{\text{amount}} \quad \forall t \in T$$

Electricity bus

The export (selling) of electricity to the grid (electricity bus) is not constrained.

$$x_e^{flow}(t) \leq \inf \quad \forall t \in T, \forall e \in E$$

The assigned marginal costs are added with a negative sign, as all produced electricity represents revenues for the heating system.

3.1.4 Objective Function

$$\min \quad \sum_g \sum_t c_g^{marginal_cost} \cdot x_g^{flow}(t)$$

Note: In this model the selling of electricity to the market is represented through negative marginal cost of the excess component.