


Figure S3 AMPK panel

Female dMIC60-CS versus dMIC60-WT; n = 3 biological libraries per genotype

● Up in CS ● Down in CS ● Below DE cutoffs ○ Adjusted P unavailable

−log₁₀(*P*_{adj}) ● 10 ● 30 ● 50 — Fold change unavailable

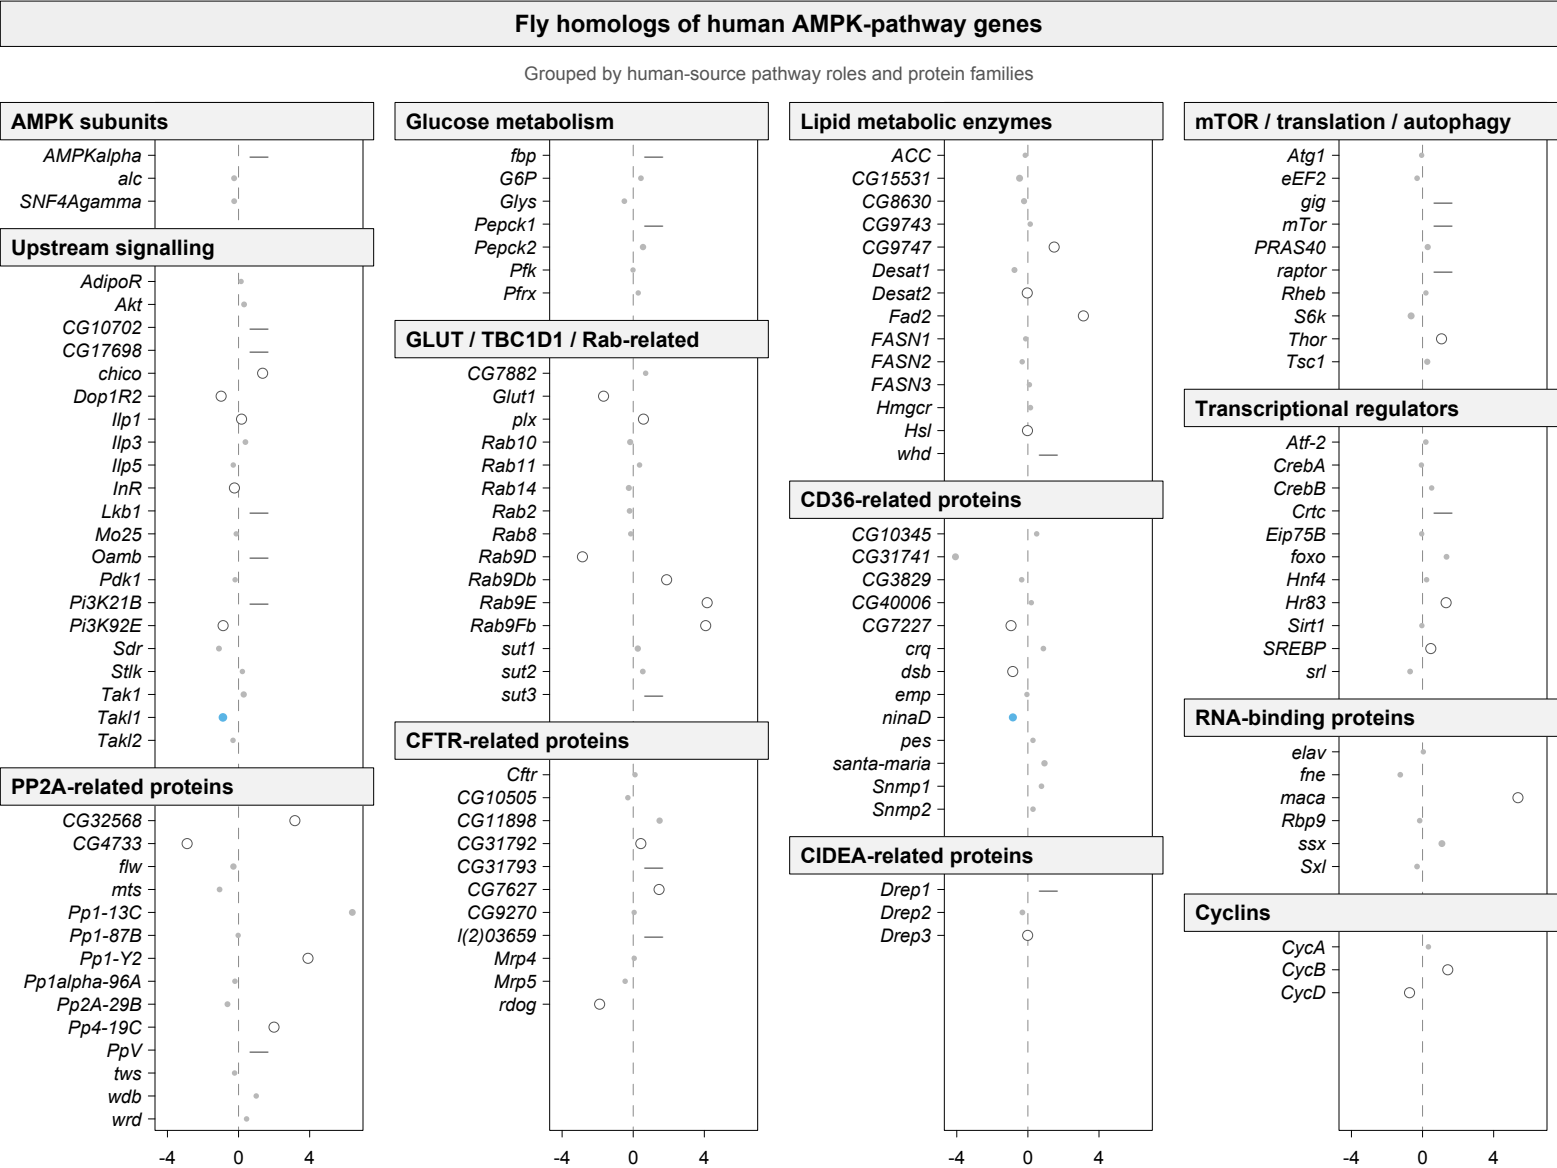

log₂ fold change (dMIC60-CS/dMIC60-WT)

DE cutoffs: BH-adjusted *P* < 0.05 and |log₂ fold change| >= 0.58. Point-size scale capped at 50.