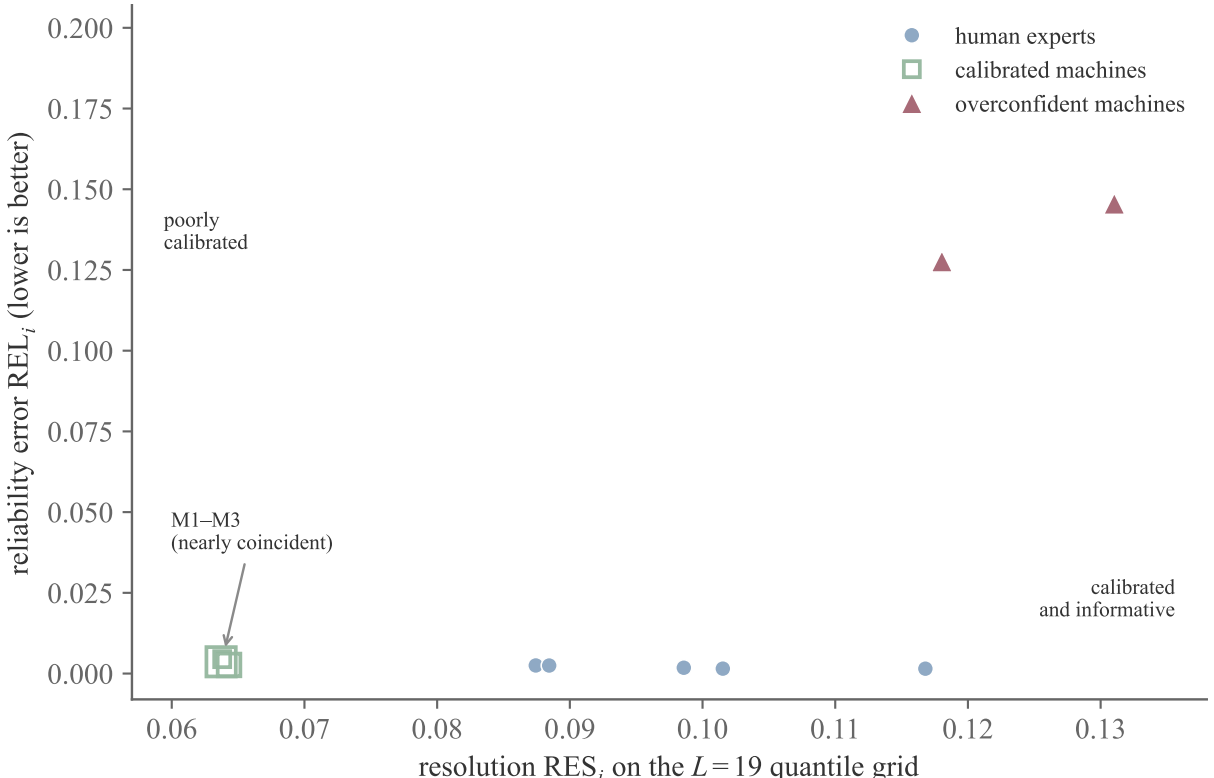
human experts
calibrated machines
overconfident machines
poorly
calibrated
M1–M3
(nearly coincident)
calibrated
and informative
reliability error REL$_i$ (lower is better)
resolution RES$_i$ on the $L = 19$ quantile grid
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
0.06
0.07
0.08
0.09
0.10
0.11
0.12
0.13