



PRELIMINARY

PRELIMINARY

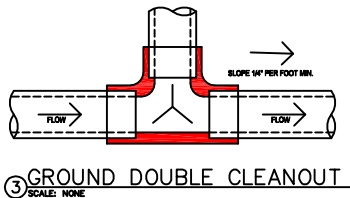


3 GROUND DOUBLE CLEANOUT
SCALE: NONE

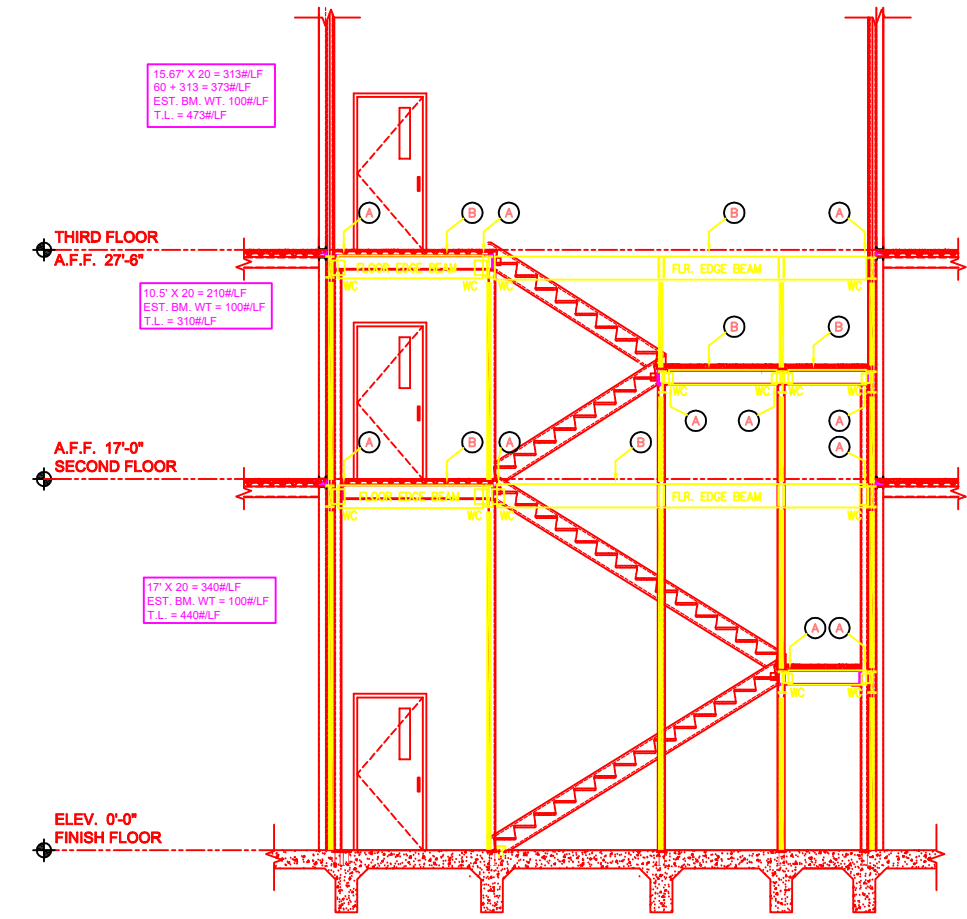


NOTE:
SEE STAIR FRAMING PLANS
FOR COMPLETE INFORMATION.

NOTE:
FABRICATOR TO VERIFY WEB PLATE LENGTHS
FOR PROPER INTERFACE. BEAM SPANS ARE
NOMINAL - VERIFY EXACT BEAM SPANS.


LEGEND
WC

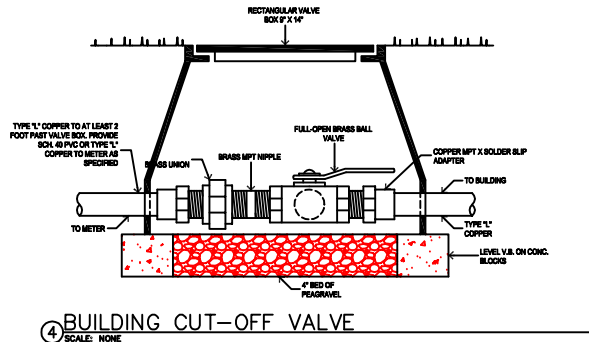

4 BUILDING CUT-OFF VALVE
SCALE: NONE

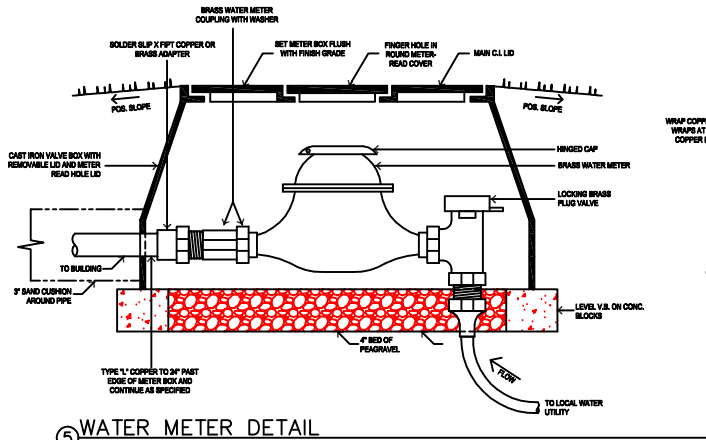


5 WATER METER DETAIL
SCALE: NONE

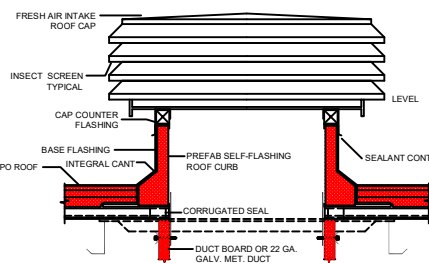


3 FRESH AIR INTAKE VENT DETAIL - NEW TPO ROOF
SCALE: NTS


NOTE:
WELD ANGLES TO ANGLES W/ 3/16" FILLET CONT. ALL
AROUND. RUN 4 X 3 X 3/16" ANGLES OVER ROOF ZEES AND
SCREW DOWNS W/ #14 TIEKS AT EACH BEARING POINT.

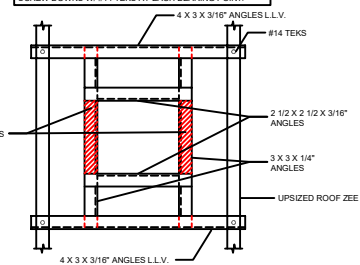

4 AHU SUPPLY PLENUM DETAIL
SCALE: NONE

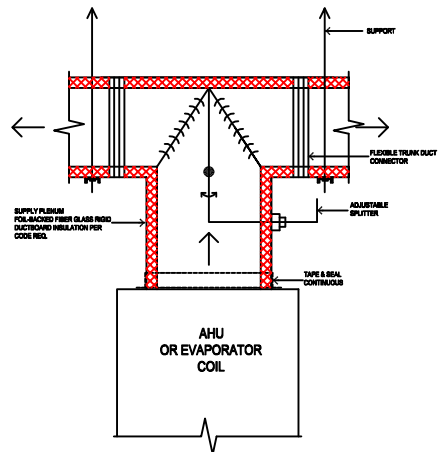


4 AHU SUPPLY PLENUM DETAIL
SCALE: NONE

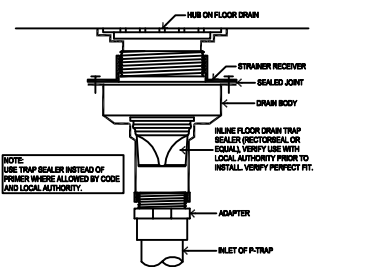


6 INLINE FLOOR DRAIN TRAP SEALER DETAIL
SCALE: NONE

ELECTRICAL RISER KEY NOTES ALL BUILDINGS	
120/208 SERVICE 4-3 1/2" C. W/4-#500 CU. KOAL. THIN & 1-#1 GND.	
GROUND PER DETAIL	
W.P. BUS TROUGH	
200A 120/208 3P4W PLUG-IN METER	
200A 240V 3P4W NEMA 3R FS W /200 AF	
400A 120/208 3P4W METER PER UTILITY STD.	
400A 240V 3P4W NEMA 3R FS W /400 AF	
FEEEDER TO SPACE	
2 SETS 2" C. W/4-#3/0 CU. THIN & 1-#4 GND.	
2" C. W/4-#3/0 THIN	

LOAD ANALYSIS	
HVAC	4,000 KVA
LIGHTING 11,800 SF x 2	75 KVA
RESTAURANT EQUIP	120 KVA
APP. REC	18 KVA
EXT LTS & SIGNS	3 KVA
WATER HEATER	30 KVA
TOTAL DEMAND	250 KVA
@ 120/208 *	695 AMPS
* PROVIDE 1800 A SERVICE	

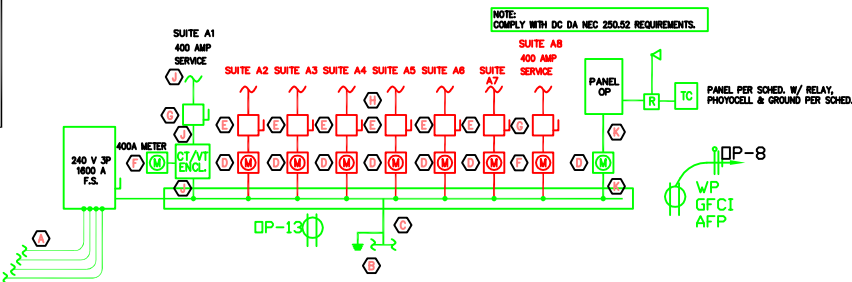

1 SERVICE RISER
SCALE: NONE

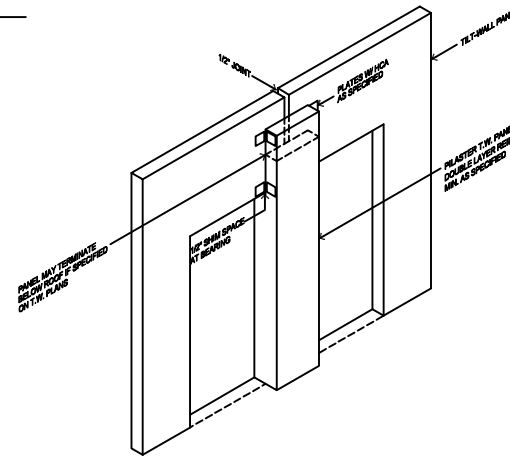

7 TILT-WALL PILASTER ISOMETRIC DETAIL
SCALE: NONE