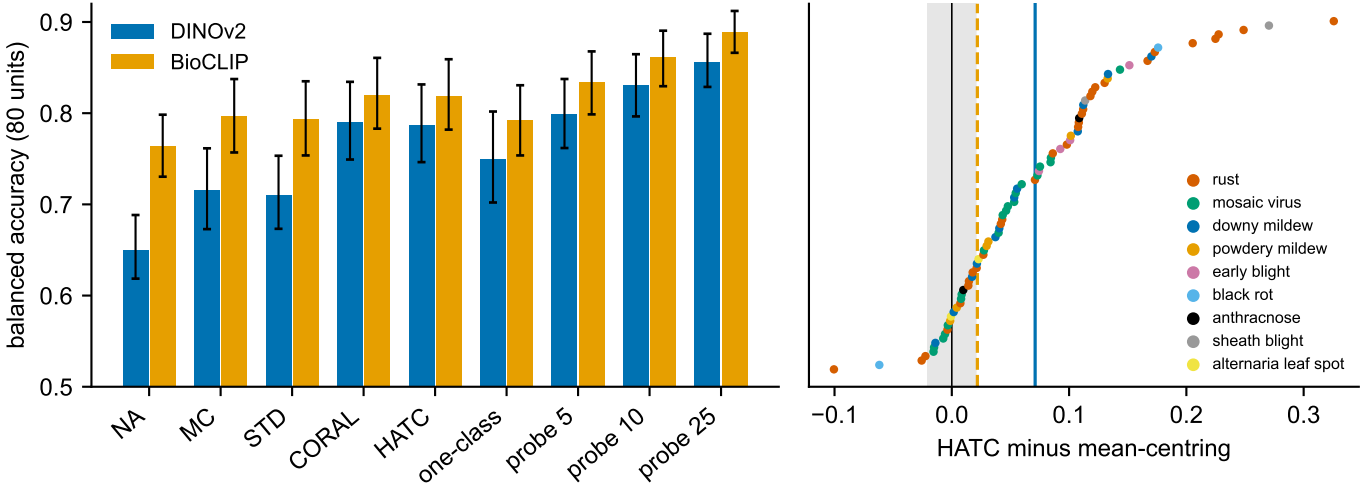
(a) mean over units
DINOv2
BioCLIP
balanced accuracy (80 units)
0.9
0.8
0.7
0.6
0.5
NA
MC
STD
CORAL
HATC
one-class
probe 5
probe 10
probe 25
(b) per unit (DINOv2)
rust
mosaic virus
downy mildew
powdery mildew
early blight
black rot
anthracnose
sheath blight
alternaria leaf spot
−0.1
0.0
0.1
0.2
0.3
HATC minus mean-centring