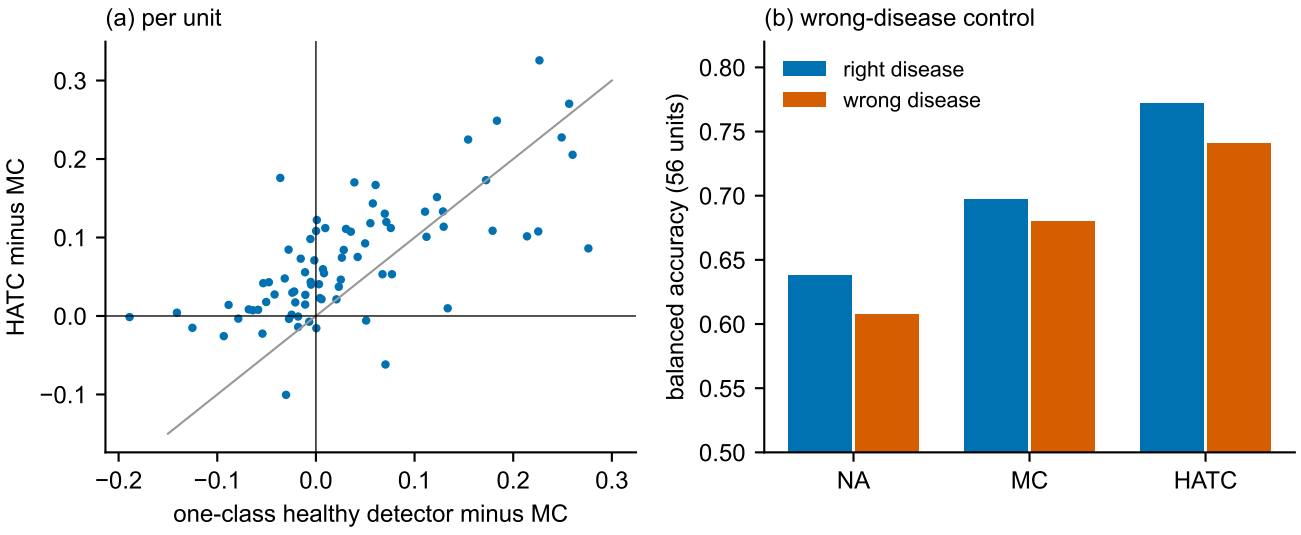
(a) per unit
HATC minus MC
one-class healthy detector minus MC
0.3
0.2
0.1
0.0
−0.1
−0.2
−0.1
0.0
0.1
0.2
0.3
(b) wrong-disease control
balanced accuracy (56 units)
right disease
wrong disease
0.80
0.75
0.70
0.65
0.60
0.55
0.50
NA
MC
HATC