



PSA Analysis

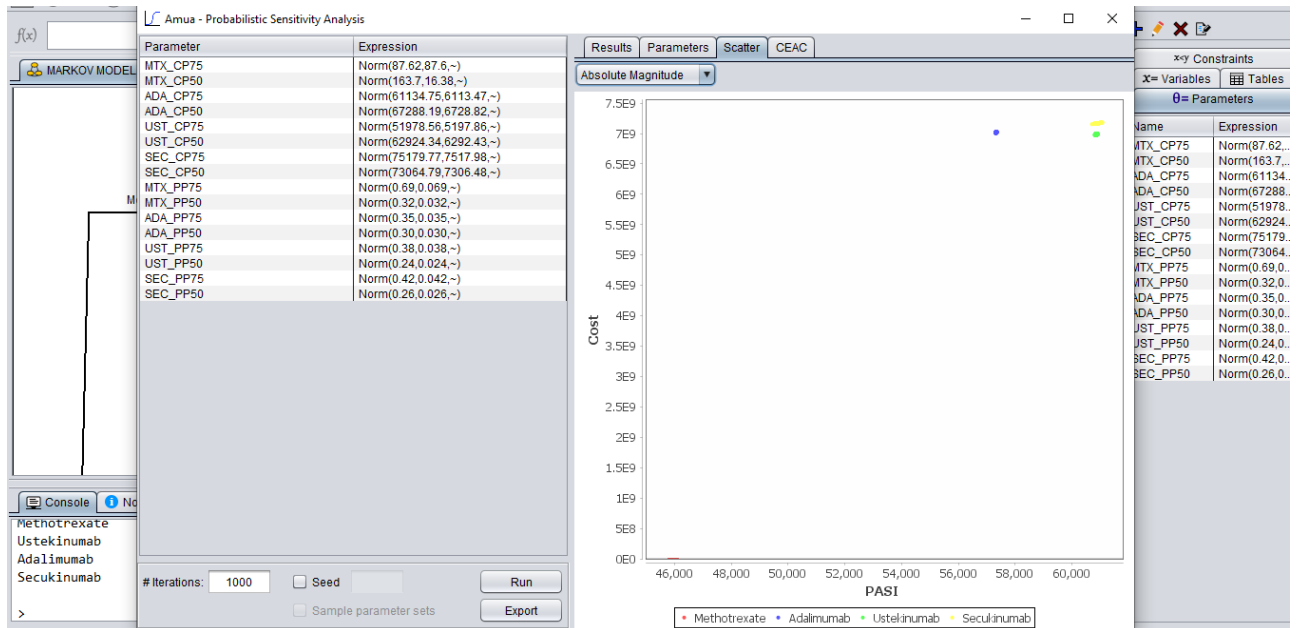

Parameter	Expression
MTX_CP75	Norm(87.62,87.6,-)
MTX_CP50	Norm(163.7,16.38,-)
ADA_CP75	Norm(61134.75,6113.47,-)
ADA_CP50	Norm(67288.19,6728.82,-)
UST_CP75	Norm(51978.56,5197.86,-)
UST_CP50	Norm(62924.34,6292.43,-)
SEC_CP75	Norm(75179.77,7517.98,-)
SEC_CP50	Norm(73064.79,7306.48,-)
MTX_PP75	Norm(0.69,0.069,-)
MTX_PP50	Norm(0.32,0.032,-)
ADA_PP75	Norm(0.35,0.035,-)
ADA_PP50	Norm(0.30,0.030,-)
UST_PP75	Norm(0.38,0.038,-)
UST_PP50	Norm(0.24,0.024,-)
SEC_PP75	Norm(0.42,0.042,-)
SEC_PP50	Norm(0.26,0.026,-)

Iterations: 1000 Seed Sample parameter sets

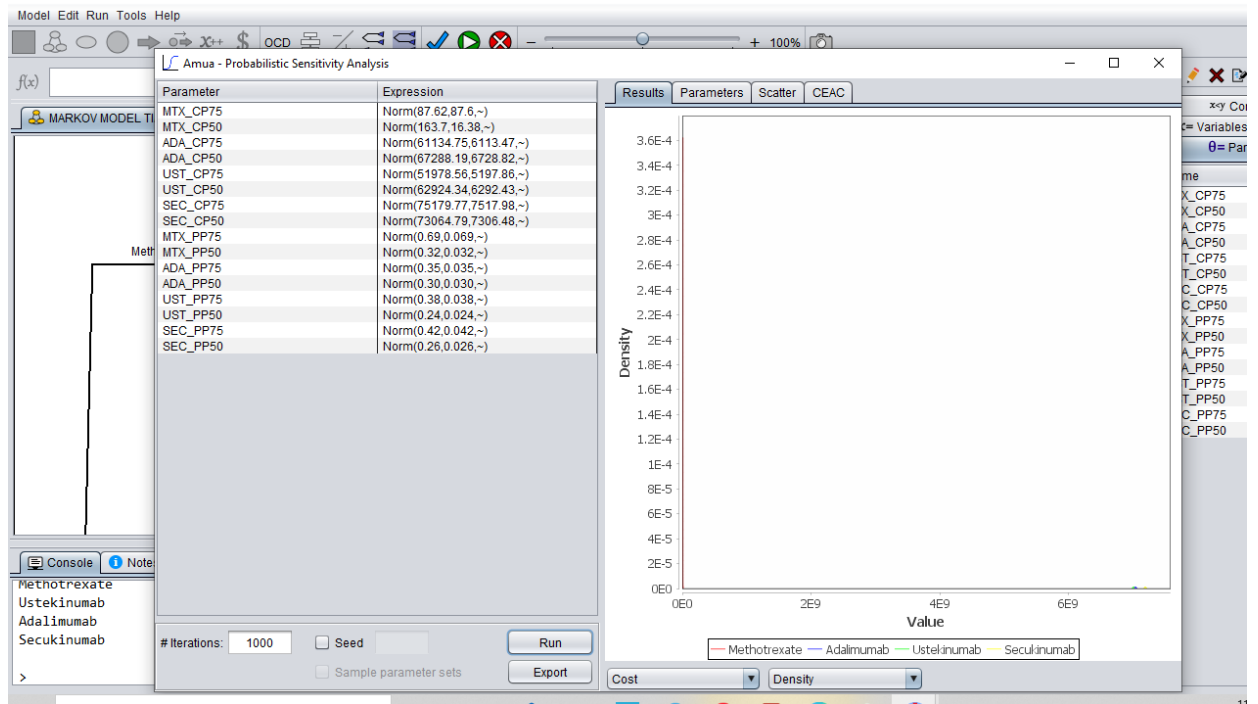