



RQ010B — the InterHub M3 human-norm envelope does NOT transfer to WOD-E2E

A M3 support gate fails
($\leq 15\%$ in-support even after fixes)

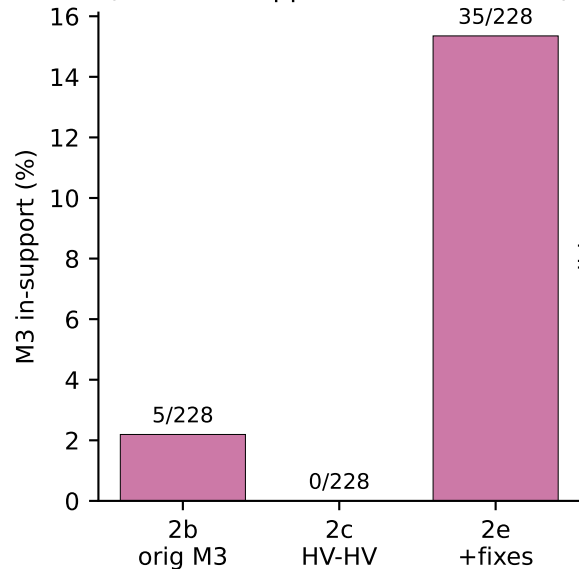

B Norm center near-constant
($\text{sd} \approx 0.062$, $\sim 0 \rightarrow$ no context-conditioning)

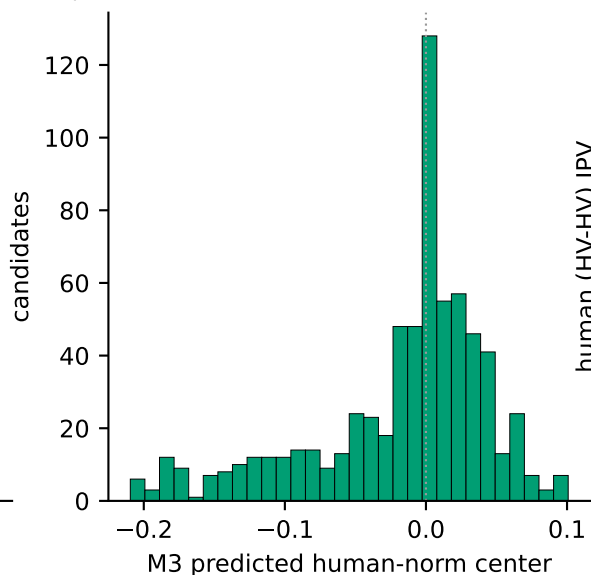

C Human IPV norm $\approx$ neutral (0)
across geometries (central-90 band)

