



EMRI r56 production-grid qualification: early transient only
 $q=1e-5$, $r/M=56$, $t_{\text{end}}/t_{\text{cross}}=0.0131$, $M_{\text{fast,proxy}}=0.676$


(a) AMR startup + early accretion response

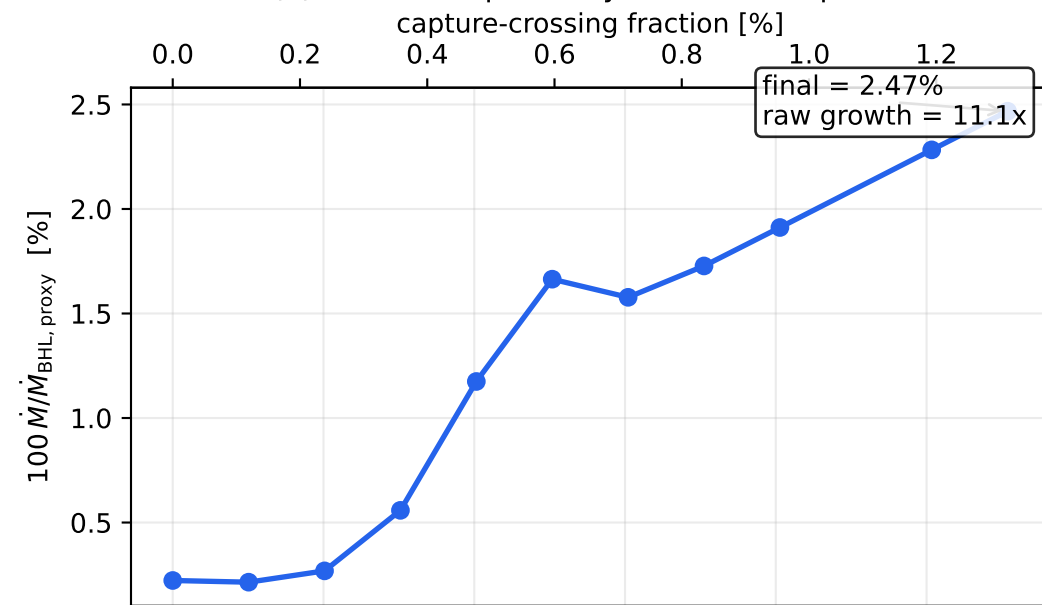

(b) Raw force estimator during AMR startup

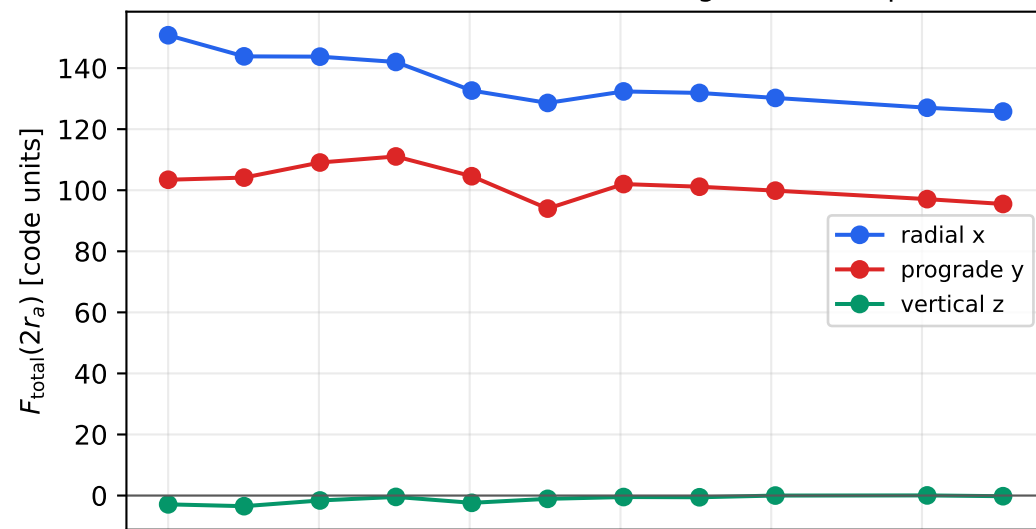

(c) Baseline difference (AMR + transient)

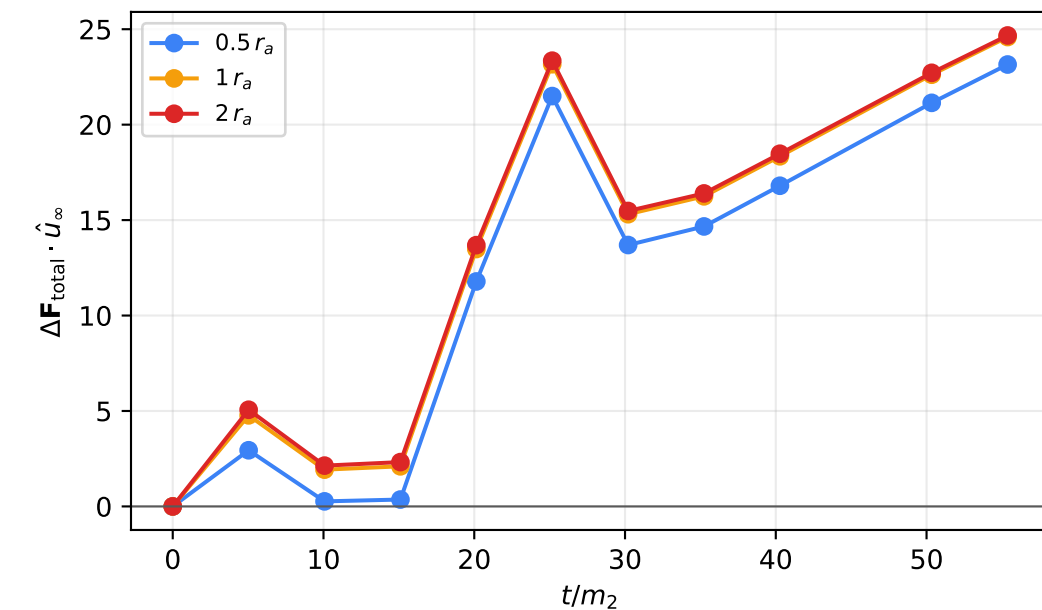

(d) Force-shell closure is not yet assessable

